

STRUCTURAL CALCULATIONS

Revised August 2018

Project:

Blake Kingsbury and Merrit Chesson
Summit Powder Mountain, Lot #70
8492 E. Spring Park, Utah

Project Number: 8332

Prepared For:

Scandinavian
6410 N. Business Park Loop Rd. Unit E
Park City, Utah 84098

Date:

June 2018

Prepared By:

Alex Hawkins, PE

Reviewed By:

David A. Jenkins, PE, SE



ENSIGN
THE STANDARD IN ENGINEERING

Ensign Engineering

45 West 10000 South, Suite 500
Sandy, Utah 84070
P: (801) 255-0529
F: (801) 255-4449
ensigneng.com



Project: Blake Kingsbury and Merrit Chesson
 By: Alex Hawkins, PE
 Date: June 2018

Project No.: 8332
 Checked By: DAJ

GENERAL PROJECT INFORMATION

Project: **Blake Kingsbury and Merrit Chesson**

Project Address: **Summit Powder Mountain, Lot #70
 8492 E. Spring Park, Utah**

Latitude: 41.380 North (Approximate)
 Longitude: -111.781 West (Approximate)
 Elevation: 8570 ft

Client: **Scandinavian**

PROJECT DESCRIPTION

Provide structural calculations for Scandinavian Log Home

GENERAL DESIGN CRITERIA

Structure Type:	Structure Type
Design Code:	2015 IBC
Risk Category:	II

DESIGN LOADS

Dead Loads:

Roof DL:

Roofing:	6	psf
Insulation:	3	psf
Sheathing:	2.5	psf
Framing:	4	psf
MPE:	1.5	psf
Sprinklers:	1.5	psf
Miscellaneous:	1.5	psf
Total Roof DL:	20	psf

Floor DL:

Flooring:	3	psf
Sheathing:	2.5	psf
Framing:	10	psf
MPE:	1.5	psf
Sprinklers:	1.5	psf
Miscellaneous:	1.5	psf
Total Floor DL:	20	psf

Wall DL:

Exterior Walls:	20	psf
Interior Bearing Walls:	15	psf
Log Walls:	30	psf

DEFLECTION LIMITS:

	Total Load	Live Load
Roof:	L / 240	360
Floor:	L / 360	480
Horizontal:	L / --	240

Live Loads:

Roof Live:	20	psf
Floor Live:	40	psf
Main Floor Corridor / Stair:	40	psf
Corridors above Main Floor:	40	psf
Balconies:	60	psf

Snow Loads:

Ground Snow Load, p_g :	261	psf
Exposure Factor, C_e :	1.0	
Thermal Factor, C_t :	1.0	
Importance Factor, I_s :	1.0	
Roof Snow Load, p_f:	183	psf

Wind Loads:

Wind Speed:	115	mph - 3 second gust
Exposure:	C	

Seismic Loads:

S_s :	0.853	g
S_1 :	0.285	g
Site Soil Class:	D	
Importance Factor, I_E :	1.00	



Project: Blake Kingsbury and Merrit Chesson

Project No.: 8332

By: Alex Hawkins, PE

Checked By: DAJ

Date: June 2018

FOUNDATION CRITERIA & SPECIFICATIONS

Soils Report: Company: Geostrata
 Date: July 11, 2018
 Report / Project Number: 594-004
 Contact: _____

Allowable Bearing Pressure: 1500 psf

Passive Pressure: 1074 psf
 Active Pressure: 31 psf
 At Rest Pressure: 53 psf

Coefficient of Friction, μ : 0.35

Foundation Type: Footing Type: Concrete Spread Footing
 Min. Depth to Frost: 30 in

MATERIAL SPECIFICATIONS

CONCRETE & REINFORCING STEEL SPECIFICATIONS:

Concrete Strength, f'_c :
 Footings / Foundation Walls: 3,000 psi
 Grade Beams: 4,000 psi
 Slab on Grade: 4,000 psi
 Bearing/Shear Walls: 4,000 psi

Deformed Reinforcing Bars: ASTM A615 Grade 60
 ASTM A706 Grade 60 Weldable Rebar is to be used where welds are specified on contract documents

Welded Wire Fabric: ASTM A185 - Flat sheets, not rolls

STEEL FRAMING SPECIFICATIONS

Structural Steel: W-Shape: ASTM A992, $F_y = 50$ ksi
 Tubing: ASTM A500, Grade B, $F_y = 46$ ksi
 Channels, Plates and Angles: ASTM A36, $F_y = 36$ ksi
 Pipe: ASTM A53, Grade B, $F_y = 35$ ksi
 Machine Bolts: ASTM A307
 High-strength Bolts: ASTM A325 or A490

Welds: E70XX Electrodes, Comply with AWS D1.1



Project: Blake Kingsbury and Merrit Chesson

Project No.: 8332

By: Alex Hawkins, PE

Checked By: DAJ

Date: June 2018

WOOD FRAMING SPECIFICATIONS

Unless noted otherwise, the following species and grades of lumber shall be used.

Sawn Lumber:	Species: Douglas Fir-Larch (North)
	2x4 studs up to 8'-0" long: Stud Grade
	2x4 studs over 8'-0" long: Grade #2
	Other studs: Grade #2
	Posts: Grade #1
	Joists: Grade #2
	Beams: Grade #2
	Headers: Grade #2
	Subpurlins: Grade #2
	Purlins: Grade #2
Glue Laminated Beams:	Species: Douglas Fir-Larch (North)
	Simple Spans: 24F-V4
	Continuous Spans: 24F-V8
Sheathing:	APA Rated OSB
Framing Hardware:	Simpson Strong-Tie Connectors
Structural Nails:	Common Wire Type (unless noted otherwise)
Bolts in Wood:	ASTM A307



Project: Blake Kingsbury and Merrit Chesson
 By: Alex Hawkins, PE
 Date: June 2018

Project No.: 8332
 Checked By: DAJ

SNOW DRIFT ANALYSIS

Drift 1 - Roof

CHAPTER 7, ASCE 7-10

IBC 2015 / ASCE 7-10

Design Parameters

Terrain Category	C
Roof Exposure	Partially Exposed
Thermal Conditions	All other structures
Snow Drift Analysis Required?	No

Ground Snow Load, p_g (psf)	261	Utah Snow Load Study	Snow Density, γ (pcf)	30.0	Equation 7.7-1
Exposure Factor, C_e	1.0	Table 7-2	Balance Snow Load Height, h_b (ft)	6.10	p_f / γ
Thermal Factor, C_t	1.0	Table 7-3	Adjacent Roof Height, h_r (ft)	6.5	
Importance Factor, I_s	1.0	Table 1.5-2	Length of Upper Roof, L_u (ft)	14	
Roof Snow Load, p_f (psf)	183	Equation 7.3-1	Length of Lower Roof, L_L (ft)	25	

Snow Drift Analysis

Windward Drift Height, $h_{d,wind}$ (ft)	2.70	Figure 7-9
Leeward Drift Height, $h_{d,lee}$ (ft)	3.24	Figure 7-9
h_c (ft)	0.40	$h_r - h_b$
Design Drift Height, h_d (ft)	0.40	Section 7.7.1
Design Drift Width, w (ft)	3.24	Section 7.7.1
Maximum Drift Surcharge Load, p_d (psf)	12.13	Section 7.7.1

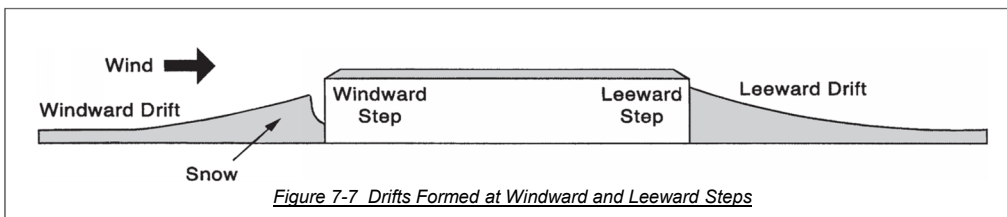


Figure 7-7 Drifts Formed at Windward and Leeward Steps

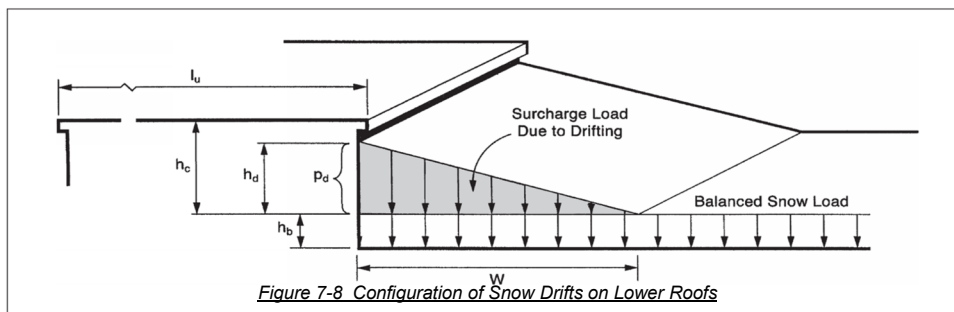


Figure 7-8 Configuration of Snow Drifts on Lower Roofs



Project: Blake Kingsbury and Merrit Chesson
 By: Alex Hawkins, PE
 Date: June 2018

Project No.: 8332
 Checked By: DAJ

SNOW DRIFT ANALYSIS

Drift 1 - Family Room

CHAPTER 7, ASCE 7-10

IBC 2015 / ASCE 7-10

Design Parameters

Terrain Category	C
Roof Exposure	Partially Exposed
Thermal Conditions	All other structures
Snow Drift Analysis Required?	Yes

Ground Snow Load, p_g (psf)	261	Utah Snow Load Study	Snow Density, γ (pcf)	30.0	Equation 7.7-1
Exposure Factor, C_e	1.0	Table 7-2	Balance Snow Load Height, h_b (ft)	6.10	p_f / γ
Thermal Factor, C_t	1.0	Table 7-3	Adjacent Roof Height, h_r (ft)	10.25	
Importance Factor, I_s	1.0	Table 1.5-2	Length of Upper Roof, L_u (ft)	40.5	
Roof Snow Load, p_f (psf)	183	Equation 7.3-1	Length of Lower Roof, L_L (ft)	11.5	

Snow Drift Analysis

Windward Drift Height, $h_{d,wind}$ (ft)	2.43	Figure 7-9
Leeward Drift Height, $h_{d,lee}$ (ft)	4.49	Figure 7-9
h_c (ft)	4.15	$h_r - h_b$
Design Drift Height, h_d (ft)	4.15	Section 7.7.1
Design Drift Width, w (ft)	19.43	Section 7.7.1
Maximum Drift Surcharge Load, p_d (psf)	124.63	Section 7.7.1

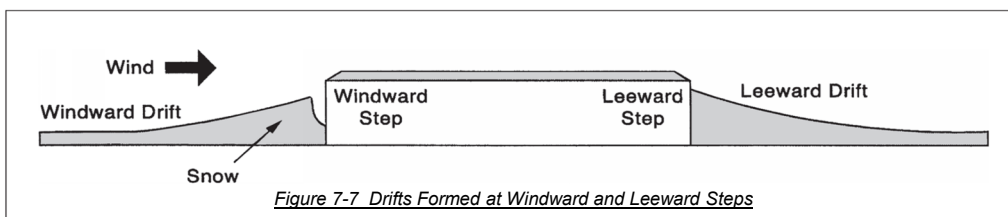


Figure 7-7 Drifts Formed at Windward and Leeward Steps

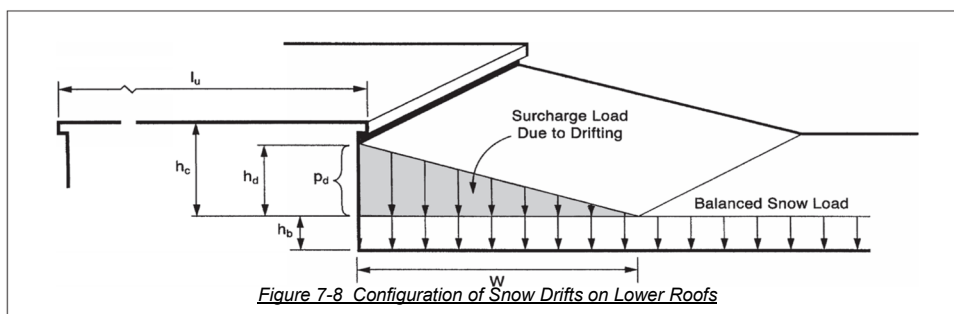


Figure 7-8 Configuration of Snow Drifts on Lower Roofs

USGS Design Maps Summary Report

User-Specified Input


Report Title Powder Mountain
Tue June 5, 2018 23:24:18 UTC

Building Code Reference Document 2012/2015 International Building Code
(which utilizes USGS hazard data available in 2008)

Site Coordinates 41.38004°N, 111.78098°W

Site Soil Classification Site Class D – “Stiff Soil”


Risk Category I/II/III

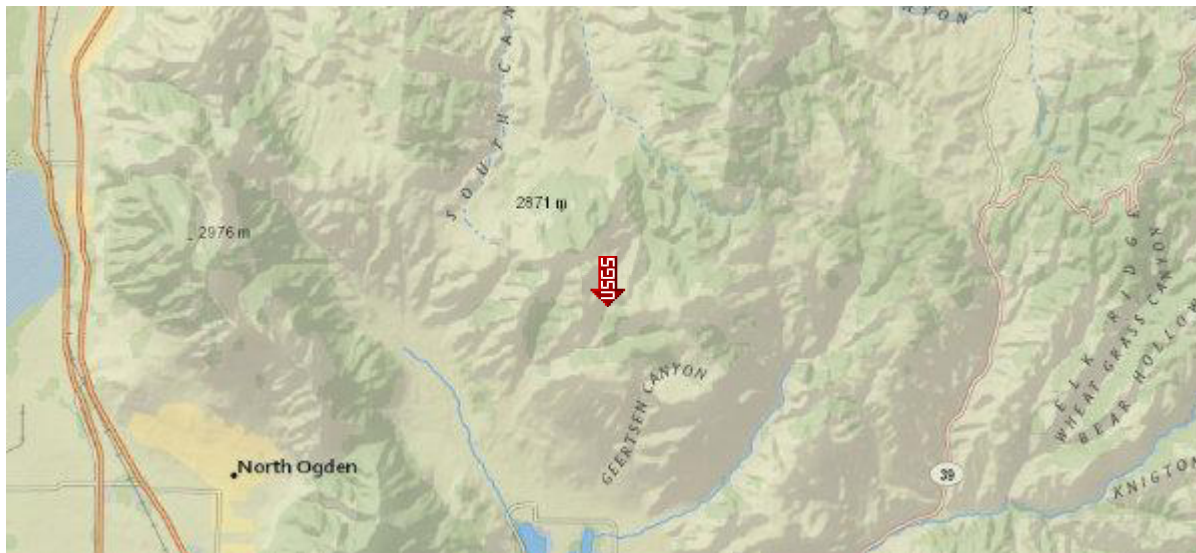

USGS-Provided Output

$S_S = 0.853 \text{ g}$	$S_{MS} = 0.989 \text{ g}$	$S_{DS} = 0.659 \text{ g}$
$S_1 = 0.285 \text{ g}$	$S_{M1} = 0.521 \text{ g}$	$S_{D1} = 0.347 \text{ g}$

For information on how the S_S and S_1 values above have been calculated from probabilistic (risk-targeted) and deterministic ground motions in the direction of maximum horizontal response, please return to the application and select the “2009 NEHRP” building code reference document.

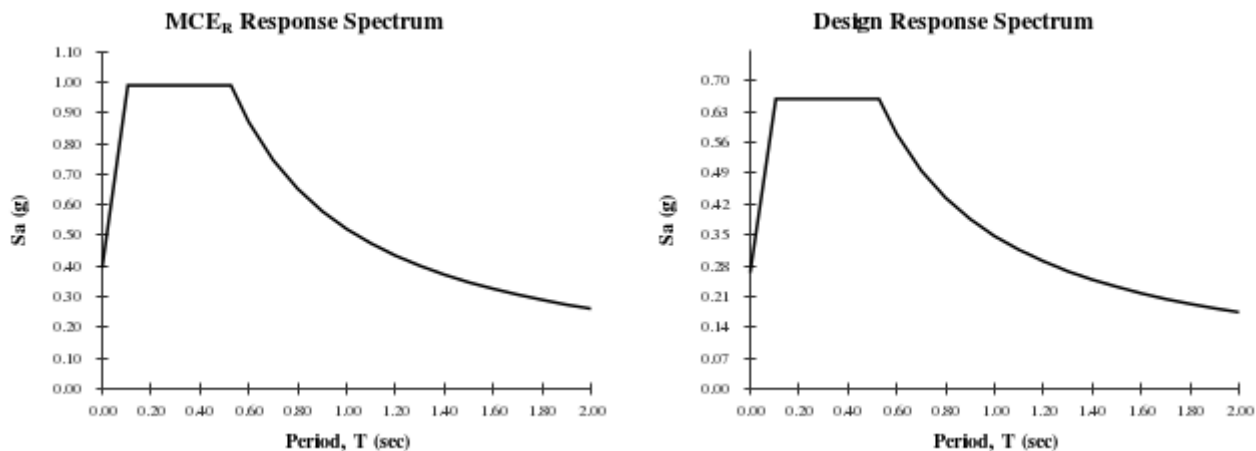

Although this information is a product of the U.S. Geological Survey, we provide no warranty, expressed or implied, as to the accuracy of the data contained therein. This tool is not a substitute for technical subject-matter knowledge.



Project: Blake Kingsbury and Merrit Chesson

Project No.: 8332

By: Alex Hawkins, PE

Checked By: DAJ

Date: June 2018

SEISMIC FORCE ANALYSIS - DIAPHRAGM FORCES

CHAPTER 12 ASCE 7-10

IBC 2015 / ASCE 7-10

Design Parameters

Risk Category	II	Table 1604.5	S_{DS} (g)	0.659	$2/3(S_{MS})$
S_s (g)	0.853	USGS	S_{D1} (g)	0.348	$2/3(S_{M1})$
S_1 (g)	0.285	USGS	Seismic Design Category	D	Table 1613.3.5(1,2)
Site Class	D	Geotech Report	Importance Factor, I_E	1.00	Table 1.5-2

Diaphragm Design Forces

Level	F_i (k)	Sum F_i (k)	w_{px} (k)	Sum w_i (k)	F_{px} (k) <i>Eq. 12.10-1</i>	$F_{px,min}$ (k) <i>Eq. 12.10-2</i>	$F_{px,max}$ (k) <i>Eq. 12.10-3</i>	$F_{px,design}$ (k)	Scale Factor F_{px} / F_x
Roof	12.94	12.9	30.80	30.8	12.9	4.1	8.1	8.1	1.00
Rooftop Balcon	25.08	38.0	82.45	113.2	27.7	10.9	21.7	21.7	1.00
Upper	11.14	49.2	73.28	186.5	19.3	9.7	19.3	19.3	1.73
		-		-	-	-	-	-	-
		-		-	-	-	-	-	-
		-		-	-	-	-	-	-
		-		-	-	-	-	-	-
		-		-	-	-	-	-	-
		-		-	-	-	-	-	-



Project: Blake Kingsbury and Merrit Chesson

Project No.: 8332

By: Alex Hawkins, PE

Checked By: DAJ

Date: June 2018

WIND FORCE ANALYSIS - DIRECTIONAL PROCEDURE

CHAPTER 27 (PART 1) ASCE 7-10

IBC 2015 / ASCE 7-10

Design Parameters

Wind Speed, V (mph)	115	Section 26.5	Exposure Coefficient, K_h	1.024	Table 27.3-1
Exposure Category	C	Section 26.7	K_{zt} Applicable?	No	
Enclosure Classification	Enclosed		Height of Hill or Ridge, H (ft)	0	Table 26.8-1
Positive / Negative?	Positive		L_h (ft)	0	Table 26.8-1
nt. Pressure Coefficient, GC_{pi}	0.18	Table 26.11-1	H / L_h	0.00	
Mean Roof Height, h (ft)	36.5		x (ft)	0	Table 26.8-1
Building Length, L (ft)	48		Horizontal Attenuation, μ	0	Table 26.8-1
Building Width, B (ft)	24		Height Attenuation, γ	0	Table 26.8-1
L/B	2.00		$K_1 / (H / L_h)$	0	Table 26.8-1
h/L	0.76		K_1	0.00	Table 26.8-1
Roof Pitch	3.75	/12	K_2	0.00	Table 26.8-1
Roof Angle, θ	17.4		K_3	0.00	Table 26.8-1
Gust Effect Factor, G	0.85	Section 26.9	Topographic Factor, K_{zt} at h	1.00	Section 26.8
Terrain Constant, α	9.5	Table 26.9-1	Wind Directionality Factor, K_d	0.85	Section 26.6
Terrain Constant, z_g (ft)	900	Table 26.9-1	Velocity Pressure, q_h (psf)	29.46	Equation 30.3-1

MWFRS Wind Pressure Analysis

Surface Mark	Surface Type	z (ft)	K_z	Pressure Coefficients, C_p	Wall			Parapet	
					Windward	Leeward	Side	Windward	Leeward
					0.80	-0.50	-0.70	1.50	-1.00
				q_z (psf)	Wind Pressure, p (psf)				
1	Roof	40	1.044	30.0	-	-	-	-	-
2	Wall	38	1.032	29.7	14.90	-17.82	-22.83	-	-
3	Wall	32	0.996	28.7	14.18	-17.82	-22.83	-	-
4	Wall	21	0.911	26.2	12.53	-17.82	-22.83	-	-
5	Wall	10.5	0.849	24.4	11.31	-17.82	-22.83	-	-
6			-	-	-	-	-	-	-

Roof Type	Monoslope	Roof							
Surface Mark	Surface Type	Normal to Ridge for $\theta \geq 10^\circ$			Parallel to Ridge for all θ				Windward Overhang
		Windward In	Windward Out	Leeward	0 to h/2	h/2 to h	h to 2h	> 2h	
		-0.18	-0.85	-0.60	-1.10	-0.70	-0.70	-0.70	0.80
		Wind Pressure, p (psf)							
1	Roof	-9.81	-26.59	-20.33	-32.85	-22.83	-22.83	-22.83	20.03
2	Wall	-	-	-	-	-	-	-	-
3	Wall	-	-	-	-	-	-	-	-
4	Wall	-	-	-	-	-	-	-	-
5	Wall	-	-	-	-	-	-	-	-
6		-	-	-	-	-	-	-	-

Diaphragm Forces

North-South, Positive Internal Pressure

Surface Mark	Surface Type	Projected Horizontal Pressure, p (psf)	Tributary Height (ft)	Unit Force (plf)	Diaphragm Width, W (ft)	Force (kips)
1	Roof	8.00	5	40.0	24	1.0
2	Wall	32.72	3	98.2	24	2.4
3	Wall	32.00	8	256.0	24	6.1
4	Wall	30.35	10.667	323.8	24	7.8
5	Wall	29.13	10.5	305.9	24	7.3
6		-		-		-

Total Force (kips) 24.6



Project: Blake Kingsbury and Merrit Chesson

Project No.: 8332

By: Alex Hawkins, PE

Checked By: DAJ

Date: June 2018

WIND FORCE ANALYSIS - DIRECTIONAL PROCEDURE

CHAPTER 27 (PART 1) ASCE 7-10

IBC 2015 / ASCE 7-10

Design Parameters			
Wind Speed, V (mph)	115 <i>Section 26.5</i>	Exposure Coefficient, K_h	1.024 <i>Table 27.3-1</i>
Exposure Category	C <i>Section 26.7</i>	K_{zt} Applicable?	No
Enclosure Classification	Enclosed	Height of Hill or Ridge, H (ft)	0 <i>Table 26.8-1</i>
Positive / Negative?	Positive	L_h (ft)	0 <i>Table 26.8-1</i>
nt. Pressure Coefficient, GC_{pi}	0.18 <i>Table 26.11-1</i>	H / L_h	0.00
Mean Roof Height, h (ft)	36.5	x (ft)	0 <i>Table 26.8-1</i>
Building Length, L (ft)	24	Horizontal Attenuation, μ	0 <i>Table 26.8-1</i>
Building Width, B (ft)	48	Height Attenuation, γ	0 <i>Table 26.8-1</i>
L/B	0.50	$K_1 / (H / L_h)$	0 <i>Table 26.8-1</i>
h/L	1.52	K_1	0.00 <i>Table 26.8-1</i>
Roof Pitch	3.75 /12	K_2	0.00 <i>Table 26.8-1</i>
Roof Angle, θ	17.4	K_3	0.00 <i>Table 26.8-1</i>
Gust Effect Factor, G	0.85 <i>Section 26.9</i>	Topographic Factor, K_{zt} at h	1.00 <i>Section 26.8</i>
Terrain Constant, α	9.5 <i>Table 26.9-1</i>	Wind Directionality Factor, K_d	0.85 <i>Section 26.6</i>
Terrain Constant, z_g (ft)	900 <i>Table 26.9-1</i>	Velocity Pressure, q_h (psf)	29.46 <i>Equation 30.3-1</i>

MWFRS Wind Pressure Analysis

Surface Mark	Surface Type	z (ft)	K_z	Pressure Coefficients, C_p	Wall			Parapet	
					Windward	Leeward	Side	Windward	Leeward
					0.80	-0.50	-0.70	1.50	-1.00
				q_z (psf)	Wind Pressure, p (psf)				
1	Wall	5.5	0.849	24.4	11.31	-17.82	-22.83	-	-
2	Wall	10	0.849	24.4	11.31	-17.82	-22.83	-	-
3	Wall	10.667	0.849	24.4	11.31	-17.82	-22.83	-	-
4	Wall	10.5	0.849	24.4	11.31	-17.82	-22.83	-	-
5			-	-	-	-	-	-	-
6			-	-	-	-	-	-	-

Roof Type	Monoslope	Roof							
Surface Mark	Pressure Coefficients, C_p	Normal to Ridge for $\theta \geq 10^\circ$			Parallel to Ridge for all θ				Windward Overhang
		Windward In	Windward Out	Leeward	0 to h/2	h/2 to h	h to 2h	> 2h	
		-0.18	-0.70	-0.30	-0.90	-0.90	-0.50	-0.30	0.80
		Wind Pressure, p (psf)							
1	Wall	-	-	-	-	-	-	-	-
2	Wall	-	-	-	-	-	-	-	-
3	Wall	-	-	-	-	-	-	-	-
4	Wall	-	-	-	-	-	-	-	-
5		-	-	-	-	-	-	-	-
6		-	-	-	-	-	-	-	-

Diaphragm Forces

East-West, Positive Internal Pressure

Surface Mark	Surface Type	Projected Horizontal Pressure, p (psf)	Tributary Height (ft)	Unit Force (plf)	Diaphragm Width, W (ft)	Force (kips)
1	Wall	29.13	6	174.8	18.5	3.2
2	Wall	29.13	10	291.3	36	10.5
3	Wall	29.13	10.667	310.7	42	16.1
4	Wall	29.13	10.5	305.9	42	12.8
5		-		-		-
6		-		-		-

Total Force (kips) 42.6



Project: Blake Kingsbury and Merrit Chesson

Project No.: 8332

By: Alex Hawkins, PE

Checked By: DAJ

Date: June 2018

WIND FORCE ANALYSIS - COMPONENTS & CLADDING

CHAPTER 30 ASCE 7-10


IBC 2015 / ASCE 7-10

Design Parameters

Wind Speed, V (mph)	115	Section 26.5	L_h (ft)	0	Table 26.8-1
Exposure Category	C	Section 26.7	H / L_h	0.00	
nt. Pressure Coefficient, GC_{pi}	0.18	Table 26.11-1	x (ft)	0	Table 26.8-1
Mean Roof Height, h (ft)	36.5		Horizontal Attenuation, μ	0	Table 26.8-1
Roof Pitch	3.75	/12	Height Attenuation, γ	0	Table 26.8-1
Roof Angle, θ	17.4		$K_1 / (H / L_h)$	0	Table 26.8-1
Gust Effect Factor, G	0.85	Section 26.9	K_1	0.00	Table 26.8-1
Terrain Constant, α	9.5	Table 26.9-1	K_2	0.00	Table 26.8-1
Terrain Constant, z_g (ft)	900	Table 26.9-1	K_3	0.00	Table 26.8-1
Exposure Coefficient, K_h	1.024	Table 30.3-1	Topographic Factor, K_{zt} at h	1.00	Section 26.8
K_{zt} Applicable?	No		Wind Directionality Factor, K_d	0.85	Section 26.6
Height of Hill or Ridge, H (ft)	0	Table 26.8-1	Velocity Pressure, q_h (psf)	29.46	Equation 30.3-1

Design Wind Pressure

Location		Tributary Area (ft ²)					
		< 10	20	50	100	>500	
Walls	Within 5 ft of building corner	-46.5	-43.6	-39.2	-36.2	-28.9	
	All other areas	-37.7	-36.2	-34.8	-32.6	-28.9	
	Positive Pressure	34.8	33.3	31.8	30.3	25.9	
Roof	Within 5 ft of building corner	-87.8	-73.1	-52.4	-37.7	-37.7	
	Within 5 ft of building edge	-58.3	-52.4	-43.6	-37.7	-37.7	
	All other areas	-34.8	-34.0	-33.3	-31.8	-31.8	
Parapet	Within 5 ft of building corner	A	111.9	95.7	73.6	57.4	53.0
		B	-70.7	-66.3	-60.4	-56.0	-44.2
	All other areas	A	82.5	75.1	64.8	57.4	53.0
		B	-61.9	-58.9	-56.0	-52.3	-44.2

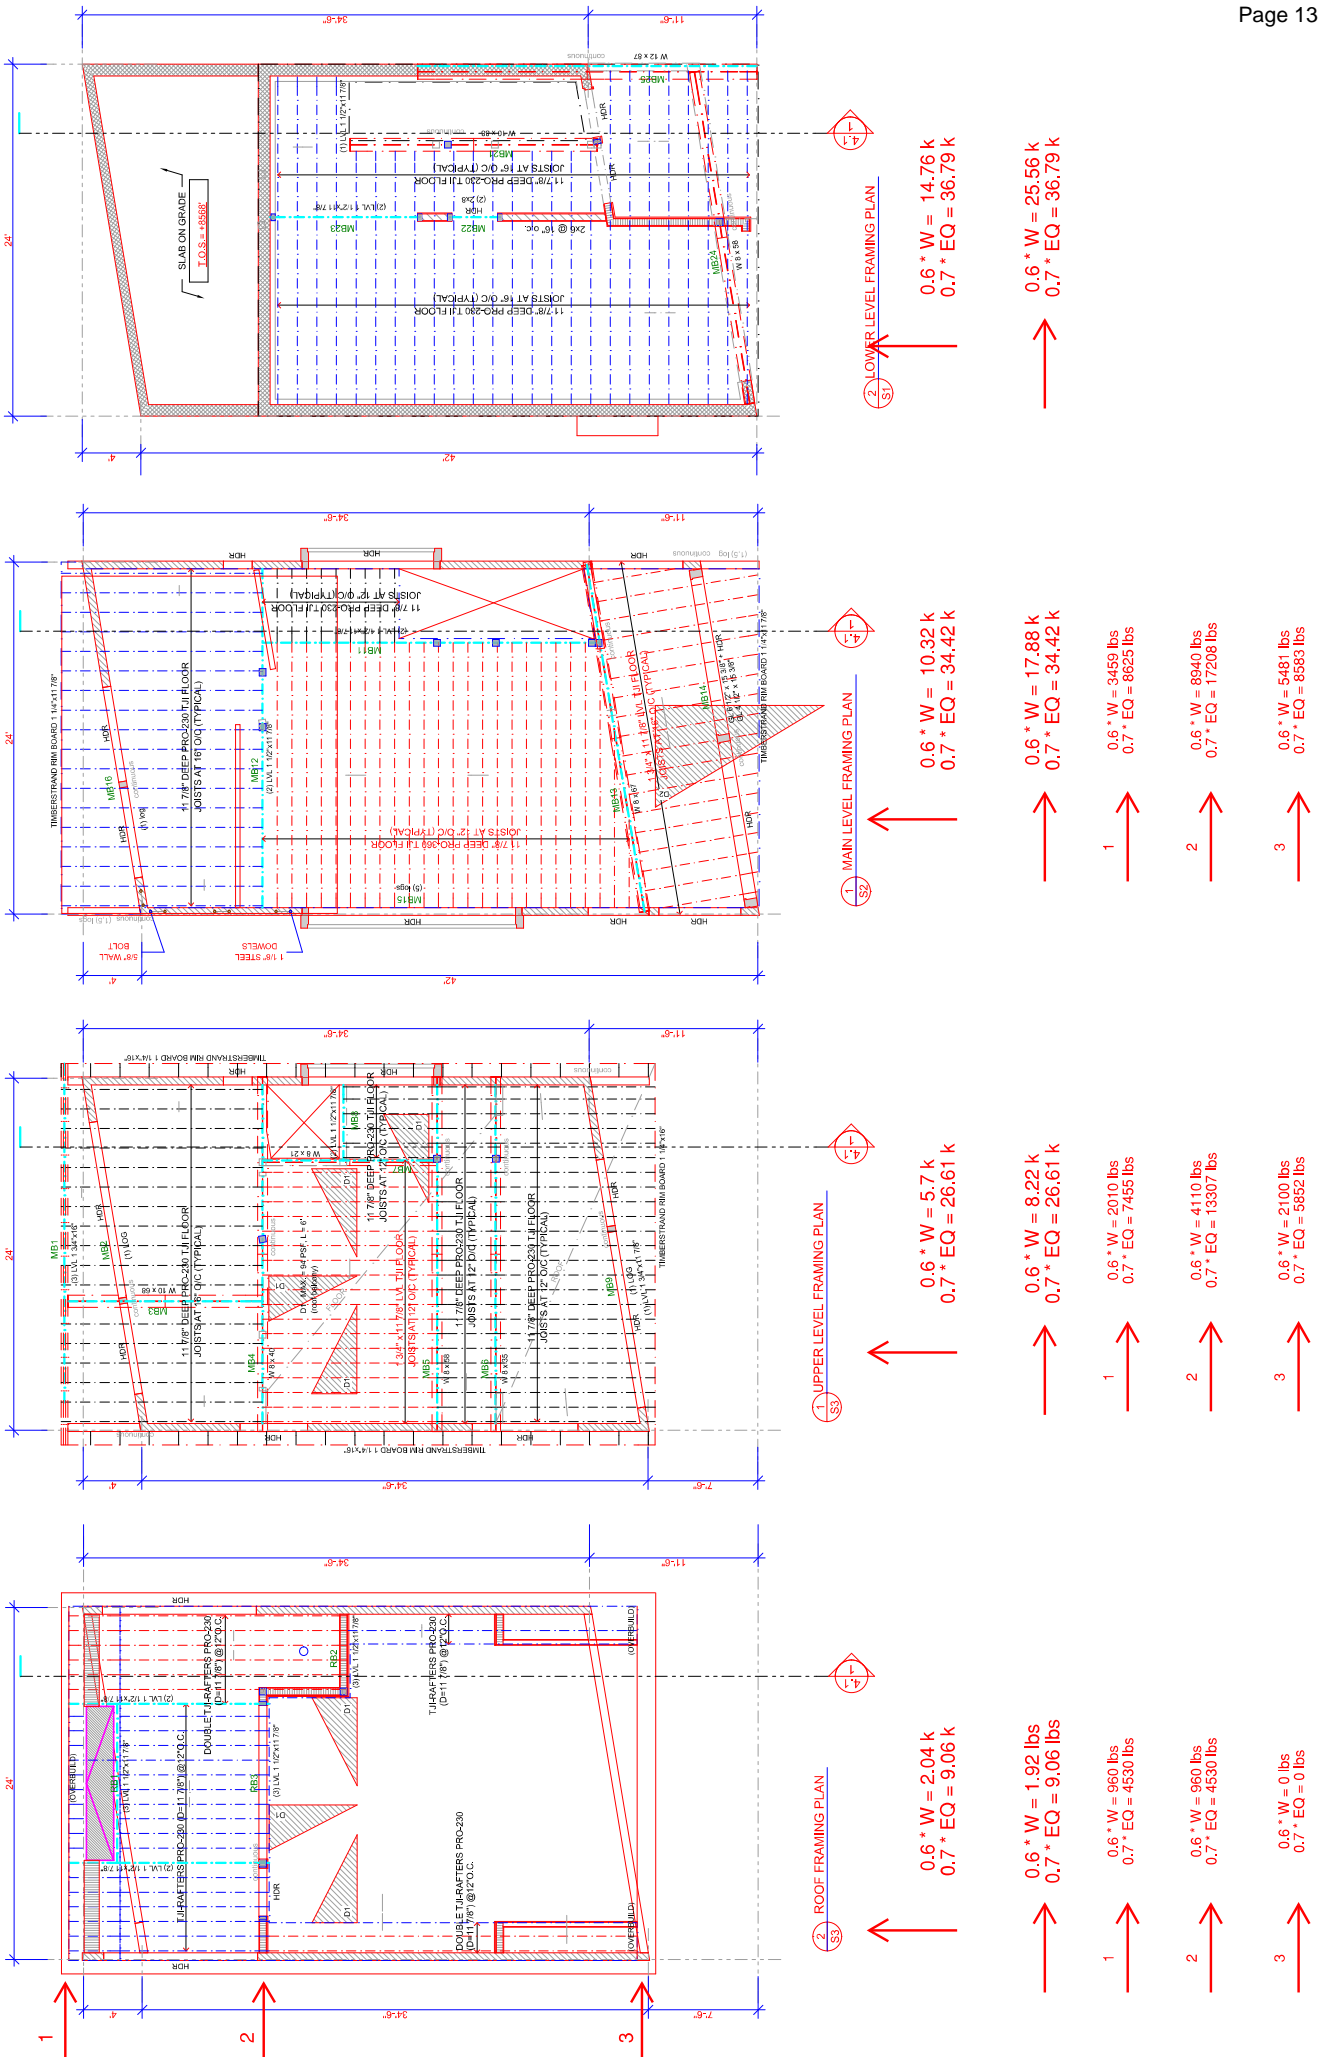

Torsional Analysis of Rigid Diaphragm

File = C:\Users\lahawkins\Desktop\3SIDED-1.EC6

Lic. #: KW-06004069

Licensee : ENSIGN ENGINEERING

Description : Upper Level - Find center of Rigidity / where to apply load from upper level on to main level

ANALYSIS SUMMARY

Maximum shear forces applied to resisting elements. Eccentricity with respect to Center of Rigidity

Resisting Element	Load Angle	Max Shear along Member Local "y-y" Axis			Max Shear along Member Local "x-x" Axis			
		X-Ecc (ft)	Y-Ecc (ft)	Shear Force (k)	Load Angle	X-Ecc (ft)	Y-Ecc (ft)	Shear Force (k)
1 Mid	0	0.72	-13.95	17.158	0	-0.48	-16.25	0.000
2 Mid	0	-0.17	-16.17	4.937	0	-0.48	-16.25	0.036
3 Left	45	-1.08	-15.94	19.310	345	-0.17	-16.17	0.000
4 Right	45	-0.17	-16.17	1.059	345	-0.79	-11.73	0.000
5 Right	45	-0.17	-16.17	15.803	345	-0.17	-16.17	0.000
6 Front	0	-0.17	-16.17	3.860	0	-0.48	-16.25	0.978
7 Back	0	-0.48	-16.25	0.364	0	-0.48	-16.25	0.049
8 Back	0	-0.17	-16.17	0.618	0	-0.48	-16.25	0.079

Layout of Resisting Elements


Legend :  Defined Wall

 Datum

 Center of Rigidity

 Center of Mass

 Accidental eccentricity application boundary

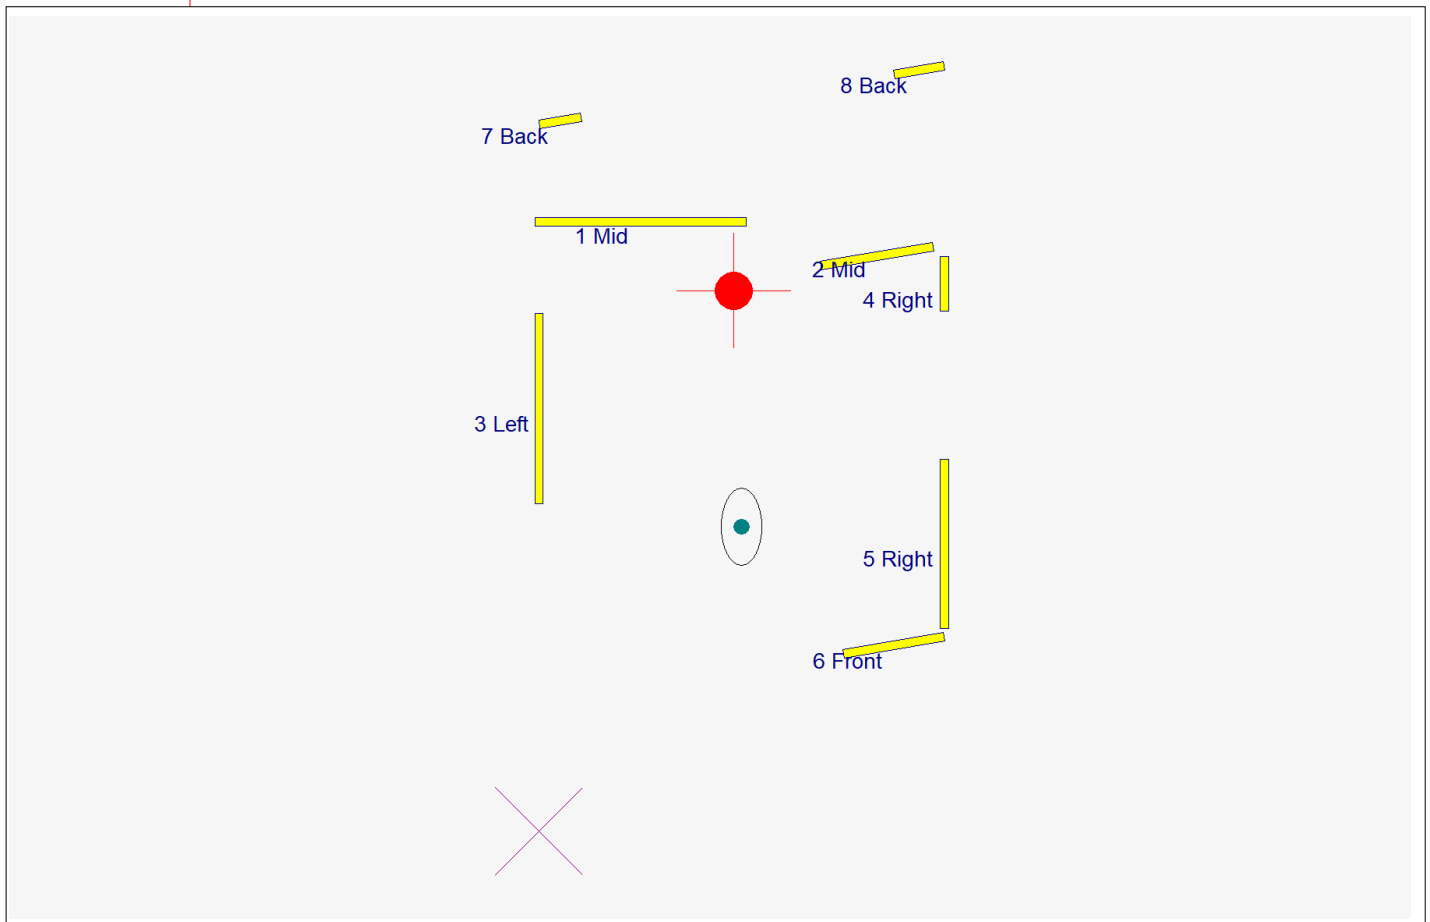



Ensign Engineering
45 West 10000 South, Suite 500
Sandy, Utah 84070
P: (801) 255-0529

Project Title: Powder Mountain
Engineer: Alex Hawkins
Project ID: 8332
Project Descr:

Printed: 7 JUN 2018, 9:57AM

Torsional Analysis of Rigid Diaphragm

File = C:\Users\lahawkins\Desktop\3SIDED-1.EC6

Lic. # : KW-06004069

Licensee : ENSIGN ENGINEERING

Description : Upper Level - Find center of Rigidity / where to apply load from upper level on to main level

Analysis Notes

This program is designed to distribute an applied shear load to a set of resisting elements.

Each resisting element data entry specifies a deflection along a "major" and "minor" axis due to a 1,000 lb load. Each resisting element may be entered as a wall or a column (whereby the deflection is calculated), or as a generic resisting element with specified deflection. The deflections define the stiffness of each resisting element.

Each resisting element is defined at an (X,Y) location from a datum the user has previously defined. A counter-clockwise rotation of the element can be entered with respect to a traditional "+X" axis line.

A main "shear" load and an optional orthogonal shear load are specified for distribution to the system of resisting elements. In addition the maximum orthogonal dimensions of the structure and minimum accidental eccentricity percentage are specified.

From the entered loads the program calculates resultant force vectors for each angular orientation that is requested. The force is applied to the resisting elements in angular increments to generate a series of resulting direct and torsional shear loads on each element. This application of force is then repeated at angular intervals along an elliptical path defined by the minimum accidental eccentricity.

The end result is a table of direct shear and torsional shear values for each element from the iterated angles of load application and accidental eccentricity. These values are then searched to find the maximum major and minor axis shears applied to each resisting element.



Torsional Analysis of Rigid Diaphragm

File = P:\8332 Powder Mountain 70\Structural Calcs\3 Sided Diaphragms.ec6

Lic. #: KW-06004069

Licensee: ENSIGN ENGINEERING

Description: Main Level - Average of center of rigidity above and

General Information

Calculations per IBC 2015, CBC 2016, ASCE 7-1

Applied Lateral Force 34.420 k
Additional Orthogonal Force 10.326 k
 Maximum Load Used for Analysis: 35.936 k

Center of Shear Application :
 Distance from "X" datum point 12.0 ft
 Distance from "Y" datum point 29.918 ft

Note: This load is the vector resolved from the above two entries and will be applied to the system of elements at angular increments.

Accidental Torsion values per ASCE 7-05 12.8.4.2
 Ecc. as % of Maximum Dimension 5.00 %

Maximum Dimensions :
 Along "X" Axis 24.0 ft
 Along "Y" Axis 46.0 ft

Load Orientation Angular Increment 15.0 deg
 Load Location Angular Increment 15.0 deg

Center of Rigidity Location (calculated) . . .
 "X" dist. from Datum 16.088 ft
 "Y" dist. from Datum 38.482 ft

Accidental Eccentricity +/- from "X" Coord. of Load Application : 1.20 ft
 Accidental Eccentricity +/- from "Y" Coord. of Load Application : 2.30 ft

Wall Information

Label	X Wall C.G. Location	Y Wall C.G. Location	Wall Angle CCW	Wall Fixity	Length	Height	Thickness	E - Bending	E - Shear
1 Left	0 ft	14 ft	90 deg	Fix-Fix	5 ft	10 ft	6 in	1 Mpsi	1 Mpsi
Wall Deflections (Stiffness) for 1.0 kip load :									
Along Wall "y" Dir	1.7333E-003 in								
Along Wall "x" Dir	1.3373E+004 in								
2 Left	0 ft	36 ft	90 deg	Fix-Fix	11.5 ft	10 ft	6 in	1 Mpsi	1 Mpsi
Wall Deflections (Stiffness) for 1.0 kip load :									
Along Wall "y" Dir	2.8350E-004 in								
Along Wall "x" Dir	5.8144E+003 in								
3 Back	1.25 ft	42 ft	9.5 deg	Fix-Fix	2.5 ft	10 ft	6 in	1 Mpsi	1 Mpsi
Wall Deflections (Stiffness) for 1.0 kip load :									
Along Wall "y" Dir	1.1467E-002 in								
Along Wall "x" Dir	2.6746E+004 in								
4 Back	19.75 ft	45 ft	9.5 deg	Fix-Fix	8.5 ft	10 ft	6 in	1 Mpsi	1 Mpsi
Wall Deflections (Stiffness) for 1.0 kip load :									
Along Wall "y" Dir	5.0668E-004 in								
Along Wall "x" Dir	7.8666E+003 in								
5 Right	24 ft	38.5 ft	90 deg	Fix-Fix	15 ft	10 ft	6 in	1 Mpsi	1 Mpsi
Wall Deflections (Stiffness) for 1.0 kip load :									
Along Wall "y" Dir	1.8272E-004 in								
Along Wall "x" Dir	4.4577E+003 in								
6 Right	24 ft	16.75 ft	90 deg	Fix-Fix	10.75 ft	10 ft	6 in	1 Mpsi	1 Mpsi
Wall Deflections (Stiffness) for 1.0 kip load :									
Along Wall "y" Dir	3.2021E-004 in								
Along Wall "x" Dir	6.2201E+003 in								
7 Mid	6.25 ft	33.5 ft	0 deg	Fix-Fix	12.5 ft	10 ft	3.5 in	1 Mpsi	1 Mpsi
Wall Deflections (Stiffness) for 1.0 kip load :									
Along Wall "y" Dir	4.2057E-004 in								
Along Wall "x" Dir	2.6896E+004 in								

ANALYSIS SUMMARY

Maximum shear forces applied to resisting elements. Eccentricity with respect to Center of Rigidity

Resisting Element	Load Angle	Max Shear along Member Local "y-y" Axis			Max Shear along Member Local "x-x" Axis			
		X-Ecc (ft)	Y-Ecc (ft)	Shear Force (k)	Load Angle	X-Ecc (ft)	Y-Ecc (ft)	Shear Force (k)
1 Left	315	4.09	-10.86	3.102	345	4.40	-10.79	0.000
2 Left	315	4.09	-10.86	18.969	345	4.40	-10.79	0.000

Torsional Analysis of Rigid Diaphragm

File = P:\8332 Powder Mountain 70\Structural Calcs\3 Sided Diaphragms.ec6

Lic. #: KW-06004069

Licensee : ENSIGN ENGINEERING

Description : Main Level - Average of center of rigidity above and

ANALYSIS SUMMARY

Maximum shear forces applied to resisting elements. Eccentricity with respect to Center of Rigidity


Resisting Element	Load Angle	Max Shear along Member Local "y-y" Axis			Max Shear along Member Local "x-x" Axis			
		X-Ecc (ft)	Y-Ecc (ft)	Shear Force (k)	Load Angle	X-Ecc (ft)	Y-Ecc (ft)	Shear Force (k)
3 Back	0	4.09	-10.86	0.704	345	4.40	-10.79	0.020
4 Back	0	4.40	-10.79	16.008	345	4.40	-10.79	0.449
5 Right	105	5.13	-9.71	21.335	345	3.78	-6.34	0.000
6 Right	105	5.13	-9.71	12.174	345	4.40	-10.79	0.000
7 Mid	0	4.09	-10.86	22.211	345	4.40	-10.79	0.000

Layout of Resisting Elements


Legend :  Defined Wall

 Datum

 Center of Rigidity

 Center of Mass

 Accidental eccentricity application boundary

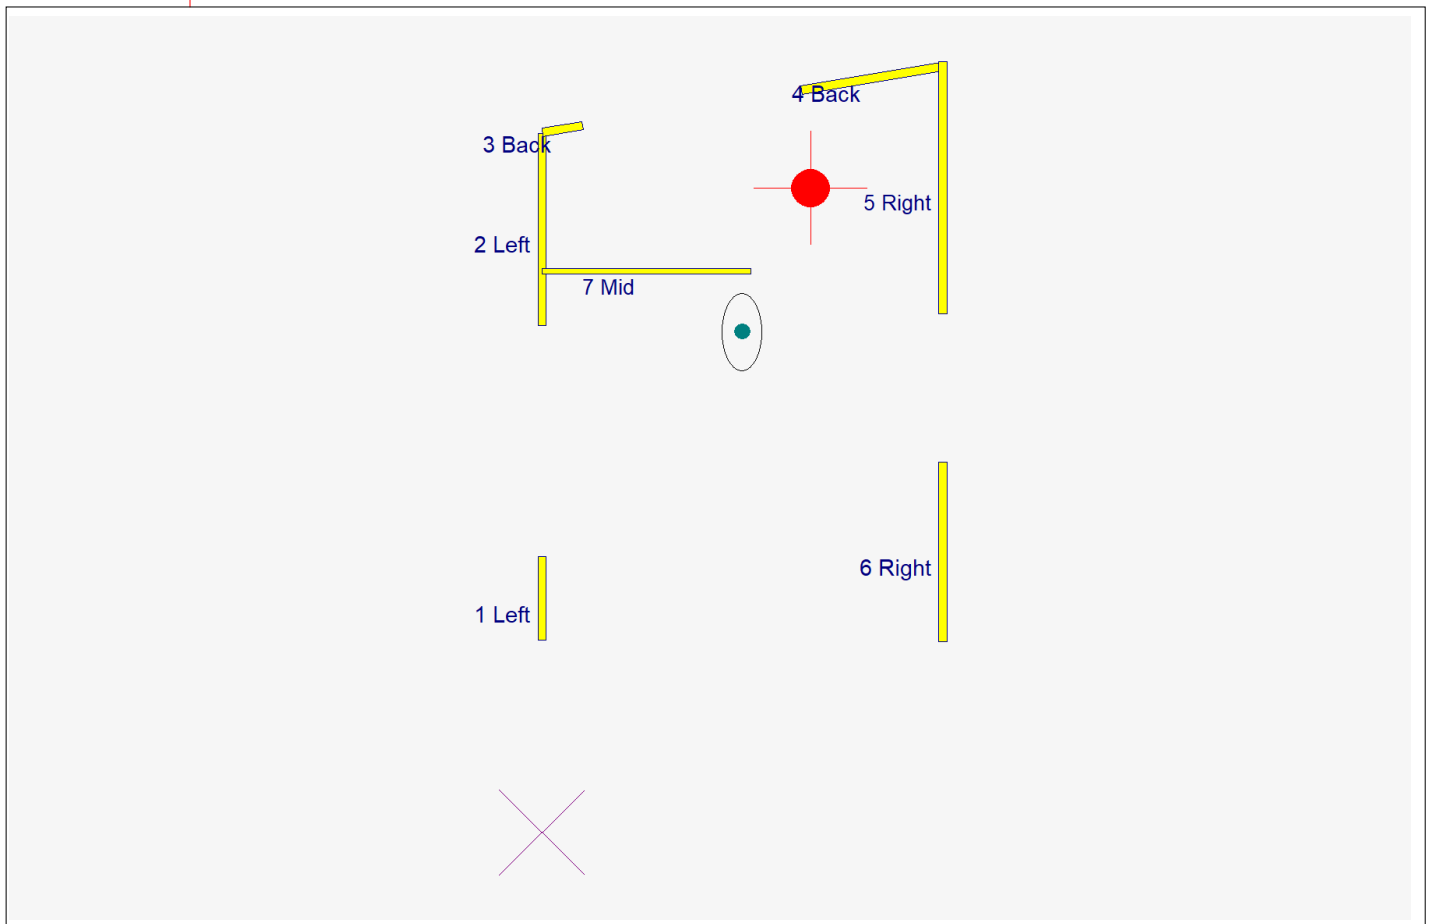



Ensign Engineering
45 West 10000 South, Suite 500
Sandy, Utah 84070
P: (801) 255-0529

Project Title: Powder Mountain
Engineer: Alex Hawkins
Project ID: 8332
Project Descr:

Printed: 1 AUG 2018, 2:06PM

Torsional Analysis of Rigid Diaphragm

File = P:\8332 Powder Mountain 70\Structural Calcs\3 Sided Diaphragms.ec6

Lic. # : KW-06004069

Licensee : ENSIGN ENGINEERING

Description : Main Level - Average of center of rigidity above and

Analysis Notes

This program is designed to distribute an applied shear load to a set of resisting elements.

Each resisting element data entry specifies a deflection along a "major" and "minor" axis due to a 1,000 lb load. Each resisting element may be entered as a wall or a column (whereby the deflection is calculated), or as a generic resisting element with specified deflection. The deflections define the stiffness of each resisting element.

Each resisting element is defined at an (X,Y) location from a datum the user has previously defined. A counter-clockwise rotation of the element can be entered with respect to a traditional "+X" axis line.

A main "shear" load and an optional orthogonal shear load are specified for distribution to the system of resisting elements. In addition the maximum orthogonal dimensions of the structure and minimum accidental eccentricity percentage are specified.

From the entered loads the program calculates resultant force vectors for each angular orientation that is requested. The force is applied to the resisting elements in angular increments to generate a series of resulting direct and torsional shear loads on each element. This application of force is then repeated at angular intervals along an elliptical path defined by the minimum accidental eccentricity.

The end result is a table of direct shear and torsional shear values for each element from the iterated angles of load application and accidental eccentricity. These values are then searched to find the maximum major and minor axis shears applied to each resisting element.



Project: Blake Kingsbury and Merrit Chesson

By: Alex Hawkins, PE

Date: June 2018

Project No.: 8332

Checked By: DAJ

SHEAR WALL SCHEDULE

CHAPTER 4.3, AWC SDPWS-2015

IBC 2015 / ASCE 7-10

Mark	Nailing Requirements		Notes	V_{allow} (8)	V_{allow} (8)	Sole Plate Nailing (10 & 13) (Sole Plate to 2x blocking or rim)
	Edge	Field		Seismic (plf)	Wind (plf)	
SW1	6"	12"	1,2,3	260	365	16d common @ 6" o.c.
SW2	4"	12"	1,2,3	350	490	16d common @ 4" o.c.
SW3	4"	12"	1,2,3,4	380	532	16d common @ 4" o.c.
SW4	3"	12"	1,2,3,4	490	685	(2) 16d common @ 6" o.c.
SW5	2"	12"	1,2,3,4	640	895	(2) 16d common @ 6" o.c.
SW6	2"	12"	1,3,4,6	770	1078	(2) 16d common @ 4" o.c.
SW7	3"	12"	1,2,3,4,5	980	1370	(2) SDS screws @ 6" o.c.
SW8	2"	12"	1,2,3,4,5,11	1280	1790	(2) SDS screws @ 4" o.c.
SW9	2"	12"	1,3,4,5,6,11	1540	2155	(2) SDS screws @ 4" o.c.
SW10	2"	12"	1,3,4,5,7,11	1740	2435	(2) SDS screws @ 3" o.c.

- Notes:
- 16" o.c. max stud spacing or panels applied with the long dimension across the studs (AF&PA SDPWS table 4.3A note 2).
 - 7/16" APA rated sheathing panel with 8d common or galvanized box nails.
 - Block all edges.
 - 3" nominal framing at abutting panel edges (AF&PA SDPWS 4.3.7.1.5.c)
 - Sheathing applied to both sides of wall
 - 15/32" APA rated sheathing with 10d common or galvanized box nails
 - 15/32" APA Structural I rated sheathing with 10d common or galvanized box nails
 - Allowable shear values per AF&PA SDPWS table 4.3A.
 - For all walls, provide hot dipped zinc-coated galvanized steel, stainless steel, silicon bronze or copper nails at preservative-treated and fire-retardant-treated wood locations.
 - SDS screws to be 4.5" minimum length and penetrate 2" into rim board or blocking
 - SDS screws must be into 2x DFL blocking or 2x DFL rim board (not LVL or LSL)
 - Where panels are applied to both faces of the wall and nail spacing is less than 6" on center on either side offset panel joints to different framing members.
 - If (2) SDS screws are required on the sole plate nailing 2x blocking must be provided adjacent to rimboard or (2) 2x blocks must be provided. SDS screws require 5/8" edge and 3" end distance.

STAPLE EQUIVALENCY CHART

Staple Type	Stapling Requirements		V_{allow} (8)	Equivalent to Nailed Shearwall designated above:	V_{allow} (8)	Equivalent to Nailed Shearwall designated above:
	Edge	Field	Seismic (plf)		Wind (plf)	
16 Gage 1/2" Staples	6"	6"	155	NONE	215	NONE
	4"	6"	230	NONE	320	NONE
	3"	6"	310	SW1	435	SW1
	2"	6"	395	SW2 and SW3	555	SW2 and SW3

- Notes:
- Minimum staple penetration into main member is 1".
 - Staples shall have a minimum crown width of 7/16".
 - Install staple crown parallel to the long dimension of the framing member.
 - Where staple spacing is 2" or less, framing at adjoining panel edges shall be 3" nominal.
 - Provide 3/8" distance from panel edge to staple.
 - Table valid for shearwalls only.
 - Provide hot dipped zinc-coated galvanized steel, stainless steel, silicon bronze or copper staples at preservative-treated and fire-retardant-treated wood locations.
 - Allowable shear values per ICC-ES Evaluation Report ESR-1539 and IBC 2015 Table 2306.3(1).
 - Allowable shear values shown are based on 7/16" nominal sheathing thickness.



Project: Blake Kingsbury and Merrit Chesson

By: Alex Hawkins, PE

Date: June 2018

Project No.: 8332

Checked By: DAJ

SINGLE-STORY WOOD SHEAR WALLS

CHAPTER 4.3, AWC SDPWS-2015

IBC 2015 / ASCE 7-10

NOTES: 1. Typically when seismic is found to govern wind loads will not be checked here. However, if wind loads are found to govern both wind and seismic need to be checked in order to account for the difference in shearwall capacities.
 2. ASD loads are to be entered here.
 3. PSW is defined as Perforated Shear Wall.
 4. For PSW analysis the Length column is entered as the sum of the PSW segment lengths. The Shortest Wall Segment column is entered as the shortest segment in the PSW. The Opening Height column is the worst case opening height of all the openings in the PSW.

S_{DS}= 0.66

Grid A		Wind Force on Wall Line: 1,020 lbs		lbs / Dowel: 2,750 lbs		Total: 0 lbs											
Roof Balcony		Seismic Force on Wall Line: 4,711 lbs		# of Dowels: 0		NG											
Wall ID	# of Walls	Length (ft)	Height (ft)	H:W Ratio	Aspect Ratio Reduct.	Effective Length (2b _s /h)*L	Total Length (ft)	Uniform DL (plf)	Seismic Uplift (lb)	Wind Uplift (lb)	PSW	Shortest Wall Seg. (ft)	Opening Height (ft)	Opening Length (ft)	Co. PSW Reduct.	Holdown Required	
1	1	22.75	3.5	0.15	1.00	22.75	22.75	145	0	0					1.00		
Total Length: 22.75		Wind Force / Wind Length = 45		plf (SW1)		Use: SW1		Anchor Bolt Size (inches):		NA		Seismic Force / Seismic Length = 207		plf (SW1)		Anchor Bolt Designation: NA	

Grid B		Wind Force on Wall Line: 1,020 lbs		lbs / Dowel: 2,750 lbs		Total: 0 lbs											
Roof Balcony		Seismic Force on Wall Line: 4,711 lbs		# of Dowels: 0		NG											
Wall ID	# of Walls	Length (ft)	Height (ft)	H:W Ratio	Aspect Ratio Reduct.	Effective Length (2b _s /h)*L	Total Length (ft)	Uniform DL (plf)	Seismic Uplift (lb)	Wind Uplift (lb)	PSW	Shortest Wall Seg. (ft)	Opening Height (ft)	Opening Length (ft)	Co. PSW Reduct.	Holdown Required	
1	1	22.75	3.5	0.15	1.00	22.75	22.75	145	0	0					1.00		
Total Length: 22.75		Wind Force / Wind Length = 45		plf (SW1)		Use: SW1		Anchor Bolt Size (inches):		NA		Seismic Force / Seismic Length = 207		plf (SW1)		Anchor Bolt Designation: NA	

Grid A	Wind Force on Wall Line: 2,850 lbs	lbs / Dowel: 2,750 lbs	Total: 16,500 lbs
Upper Floor	Seismic Force on Wall Line: 13,837 lbs	# of Dowels: 6	OK

Grid B	Wind Force on Wall Line: 2,850 lbs	lbs / Dowel: 2,750 lbs	Total: 19,250 lbs
Upper Floor	Seismic Force on Wall Line: 13,837 lbs	# of Dowels: 7	OK

Grid A - See 3 Sided Diaphragm	Wind Force on Wall Line: 5,160 lbs	lbs / Dowel: 2,750 lbs	Total: 22,000 lbs
Main Floor	Seismic Force on Wall Line: 21,987 lbs	# of Dowels: 8	OK
	Anchor Bolt Size (inches): 5/8		
	Anchor Bolt Designation: AB24		

Grid B - 3 Sided Diaphragm	Wind Force on Wall Line: 5,160 lbs	lbs / Dowel: 2,750 lbs	Total: 35,750 lbs
Main Floor	Seismic Force on Wall Line: 33,380 lbs	# of Dowels: 13	OK
	Anchor Bolt Size (inches): 5/8		
	Anchor Bolt Designation: AB12		



Project: Blake Kingsbury and Merrit Chesson
 By: Alex Hawkins, PE
 Date: June 2018

Project No.: 8332
 Checked By: DAJ

SINGLE-STORY WOOD SHEAR WALLS

CHAPTER 4.3. AWC SDPWS-2015

IBC 2015 / ASCE 7-10

NOTES: 1. Typically when seismic is found to govern wind loads will not be checked here. However, if wind loads are found to govern both wind and seismic need to be checked in order to account for the difference in shearwall capacities.
 2. ASD loads are to be entered here.
 3. PSW is defined as Perforated Shear Wall.
 4. For PSW analysis the Length column is entered as the sum of the PSW segment lengths. The Shortest Wall Segment column is entered as the shortest segment in the PSW. The Opening Height column is the worst case opening height of all the openings in the PSW.

S_{DS} = 0.66

Grid 1		Wind Force on Wall Line:	960	lbs	lbs / Dowell:	2,750	lbs	Total:	0	lbs						
Roof Balcony		Seismic Force on Wall Line:	4,711	lbs	# of Dowells:	0			NG							
Wall ID	# of Walls	Length (ft)	Height (ft)	H:W Ratio	Aspect Ratio Reduct.	Effective Length (2b _v /h)*L	Total Length (ft)	Uniform DL (plf)	Seismic Uplift (lb)	Wind Uplift (lb)	PSW	Shortest Wall Seg. (ft)	Opening Height (ft)	Opening Length (ft)	Co, PSW Reduct.	Holdown Required
1	2	6.00	11.0	1.83	1.00	6.00	12.00	210	4234	531					1.00	MSTC52 - (44)
Total Length:		12.00	Wind Force / Wind Length =		80	plf (SW1)	Use: SW4		Anchor Bolt Size (inches):		NA	Anchor Bolt Designation:		NA		
			Seismic Force / Seismic Length =		393	plf (SW4)										

Grid 2		Wind Force on Wall Line:	960	lbs	lbs / Dowell:	2,750	lbs	Total:	0	lbs						
Roof Balcony		Seismic Force on Wall Line:	4,711	lbs	# of Dowells:	0			NG							
Wall ID	# of Walls	Length (ft)	Height (ft)	H:W Ratio	Aspect Ratio Reduct.	Effective Length (2b _v /h)*L	Total Length (ft)	Uniform DL (plf)	Seismic Uplift (lb)	Wind Uplift (lb)	PSW	Shortest Wall Seg. (ft)	Opening Height (ft)	Opening Length (ft)	Co, PSW Reduct.	Holdown Required
1	1	3.00	5.0	1.67	1.00	3.00	3.00	165	8691	1633					1.00	CMST12
Total Length:		3.00	Wind Force / Wind Length =		320	plf (SW1)	Use: SW1		Anchor Bolt Size (inches):		NA	Anchor Bolt Designation:		NA		
			Seismic Force / Seismic Length =		1570	plf (SW10)										

Grid 1		Wind Force on Wall Line:	2,010	lbs	lbs / Dowell:	2,750	lbs	Total:	8,250	lbs						
Upper Floor		Seismic Force on Wall Line:	7,753	lbs	# of Dowells:	3			OK							
Grid 2		Wind Force on Wall Line:	4,110	lbs	lbs / Dowell:	2,750	lbs	Total:	0	lbs						
Upper Floor		Seismic Force on Wall Line:	13,839	lbs	# of Dowells:	0			NG							
Wall ID	# of Walls	Length (ft)	Height (ft)	H:W Ratio	Aspect Ratio Reduct.	Effective Length (2b _v /h)*L	Total Length (ft)	Uniform DL (plf)	Seismic Uplift (lb)	Wind Uplift (lb)	PSW	Shortest Wall Seg. (ft)	Opening Height (ft)	Opening Length (ft)	Co, PSW Reduct.	Holdown Required
1	1	12.50	10.0	0.80	1.00	12.50	12.50	200	7473	1642					1.00	HDU11
2	1	5.00	10.0	2.00	1.00	5.00	5.00	200	8200	2195					1.00	HDU11
Total Length:		17.50	Wind Force / Wind Length =		235	plf (SW1)	Use: SW7		Anchor Bolt Size (inches):		NA	Anchor Bolt Designation:		NA		
			Seismic Force / Seismic Length =		791	plf (SW7)										

Grid 3		Wind Force on Wall Line:	2,100	lbs	lbs / Dowell:	2,750	lbs	Total:	8,250	lbs
Upper Floor		Seismic Force on Wall Line:	6,086	lbs	# of Dowells:	3			OK	



Project: Blake Kingsbury and Merrit Chesson
 By: Alex Hawkins, PE
 Date: June 2018

Project No.: 8332
 Checked By: DAJ

Grid 1 - 3 Sided Diaphragm

Main Floor

Wind Force on Wall Line: _____ lbs lbs / Dowell: 2,750 lbs Total: 13,750 lbs
 Seismic Force on Wall Line: 12,018 lbs # of Dowells: 5 OK
 Anchor Bolt Size (inches): 5/8
 Anchor Bolt Designation: AB24

Grid 2 - 3 Sided Diaphragm

1st Floor

Wind Force on Wall Line: _____ lbs
 Seismic Force on Wall Line: 22,125 lbs

Wall ID	# of Walls	Length (ft)	Height (ft)	H:W Ratio	Aspect Ratio Reduct.	Effective Length (2b _v /h)*L	Total Length (ft)	Uniform DL (plf)	Seismic Uplift (lb)	Wind Uplift (lb)	PSW	Shortest Wall Seg. (ft)	Opening Height (ft)	Opening Length (ft)	Co. PSW Reduct.	Holdown Required
1	1	12.75	10.0	0.78	1.00	12.75	12.75	250	22128	0					1.00	(2) HDU14

Total Length: 12.75

Wind Force / Wind Length = 0 plf (SW1) Use: SW1

Anchor Bolt Size (inches): 5/8

Seismic Force / Seismic Length = 1735 plf (SW10)

Anchor Bolt Designation: AB8


Beam Id: Lot70 / Garage column

Structural Engineer:


Licensed to: FINNLAMELLI OY

REINFORCED
CONCR. 26" x 10"
(SIDE WALL) 660 mm x 250 mm


Date 30-05-2018

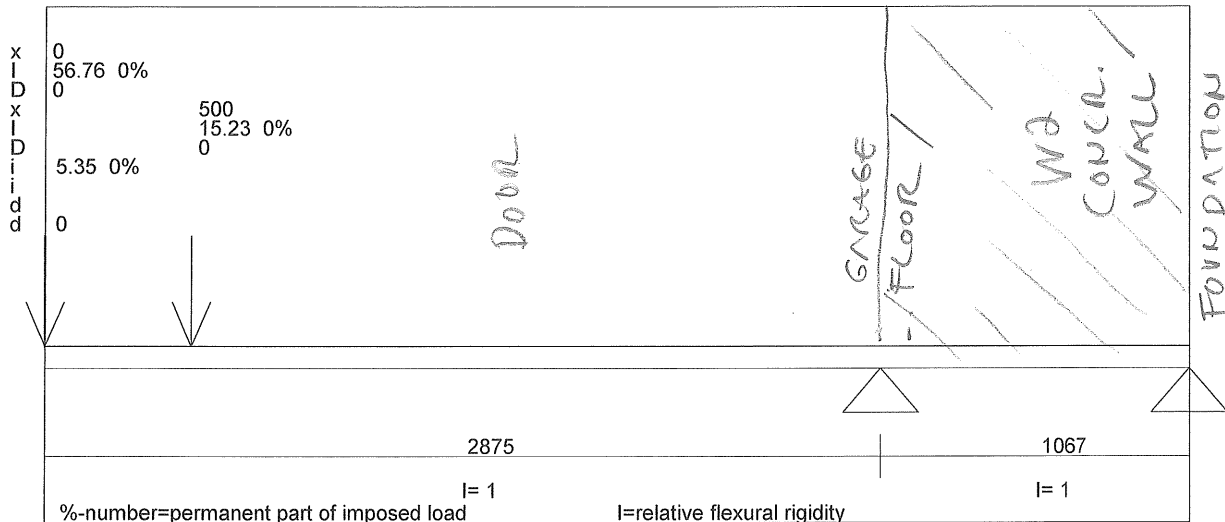

Licensed to: FINNLAMELLI OY

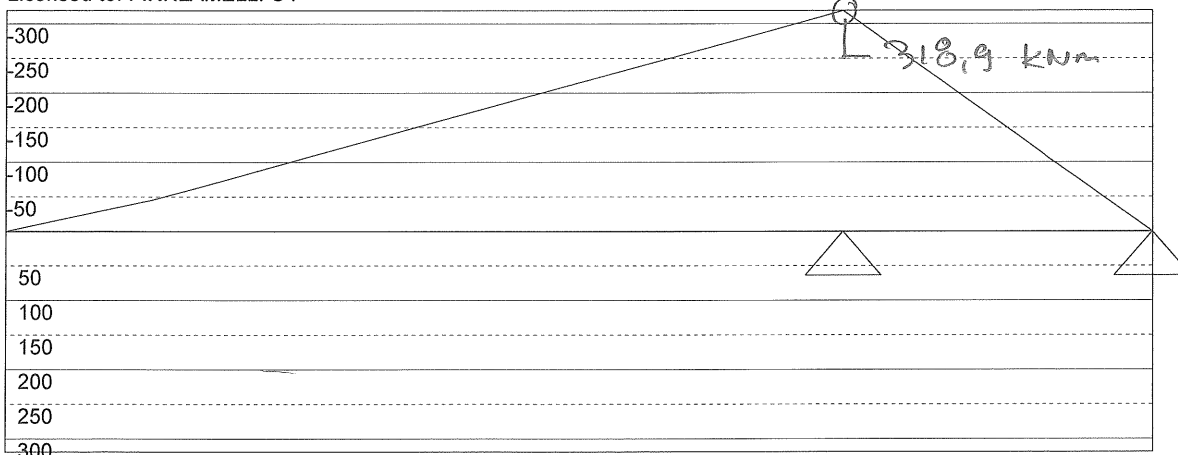

Licensed to: FINNLAMELLI OY

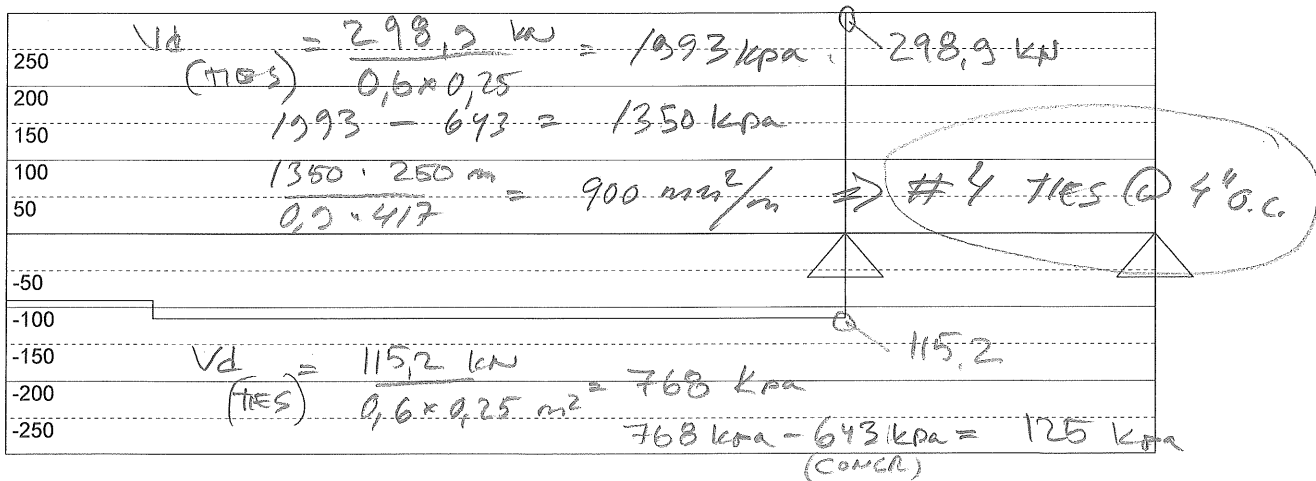

Load factor of dead load= 1.2 Load factor of imposed load= 1.6

Load width 1 (m) (by which the loads has been multiplied during calculation)

Max/Min reactions of beam [kN]

414,125 0,000
0,000 -298,941

$$\frac{125 \cdot 250}{0,9 \cdot 417} = 83 \text{ mm}^2/\text{m}$$

=> MIN TIES => #3 @ 8' O.C.

$$M_d \text{ (MAIN BARS)} = \frac{M_d}{z \cdot f_{yd}} = \frac{318,9 \cdot 10^6}{600 \cdot 417} = 1275 \text{ mm}^2$$

=> (4) #7 BARS



Project: Blake Kingsbury and Merrit Chesson

Project No.: 8332

By: Alex Hawkins, PE

Checked By: DAJ

Date: June 2018

HOLDOWN & VERTICAL STRAP SCHEDULE

IBC 2015 / ASCE 7-10

HOLDOWN INTO CONCRETE					
Mark	Anchor	Wind or Seismic Capacity (LBS)	Rod Diameter	Min. Post Size	Minimum Embed Depth in Footing
H-1	HTT4 w/ (18) 10dx1½ nails	3610	5/8"	3" x 3 1/2"	9"
H-2	HTT5 w/ (26) 10d nails	4670	5/8"	3" x 3 1/2"	9"
H-3	HDU5 - SDS2.5 (14)	5645	5/8"	3" x 3 1/2"	9"
H-4	HDU8 - SDS2.5 (20)	7870	7/8"	4 1/2" x 3 1/2"	10 1/2"
H-5	HDU11 - SDS2.5 (30)	9535	1"	5 1/2" x 3 1/2"	14"
H-6	HDU11 - SDS2.5 (30)	11175	1"	7 1/4" x 3 1/2"	14"
H-7	HDU14 - SDS2.5 (36)	14445	1"	5 1/2" x 5 1/2"	14"
		14375	1"	7 1/4" x 3 1/2"	14"

FLOOR TO FLOOR TIES (STRAPS OR RODS)				
Mark	Anchor	Wind or Seismic Capacity (LBS)	Rod Diameter	Min. Post Size
	Strap Type			
T-1	CS16 - (20)-11"	1705	NA	2x
T-2	MSTC40 - (28)	2695	NA	(2) 2x
T-3	MSTC52 - (44)	4235	NA	(2) 2x
T-4	MSTC66 - (64)	5860	NA	(2) 2x
	Rod Type			
T-5	HDU2-SDS2.5 (6)	3075	5/8"	3" x 3 1/2"
T-6	HTT4 w/ (18) 10dx1½ nails	3610	5/8"	3" x 3 1/2"
T-7	HTT5 w/ (26) 10d nails	4670	5/8"	3" x 3 1/2"
T-8	HDU5 - SDS2.5 (14)	5645	5/8"	3" x 3 1/2"
T-9	HDU8 - SDS2.5 (20)	7870	7/8"	4 1/2" x 3 1/2"
T-10	(2) HDU4-SDS2.5 (20)	9130	5/8"	3" x 3 1/2"
T-11	HDU11 - SDS2.5 (30)	9535	1"	5 1/2" x 3 1/2"
T-12	HDU14 - SDS2.5 (36)	14445	1"	5 1/2" x 5 1/2"
		14375	1"	7 1/4" x 3 1/2"

Notes:

All anchors are Simpson Strong-Tie. Install per manufacturer's specifications.

Use 4" end distance at foundation blockouts.

CS straps are specified with: strap type - total # of 10d nails required - end length required

MSTC straps are specified with: strap type - total # of 16d sinker nails required

All straps are designed for 18" max floor to floor clear span

Provide 3/8" X 1 1/2" X 1 1/2" plate washer for 5/8" dia. anchors, 3/8" X 2 1/4" X 2 1/4" plate washer for 7/8" dia. anchors, 3/8" X 2 1/2" X 2 1/2" plate washer for 1" dia. anchors. Provide nut top and bottom.

For stem wall applications use simpsom SB 5/8" x 24" embed 18" min. in wall for HTT4, HTT5, HDU5 holdowns.

Ensure that the Min. Edge distances are met for all anchors in concrete.

Min. anchor bolt strength is ASTM F-1554 GRADE 36 U.N.O.

HORIZONTAL STRAP SCHEDULE



Project: Blake Kingsbury and Merrit Chesson

By: Alex Hawkins, PE

Date: June 2018

Project No.: 8332

Checked By: DAJ

Mark	Strap Req.	Notes
**	CS16	Strap horizontally above and below window. Header above and sill below window must be continuous. Provide 2x blocking in wall as required and (2) 2x sill.

ANCHOR BOLTS

2015 NDS Table 12E

1/2" Diameter Anchor Bolts		
Mark	Bolt Spacing	Capacity (plf)
AB32	32"	384
AB24	24"	512
AB16	16"	768
AB12	12"	1024
AB8	8"	1536

5/8" Diameter Anchor Bolts		
Mark	Bolt Spacing	Capacity (plf)
AB32	32"	552
AB24	24"	736
AB16	16"	1104
AB12	12"	1472
AB8	8"	2208

- Notes:
- 7" minimum embedment depth on all anchor bolts.
 - 3" x 3" x 0.229" plate washers on all anchor bolts. 1/2" away from sheathing.
 - (2) anchor bolts min. per shear wall.
 - Anchors are located a minimum of 1 3/4" away from the edge of concrete
 - Anchor bolts are to be located 15 anchor diameters away from a concrete edge that is perpendicular to the sill plate.
 - Sill plate is 2x or 3x minimum. (Capacities shown here are based on a 2x sill plate)



Project: Blake Kingsbury and Merrit Chesson

By: Alex Hawkins, PE

Date: June 2018

Project No.: 8332

Checked By: DAJ

ROOF FRAMING

NDS 2015 EDITION

IBC 2015 / ASCE 7-10

Roof Trusses:

Use pre-engineered trusses @ 24" o.c.
 Provide truss blocking as shown on plans and per manufacturer's specifications.
 All truss connection hardware to be designed by the truss manufacturer.
 Provide full depth blocking at all bearing locations with (1) A35 clip to top plate per block U.N.O.
 Nail through sheathing with 8d common @ 4" o.c. into blocking U.N.O.
 Provide "H1" clips at both ends of every truss U.N.O.

Roof Stick Frame:

Use roof joists per span chart.
 Provide full depth blocking at all bearing locations with (1) A35 clip to top plate per block UNO.
 Nail through sheathing with 8d common @ 4" o.c. into blocking U.N.O.
 Provide "H1" clips at both ends of every joist UNO.

Roof Overbuild:

Frame roof overbuild areas with 2x6 DF#2 @ 24" o.c.
 Brace joists at 6' 0" o.c.
 Use 2x8 DF#2 ridge board braced at 4' 0" o.c.
 Use 2x8 DF#2 valley members laid flat and nailed to trusses with (2) 16d per truss.
 Brace ridge and joists such that load is distributed uniformly to trusses below.
 Sheath under all overbuild areas.
 Provide access and ventilation to overbuild areas as necessary.

Roof Beams:

See attached beam calculations.

Roof Sheathing:

Provide 5/8" or thicker 24/16 APA rated panel.
 Nail with 8d common at 6" o.c. at panel edge and 12" o.c. in the field.
 Provide 'H' clips at all unsupported edges.
 Provide 1/8" gap between panels at time of installation.



Project: Blake Kingsbury and Merrit Chesson

By: Alex Hawkins, PE

Date: June 2018

Project No.: 8332

Checked By: DAJ

FLOOR FRAMING

NDS 2015 EDITION

IBC 2015 / ASCE 7-10

Floor Joists:

TJI Engineered Floor Joist Span Tables: 20DL + 40LL + L/480					
Depth	Series	12" o.c.	16" o.c.	19.2" o.c.	24" o.c.
9 1/2"	110	16'-11"	15'-6"	14'-7"	13'-7"
9 1/2"	210	17'-9"	16'-3"	15'-4"	14'-3"
11-7/8"	110	20'-2"	18'-5"	17'-4"	15'-9"***
11-7/8"	210	21'-1"	19'-3"	18'-2"	16'-11"
11-7/8"	360	22'-11"	20'-11"	19'-8"	18'-4"

LPI Engineered Floor Joist Span Tables: 15DL + 40LL + L/480					
Depth	Series	12" o.c.	16" o.c.	19.2" o.c.	24" o.c.
9 1/2"	LPI 20Plus	17'-9"	16'-2"	15'-3"	14'-3"
9 1/2"	LPI32Plus	18'-9"	17'-0"	16'-0"	14'-9"
11-7/8"	LPI 20Plus	21'-2"	19'-4"	18'-3"	17'-0"
11-7/8"	LPI32Plus	22'-3"	20'-2"	19'-0"	17'-7"

Roseberg Engineered Floor Joist Span Tables: 20DL + 40LL + L/480					
Depth	Series	12" o.c.	16" o.c.	19.2" o.c.	24" o.c.
9 1/2"	RFPI 20	16'-7"	15'-2"	14'-4"	12'-10"
9 1/2"	RFPI 400	18'-0"	16'-5"	15'-6"	14'-6"
11-7/8"	RFPI 20	19'-10"	17'-11"	16'-4"	13'-8"
11-7/8"	RFPI 400	21'-5"	19'-7"	18'-6"	16'-10"

1-1/4" Rimboard around perimeter of all floors.

Install per manufacturers specifications.

Equivalent engineered floor joists may be substituted based on published information.

***Web stiffener is required at intermediate support when bearing length is less than 5/4"

Floor Beams:

See attached beam calculations.

Floor Sheathing:

Provide 3/4" T&G APA rated Sturd-I-Floor sheathing.

Glue and nail with 10d common at 6" o.c. at panel edges and 12" o.c. in the field.



Project: Blake Kingsbury and Merrit Chesson

Project No.: 8332

By: Alex Hawkins, PE

Checked By: DAJ

Date: June 2018

STUD COLUMN DESIGN

NDS 2015 EDITION

IBC 2015 / ASCE 7-10

Species = DFLN Stud
 Height = 11.0 ft
 Fc = 900 psi
 E = 1400 ksi
 Kce = 0.3 psi
 c = 0.8 psi

Size =	2x4	2x6	
d =	3.50	5.25	in
Fce =	295.28	664.39	psi
Cp =	0.30	0.58	
F'c =	271.77	521.08	psi

Height	(2) 2x4	(3) 2x4	(4) 2x4	(5) 2x4	(6) 2x4	(7) 2x4	
11 ft	2.9	4.3	5.7	7.1	8.6	10.0	kips
9 ft	4.0	6.0	8.1	10.1	12.1	14.1	kips
10 ft	3.4	5.1	6.8	8.4	10.1	11.8	kips
12 ft	2.4	3.7	4.9	6.1	7.3	8.5	kips
18 ft	1.1	1.7	2.3	2.8	3.4	3.9	kips

Height	(2) 2x6	(3) 2x6	(4) 2x6	(5) 2x6	(6) 2x6	(7) 2x6	
11 ft	8.2	12.3	16.4	20.5	24.6	28.7	kips
9 ft	10.3	15.4	20.5	25.6	30.8	35.9	kips
10 ft	9.2	13.8	18.4	23.1	27.7	32.3	kips
12 ft	7.3	10.9	14.5	18.2	21.8	25.4	kips
18 ft	3.7	5.5	7.3	9.1	11.0	12.8	kips

SOLID POSTS

Species = DFLN #1
 Height = 14.0 ft
 Fc = 925 psi
 E = 1600 ksi
 Kce = 0.3 psi
 c = 0.8 psi

Size =	4x4	4X6	6x6	
d =	3.5	3.5	5.5	in
Fce =	208.33	208.33	514.46	psi
Cp =	0.214	0.214	0.472	
F'c =	197.60	197.60	436.47	psi

Height	4x4	4X6	6x6	
14 ft	2.4	3.8	13.2	kips
9 ft	5.6	8.8	21.9	kips
10 ft	4.7	7.3	20.1	kips
12 ft	3.3	5.2	16.5	kips
18 ft	1.5	2.4	8.6	kips



Project: Blake Kingsbury and Merrit Chesson

Project No.: 8332

By: Alex Hawkins, PE

Checked By: DAJ

Date: June 2018

STANDARD FOUNDATION WALLS

ACI 318-14

IBC 2015 / ASCE 7-10

Foundation Schedule			Horizontal Reinforcement		Vertical Reinforcement	
Mark	Wall Height	Thickness	Size	Spacing	Size	Spacing
Typ.	4'	8"	#4	18"	#4	24"
Typ.	8'	8"	#4	18"	#4	24"
Typ.	9'	8"	#4	18"	#4	16"
Typ.	10'	8"	#4	18"	#5	12"

Notes: Wall height refers to final grade difference through the wall. Total height of wall may be higher due to footing drop for frost protection or native soil bearing as long as wall is backfilled such that the grade difference does not exceed the wall height at any time during construction.

ALL REBAR TO BE GRADE 60.

Place vertical bars in the center of wall.

Extend vertical bars from the footing to within 3" of the top of wall.

Provide #4 dowel with standard hook in the footing to match the vertical rebar.

Extend vertical leg of dowel 24" min. into wall.

Place (1) #4 horizontally within 4" of top and bottom of wall.

Provide corner reinforcing so as to lap 24" min.

Provide (2) #4 above, (1) #4 each side, and (1) #4 below all openings.

Place steel within 2" of openings & extend 24" min. beyond edge of opening.


Vertical bars around openings may terminate 3" from top of wall.

3 piece(s) 1 3/4" x 11 7/8" 2.0E Microllam® LVL

This product failed due to an excessive uplift of -16402 lbs at support located at 4.00".

This product failed due to an excessive uplift of -3166 lbs at support located at 10' 4.00".

Overall Length: 10' 8.00"

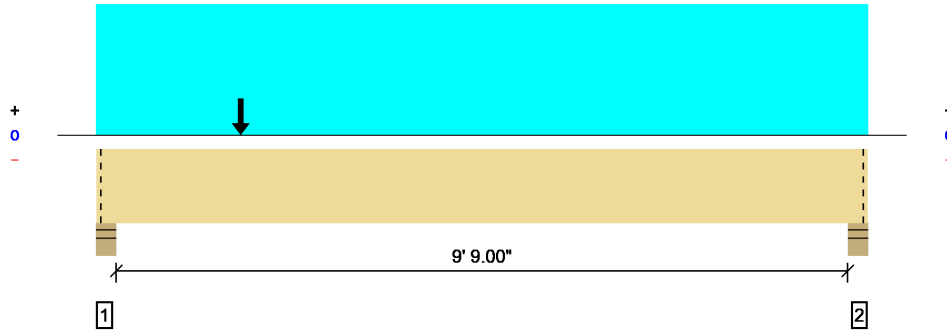

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	16785 @ 4.00"	18047 (5.50")	Passed (93%)	--	1.0 D + 0.7 E (All Spans)
Shear (lbs)	16720 @ 1' 5.38"	18953	Passed (88%)	1.60	1.0 D + 0.7 E (All Spans)
Moment (Ft-lbs)	27888 @ 2' 0.00"	42836	Passed (65%)	1.60	1.0 D + 0.7 E (All Spans)
Live Load Defl. (in)	-0.274 @ 4' 8.38"	0.333	Passed (L/437)	--	0.6 D - 0.7 E (All Spans)
Total Load Defl. (in)	0.282 @ 4' 8.59"	0.500	Passed (L/425)	--	1.0 D + 0.7 E (All Spans)

System : Floor
 Member Type : Flush Beam
 Building Use : Residential
 Building Code : IBC 2015
 Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Top Edge Bracing (Lu): Top compression edge must be braced at 9' 6.00" o/c unless detailed otherwise.
- Bottom Edge Bracing (Lu): Bottom compression edge must be braced at 9' 9.00" o/c unless detailed otherwise.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Seismic	Total	
1 - Stud wall - DF	5.50"	5.50"	5.12"	239	284	23637/-23637	24160/-23637	Blocking
2 - Stud wall - DF	5.50"	5.50"	1.50"	239	284	4727/-4727	5250/-4727	Blocking

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Seismic (1.60)	Comments
0 - Self Weight (PLF)	0 to 10' 8.00"	N/A	18.2			
1 - Uniform (PSF)	0 to 10' 8.00" (Front)	1' 4.00"	20.0	40.0	-	Residential - Living Areas
2 - Point (lb)	2' 0.00" (Front)	N/A	-	-	28364	

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC ES under technical reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by Forte Software Operator



Forte Software Operator	Job Notes
Ensign Engineering Ensign Engineering (801) 255-0529 ensign@ensignutah.com	

8/1/2018 2:20:08 PM
 Forte v5.4, Design Engine: V7.1.1.3
 Forte.4te


3 piece(s) 1 3/4" x 11 7/8" 2.0E Microllam® LVL

This product failed due to an excessive uplift of -3247 lbs at support located at 7' 4.25".

This product failed due to an excessive uplift of -5018 lbs at support located at 11' 9.75".

This product failed due to an excessive uplift of -16627 lbs at support located at 24' 0.50".

Overall Length: 24' 4.00"

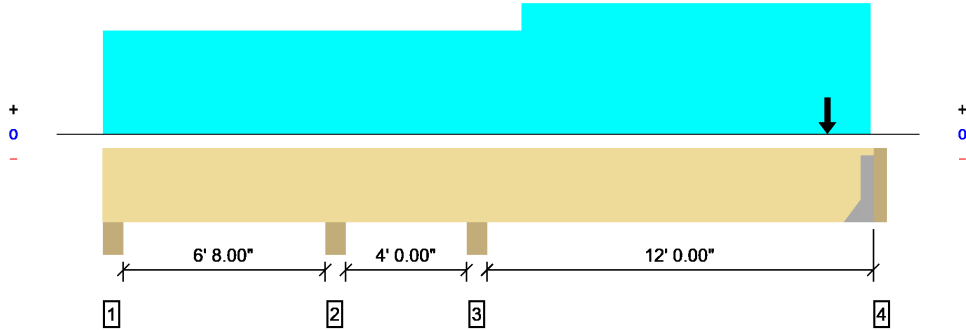

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	18596 @ 24' 0.50"	18596 (4.72")	Passed (100%)	--	1.0 D + 0.7 E (All Spans)
Shear (lbs)	18390 @ 23' 0.62"	18953	Passed (97%)	1.60	1.0 D + 0.7 E (All Spans)
Moment (Ft-lbs)	28434 @ 22' 6.00"	42836	Passed (66%)	1.60	1.0 D + 0.7 E (All Spans)
Live Load Defl. (in)	0.287 @ 19' 3.13"	0.306	Passed (L/512)	--	1.0 D + 0.525 E + 0.75 L + 0.75 S (Alt Spans)
Total Load Defl. (in)	0.343 @ 19' 1.48"	0.611	Passed (L/428)	--	1.0 D + 0.525 E + 0.75 L + 0.75 S (Alt Spans)

System : Floor
 Member Type : Flush Beam
 Building Use : Residential
 Building Code : IBC 2015
 Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Top Edge Bracing (Lu): Top compression edge must be braced at 9' 2.00" o/c unless detailed otherwise.
- Bottom Edge Bracing (Lu): Bottom compression edge must be braced at 16' 7.00" o/c unless detailed otherwise.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Seismic	Total	
1 - Column - DF	5.50"	5.50"	1.50"	760	1437/-46	473/-473	2670/-519	None
2 - Column - DF	5.50"	5.50"	1.50"	489	2837/-1060	5057/-5057	8383/-6117	None
3 - Column - DF	5.50"	5.50"	3.21"	3028	6001	9764/-9764	18793/-9764	None
4 - Hanger on 11 7/8" DF beam	3.50"	Hanger ¹	4.72"	1231	2298/-17	24807/-24807	28336/-24824	See note ¹

- At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger
- ¹ See Connector grid below for additional information and/or requirements.

Connector: Simpson Strong-Tie Connectors

Support	Model	Seat Length	Top Nails	Face Nails	Member Nails	Accessories
4 - Face Mount Hanger	Connector not found	N/A	N/A	N/A	N/A	

Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Seismic (1.60)	Comments
0 - Self Weight (PLF)	0 to 24' 0.50"	N/A	18.2			
1 - Uniform (PSF)	13' 0.00" to 23' 10.00" (Front)	12' 0.00"	20.0	40.0	-	Residential - Living Areas
2 - Point (lb)	22' 6.00" (Front)	N/A	-	-	29987	
3 - Uniform (PSF)	0 to 13' 0.00" (Front)	9' 6.00"	20.0	40.0	-	Residential - Living Areas

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC ES under technical reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by Forte Software Operator



Forte Software Operator	Job Notes
Ensign Engineering Ensign Engineering (801) 255-0529 ensign@ensignutah.com	


3 piece(s) 1 3/4" x 11 7/8" 2.0E Microllam® LVL

This product failed due to an excessive uplift of -2356 lbs at support located at 13' 1.00".

This product failed due to an excessive uplift of -17861 lbs at support located at 17' 0.50".

This product failed due to an excessive uplift of -1511 lbs at support located at 24' 4.75".

Overall Length: 24' 10.00"

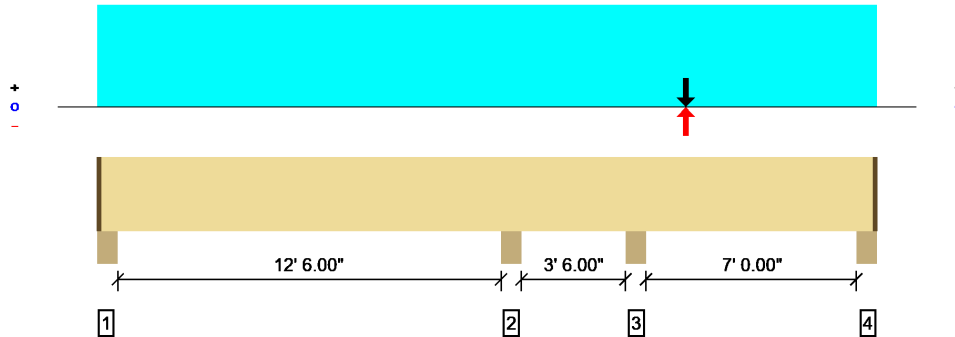

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern) [Group]
Member Reaction (lbs)	20807 @ 17' 1.75"	21656 (5.50")	Passed (96%)	--	1.0 D - 0.7 E (All Spans) [5]
Shear (lbs)	16964 @ 18' 4.38"	18953	Passed (90%)	1.60	1.0 D - 0.7 E (All Spans) [5]
Moment (Ft-lbs)	-9004 @ 13' 2.25"	26772	Passed (34%)	1.00	1.0 D + 1.0 L (Adj Spans) [5]
Live Load Defl. (in)	0.082 @ 20' 6.87"	0.184	Passed (L/999+)	--	1.0 D - 0.525 E + 0.75 L + 0.75 S (Alt Spans) [5]
Total Load Defl. (in)	0.097 @ 20' 7.33"	0.368	Passed (L/909)	--	1.0 D - 0.525 E + 0.75 L + 0.75 S (Alt Spans) [5]

System : Floor
 Member Type : Flush Beam
 Building Use : Residential
 Building Code : IBC 2015
 Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Top Edge Bracing (Lu): Top compression edge must be braced at 22' 10.00" o/c unless detailed otherwise.
- Bottom Edge Bracing (Lu): Bottom compression edge must be braced at 20' 11.00" o/c unless detailed otherwise.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Seismic	Total	
1 - Column - DF	5.50"	4.25"	1.50"	1100	2013	169/-169	3282/-169	1 1/4" Rim Board
2 - Column - DF	5.50"	5.50"	2.21"	2332	5191/-265	5364/-5364	12887/-5629	None
3 - Column - DF	5.50"	5.50"	5.28"	1841	5273/-1097	27093/-27093	34207/-28190	None
4 - Column - DF	5.50"	4.25"	1.50"	876	1632	2909/-2909	5417/-2909	1 1/4" Rim Board

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.

Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Seismic (1.60)	Comments
0 - Self Weight (PLF)	1.25" to 24' 8.75"	N/A	18.2			
1 - Uniform (PSF)	0 to 24' 10.00" (Front)	9' 0.00"	20.0	40.0	-	Residential - Living Areas
2 - Point (lb)	18' 9.00" (Front)	N/A	1231	2298/-17	24807/-24807	Linked from: MB11, Support 4

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC ES under technical reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by Forte Software Operator




Forte Software Operator	Job Notes
Ensign Engineering Ensign Engineering (801) 255-0529 ensign@ensignutah.com	

8/1/2018 2:05:34 PM
 Forte v5.4, Design Engine: V7.1.1.3
 Forte.4te

1 piece(s) 11 7/8" TJI® 230 @ 16" OC

Right cantilever length exceeds 1/3 member length or 1/2 back span length.

Overall Length: 11' 0.50"

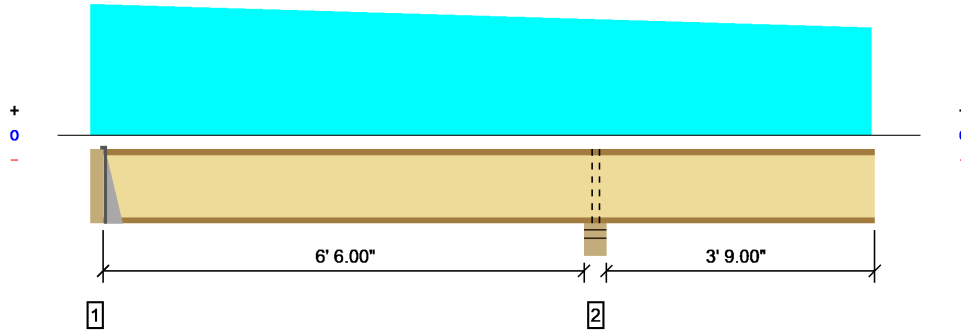

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.; Drawing is Conceptual

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	3263 @ 7' 0.50"	3209 (5.25")	Passed (102%)	1.15	1.0 D + 1.0 S (All Spans)
Shear (lbs)	1375 @ 7' 3.50"	1903	Passed (72%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	-2896 @ 7' 0.50"	4847	Passed (60%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.151 @ 11' 0.50"	0.200	Passed (2L/638)	--	1.0 D + 1.0 S (Alt Spans)
Total Load Defl. (in)	0.160 @ 11' 0.50"	0.400	Passed (2L/600)	--	1.0 D + 1.0 S (Alt Spans)
TJ-Pro™ Rating	68	40	Passed	--	--

 System : Floor
 Member Type : Joist
 Building Use : Residential
 Building Code : IBC 2015
 Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Overhang deflection criteria: LL (0.2") and TL (2L/240).
- Top Edge Bracing (Lu): Top compression edge must be braced at 6' 9.00" o/c unless detailed otherwise.
- Bottom Edge Bracing (Lu): Bottom compression edge must be braced at 5' 0.00" o/c unless detailed otherwise.
- A structural analysis of the deck has not been performed.
- Deflection analysis is based on composite action with a single layer of 23/32" Weyerhaeuser Edge™ Panel (24" Span Rating) that is glued and nailed down.
- Additional considerations for the TJ-Pro™ Rating include: None

Supports	Bearing			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Snow	Total	
1 - Hanger on 11 7/8" DF ledger	3.50"	Hanger ¹	1.75" / - ²	66	293/-71	1261	1620/-71	See note ¹
2 - Stud wall - DF	6.00"	6.00"	5.25"	228	685	3035	3948	Blocking

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.
- At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger
- ¹ See Connector grid below for additional information and/or requirements.
- ² Required Bearing Length / Required Bearing Length with Web Stiffeners

Connector: Simpson Strong-Tie Connectors

Support	Model	Seat Length	Top Nails	Face Nails	Member Nails	Accessories
1 - Top Mount Hanger	ITS2.37/11.88	2.00"	4-10d x 1-1/2	2-10d x 1-1/2	N/A	

Loads	Location (Side)	Spacing	Dead (0.90)	Floor Live (1.00)	Snow (1.15)	Comments
1 - Uniform (PSF)	0 to 11' 0.50"	16"	20.0	60.0	-	Residential - Living Areas
2 - Tapered (PLF)	0 to 11' 0.00"	N/A	-	-	418.0 to 324.0	

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC ES under technical reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by Forte Software Operator




Forte Software Operator	Job Notes
Ensign Engineering Ensign Engineering (801) 255-0529 ensign@ensignutah.com	

 6/12/2018 11:05:59 AM
 Forte v5.3, Design Engine: V7.0.0.5
 Forte.4te

Right cantilever length exceeds 1/3 member length or 1/2 back span length.
 Right overhang exceeds the maximum length of 5' 0.00" for this product.

Overall Length: 14' 3.50"

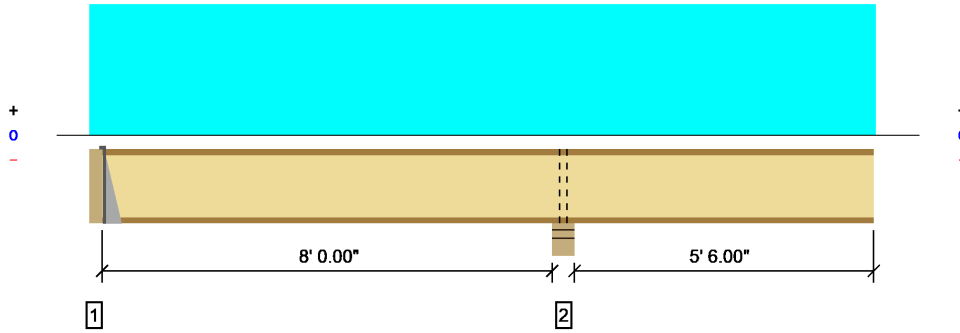

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.; Drawing is Conceptual

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	950 @ 8' 6.50"	2790 (5.25")	Passed (34%)	1.00	1.0 D + 1.0 L (All Spans)
Shear (lbs)	440 @ 8' 9.50"	1655	Passed (27%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	-1323 @ 8' 6.50"	3161	Passed (42%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.103 @ 14' 3.50"	0.287	Passed (2L/999+)	--	1.0 D + 1.0 L (Alt Spans)
Total Load Defl. (in)	0.140 @ 14' 3.50"	0.575	Passed (2L/988)	--	1.0 D + 1.0 L (Alt Spans)
TJ-Pro™ Rating	66	40	Passed	--	--

System : Floor
 Member Type : Joist
 Building Use : Residential
 Building Code : IBC 2015
 Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Overhang deflection criteria: LL (2L/480) and TL (2L/240).
- Moment capacity over cantilever support 2 has been reduced by 25% to lessen the effects of buckling.
- Top Edge Bracing (Lu): Top compression edge must be braced at 9' 7.00" o/c unless detailed otherwise.
- Bottom Edge Bracing (Lu): Bottom compression edge must be braced at 7' 6.00" o/c unless detailed otherwise.
- A structural analysis of the deck has not been performed.
- Deflection analysis is based on composite action with a single layer of 23/32" Weyerhaeuser Edge™ Panel (24" Span Rating) that is glued and nailed down.
- Additional considerations for the TJ-Pro™ Rating include: None

Supports	Bearing			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Total	
1 - Hanger on 11 7/8" DF ledger	3.50"	Hanger ¹	1.75" / - ²	64	236/-91	300/-91	See note ¹
2 - Stud wall - DF	6.00"	6.00"	3.50"	317	634	951	Blocking

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.
- At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger
- ¹ See Connector grid below for additional information and/or requirements.
- ² Required Bearing Length / Required Bearing Length with Web Stiffeners

Connector: Simpson Strong-Tie Connectors

Support	Model	Seat Length	Top Nails	Face Nails	Member Nails	Accessories
1 - Top Mount Hanger	ITS2.37/11.88	2.00"	4-10d x 1-1/2	2-10d x 1-1/2	N/A	

Loads	Location (Side)	Spacing	Dead (0.90)	Floor Live (1.00)	Comments
1 - Uniform (PSF)	0 to 14' 3.50"	16"	20.0	40.0	Residential - Living Areas

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC ESR under technical reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by Forte Software Operator




Forte Software Operator	Job Notes
Ensign Engineering Ensign Engineering (801) 255-0529 ensign@ensignutah.com	

6/12/2018 11:05:59 AM
 Forte v5.3, Design Engine: V7.0.0.5
 Forte.4te

1 piece(s) 11 7/8" TJI® 230 @ 16" OC

Overall Length: 18' 7.00"

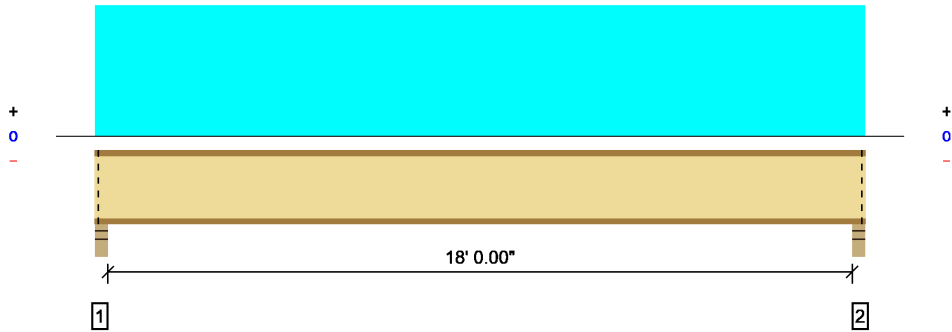

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.; Drawing is Conceptual

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	743 @ 2.50"	1485 (3.50")	Passed (50%)	1.00	1.0 D + 1.0 L (All Spans)
Shear (lbs)	720 @ 3.50"	1655	Passed (44%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	3300 @ 9' 3.50"	4215	Passed (78%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.350 @ 9' 3.50"	0.454	Passed (L/623)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.525 @ 9' 3.50"	0.908	Passed (L/415)	--	1.0 D + 1.0 L (All Spans)
TJ-Pro™ Rating	40	40	Passed	--	--

 System : Floor
 Member Type : Joist
 Building Use : Residential
 Building Code : IBC 2015
 Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Top Edge Bracing (Lu): Top compression edge must be braced at 4' 7.00" o/c unless detailed otherwise.
- Bottom Edge Bracing (Lu): Bottom compression edge must be braced at 18' 7.00" o/c unless detailed otherwise.
- A structural analysis of the deck has not been performed.
- Deflection analysis is based on composite action with a single layer of 23/32" Weyerhaeuser Edge™ Panel (24" Span Rating) that is glued and nailed down.
- Additional considerations for the TJ-Pro™ Rating include: None

Supports	Bearing			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Total	
1 - Stud wall - DF	3.50"	3.50"	1.75"	248	496	744	Blocking
2 - Stud wall - DF	3.50"	3.50"	1.75"	248	496	744	Blocking

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.


Loads	Location (Side)	Spacing	Dead (0.90)	Floor Live (1.00)	Comments
1 - Uniform (PSF)	0 to 18' 7.00"	16"	20.0	40.0	Residential - Living Areas

Weyerhaeuser Notes
Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC ES under technical reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library . The product application, input design loads, dimensions and support information have been provided by Forte Software Operator



Forte Software Operator	Job Notes
Ensign Engineering Ensign Engineering (801) 255-0529 ensign@ensignutah.com	

 6/12/2018 11:05:59 AM
 Forte v5.3, Design Engine: V7.0.0.5
 Forte.4te

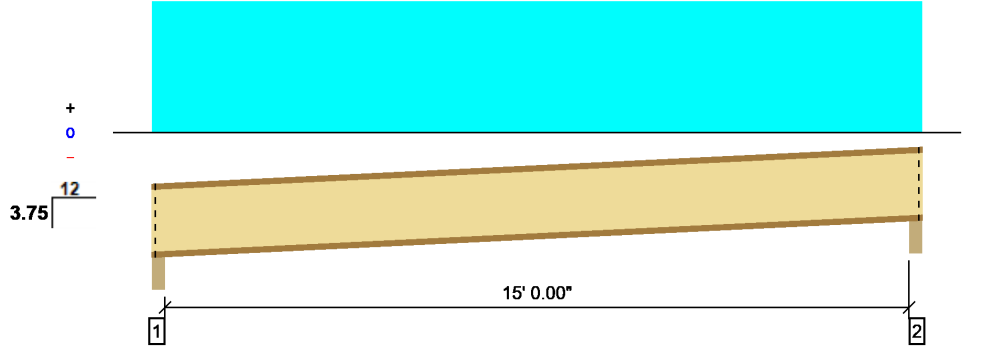1 piece(s) 11 7/8" TJI® 360 @ 12" OC
Overall Sloped Length: 16' 7.63"


All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.; Drawing is Conceptual

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	1628 @ 2.50"	1731 (3.50")	Passed (94%)	1.15	1.0 D + 1.0 S (All Spans)
Shear (lbs)	1567 @ 15' 3.50"	1961	Passed (80%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	6008 @ 7' 9.50"	7107	Passed (85%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.683 @ 7' 9.50"	0.794	Passed (L/279)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.760 @ 7' 9.50"	1.059	Passed (L/251)	--	1.0 D + 1.0 S (All Spans)

 System : Roof
 Member Type : Joist
 Building Use : Residential
 Building Code : IBC 2015
 Design Methodology : ASD
 Member Pitch : 3.75/12

- Deflection criteria: LL (L/240) and TL (L/180).
- Top Edge Bracing (Lu): Top compression edge must be braced at 3' 7.00" o/c unless detailed otherwise.
- Bottom Edge Bracing (Lu): Bottom compression edge must be braced at 16' 4.00" o/c unless detailed otherwise.

Supports	Bearing			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Total	
1 - Beveled Plate - DF	3.50"	3.50"	3.13"	163	1465	1628	Blocking
2 - Beveled Plate - DF	3.50"	3.50"	3.13"	163	1465	1628	Blocking

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Loads	Location (Side)	Spacing	Dead (0.90)	Snow (1.15)	Comments
1 - Uniform (PSF)	0 to 15' 7.00"	12"	20.0	188.0	Roof Snow


Weyerhaeuser Notes
Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC E5 under technical reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library . The product application, input design loads, dimensions and support information have been provided by Forte Software Operator



Forte Software Operator	Job Notes
Ensign Engineering Ensign Engineering (801) 255-0529 ensign@ensignutah.com	

 6/12/2018 11:05:59 AM
 Forte v5.3, Design Engine: V7.0.0.5
 Forte.4te

1 piece(s) 11 7/8" TJI® 230 @ 12" OC

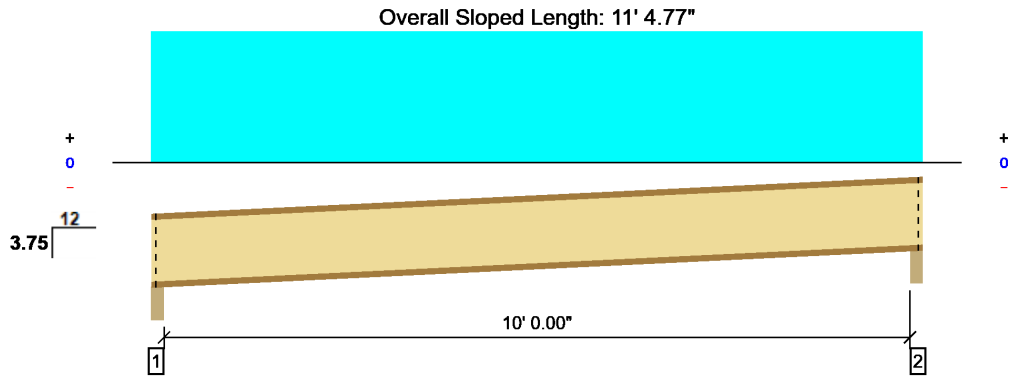

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.; Drawing is Conceptual

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	1106 @ 2.50"	1708 (3.50")	Passed (65%)	1.15	1.0 D + 1.0 S (All Spans)
Shear (lbs)	1045 @ 10' 3.50"	1903	Passed (55%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	2700 @ 5' 3.50"	4847	Passed (56%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.187 @ 5' 3.50"	0.533	Passed (L/685)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.207 @ 5' 3.50"	0.710	Passed (L/616)	--	1.0 D + 1.0 S (All Spans)

System : Roof
 Member Type : Joist
 Building Use : Residential
 Building Code : IBC 2015
 Design Methodology : ASD
 Member Pitch : 3.75/12

- Deflection criteria: LL (L/240) and TL (L/180).
- Top Edge Bracing (Lu): Top compression edge must be braced at 5' 2.00" o/c unless detailed otherwise.
- Bottom Edge Bracing (Lu): Bottom compression edge must be braced at 11' 1.00" o/c unless detailed otherwise.

Supports	Bearing			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Total	
1 - Beveled Plate - DF	3.50"	3.50"	1.75"	111	995	1106	Blocking
2 - Beveled Plate - DF	3.50"	3.50"	1.75"	111	995	1106	Blocking

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Loads	Location (Side)	Spacing	Dead (0.90)	Snow (1.15)	Comments
1 - Uniform (PSF)	0 to 10' 7.00"	12"	20.0	188.0	Roof Snow

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC ES under technical reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by Forte Software Operator



Forte Software Operator	Job Notes
Ensign Engineering Ensign Engineering (801) 255-0529 ensign@ensignutah.com	

Overall Length: 12' 4.00"

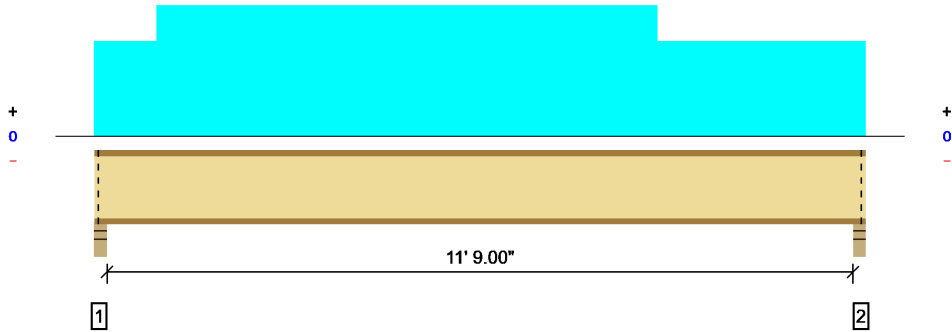

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.; Drawing is Conceptual

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	1606 @ 2.50"	1708 (3.50")	Passed (94%)	1.15	1.0 D + 0.75 L + 0.75 S (All Spans)
Shear (lbs)	1547 @ 3.50"	1903	Passed (81%)	1.15	1.0 D + 0.75 L + 0.75 S (All Spans)
Moment (Ft-lbs)	4728 @ 6' 0.76"	4847	Passed (98%)	1.15	1.0 D + 0.75 L + 0.75 S (All Spans)
Live Load Defl. (in)	0.398 @ 6' 1.66"	0.397	Passed (L/359)	--	1.0 D + 0.75 L + 0.75 S (All Spans)
Total Load Defl. (in)	0.431 @ 6' 1.69"	0.596	Passed (L/332)	--	1.0 D + 0.75 L + 0.75 S (All Spans)

System : Roof
 Member Type : Joist
 Building Use : Residential
 Building Code : IBC 2015
 Design Methodology : ASD
 Member Pitch: 0/12

- Deflection criteria: LL (L/360) and TL (L/240).
- Top Edge Bracing (Lu): Top compression edge must be braced at 3' 9.00" o/c unless detailed otherwise.
- Bottom Edge Bracing (Lu): Bottom compression edge must be braced at 12' 4.00" o/c unless detailed otherwise.

Supports	Bearing			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Snow	Total	
1 - Stud wall - DF	3.50"	3.50"	3.13"	123	725	1252	2100	Blocking
2 - Stud wall - DF	3.50"	3.50"	2.71"	123	568	1252	1943	Blocking

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Loads	Location (Side)	Spacing	Dead (0.90)	Floor Live (1.00)	Snow (1.15)	Comments
1 - Uniform (PSF)	0 to 12' 4.00"	12"	20.0	40.0	203.0	Roof Snow
2 - Uniform (PSF)	1' 0.00" to 9' 0.00"	12"	-	100.0	-	Hot tub

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC ESR under technical reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by Forte Software Operator



Forte Software Operator	Job Notes
Ensign Engineering Ensign Engineering (801) 255-0529 ensign@ensignutah.com	


6/12/2018 11:05:59 AM
 Forte v5.3, Design Engine: V7.0.0.5
 Forte.4te

Beam Id: Lot # 70 - NB


Date 18-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

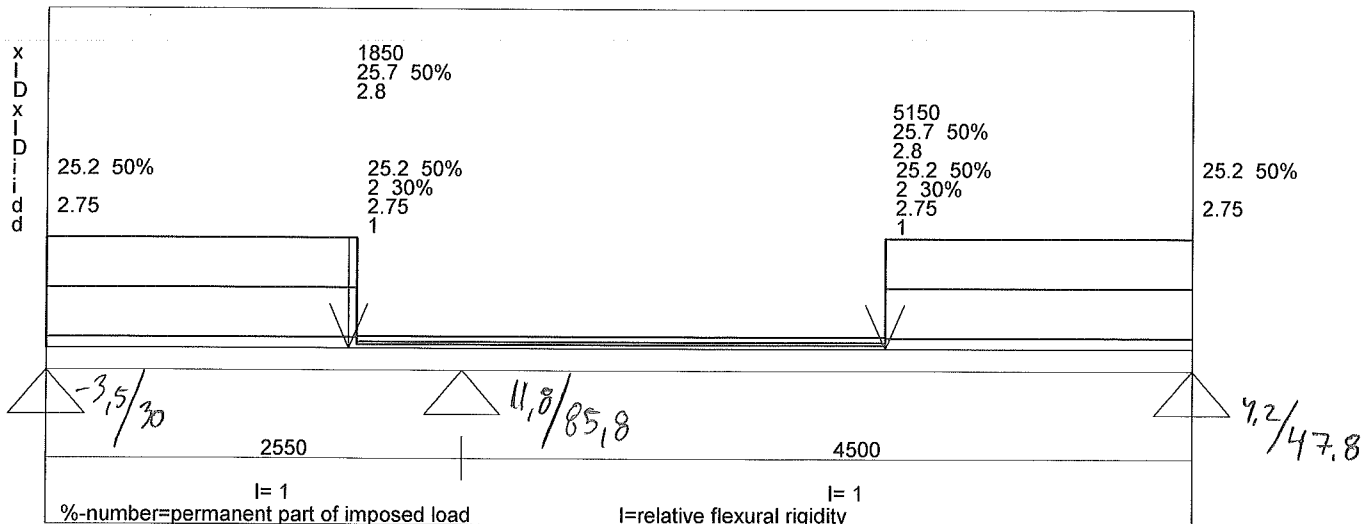

Licensed to: FINNLAMELLI OY

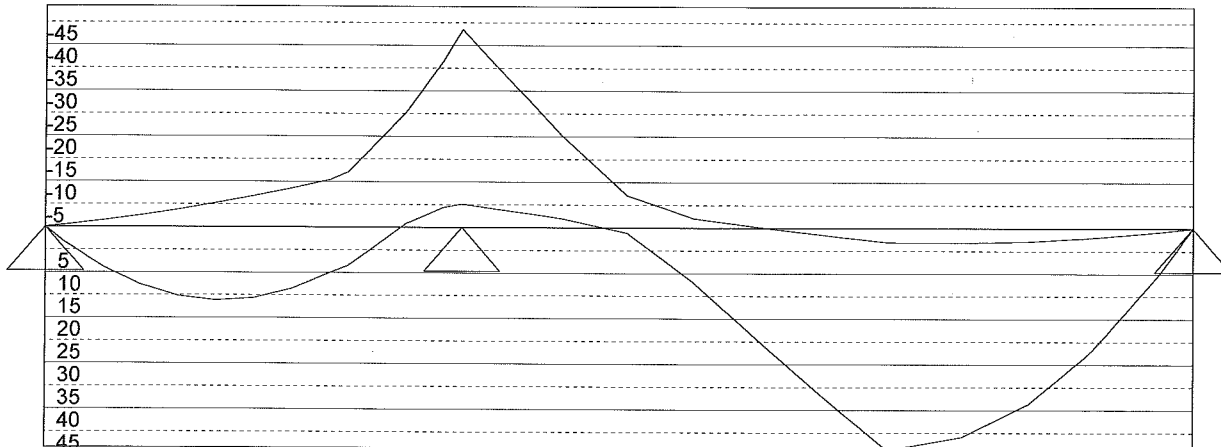

Licensed to: FINNLAMELLI OY

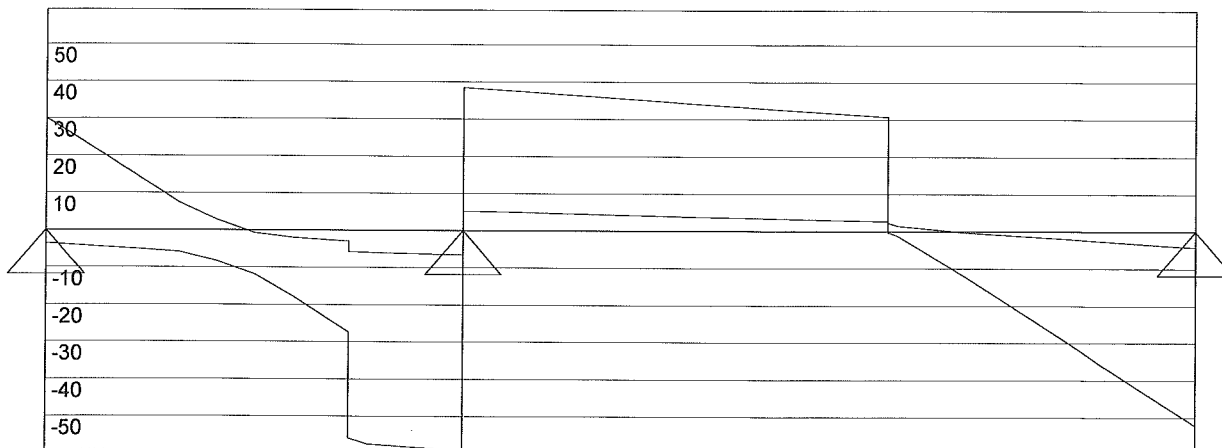

Load factor of dead load= 1 Load factor of imposed load= 1

Load width 1 (m) (by which the loads has been multiplied during calculation)

Max/Min reactions of beam [kN]

30,043 97,664 52,083

-3,577 11,805 4,227

KER 133 x 406 B 2 Cf=0,97 Design method: Allowable stress design

Increasing factor of the allowable stress 1,03

Factored Moment/Moment capacity [kNm] 48,519 65,401 74 %

Factored shear force/shear capacity [kN] 59,212 62,936 94 %

(3) LVL 1 3/4 x 16" ✓

Deflection due to unfactored load (Deflection limit L/360)


1,2 mm (16 %) 9,1 mm (73 %)

Beam Id: Lot # 70 - MB 2


Date 18-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

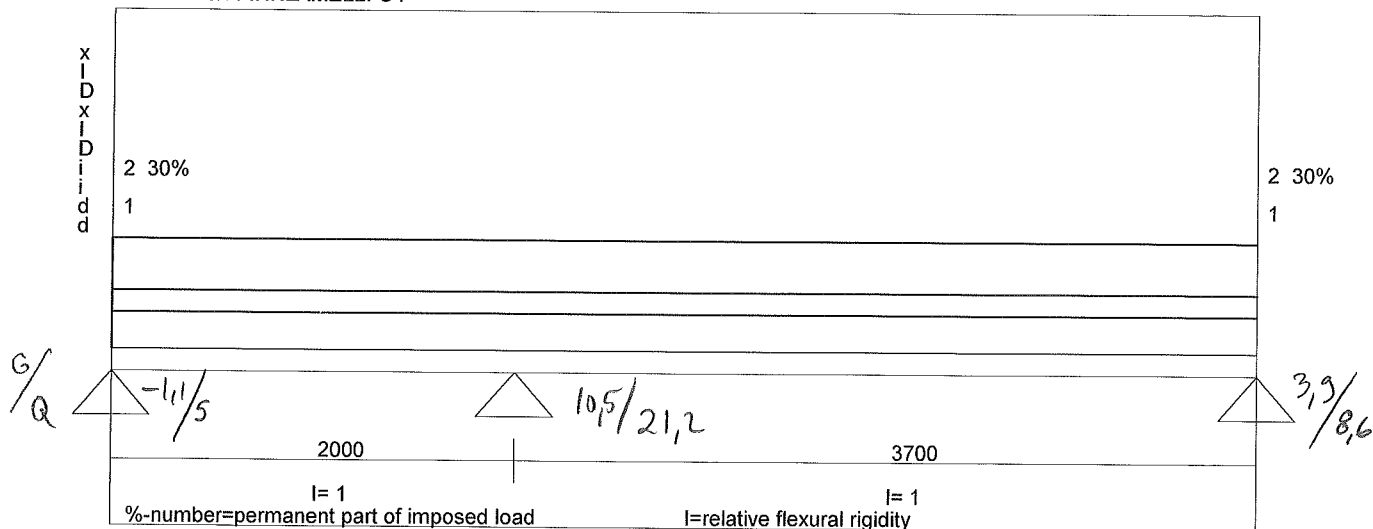

Licensed to: FINNLAMELLI OY

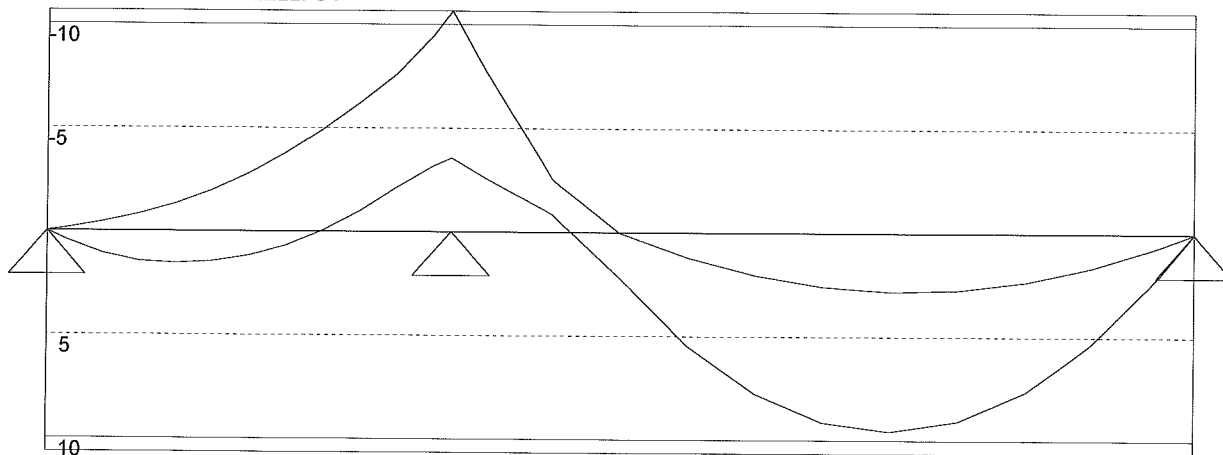

Licensed to: FINNLAMELLI OY

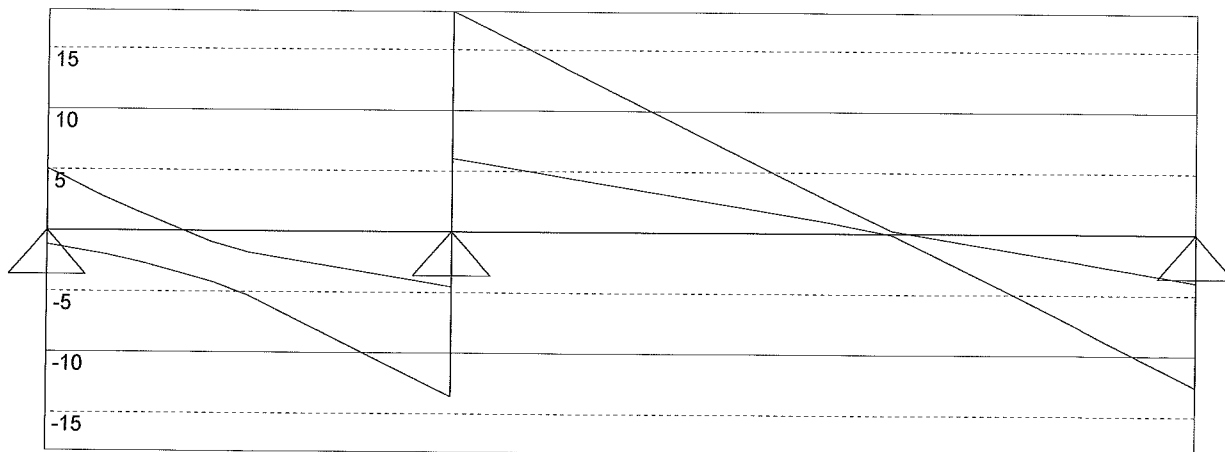

Load factor of dead load= 1 Load factor of imposed load= 1

Load width 2.75 (m) (by which the loads has been multiplied during calculation)

Max/Min reactions of beam [kN]

5,069 31,713 12,567
-1,173 10,571 3,945

T24 164 x 260 B 2 Cf=1,00 Design method: Allowable stress design
Increasing factor of the allowable stress 1,09

Factored Moment/Moment capacity [kNm] 10,650 19,351 55 %

Factored shear force/shear capacity [kN] 18,138 29,770 61 %

(1) Log ✓

Deflection due to unfactored load (Deflection limit L/360)


0,2 mm (4 %) 7,5 mm (73 %)

Beam Id: Lot # 70 - MB 3


Date 18-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

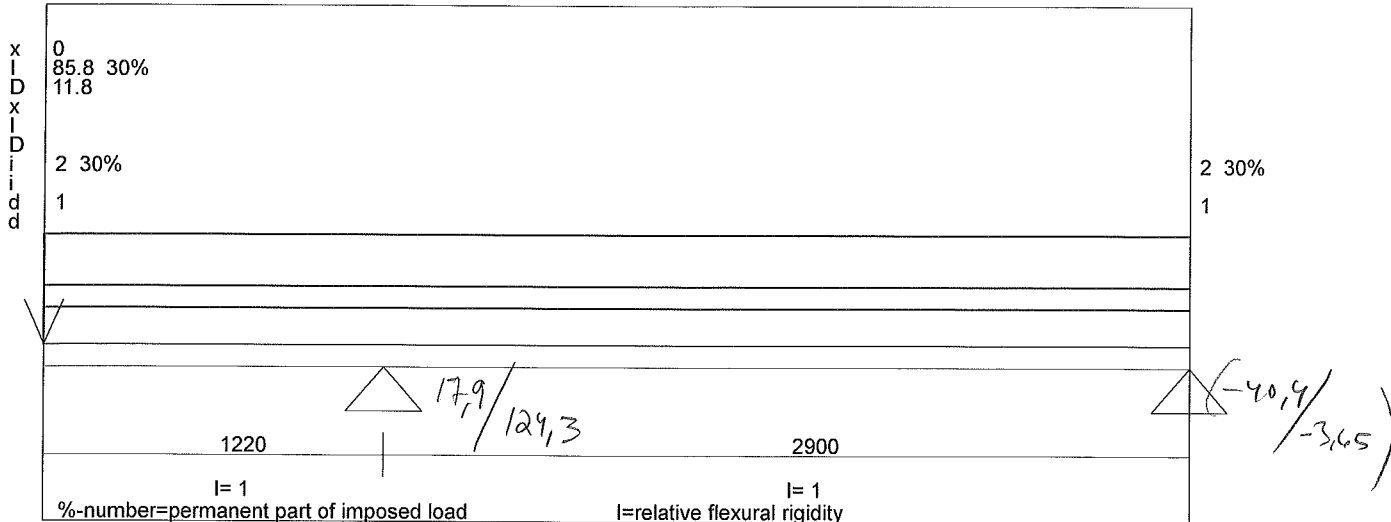

Licensed to: FINNLAMELLI OY

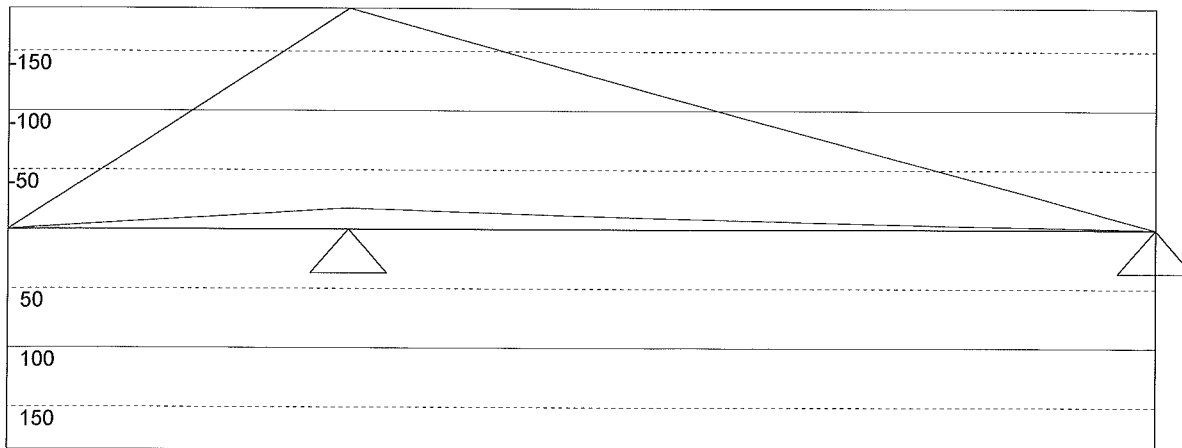

Licensed to: FINNLAMELLI OY

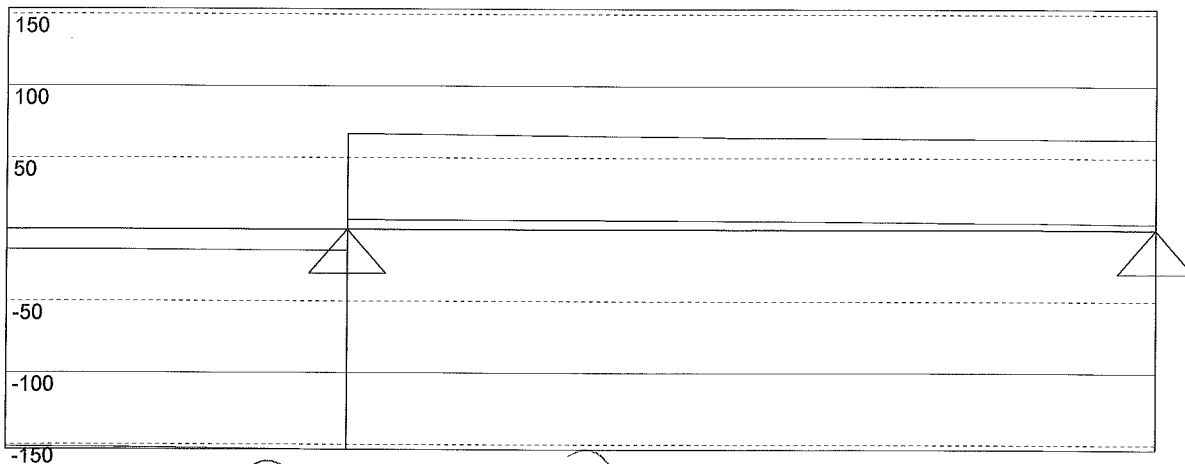

Load factor of dead load = 1.2 Load factor of imposed load = 1.6
 Load width .406 (m) (by which the loads has been multiplied during calculation)
 Max/Min reactions of beam [kN]
 220,373 -4,057
 21,542 -62,893

HEB 260 (Class of section=1/1) G= 93 I(cm⁴)=14919 W(cm³)=1150 f_y=235
 Factored Moment/Moment capacity [kNm] 186,058 301,270 62 %
 Factored shear force/shear capacity [kN] 153,619 341,925 45 %

W 10 x 68 ✓


Deflection due to unfactored load (Deflection limit L/360)/L/180!
 6,4 mm (94 %) -0,2 mm (3 %)
 Attention! Ultimate limit design! Remember the load factors!!

Beam Id: Lot # 70 - MB 4


Date 22-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

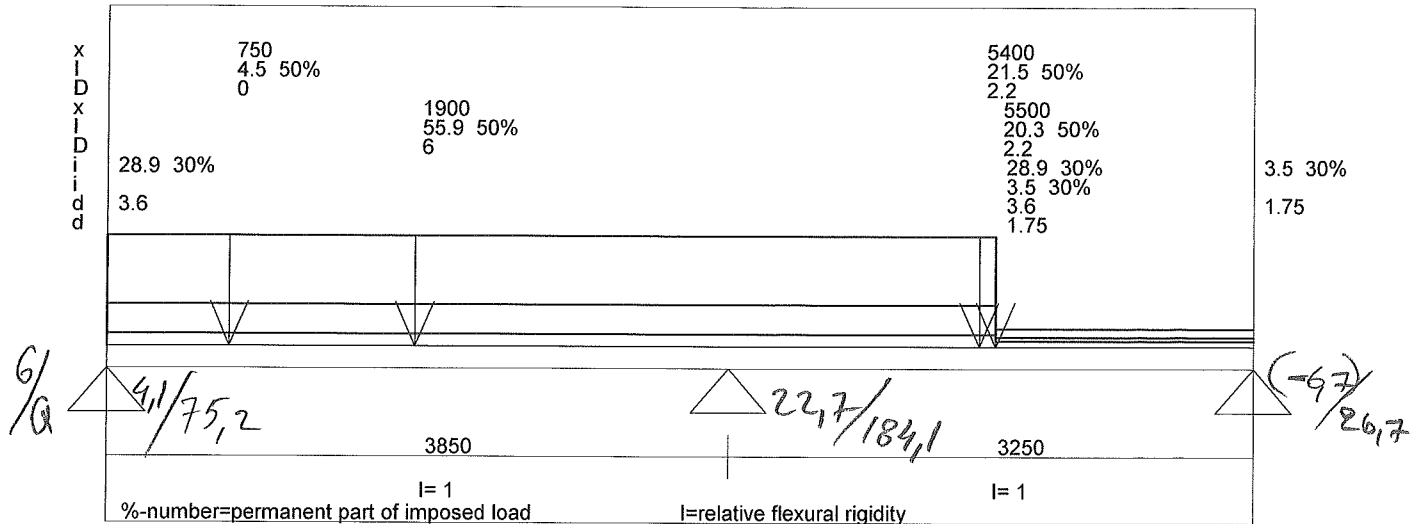

Licensed to: FINNLAMELLI OY

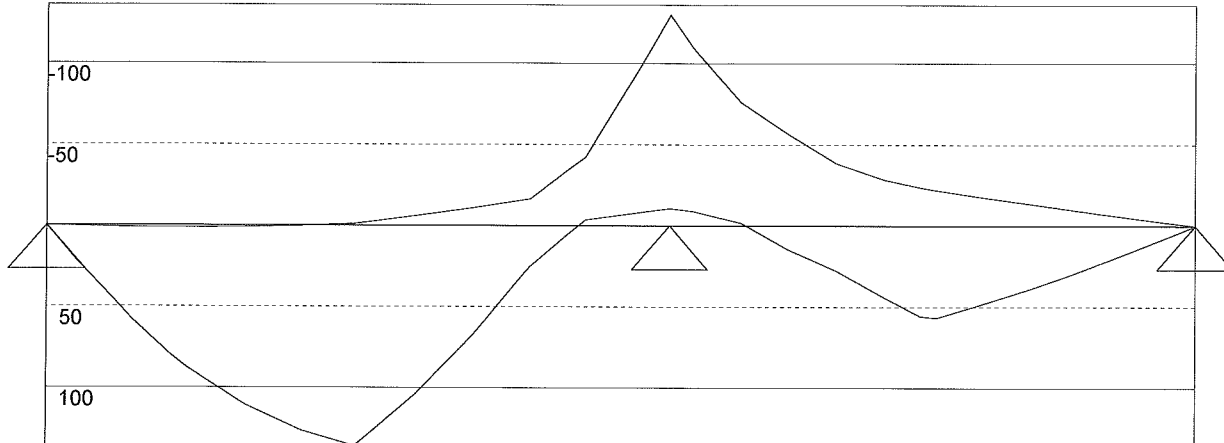

Licensed to: FINNLAMELLI OY

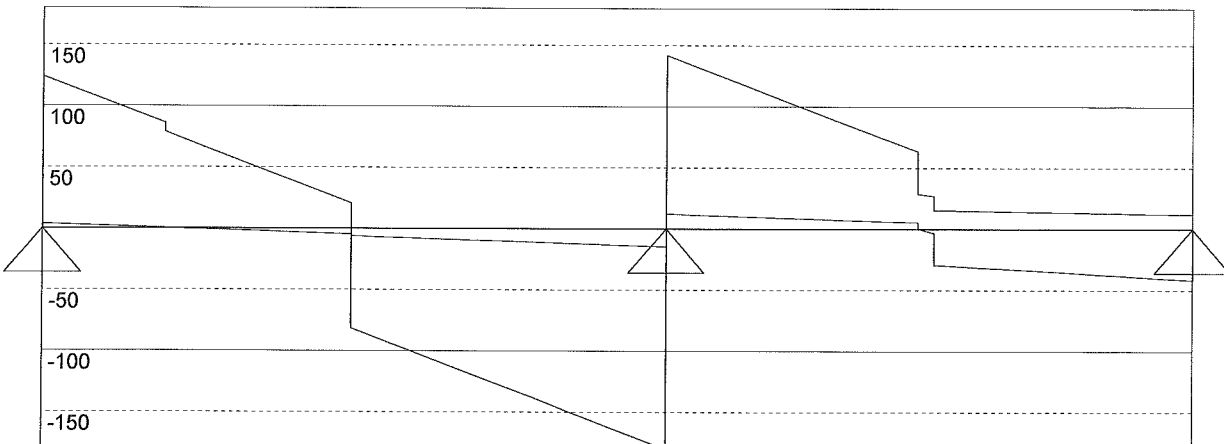

Load factor of dead load = 1.2 Load factor of imposed load = 1.6
 Load width 1 (m) (by which the loads has been multiplied during calculation)
 Max/Min reactions of beam [kN]
 123,932 322,000 41,617
 3,559 26,755 -11,967

HEB 200 (Class of section=1/1) G= 61,3 I(cm4)=5696 W(cm3)=570 fy=235
 Factored Moment/Moment capacity [kNm] 135,979 150,870 90 %
 Factored shear force/shear capacity [kN] 180,123 234,765 77 %

W 8x40 ✓


Sum infl M+S 0,89 (must be <=1) x= 1900 M=135,98 S=75,93
 Deflection due to unfactored load (Deflection limit L/360)
 8,8 mm (82 %) 2,2 mm (25 %)
 Attention! Ultimate limit design! Remember the load factors!!

Beam Id: Lot # 70 - MB 5


Date 22-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

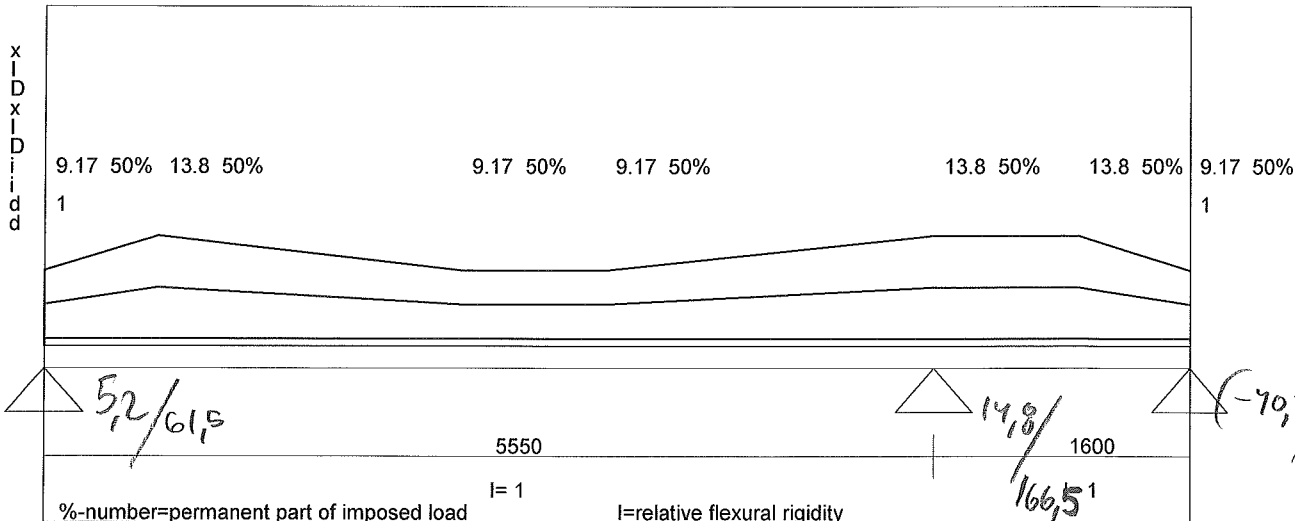

Licensed to: FINNLAMELLI OY

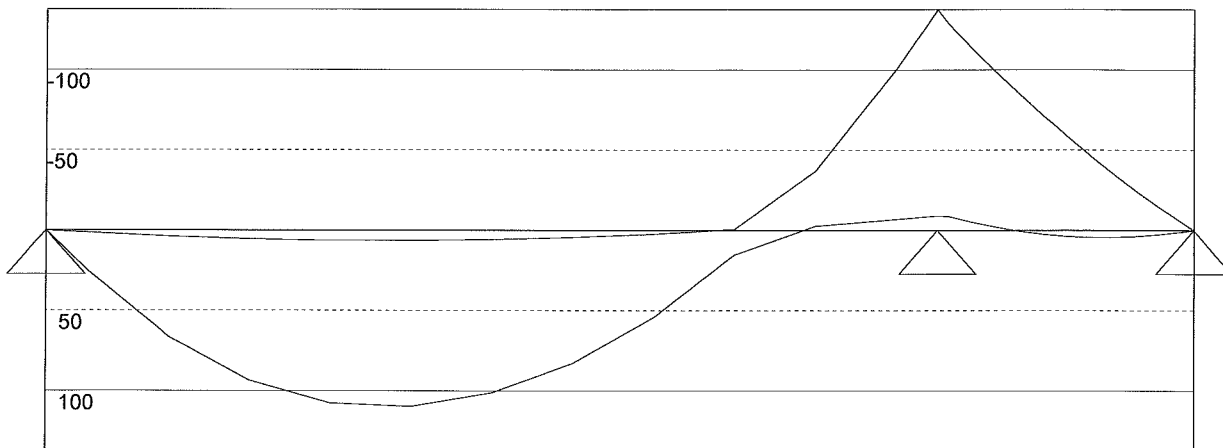

Licensed to: FINNLAMELLI OY

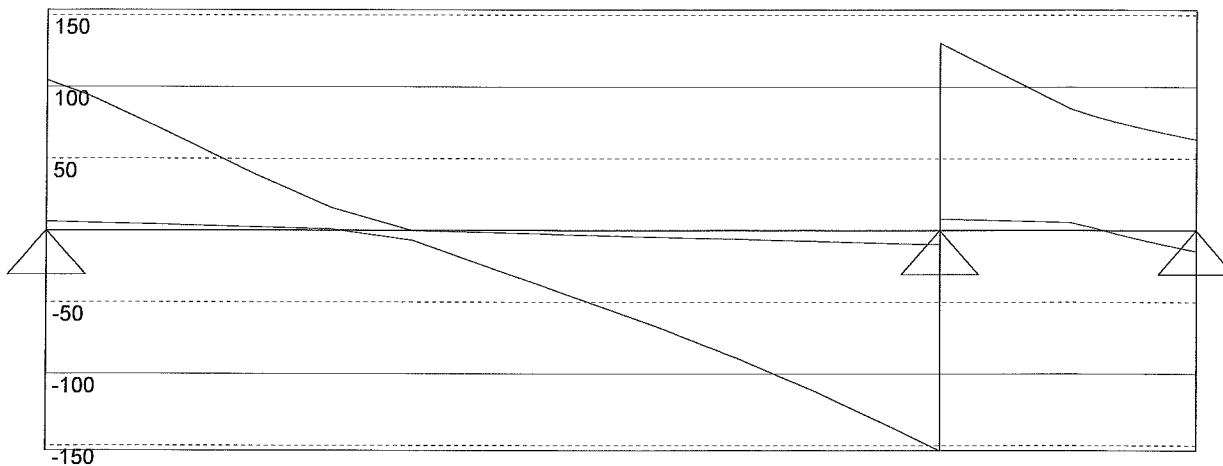

Load factor of dead load= 1.2 Load factor of imposed load= 1.6

Load width 2.45 (m) (by which the loads has been multiplied during calculation)

Max/Min reactions of beam [kN]

104,678 284,183 14,466
6,193 17,781 -63,424

HEA 240 (Class of section=1/1) G= 60,3 I(cm4)=7763 W(cm3)=675 fy=235

Factored Moment/Moment capacity [kNm] 137,367 174,840 79 %

Factored shear force/shear capacity [kN] 153,622 230,535 67 %

$W_0 \times 58$ ✓

Sum infl M+S 0,80 (must be <=1) x= 5549 M=137,3 S=153,62

Deflection due to unfactored load (Deflection limit L/360)

11,3 mm (74 %) 0,0 mm (0 %)


Attention! Ultimate limit design! Remember the load factors!!

Beam Id: Lot # 70 - MB 6


Date 22-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

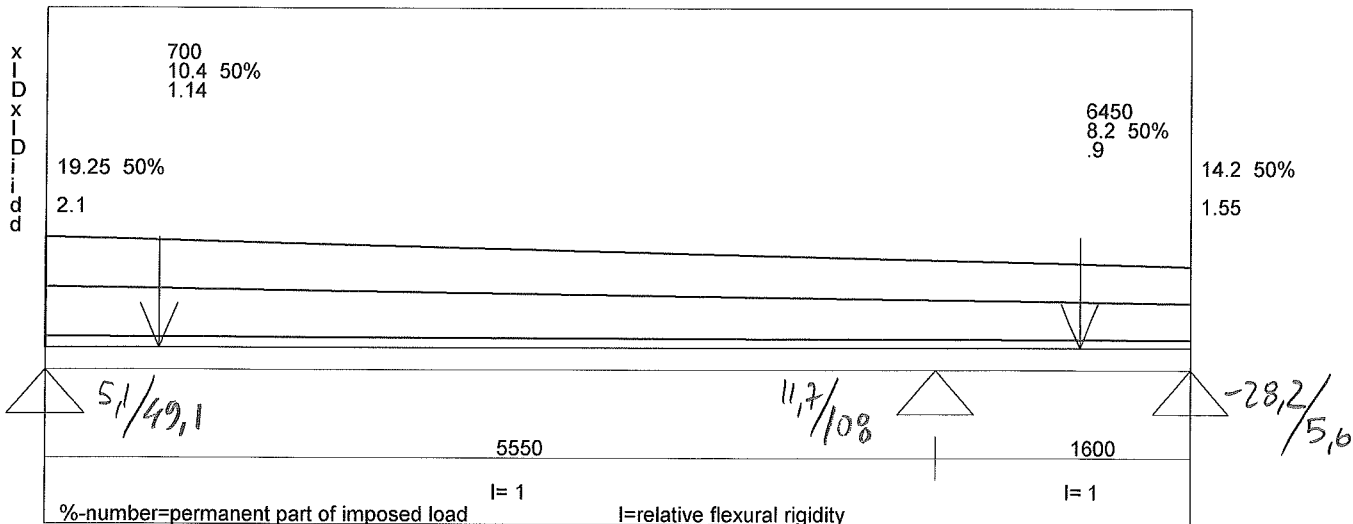

Licensed to: FINNLAMELLI OY

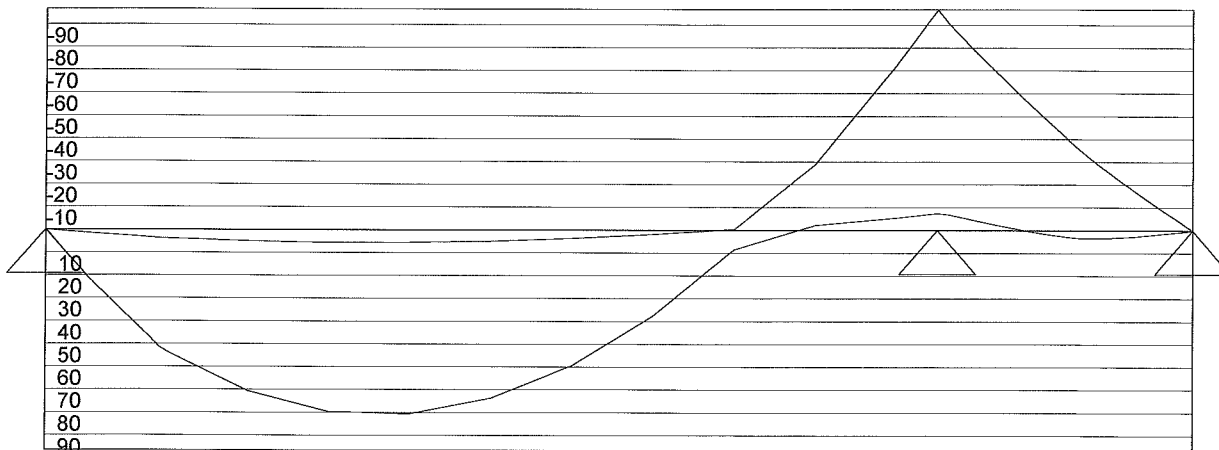

Licensed to: FINNLAMELLI OY

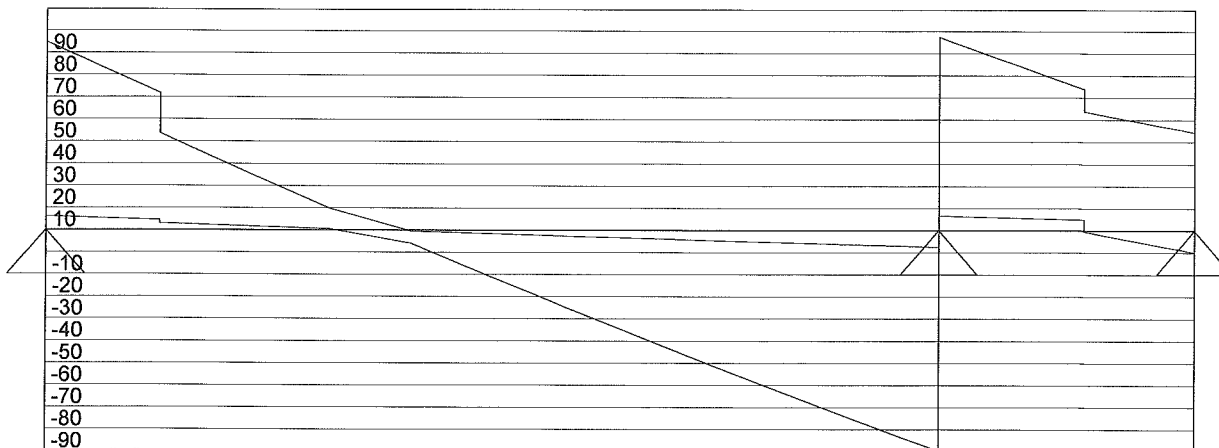

Load factor of dead load= 1.2 Load factor of imposed load= 1.6

Load width 1 (m) (by which the loads has been multiplied during calculation)

Max/Min reactions of beam [kN]

84,707 186,903 9,791

6,166 14,144 -44,463

HEA 220 (Class of section=1/1) G= 50,5 I(cm4)=5410 W(cm3)=515 fy=235

Factored Moment/Moment capacity [kNm] 96,638 133,480 72 %

Factored shear force/shear capacity [kN] 99,582 196,413 51 %

W 8 x 35 ✓

Deflection due to unfactored load (Deflection limit L/360)

11,9 mm (77 %) 0,0 mm (0 %)


Attention! Ultimate limit design! Remember the load factors!!

Beam Id: Lot # 70 - MB ⁷


Date 22-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

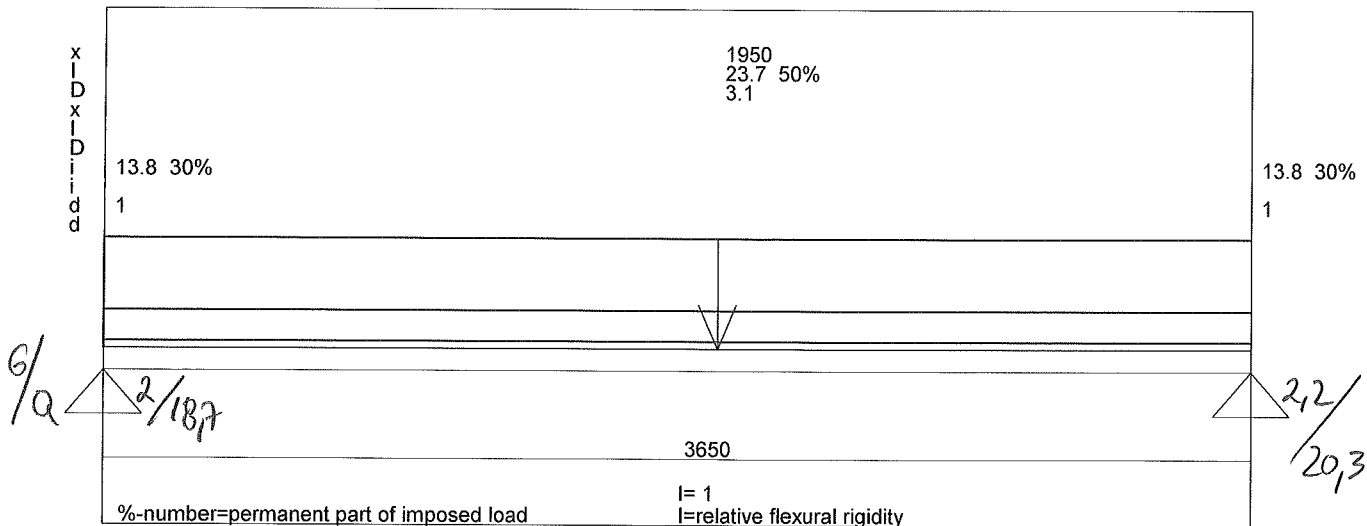

Licensed to: FINNLAMELLI OY

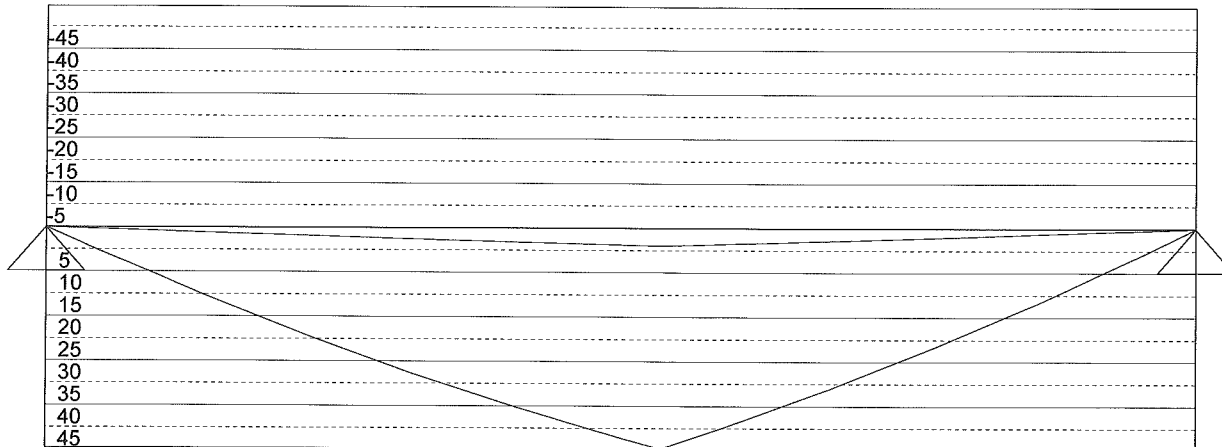

Licensed to: FINNLAMELLI OY

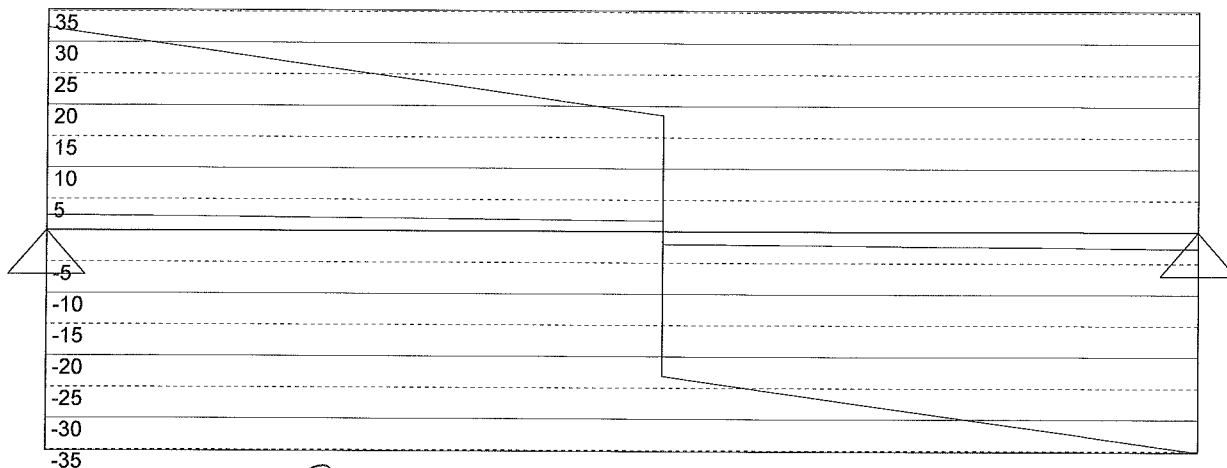

Load factor of dead load=1.2 Load factor of imposed load=1.6
 Load width .305 (m) (by which the loads
 has been multiplied during calculation)
 Max/Min reactions of beam [kN]
 32,349 35,204
 2,400 2,655

HEA 180 (Class of section=1/1) G= 35,5 I(cm4)=2510 W(cm3)=294 fy=235
 Factored Moment/Moment capacity [kNm] 49,586 76,140 65 %
 Factored shear force/shear capacity [kN] 35,201 136,629 26 %

WBx21 ✓


Deflection due to unfactored load (Deflection limit L/360)
 7,1 mm (70 %)
 Attention! Ultimate limit design! Remember the load factors!!

Beam Id: Lot # 70 - MB


Date 22-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

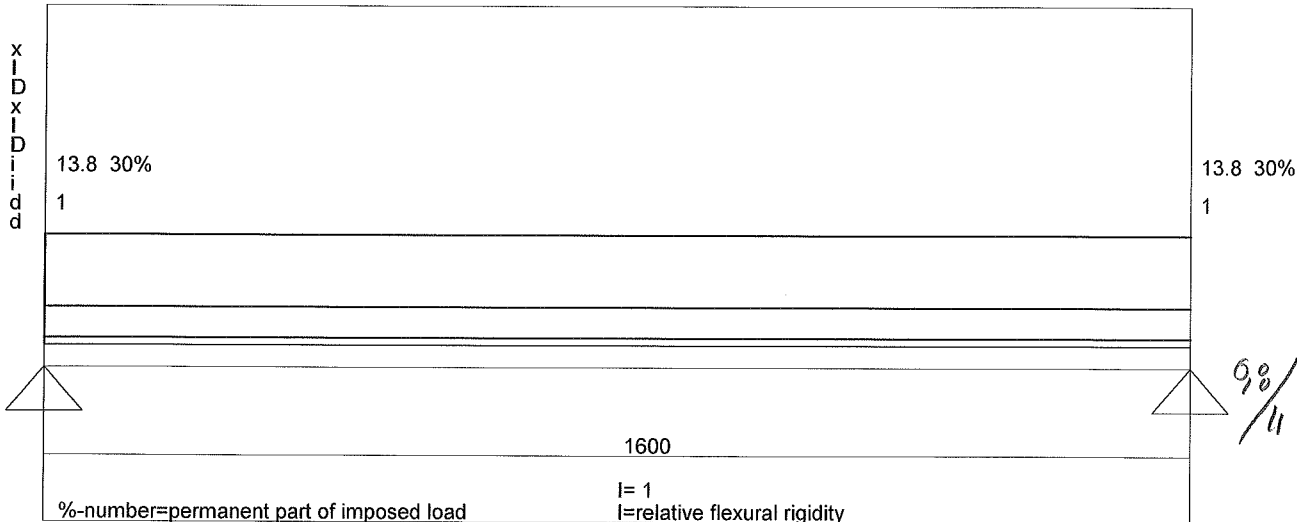

Licensed to: FINNLAMELLI OY

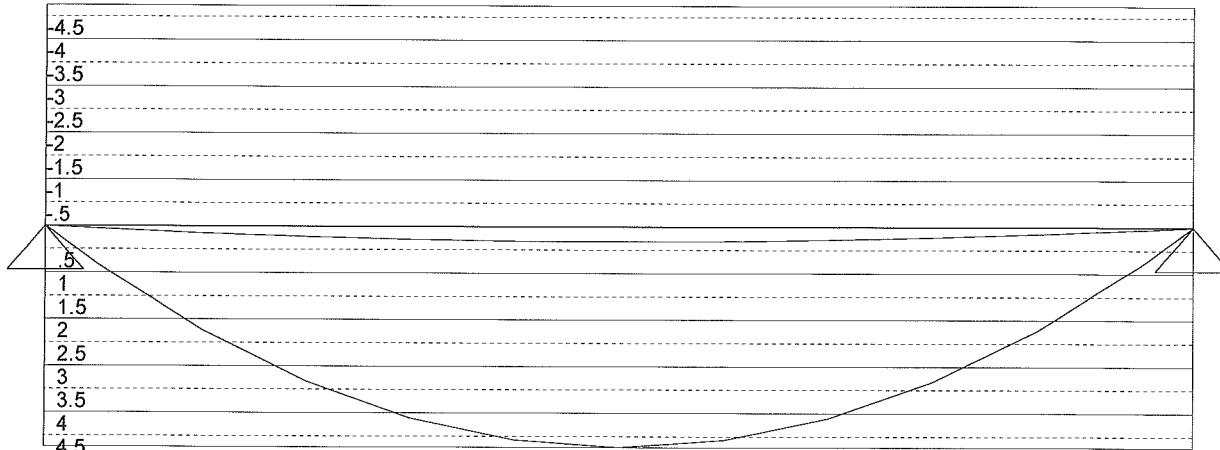

Licensed to: FINNLAMELLI OY

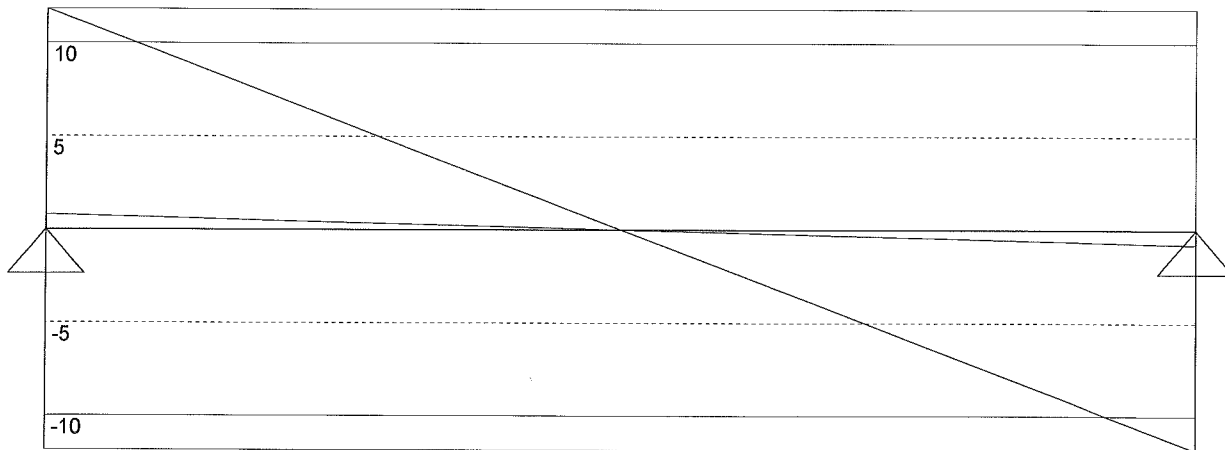

Load factor of dead load= 1 Load factor of imposed load= 1
 Load width 1 (m) (by which the loads has been multiplied during calculation)
 Max/Min reactions of beam [kN]
 11,838 11,840
 0,800 0,800

T24 76 x 300 B 2 Cf=1,00 Design method: Allowable stress design
 Increasing factor of the allowable stress 1,02
 Factored Moment/Moment capacity [kNm] 4,736 11,132 43 %
 Factored shear force/shear capacity [kN] 11,838 14,843 80 %

(2) LVL $1\frac{1}{2} \times 1\frac{7}{8}$ ✓


Deflection due to unfactored load (Deflection limit L/360)
 1,1 mm (26 %)

Beam Id: Lot # 70 - MB **9 (LVL)**


Date 22-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

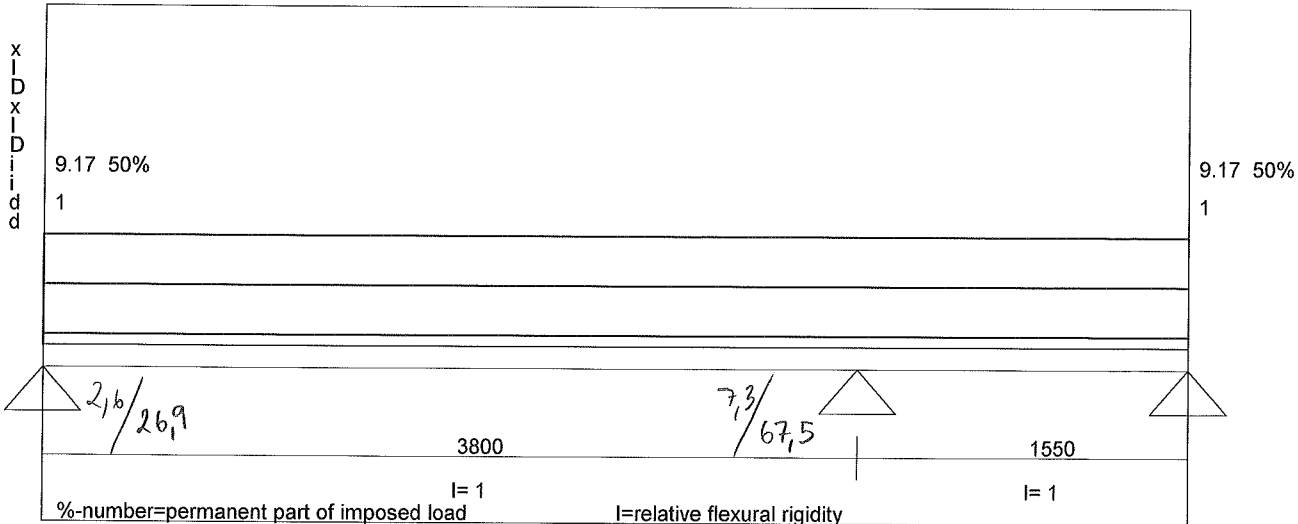

Licensed to: FINNLAMELLI OY

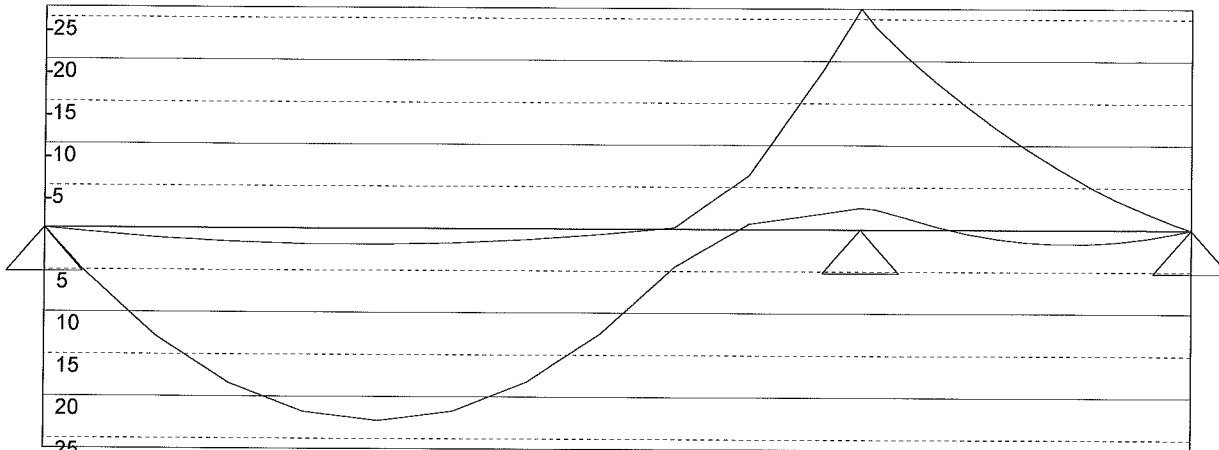

Licensed to: FINNLAMELLI OY

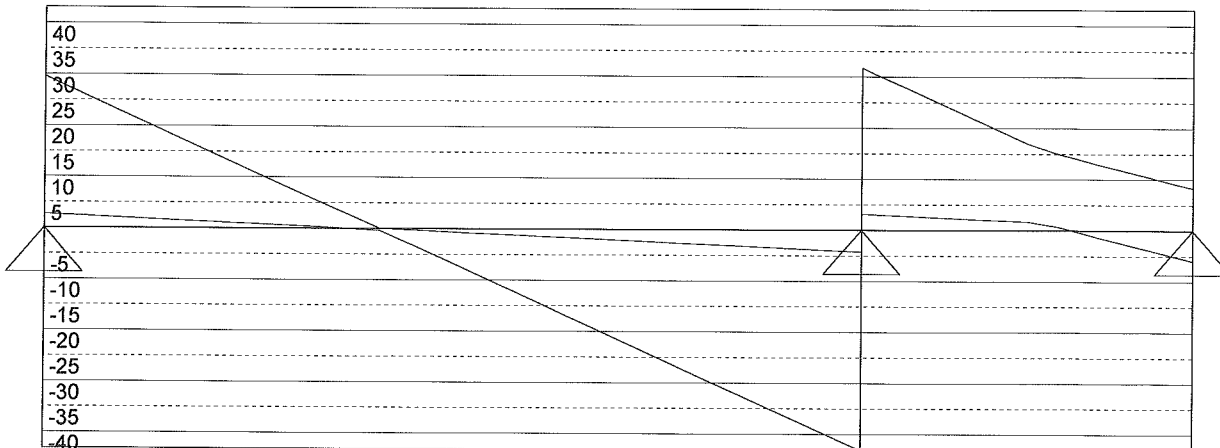

Load factor of dead load= 1 Load factor of imposed load= 1
 Load width 1.875 (m) (by which the loads has been multiplied during calculation)
 Max/Min reactions of beam [kN]
 29,524 74,803 5,969
 2,686 7,355 -8,307

KER 44 x 300 B 2 Cf=1,00 Design method: Allowable stress design
 Increasing factor of the allowable stress 1,03
 Factored Moment/Moment capacity [kNm] 26,202 12,179 215 %
 Factored shear force/shear capacity [kN] 43,120 15,337 281 %

$$\Rightarrow \frac{LVL}{12,1} + \frac{Lob}{18,1} = 30,2 \quad OK$$

$$\Rightarrow 15,3 + 27,9 = 43,2 \quad OK$$




Deflection due to unfactored load (Deflection limit L/240)
 28,1 mm (178 %) 0,3 mm (4 %)

Beam Id: Lot # 70 - MB 9 (L06)


Date 22-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

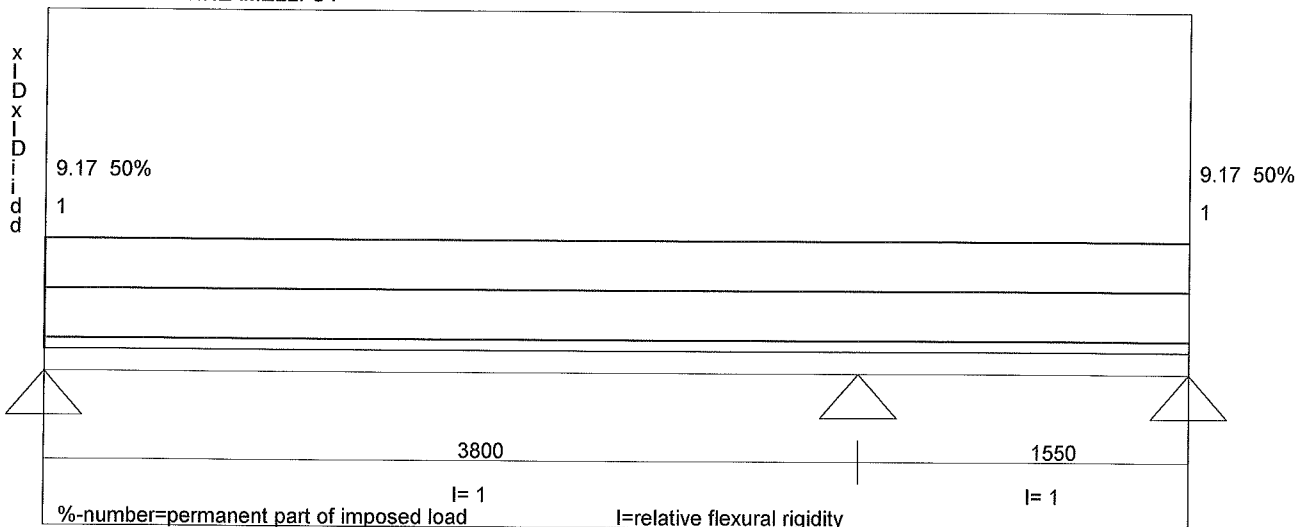

Licensed to: FINNLAMELLI OY

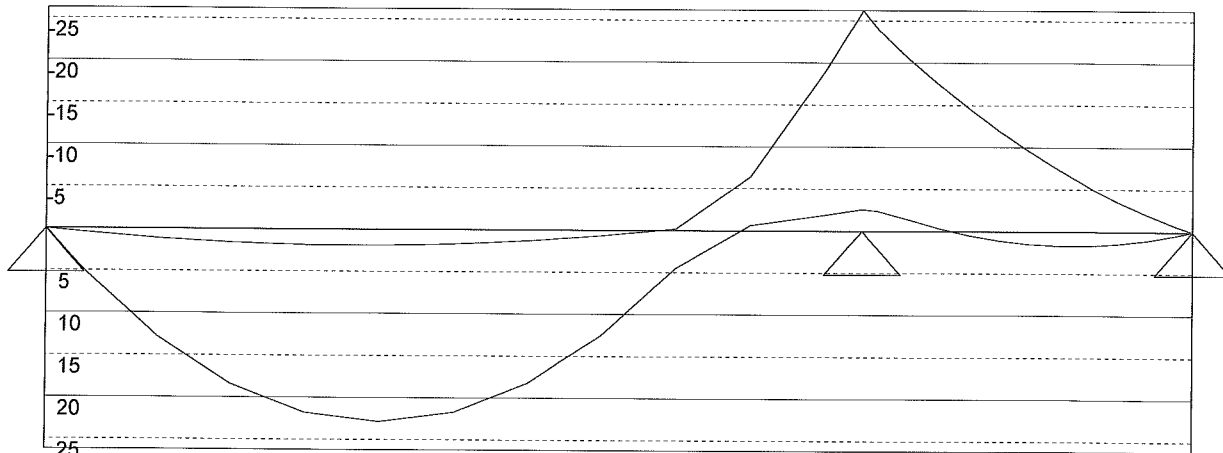

Licensed to: FINNLAMELLI OY

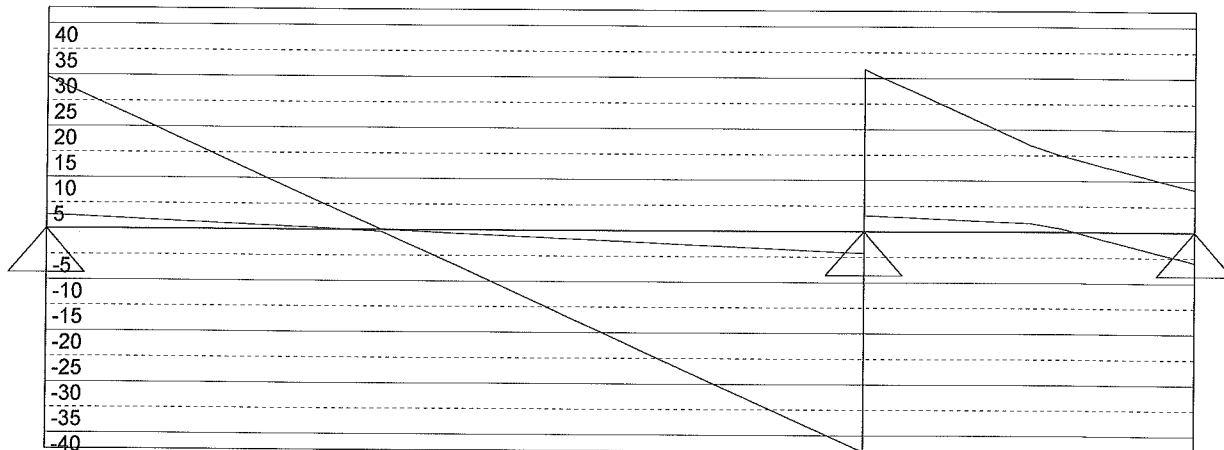

Load factor of dead load= 1 Load factor of imposed load= 1

Load width 1.875 (m) (by which the loads has been multiplied during calculation)

Max/Min reactions of beam [kN]

29,524 74,803 5,969
2,686 7,355 -8,307

T24 164 x 260 B 2 Cf=1,00 Design method: Allowable stress design

Increasing factor of the allowable stress 1,03

Factored Moment/Moment capacity [kNm] 26,202 18,185 144 %

Factored shear force/shear capacity [kN] 43,120 27,977 154 %

(1) L06 +
(1) LVL 1 3/4 x 1 7/8 ✓

Deflection due to unfactored load (Deflection limit L/240)

18,6 mm (117 %) 0,2 mm (3 %)


m

Beam Id: Lot # 70 - MB //


Date 23-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

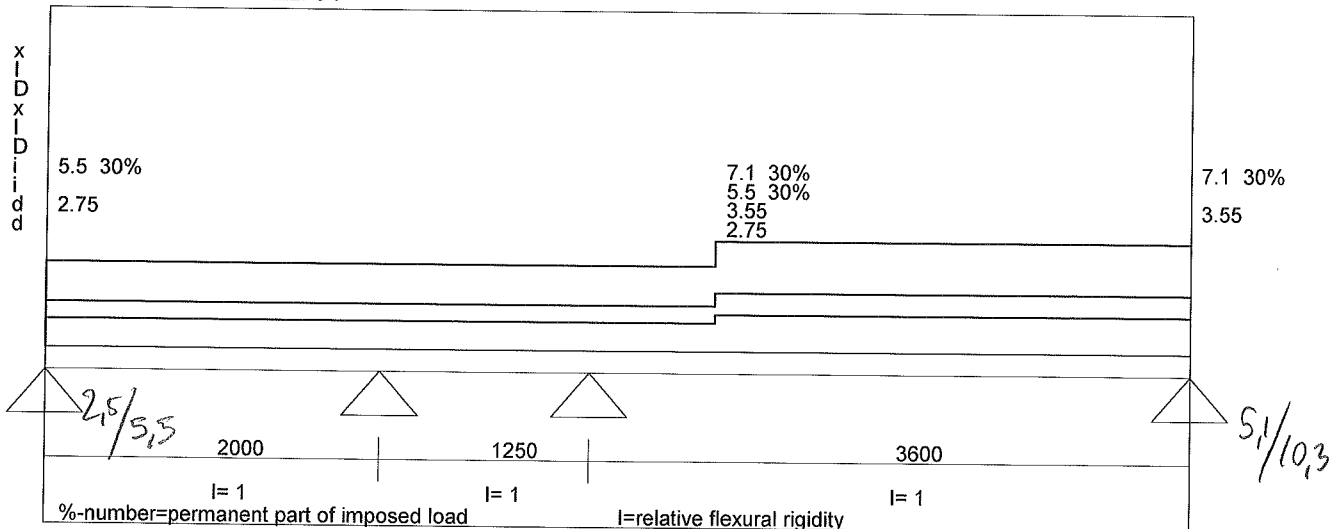

Licensed to: FINNLAMELLI OY

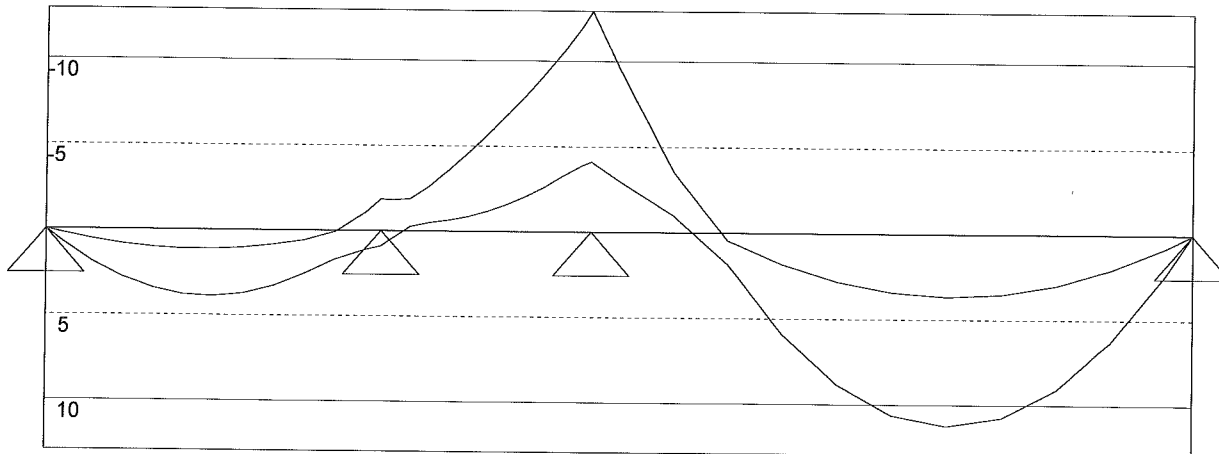

Licensed to: FINNLAMELLI OY

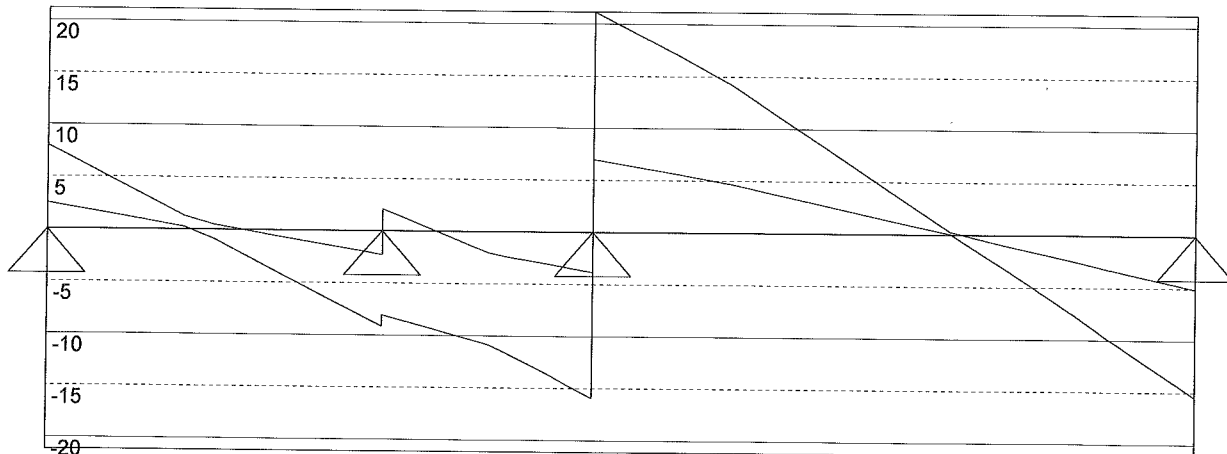

Load factor of dead load= 1 Load factor of imposed load= 1

Load width 1 (m) (by which the loads has been multiplied during calculation)

Max/Min reactions of beam [kN]

8,022 10,366 37,053 15,479
2,501 -4,886 10,825 5,100

KER 76 x 300 B 2 Cf=1,00 Design method: Allowable stress design
Increasing factor of the allowable stress 1,09

Factored Moment/Moment capacity [kNm] 12,930 22,385 58 %

Factored shear force/shear capacity [kN] 21,147 28,189 75 %

(2) LVL $1 \frac{1}{2} \times 11 \frac{7}{8}$

SEE FORTE CALCULATION WITH SEISMIC HOLD DOWN FORCE

Deflection due to unfactored load (Deflection limit L/360)


0,9 mm (16 %) -0,2 mm (4 %) 7,1 mm (71 %)

Beam Id: Lot # 70 - MB 12


Date 23-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

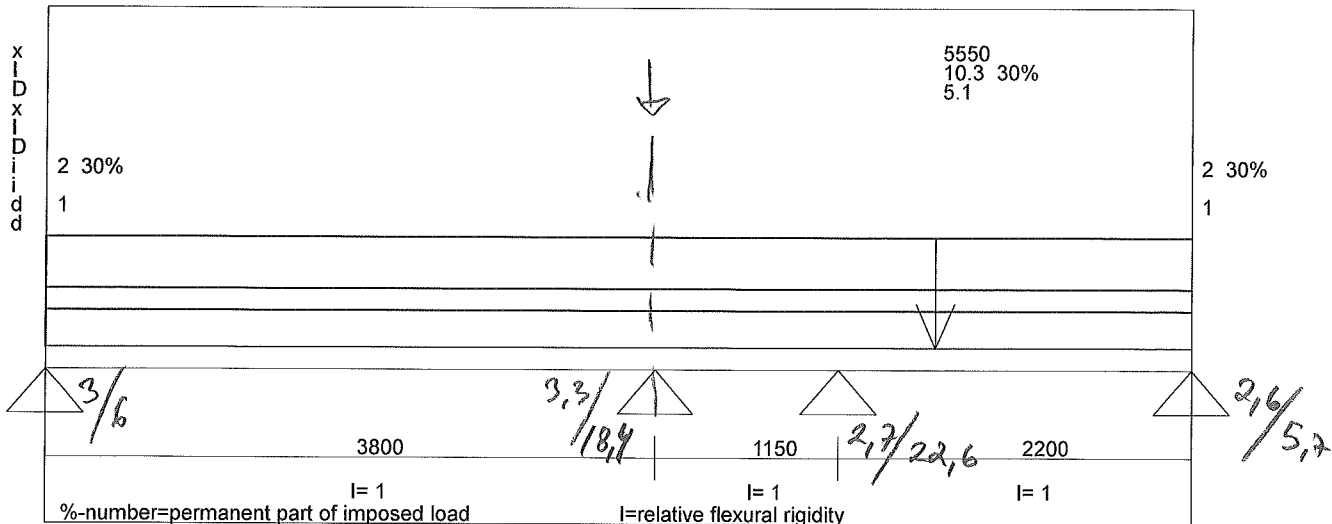

Licensed to: FINNLAMELLI OY

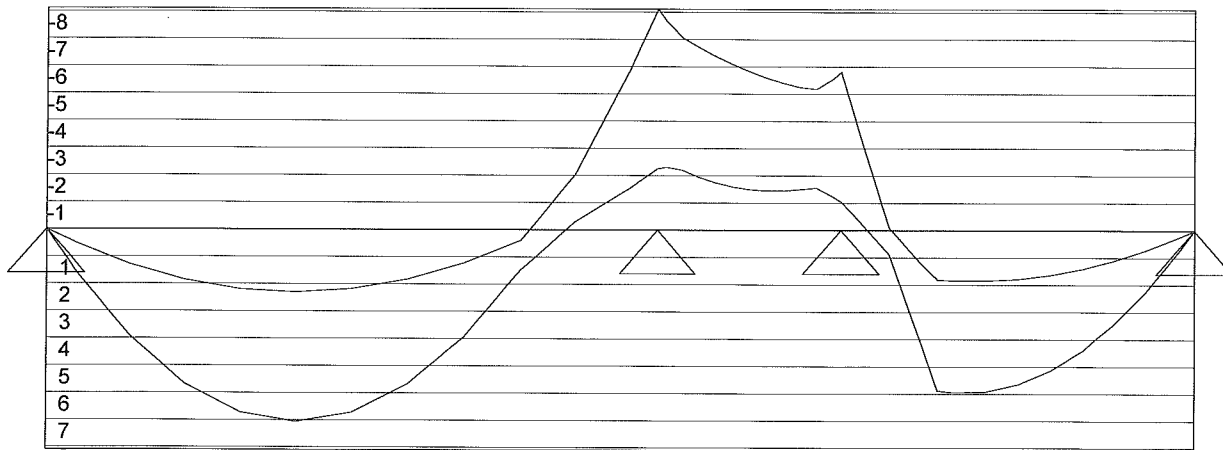

Licensed to: FINNLAMELLI OY

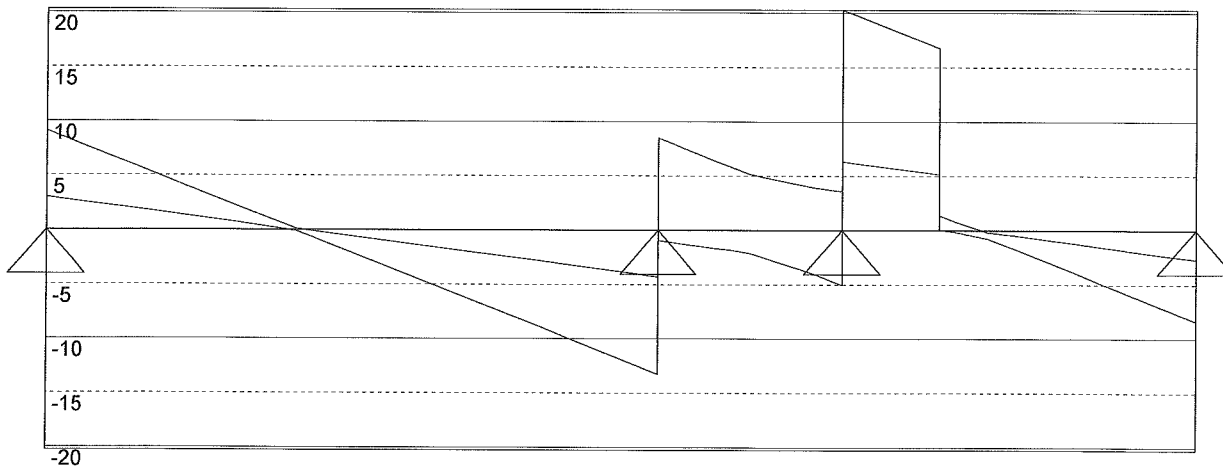

Load factor of dead load= 1 Load factor of imposed load= 1
 Load width 1.95 (m) (by which the loads has been multiplied during calculation)
 Max/Min reactions of beam [kN]
 9,093 21,730 25,306 8,360
 3,000 3,339 2,735 2,697

KER 76 x 300 B 2 Cf=1,00 Design method: Allowable stress design
 Increasing factor of the allowable stress 1,09
 Factored Moment/Moment capacity [kNm] 8,102 22,377 36 %
 Factored shear force/shear capacity [kN] 20,274 28,178 72 %

(2) LVL 1 1/2 x 11 7/8

Deflection due to unfactored load (Deflection limit L/360)
 5,1 mm (48 %) -0,2 mm (5 %) 1,6 mm (26 %)

SEE FORTE CALCULATION WITH SEISMIC HOLD DOWN FORCE


Beam Id: Lot # 70 - MB

13


Date 23-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

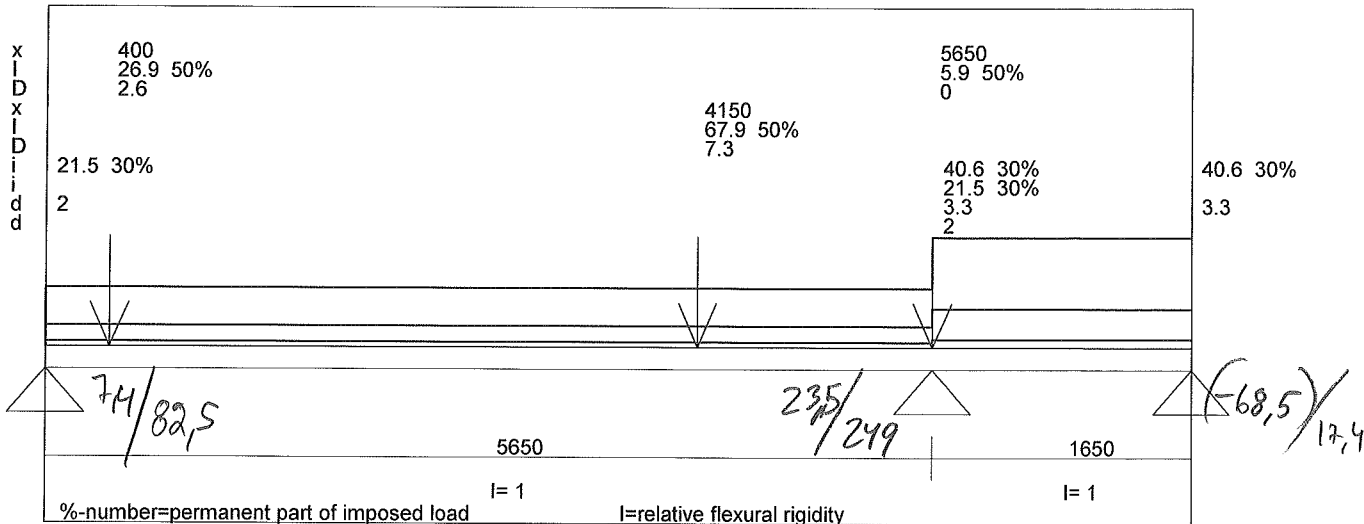

Licensed to: FINNLAMELLI OY

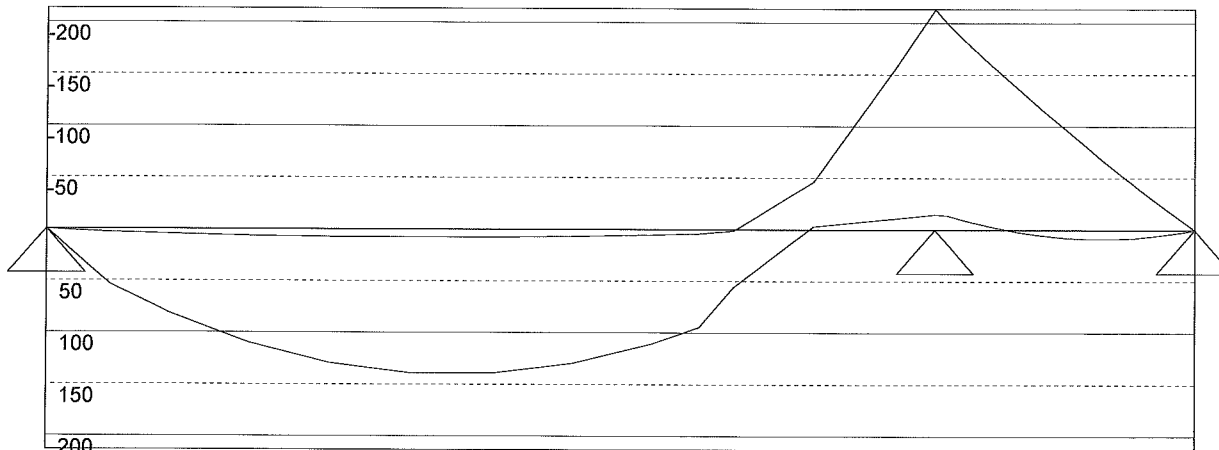

Licensed to: FINNLAMELLI OY

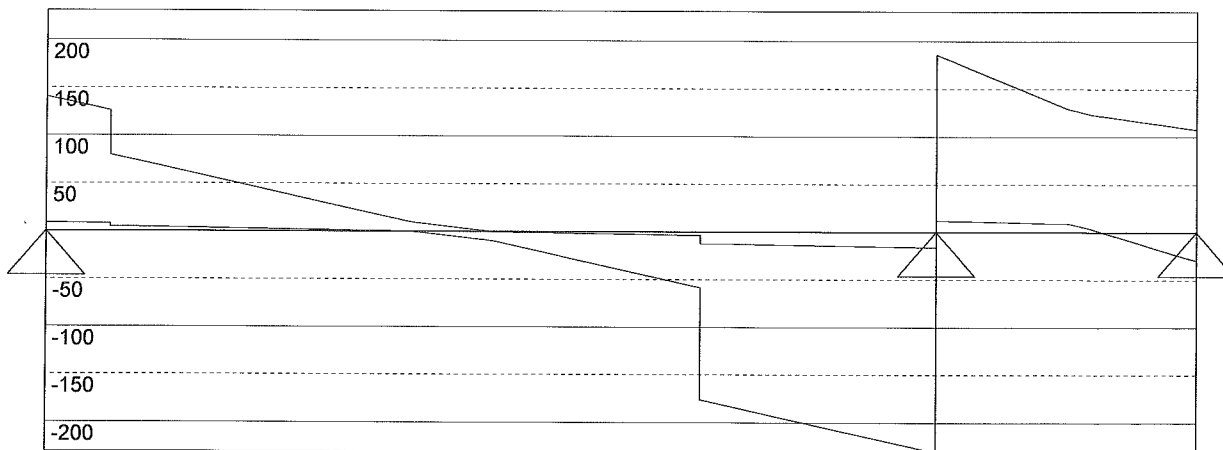

Load factor of dead load = 1.2 Load factor of imposed load = 1.6

Load width 1 (m) (by which the loads has been multiplied during calculation)

Max/Min reactions of beam [kN]

140,863 426,732 29,743

8,779 28,212 -107,791

HEB 240 (Class of section=1/1) G= 83,2 I(cm4)=11259 W(cm3)=938 fy=235

Factored Moment/Moment capacity [kNm] 213,255 247,690 86 %

Factored shear force/shear capacity [kN] 231,180 314,430 74 %

W8x67 ✓

Sum infl M+S 0,88 (must be <=1) x= 5649 M=213,15 S=231,18

Deflection due to unfactored load (Deflection limit L/360)

11,5 mm (73 %) 0,0 mm (1 %)


Attention! Ultimate limit design! Remember the load factors!!

Beam Id: Lot # 70 - MB /4


Date 23-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

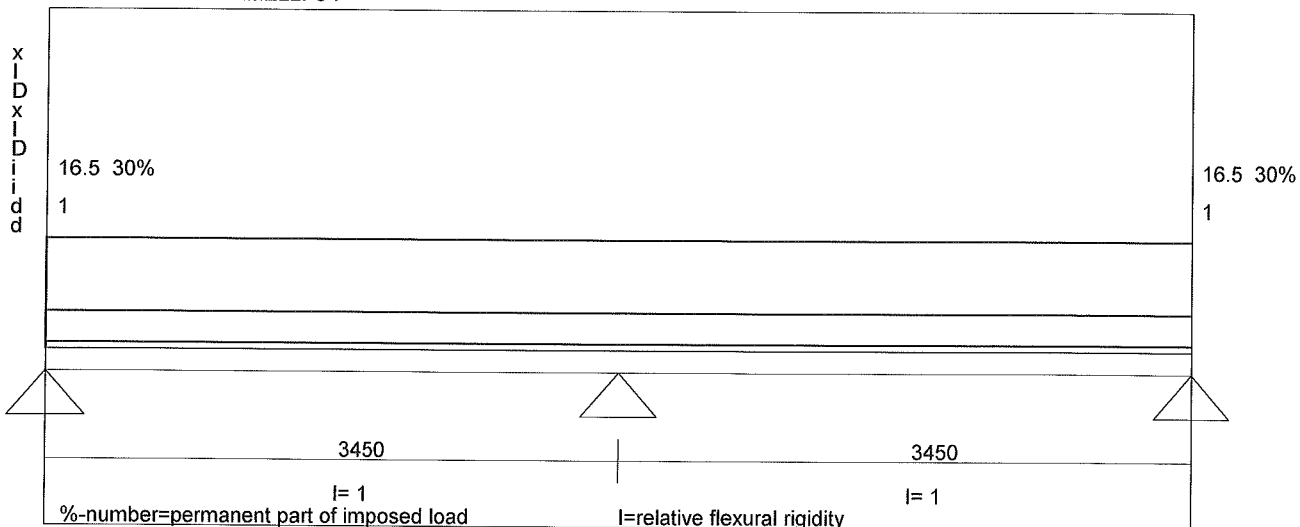

Licensed to: FINNLAMELLI OY

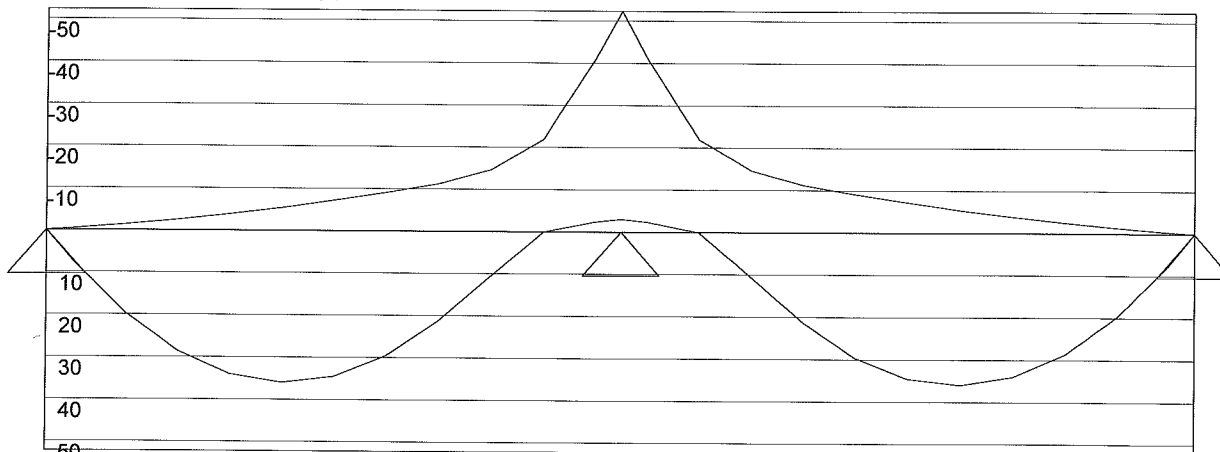

Licensed to: FINNLAMELLI OY

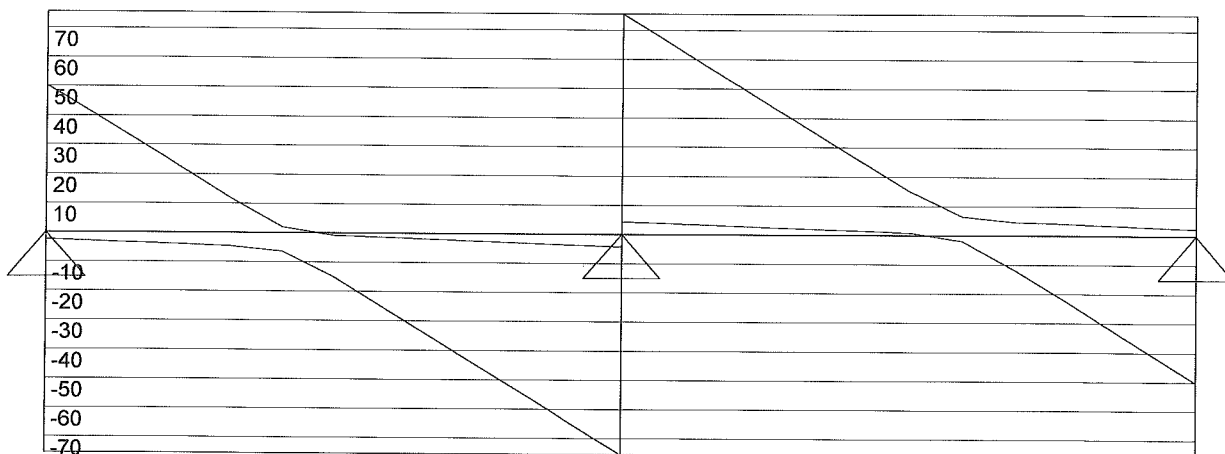

Load factor of dead load= 1 Load factor of imposed load= 1

Load width 2 (m) (by which the loads has been multiplied during calculation)

Max/Min reactions of beam [kN]

50,211 151,030 50,223

-2,417 8,630 -2,416

L40 255 x 390 B 2 Cf=0,97 Design method: Allowable stress design

Increasing factor of the allowable stress 1,01

Factored Moment/Moment capacity [kNm] 52,248 94,906 55 %

Factored shear force/shear capacity [kN] 75,515 77,350 98 %

$$GL \frac{255}{(90 + 165)} \times 390$$

$$(115) + 165 = 280$$

$$GL \left(4\frac{1}{2} + 6\frac{1}{2} \right) \times 15\frac{3}{8}$$



Deflection due to unfactored load (Deflection limit L/360)


3,6 mm (38 %) 3,6 mm (38 %)

Beam Id: Lot # 70 - MB **15**


Date 23-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

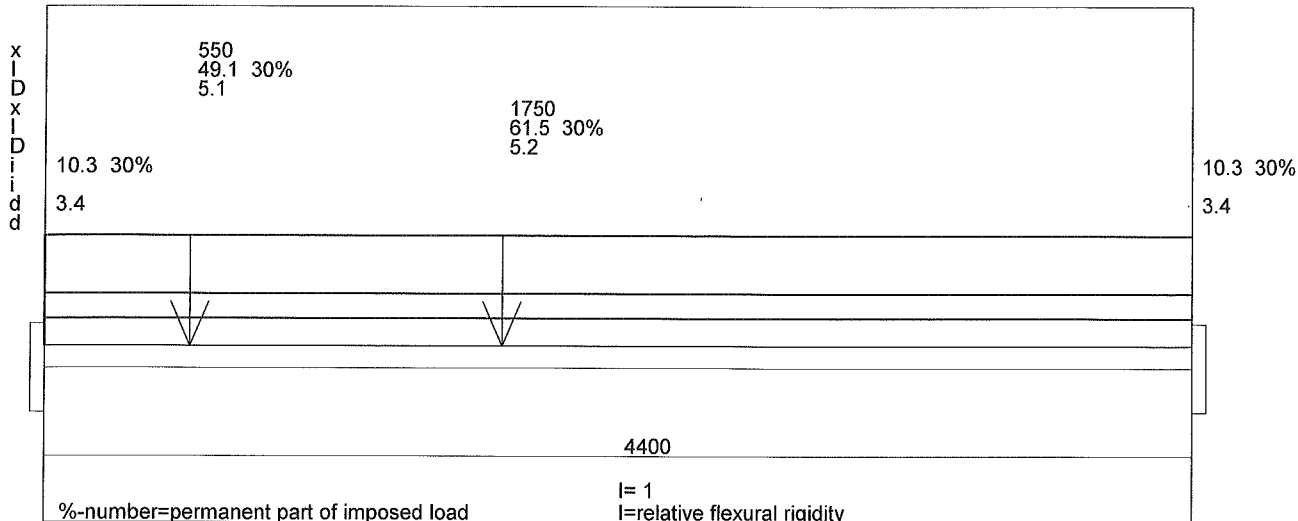

Licensed to: FINNLAMELLI OY

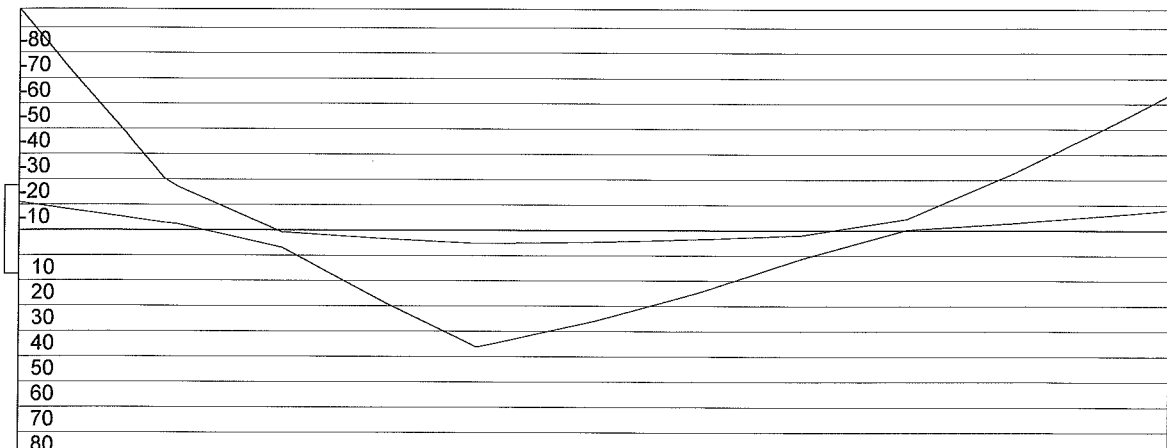

Licensed to: FINNLAMELLI OY

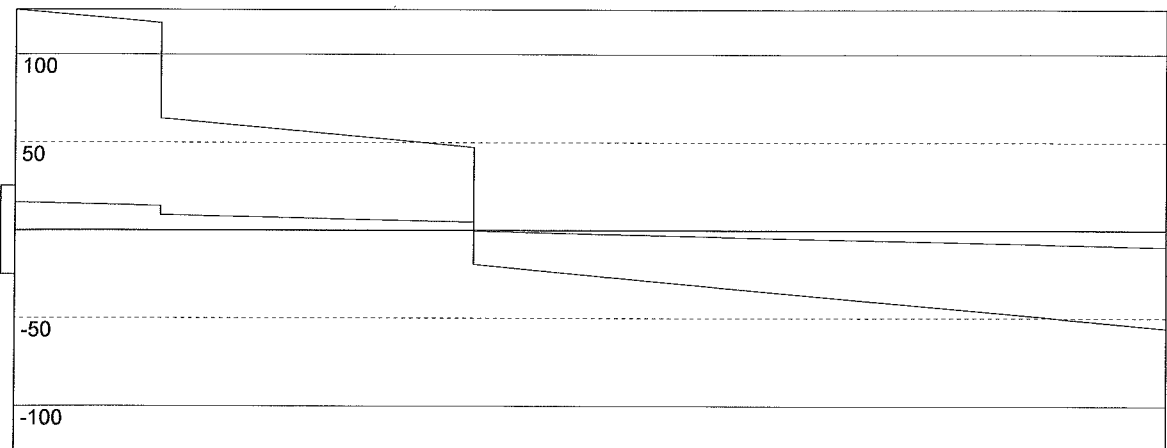

Load factor of dead load= 1 Load factor of imposed load= 1

Load width 1 (m) (by which the loads has been multiplied during calculation)

Max/Min reactions of beam [kN]

125,433 55,731

15,743 9,513

T24 825 x 260 B 2 Cf=1,00 Design method: Allowable stress design

Increasing factor of the allowable stress 1,03

Factored Moment/Moment capacity [kNm] 87,277 92,120 95 %

Factored shear force/shear capacity [kN] 125,433 141,722 89 %

(5) LOGS ✓

Deflection due to unfactored load (Deflection limit L/360)


5,5 mm (45 %)

Beam Id: Lot # 70 - MB /6


Date 23-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

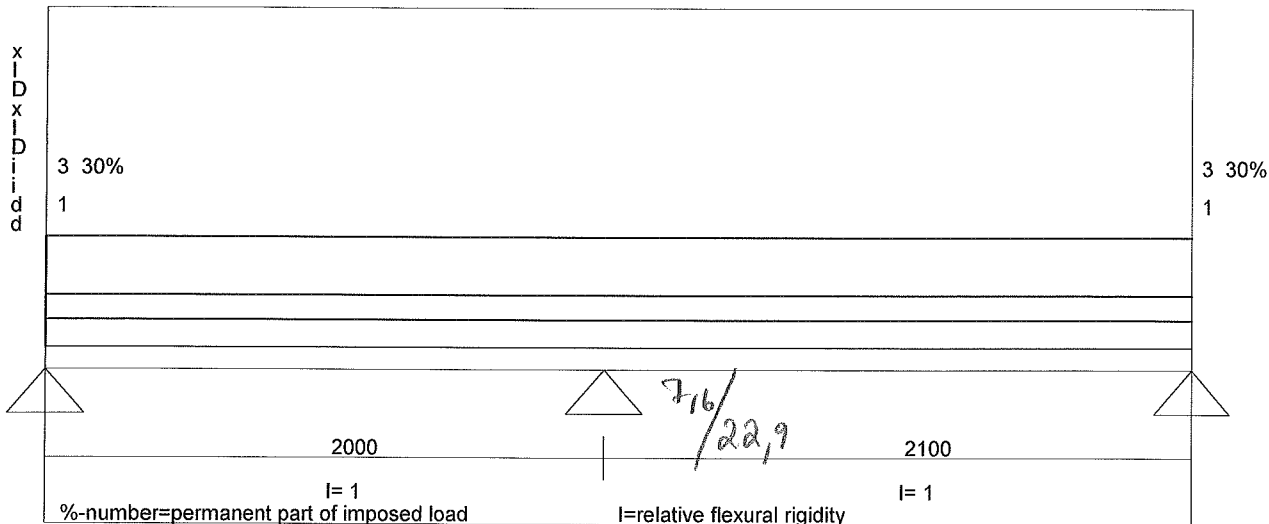

Licensed to: FINNLAMELLI OY

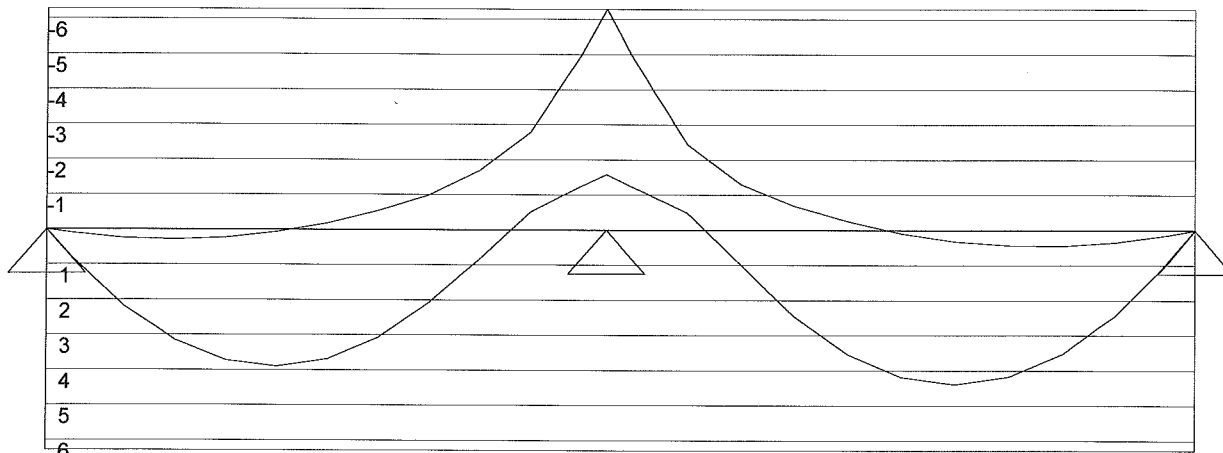

Licensed to: FINNLAMELLI OY

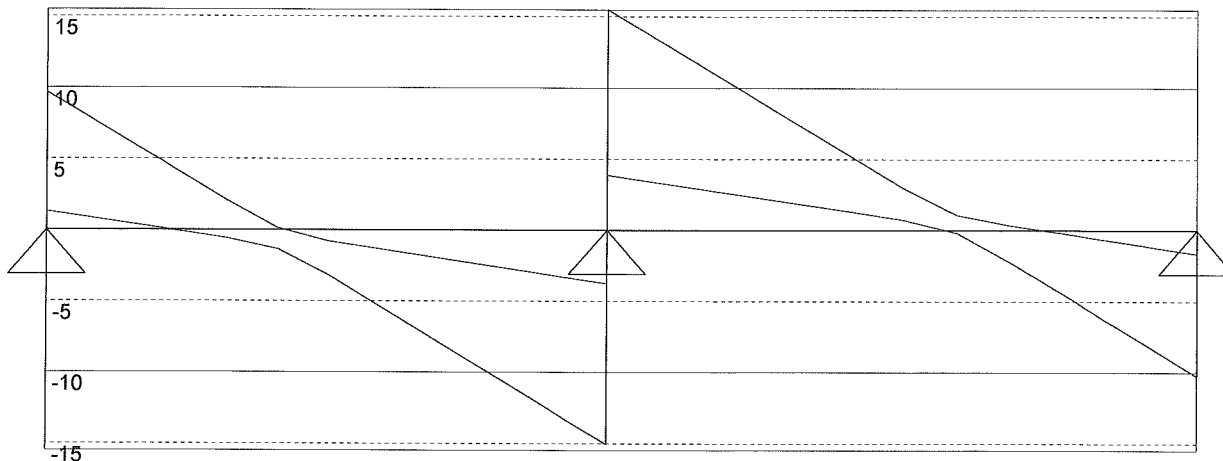

Load factor of dead load= 1 Load factor of imposed load= 1
 Load width 2.975 (m) (by which the loads
 has been multiplied during calculation)
 Max/Min reactions of beam [kN]
 9,640 30,527 10,230
 1,303 7,632 1,647

T24 164 x 260 B 2 Cf=1,00 Design method: Allowable stress design
 Increasing factor of the allowable stress 1,07
 Factored Moment/Moment capacity [kNm] 6,283 18,921 33 %
 Factored shear force/shear capacity [kN] 15,486 29,109 53 %

1 LOG ✓


Deflection due to unfactored load (Deflection limit L/360)
 0,9 mm (16 %) 1,1 mm (19 %)

Beam Id: Lot # 70 - MB *21*


Date 24-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

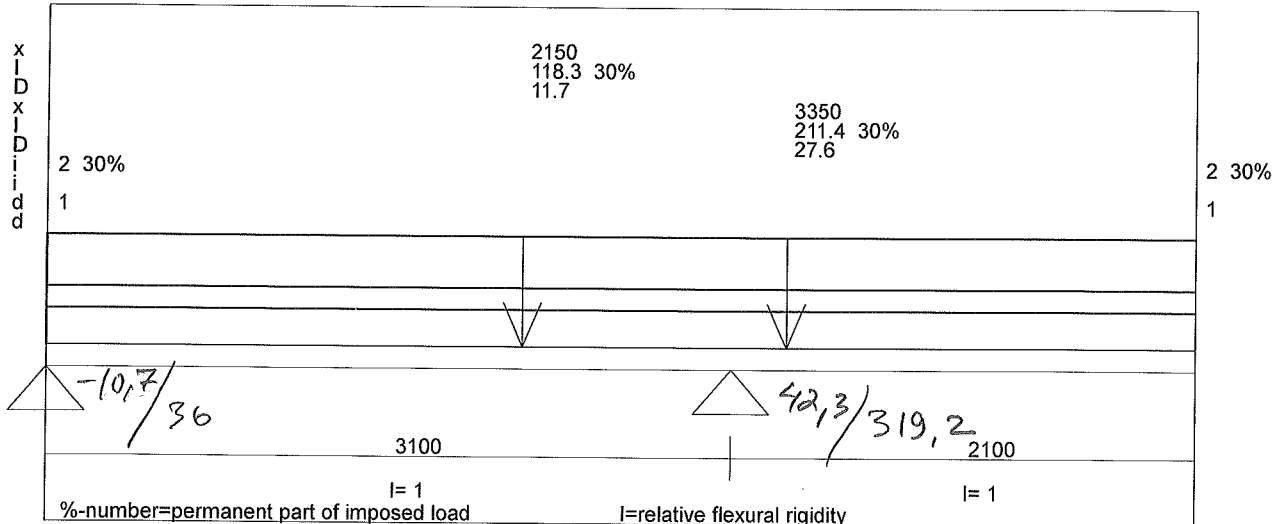

Licensed to: FINNLAMELLI OY

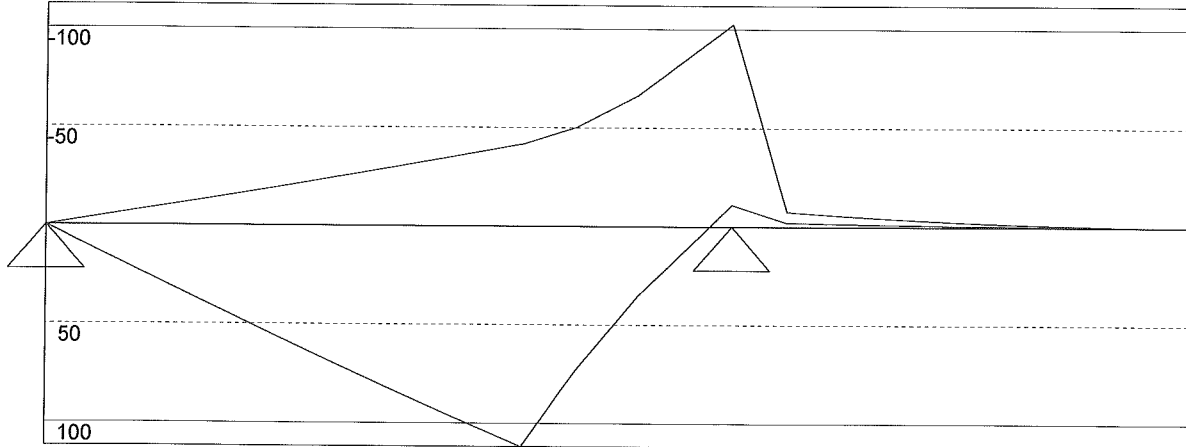

Licensed to: FINNLAMELLI OY

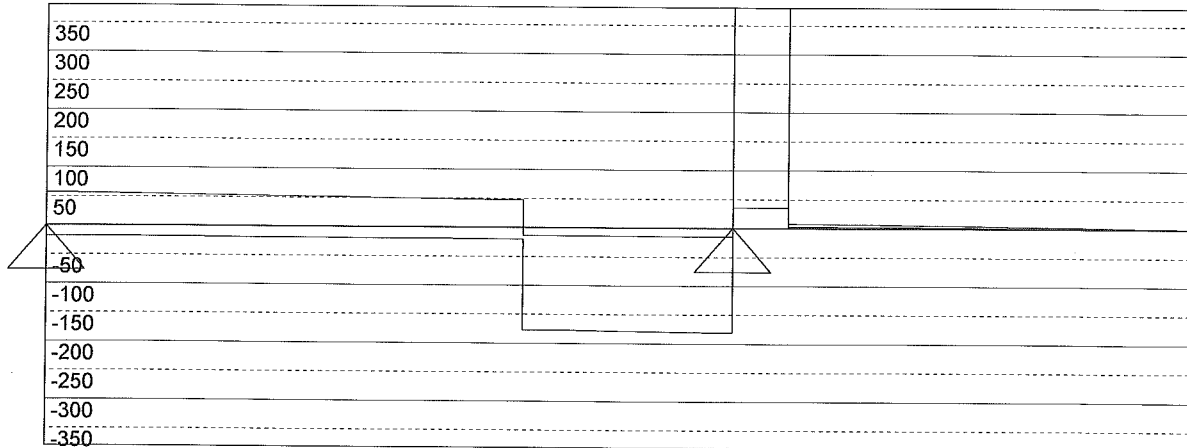

Load factor of dead load= 1.2 Load factor of imposed load= 1.6

Load width 1 (m) (by which the loads has been multiplied during calculation)

Max/Min reactions of beam [kN]

56,736 561,507
-18,050 50,761

HEB 280 (Class of section=1/1) G= 103 I(cm4)=19270 W(cm3)=1380 fy=235

Factored Moment/Moment capacity [kNm] 111,815 360,490 31 %

Factored shear force/shear capacity [kN] 380,598 387,891 98 %

W10 x 88

Deflection due to unfactored load (Deflection limit L/360)/L/180!

1,3 mm (15 %) 2,6 mm (23 %)


Attention! Ultimate limit design! Remember the load factors!!

Beam Id: Lot # 70 - MB *22*


Date 24-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

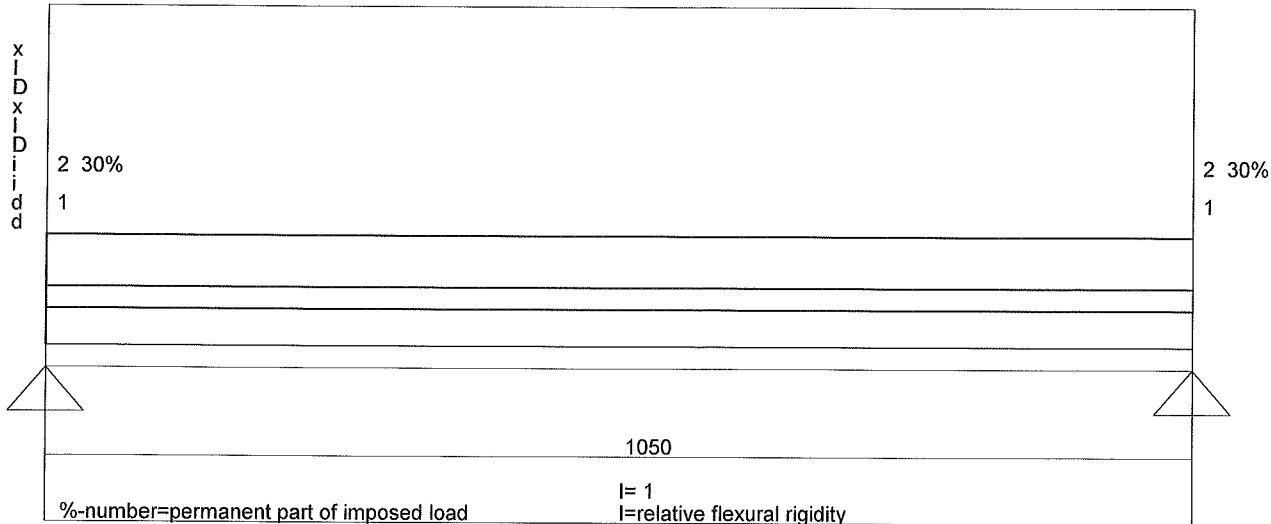

Licensed to: FINNLAMELLI OY

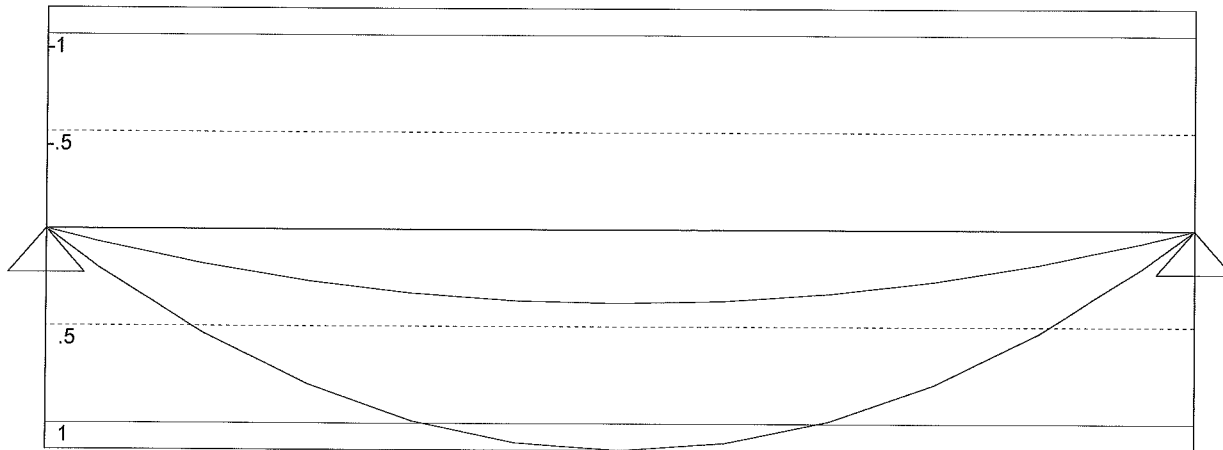

Licensed to: FINNLAMELLI OY

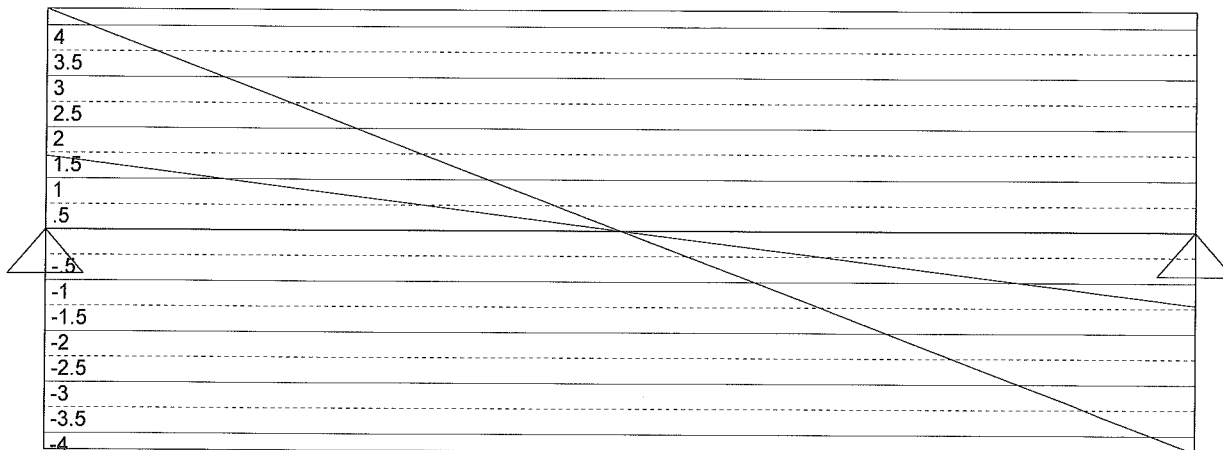

Load factor of dead load= 1 Load factor of imposed load= 1
 Load width 2.75 (m) (by which the loads
 has been multiplied during calculation)
 Max/Min reactions of beam [kN]
 4,330 4,331
 1,443 1,444

T24 76 x 185 B 2 Cf=1,00 Design method: Allowable stress design
 Increasing factor of the allowable stress 1,09
 Factored Moment/Moment capacity [kNm] 1,137 4,540 25 %
 Factored shear force/shear capacity [kN] 4,330 9,816 44 %

(2) 2x8

Deflection due to unfactored load (Deflection limit L/360)
 0,5 mm (17 %)


Beam Id: Lot # 70 - MB

23


Date 24-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

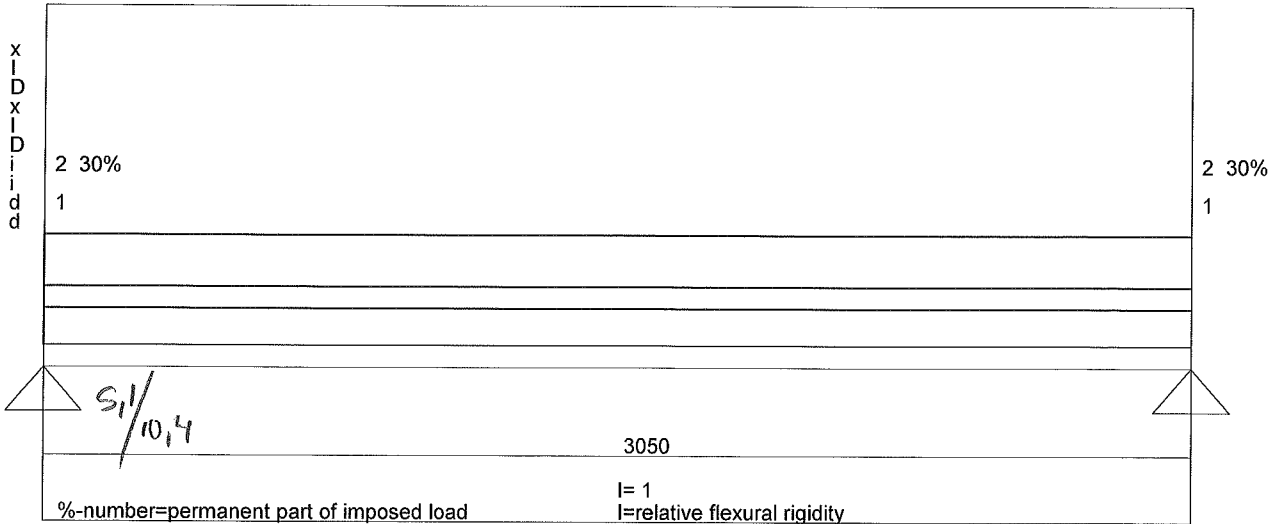

Licensed to: FINNLAMELLI OY

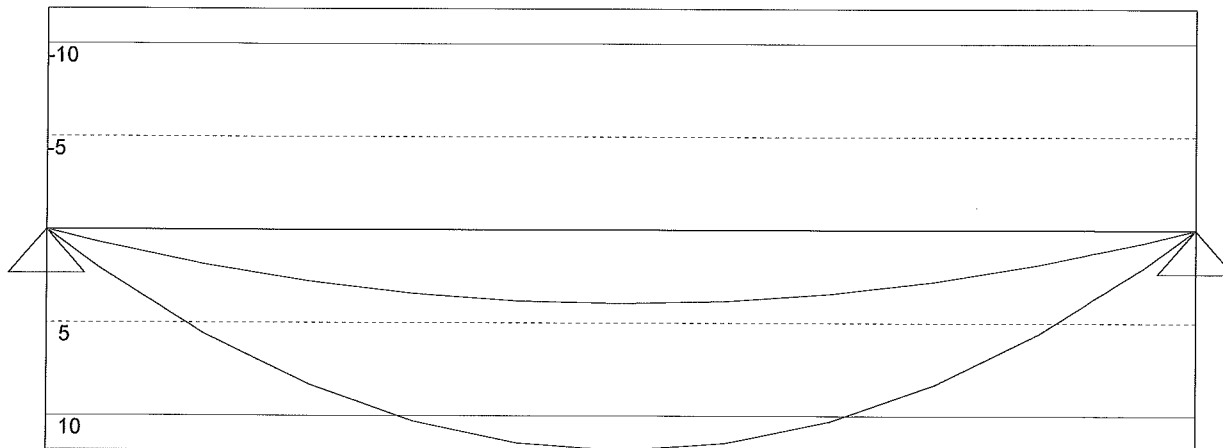

Licensed to: FINNLAMELLI OY

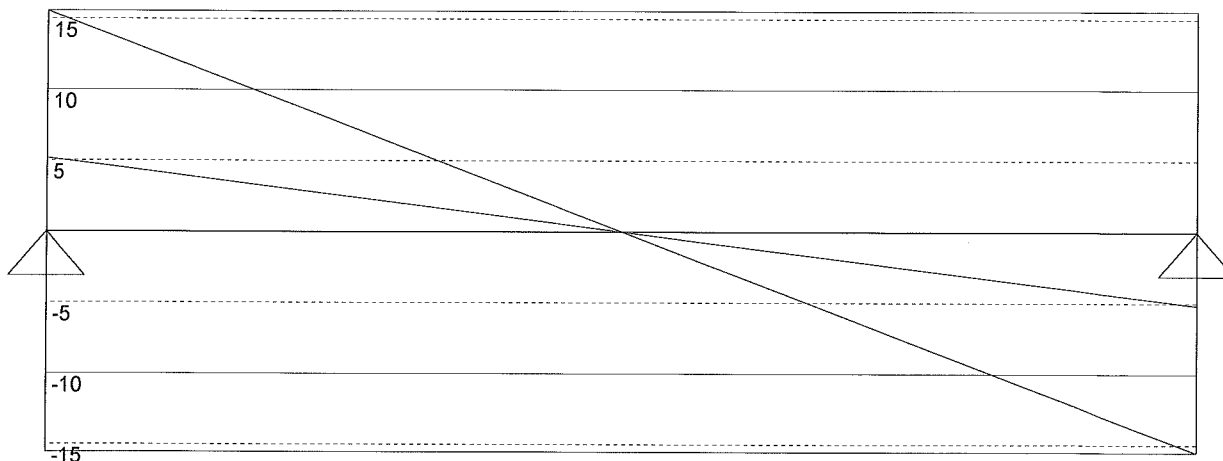

Load factor of dead load= 1 Load factor of imposed load= 1
 Load width 3.4 (m) (by which the loads
 has been multiplied during calculation)
 Max/Min reactions of beam [kN]
 15,552 15,555
 5,184 5,185

KER 76 x 300 B 2 Cf=1,00 Design method: Allowable stress design
 Increasing factor of the allowable stress 1,09
 Factored Moment/Moment capacity [kNm] 11,861 22,385 53 %
 Factored shear force/shear capacity [kN] 15,552 28,189 55 %

(2) LVL 1 1/2 x 1 7/8

Deflection due to unfactored load (Deflection limit L/360)
 6,5 mm (77 %)


Beam Id: Lot £ 70 - MB

27


Date 24-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

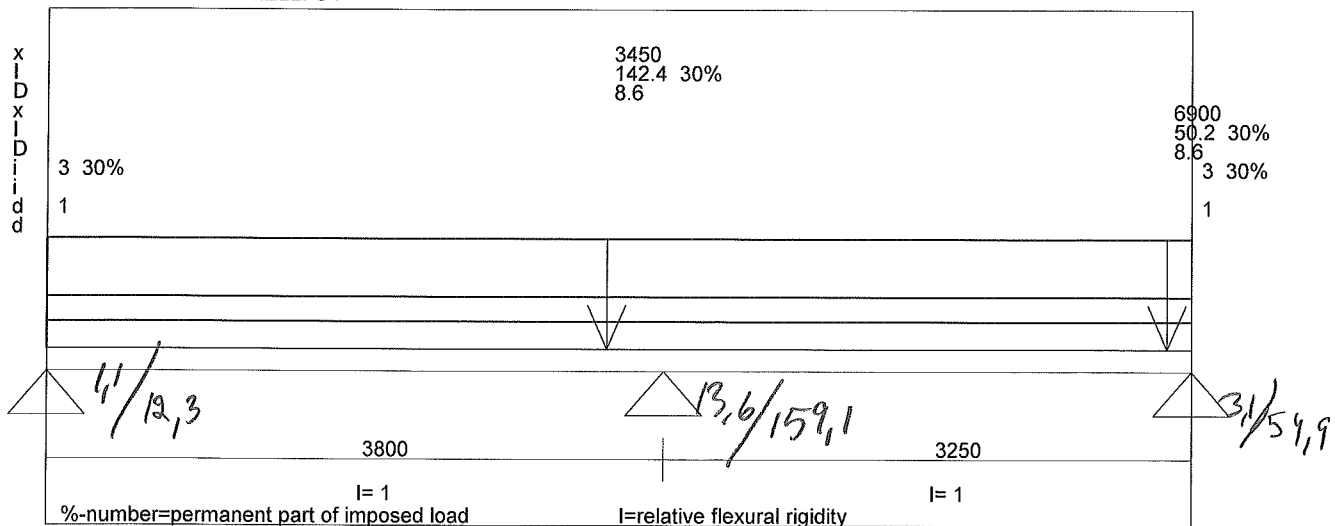

Licensed to: FINNLAMELLI OY

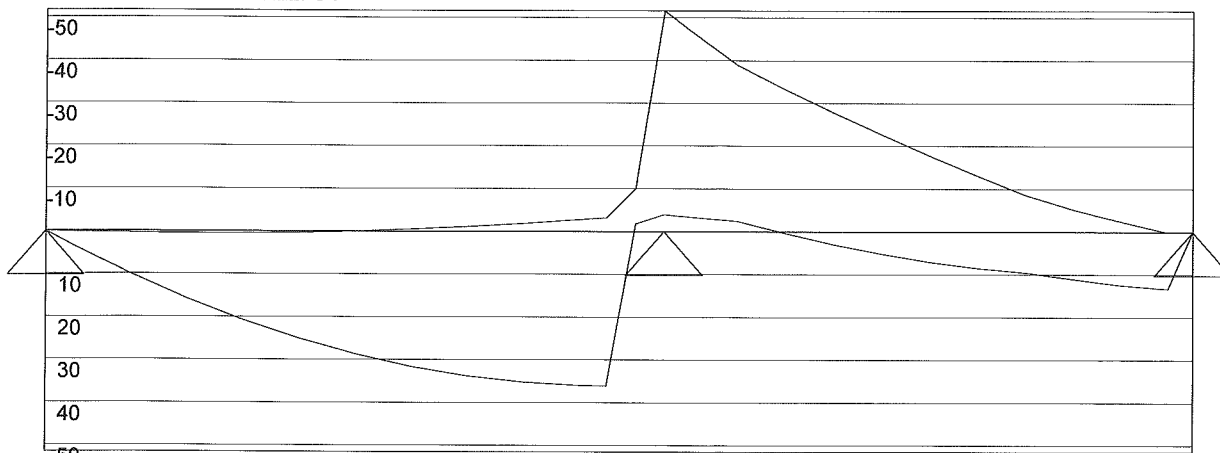

Licensed to: FINNLAMELLI OY

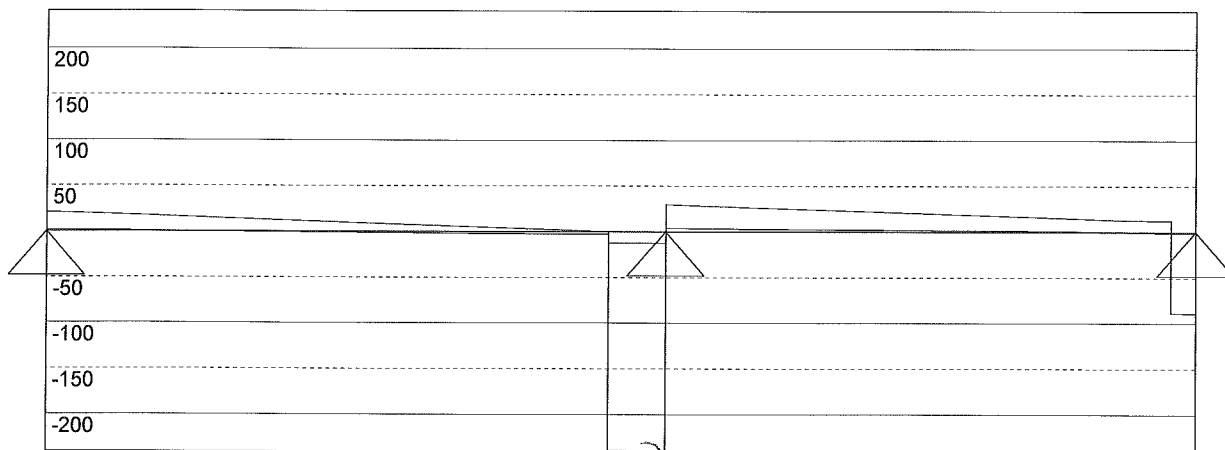

Load factor of dead load = 1.2 Load factor of imposed load = 1.6
 Load width 1 (m) (by which the loads has been multiplied during calculation)
 Max/Min reactions of beam [kN]
 20,815 270,987 89,367
 1,141 16,328 1,552

HEB 220 (Class of section=1/1) G= 71,5 I(cm4)=8091 W(cm3)=736 fy=235
 Factored Moment/Moment capacity [kNm] 51,553 194,580 26 %
 Factored shear force/shear capacity [kN] 241,190 273,258 88 %

WBx 58


Deflection due to unfactored load (Deflection limit L/360)
 1,8 mm (17 %) 0,3 mm (3 %)
 Attention! Ultimate limit design! Remember the load factors!!

Beam Id: LOT#70 MB **4** **GLULAM**


Date 19-06-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

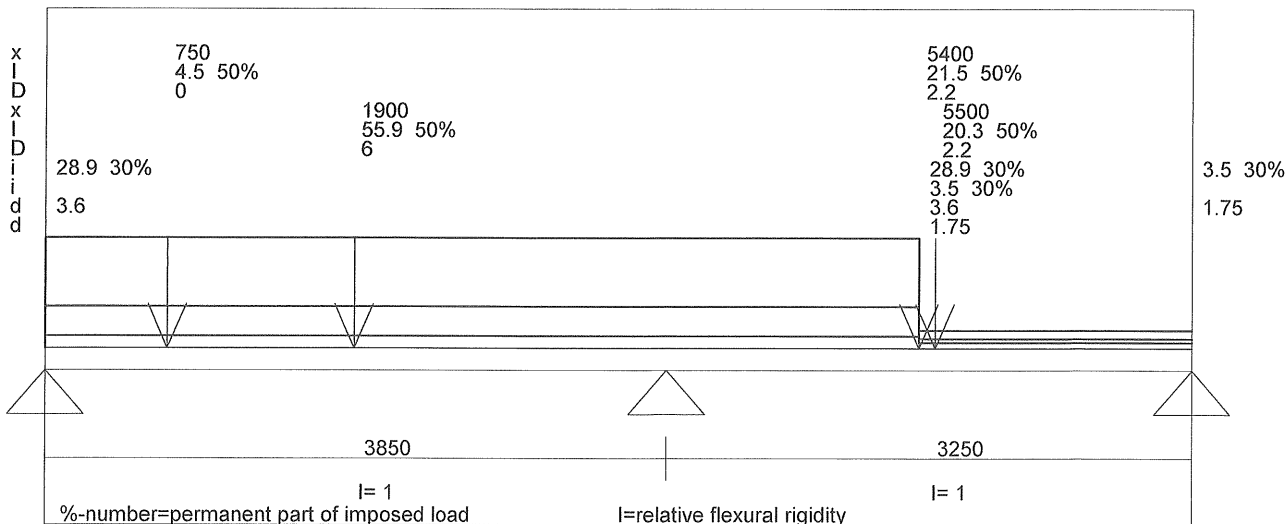

Licensed to: FINNLAMELLI OY

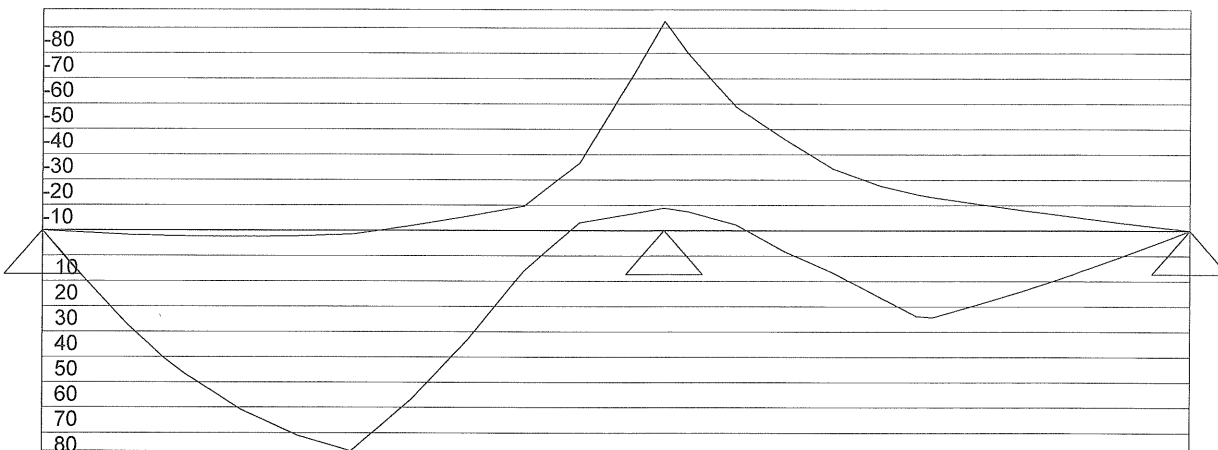

Licensed to: FINNLAMELLI OY

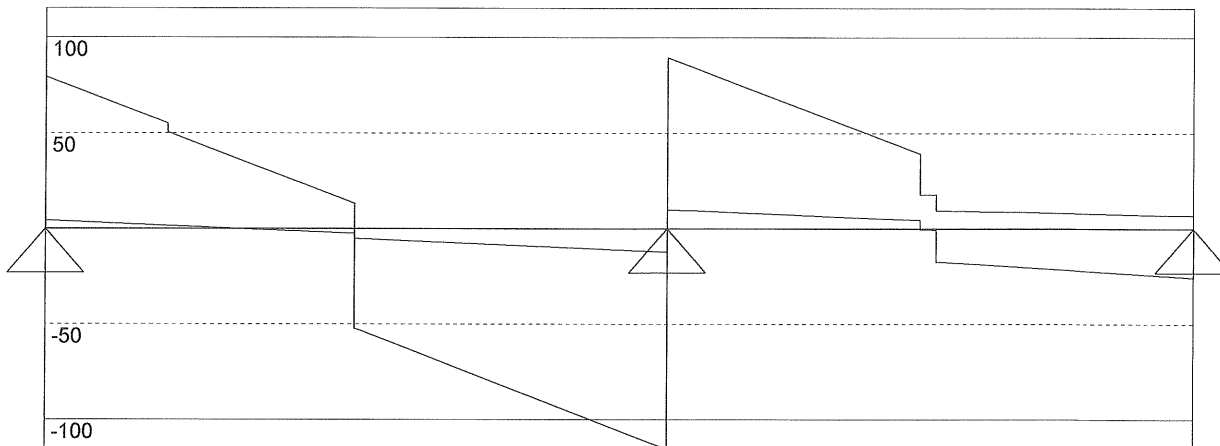

Load factor of dead load= 1 Load factor of imposed load= 1

Load width 1 (m) (by which the loads has been multiplied during calculation)

Max/Min reactions of beam [kN]

79,439 205,008 25,666

4,281 22,173 -6,793

L40 380 x 390 B 2 Cf=0,97 Design method: Allowable stress design

Increasing factor of the allowable stress 1,03

Factored Moment/Moment capacity [kNm] 87,130 142,984 61 %

Factored shear force/shear capacity [kN] 115,429 116,534 99 %

GL (2) 7 1/2" x 15 3/8"

Deflection due to unfactored load (Deflection limit L/360)


6,6 mm (62 %) 1,6 mm (18 %)

Beam Id: LOT#70 MB **B** **GLULAM**


Date 19-06-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

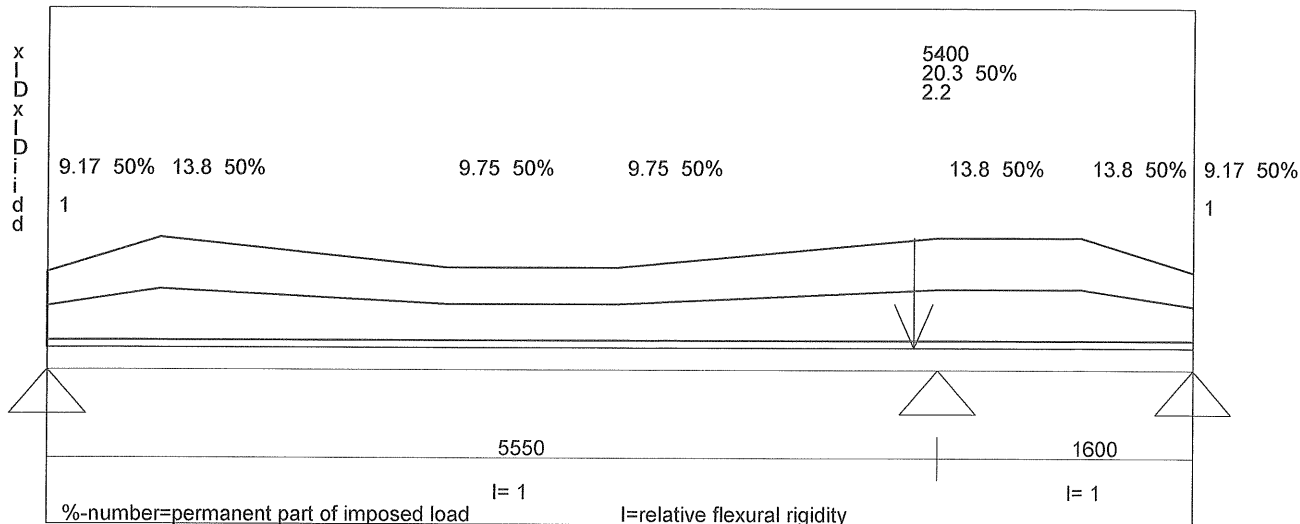

Licensed to: FINNLAMELLI OY

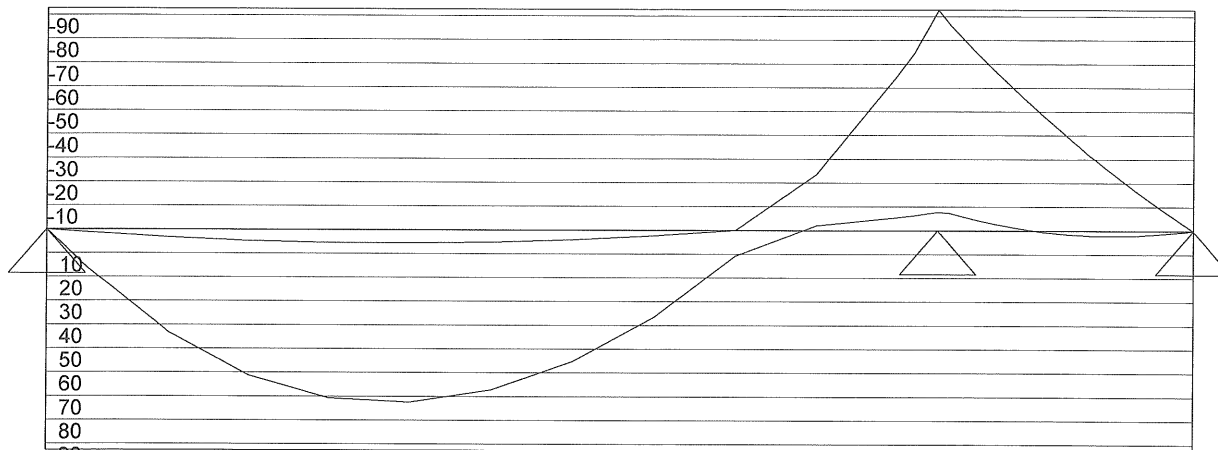

Licensed to: FINNLAMELLI OY

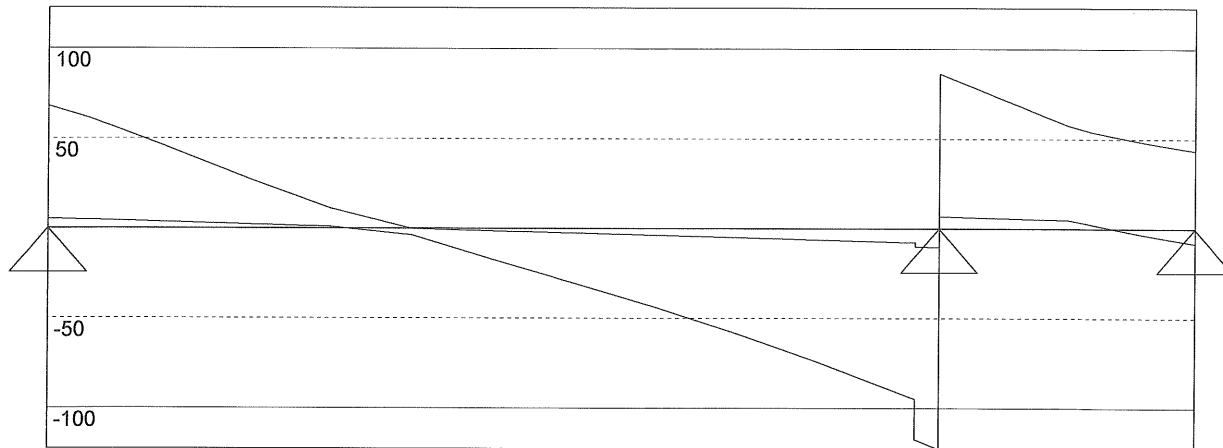

Load factor of dead load= 1 Load factor of imposed load= 1
 Load width 2.45 (m) (by which the loads has been multiplied during calculation)
 Max/Min reactions of beam [kN]
 67,927 209,092 8,202
 5,246 17,155 -43,405

L40 380 x 430 B 2 Cf=0,96 Design method: Allowable stress design
 Increasing factor of the allowable stress 1,02
 Factored Moment/Moment capacity [kNm] 92,662 171,091 54 %
 Factored shear force/shear capacity [kN] 122,747 127,850 96 %

GL (2) 7 1/2" x 17"


Deflection due to unfactored load (Deflection limit L/360)
 9,0 mm (58 %) 0,0 mm (0 %)

Beam Id: LOT#70 MB **6 Gwlam**


Date 19-06-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

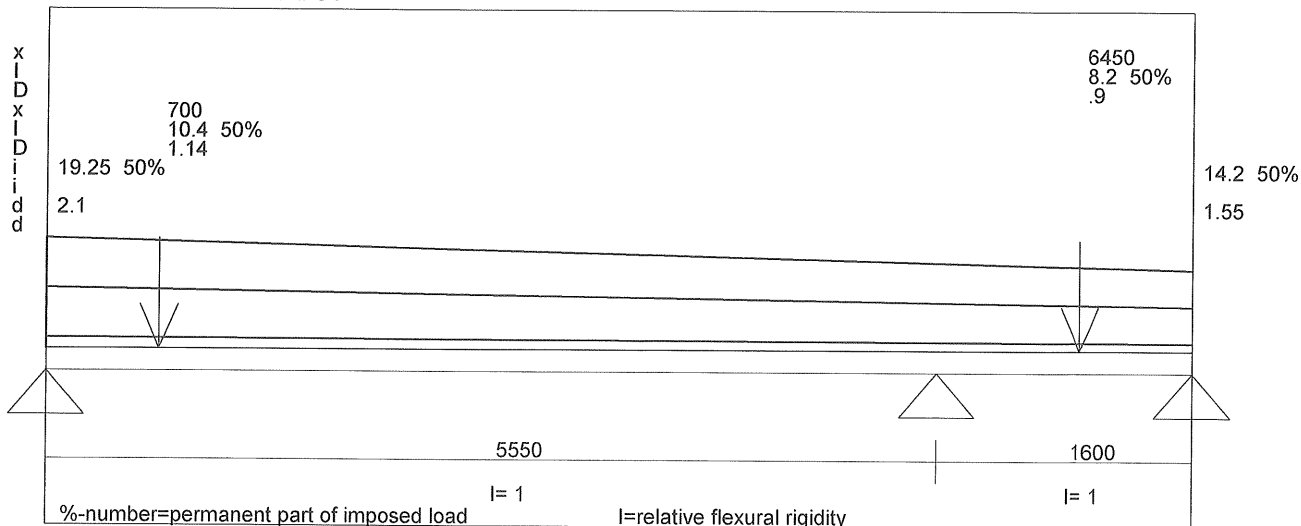

Licensed to: FINNLAMELLI OY

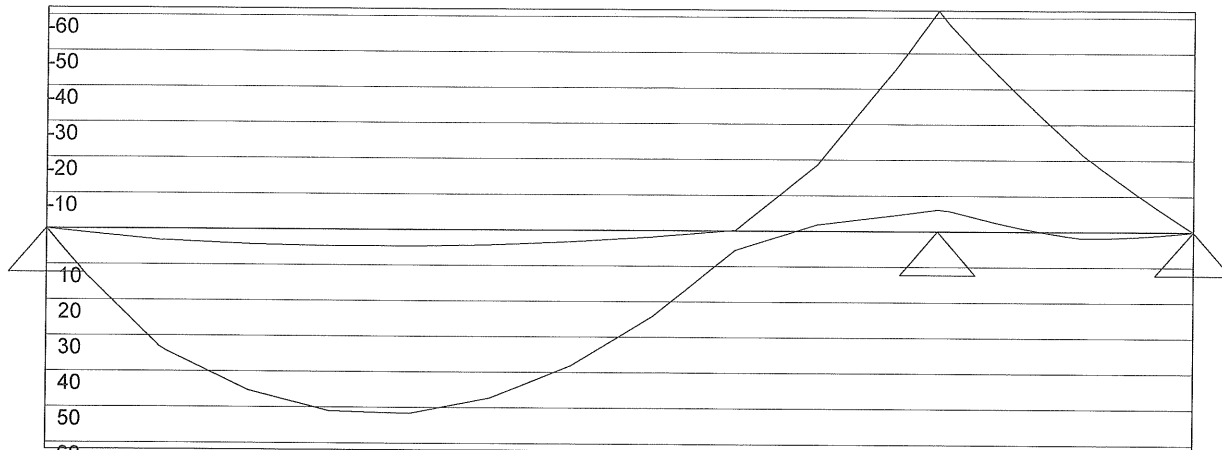

Licensed to: FINNLAMELLI OY

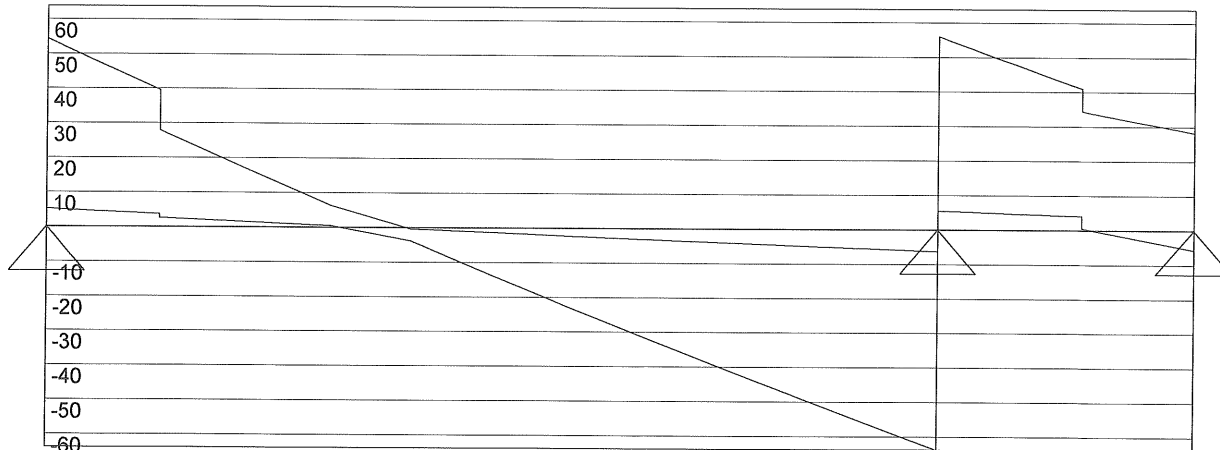

Load factor of dead load= 1 Load factor of imposed load= 1

Load width 1 (m) (by which the loads has been multiplied during calculation)

Max/Min reactions of beam [kN]

54,274 119,761 5,612

5,186 11,786 -28,297

L40 380 x 430 B 2 Cf=0,96 Design method: Allowable stress design

Increasing factor of the allowable stress 1,03

Factored Moment/Moment capacity [kNm] 61,922 171,870 36 %

Factored shear force/shear capacity [kN] 63,808 128,433 50 %

GL (2) 7 1/2" x 17"


Deflection due to unfactored load (Deflection limit L/360)

6,3 mm (41 %) 0,0 mm (0 %)


Beam Id: LOT#70 MB **7 LVL**
 Structural Engineer:

Date 19-06-2018


Licensed to: FINNLAMELLI OY

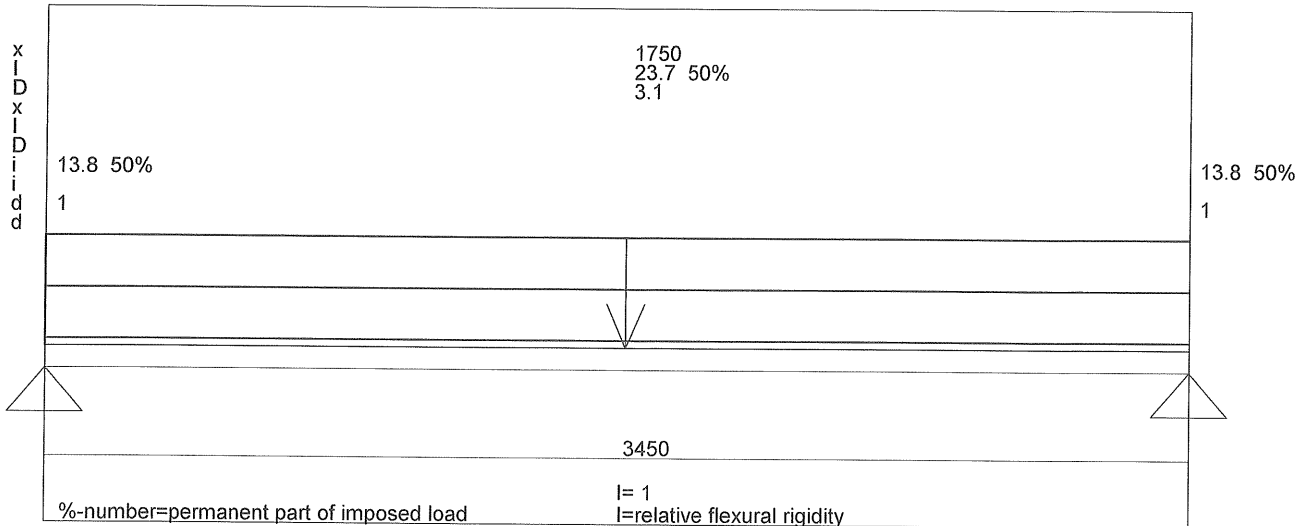

Licensed to: FINNLAMELLI OY

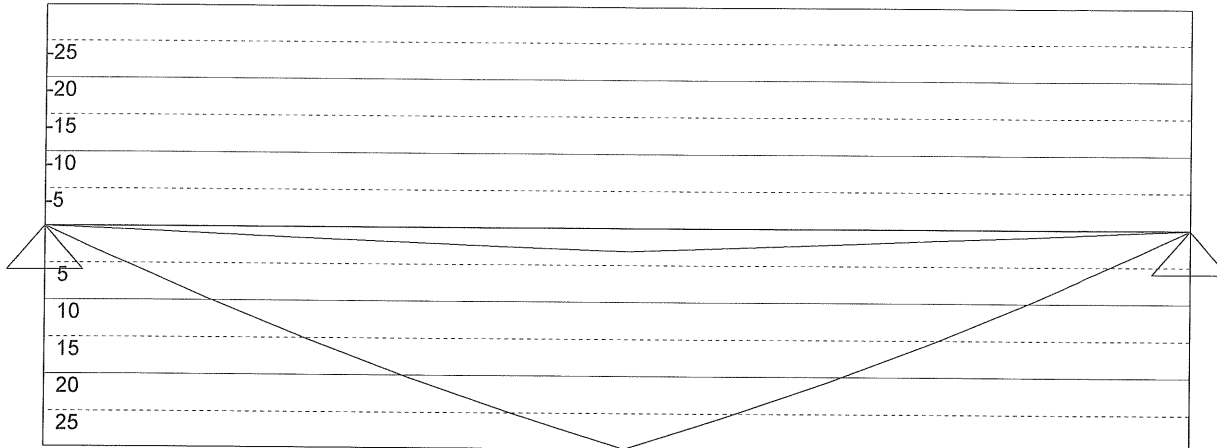

Licensed to: FINNLAMELLI OY

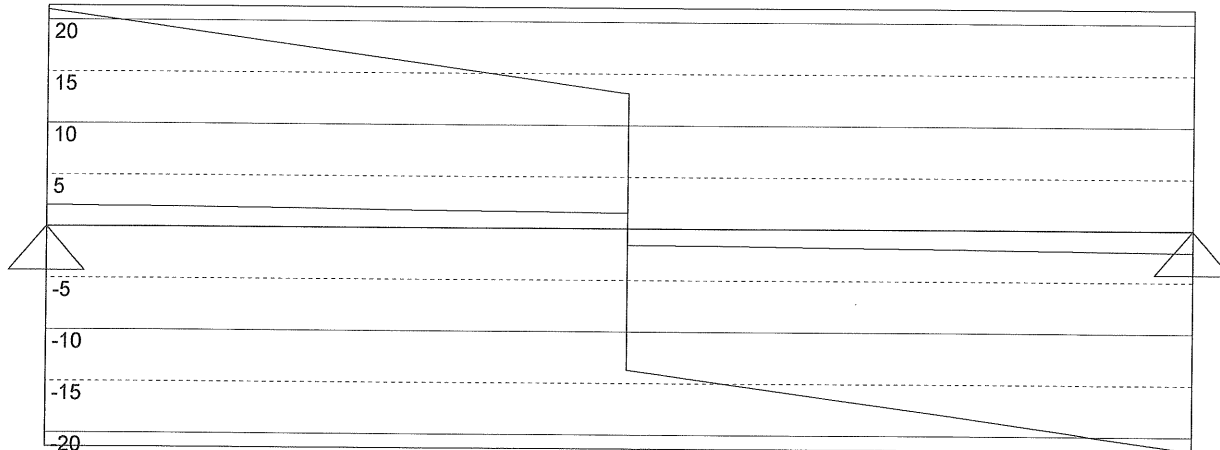

Load factor of dead load= 1 Load factor of imposed load= 1
 Load width .305 (m) (by which the loads
 has been multiplied during calculation)
 Max/Min reactions of beam [kN]
 20,991 21,381
 2,054 2,099

KER 152 x 300 B 2 Cf=1,00 Design method: Allowable stress design
 Increasing factor of the allowable stress 1,03
 Factored Moment/Moment capacity [kNm] 29,825 42,071 71 %
 Factored shear force/shear capacity [kN] 21,379 52,978 40 %

(4) LVL 1 1/2" x 1 7/8"


Deflection due to unfactored load (Deflection limit L/360)
 8,8 mm (92 %)

Beam Id: LOT#70 MB *13 6LO LAM*


Date 19-06-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

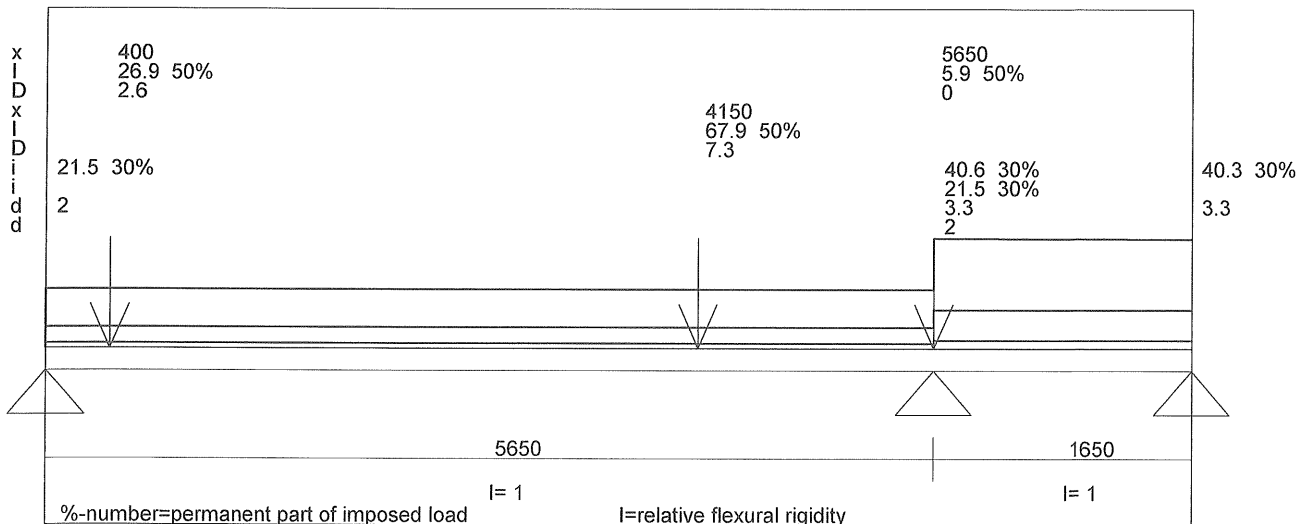

Licensed to: FINNLAMELLI OY

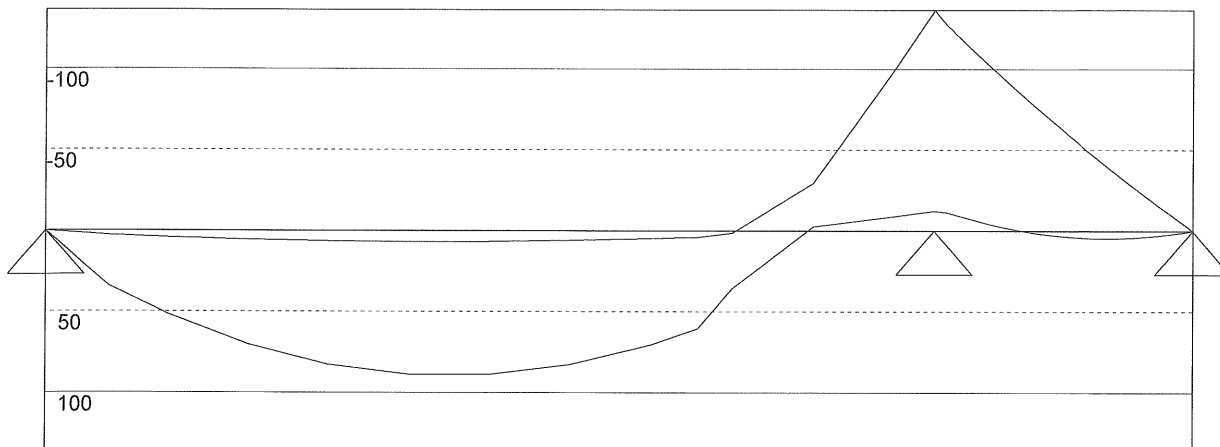

Licensed to: FINNLAMELLI OY

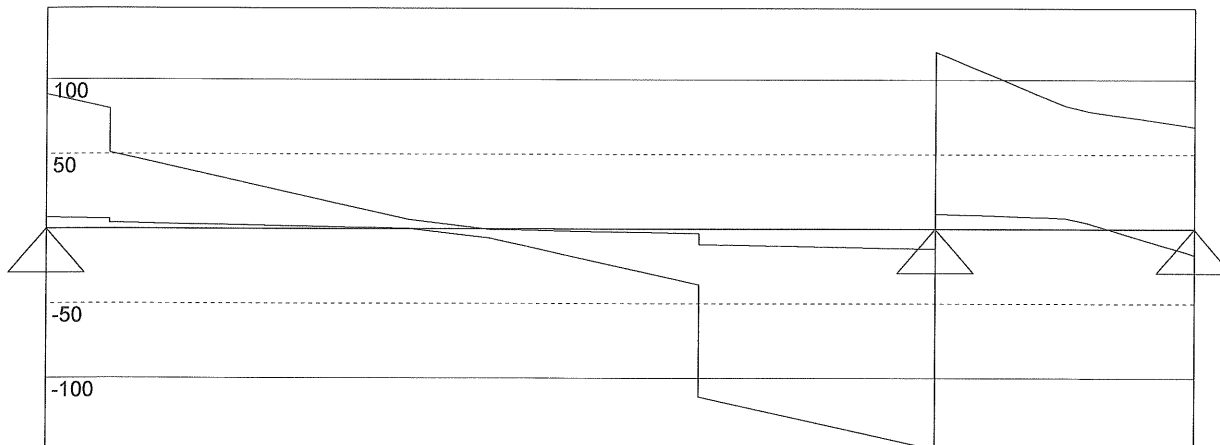

Load factor of dead load= 1 Load factor of imposed load= 1

Load width 1 (m) (by which the loads has been multiplied during calculation)

Max/Min reactions of beam [kN]

89,999 272,494 17,303

7,447 23,510 -68,593

L40 380 x 515 B 2 Cf=0,94 Design method: Allowable stress design

Increasing factor of the allowable stress 1,02

Factored Moment/Moment capacity [kNm] 136,336 240,880 57 %

Factored shear force/shear capacity [kN] 147,826 153,335 96 %

(2) 6L 7 1/2" x 20 1/4"

Deflection due to unfactored load (Deflection limit L/360)


7,4 mm (47 %) 0,0 mm (0 %)

Beam Id: LOT#70 HDR #1


Date 20-06-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

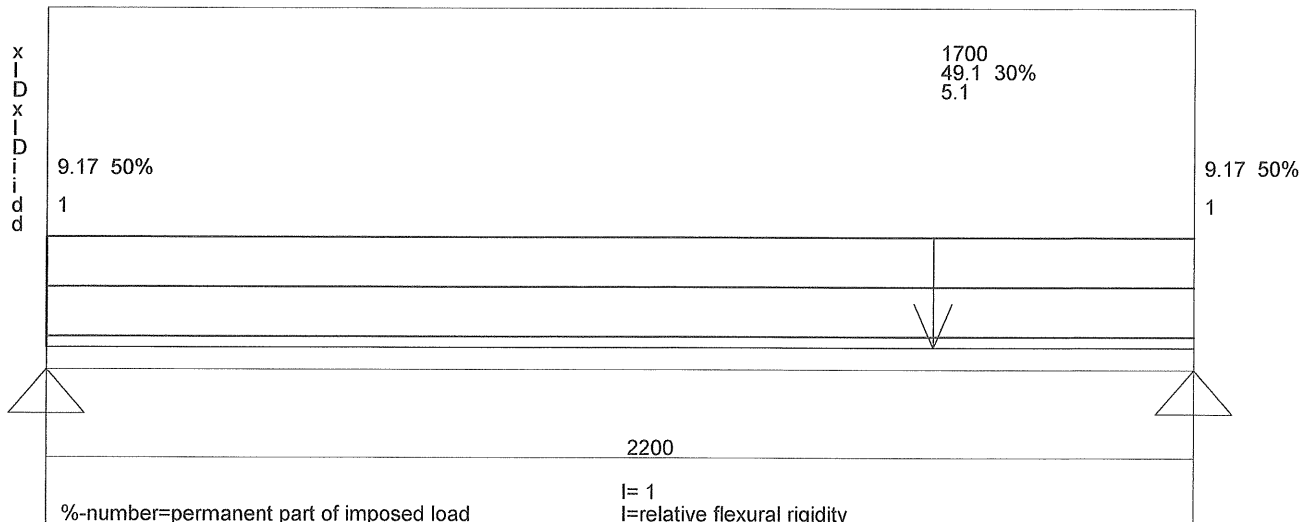

Licensed to: FINNLAMELLI OY

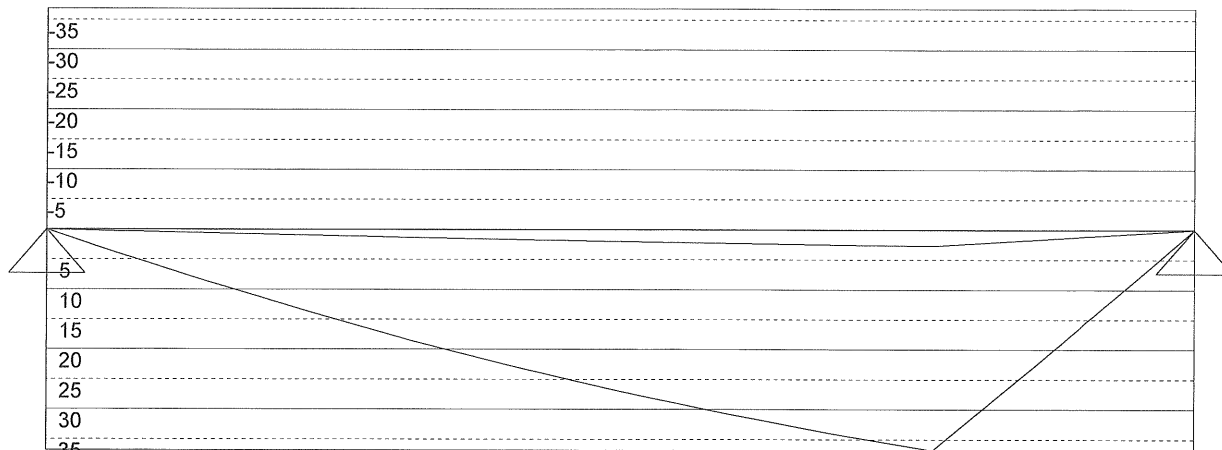

Licensed to: FINNLAMELLI OY

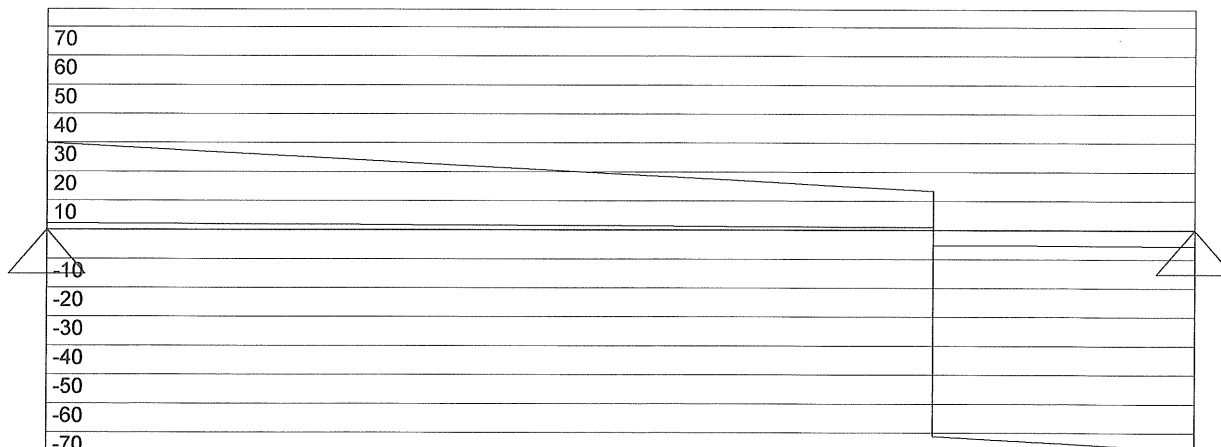

Load factor of dead load= 1.2 Load factor of imposed load= 1.6
 Load width .61 (m) (by which the loads
 has been multiplied during calculation)
 Max/Min reactions of beam [kN]
 29,893 76,083
 2,196 5,534

T24 328 x 260 B 2 Cf=1,00 Design method: Ultimate limit design
 Factored Moment/Moment capacity [kNm] 36,831 56,853 65 %
 Factored shear force/shear capacity [kN] 76,081 87,467 87 %


(2) LOGS

Deflection due to unfactored load (Deflection limit L/360)
 3,1 mm (50 %)


Beam Id: LOT#70 HDR #2
 Structural Engineer:

Date 20-06-2018


Licensed to: FINNLAMELLI OY

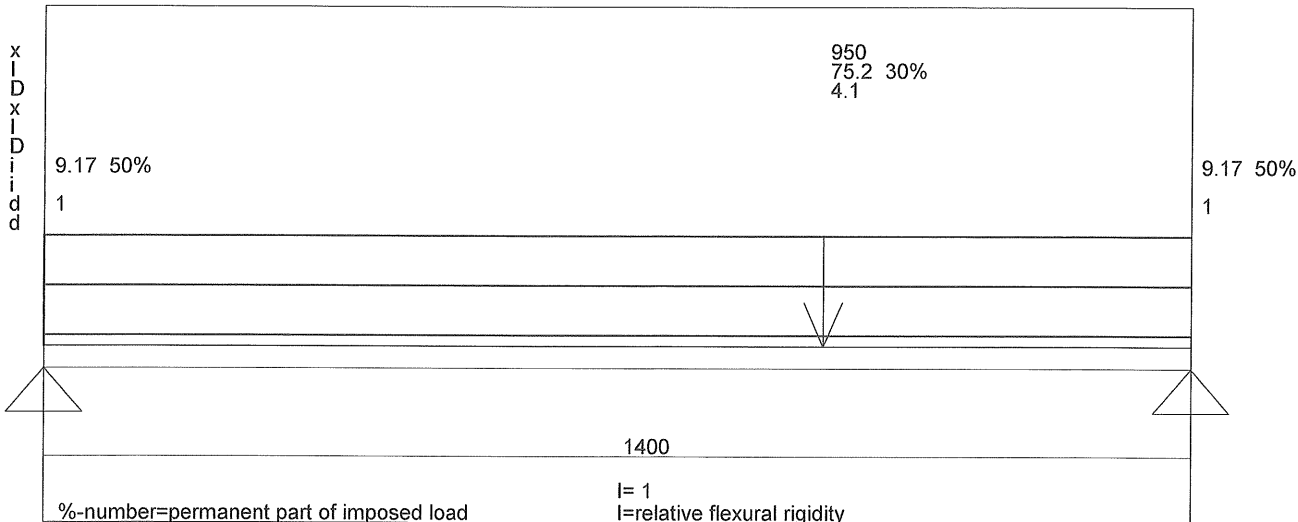

Licensed to: FINNLAMELLI OY

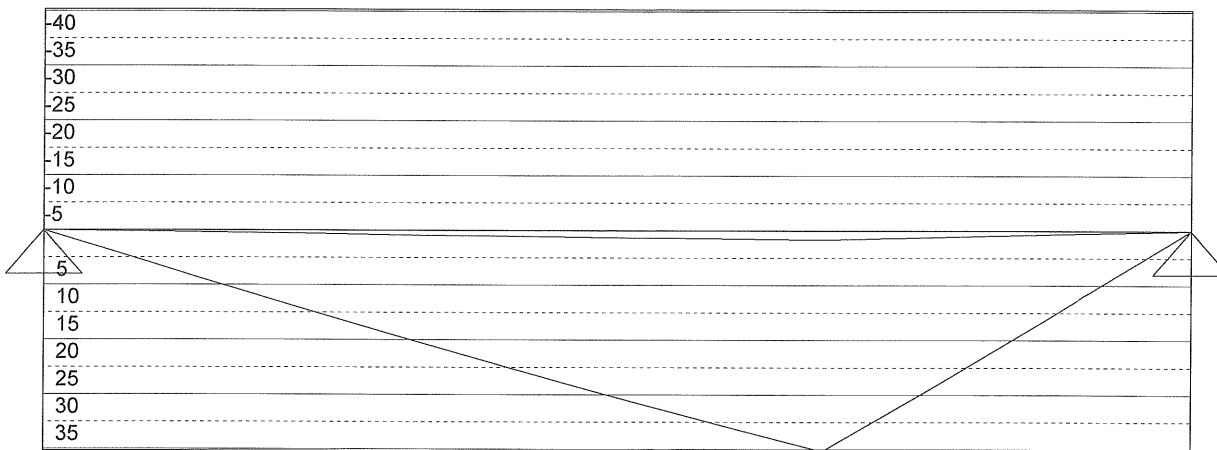

Licensed to: FINNLAMELLI OY

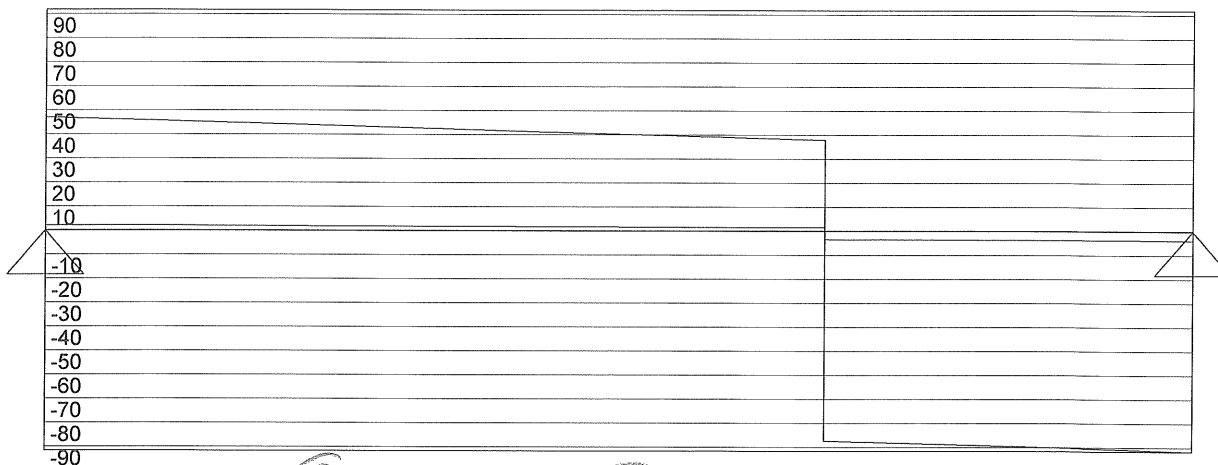

Load factor of dead load= 1.2 Load factor of imposed load= 1.6
 Load width .61 (m) (by which the loads has been multiplied during calculation)
 Max/Min reactions of beam [kN]
 47,031 91,761
 2,094 3,851

T24 492 x 260 B 2 Cf=1,00 Design method: Ultimate limit design
 Factored Moment/Moment capacity [kNm] 40,312 85,280 47 %
 Factored shear force/shear capacity [kN] 91,759 131,200 70 %

(3) L065


Deflection due to unfactored load (Deflection limit L/360)
 0,9 mm (22 %)

Beam Id: LOT#70 HDR #3


Date 20-06-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

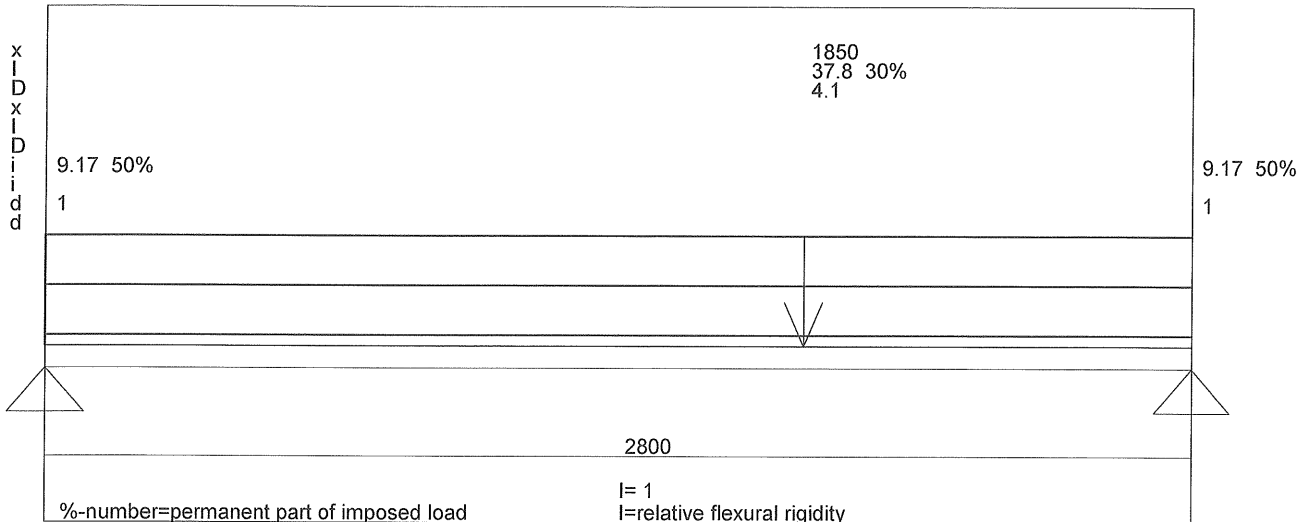

Licensed to: FINNLAMELLI OY

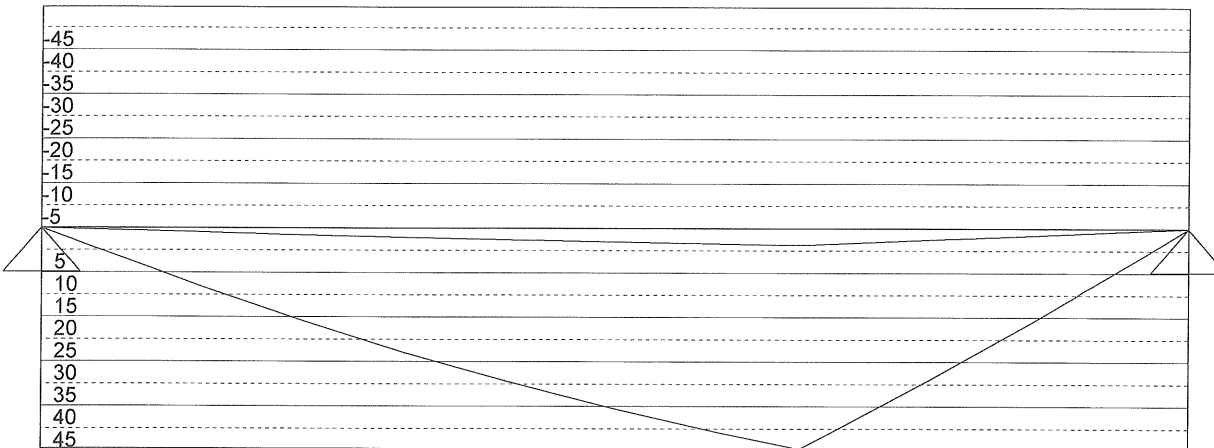

Licensed to: FINNLAMELLI OY

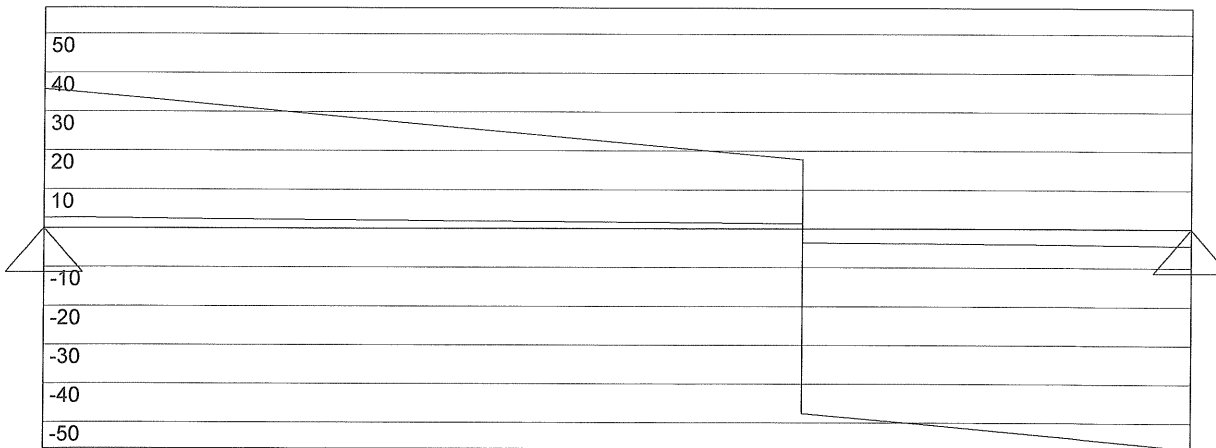

Load factor of dead load= 1.2 Load factor of imposed load= 1.6
 Load width .61 (m) (by which the loads has been multiplied during calculation)
 Max/Min reactions of beam [kN]
 35,741 56,764
 2,694 4,275

T24 328 x 260 B 2 Cf=1,00 Design method: Ultimate limit design
 Factored Moment/Moment capacity [kNm] 49,557 56,853 87 %
 Factored shear force/shear capacity [kN] 56,761 87,467 65 %


2 Lobs

Deflection due to unfactored load (Deflection limit L/360)
 6,9 mm (88 %)


Beam Id: LOT#70 HDR #4
 Structural Engineer:

Date 20-06-2018


Licensed to: FINNLAMELLI OY

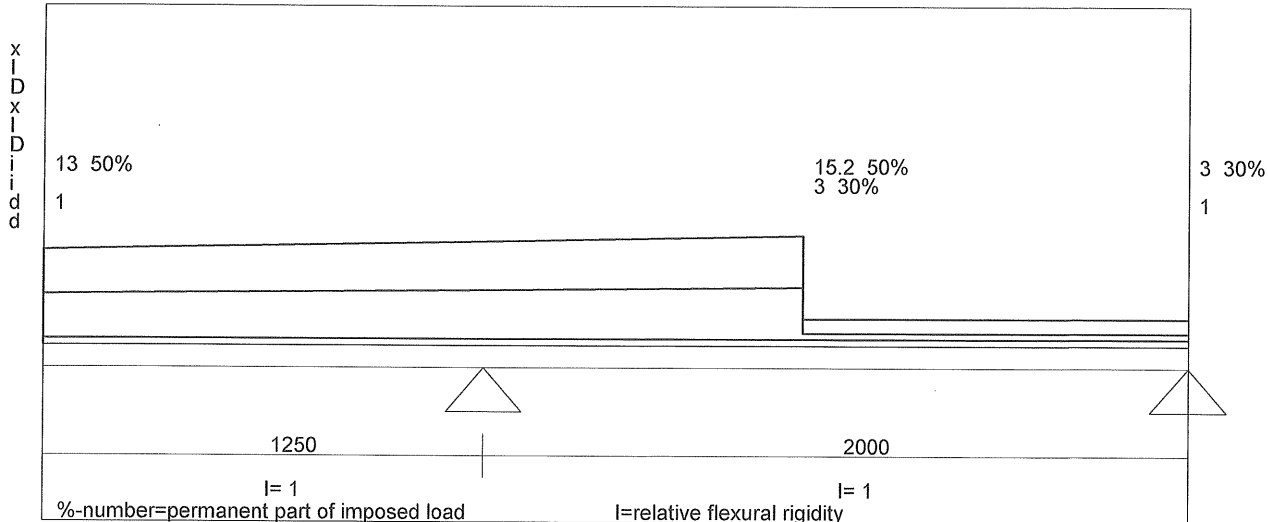

Licensed to: FINNLAMELLI OY

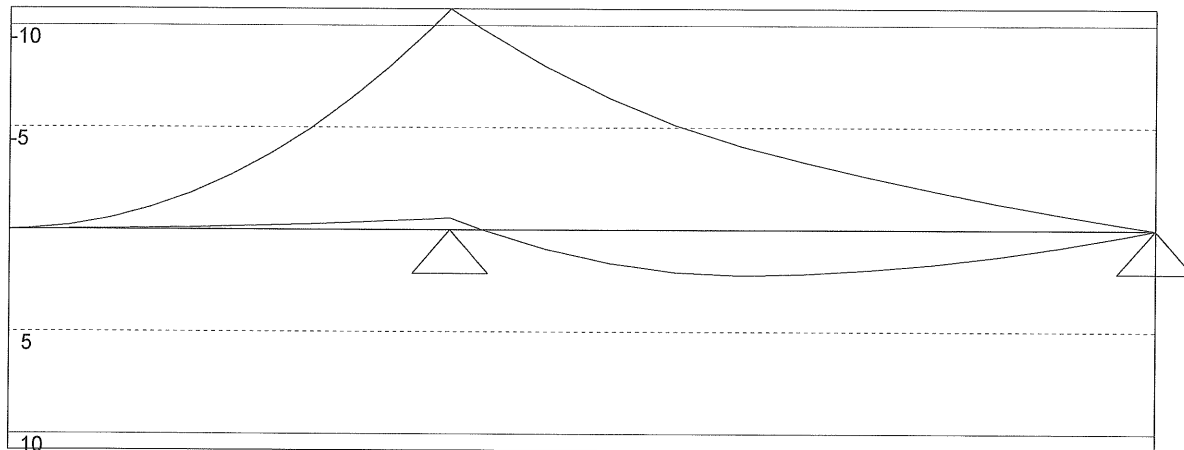

Licensed to: FINNLAMELLI OY

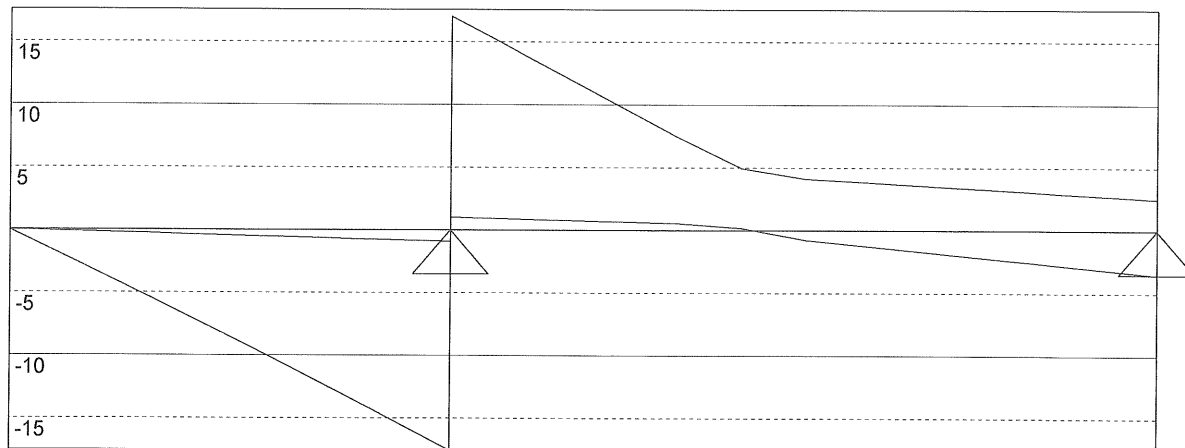

Load factor of dead load=1.2 Load factor of imposed load=1.6
 Load width .61 (m) (by which the loads has been multiplied during calculation)
 Max/Min reactions of beam [kN]
 34,577 3,552
 1,933 -2,500

T24 164 x 260 B 2 Cf=1,00 Design method: Ultimate limit design
 Factored Moment/Moment capacity [kNm] 10,807 28,427 38 %
 Factored shear force/shear capacity [kN] 17,553 43,733 40 %

(1) L06


Deflection due to unfactored load (Deflection limit L/360)/L/180!
 4,5 mm (65 %) 0,4 mm (6 %)

Beam Id: LOT#70 HDR #5


Date 20-06-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

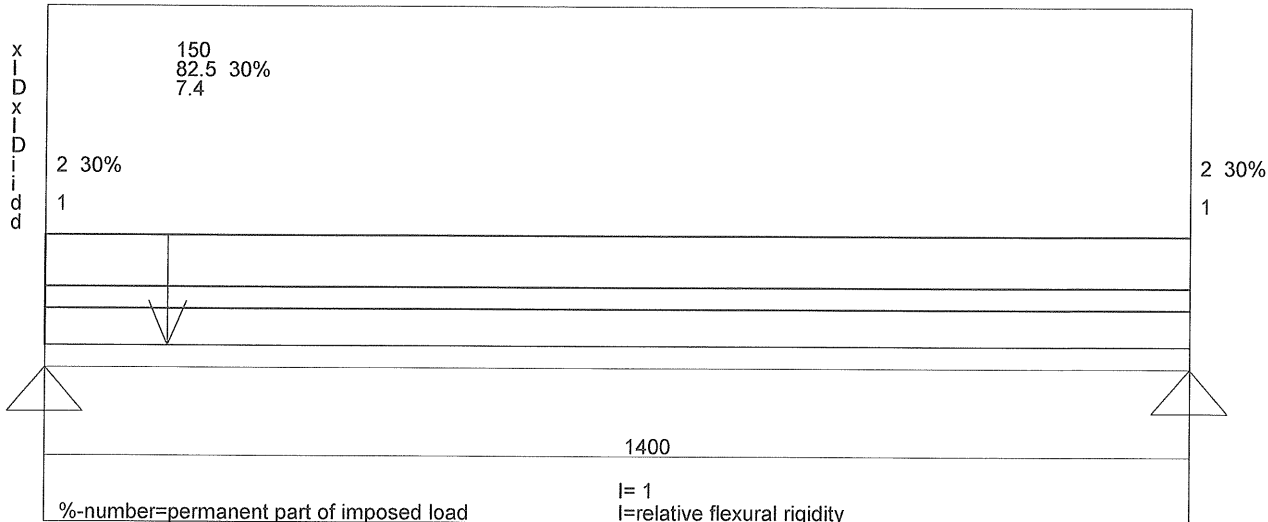

Licensed to: FINNLAMELLI OY

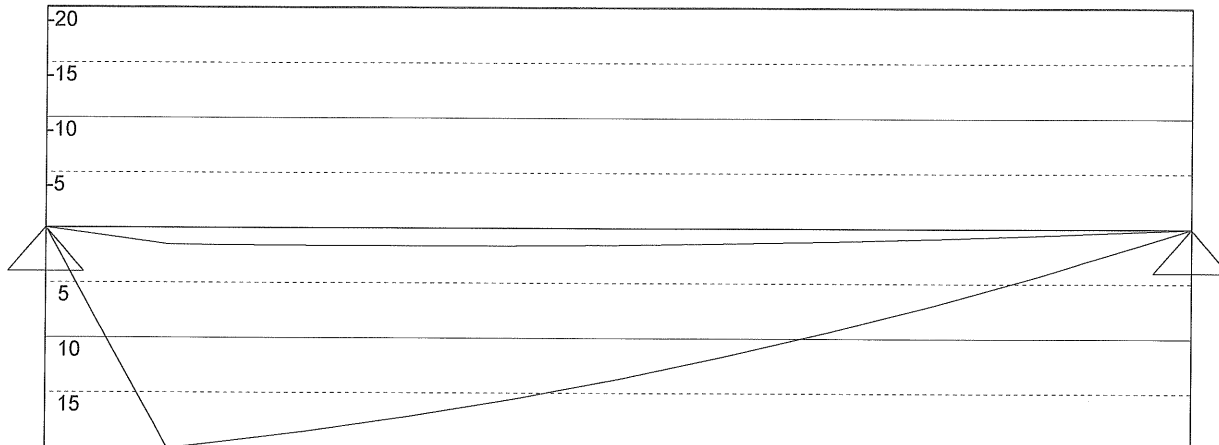

Licensed to: FINNLAMELLI OY

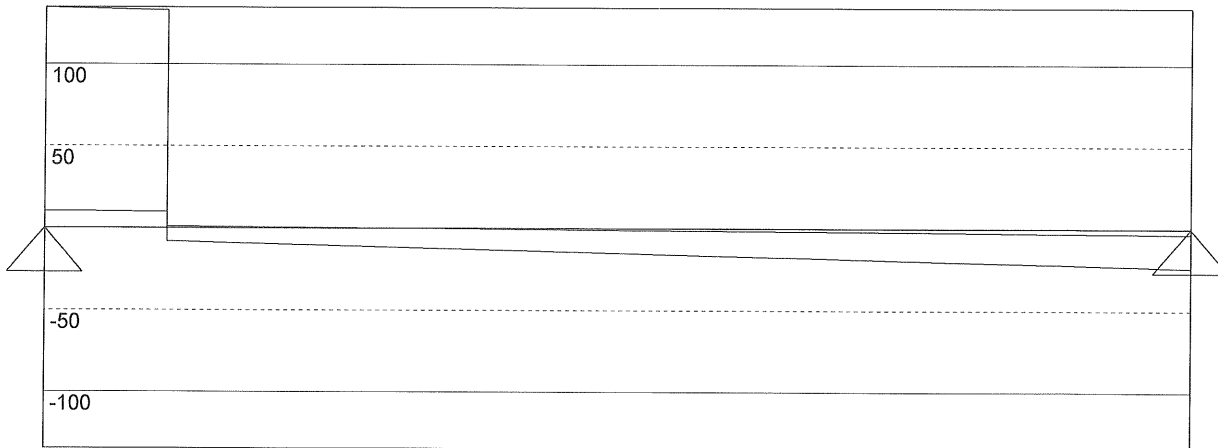

Load factor of dead load = 1.2 Load factor of imposed load = 1.6
 Load width 2.9 (m) (by which the loads has been multiplied during calculation)
 Max/Min reactions of beam [kN]
 134,715 24,026
 10,364 3,387

T24 656 x 260 B 2 Cf=1,00 Design method: Ultimate limit design
 Factored Moment/Moment capacity [kNm] 20,064 113,707 18 %
 Factored shear force/shear capacity [kN] 134,715 174,933 77 %

(4) Logs

Deflection due to unfactored load (Deflection limit L/360)
 0,3 mm (8 %)



Company:	Ensign Engineering	Date:	6/11/2018
Engineer:	Alex Hawkins, P.E.	Page:	1/5
Project:			
Address:	45 W 10000 S Ste. 500		
Phone:	801-255-0529		
E-mail:	ahawkins@ensigneng.com		

1. Project information

Customer company:
Customer contact name:
Customer e-mail:
Comment:

Project description:
Location: Utah
Fastening description:

2. Input Data & Anchor Parameters

General

Design method: ACI 318-14
Units: Imperial units

Anchor Information:

Anchor type: Concrete screw
Material: Carbon Steel
Diameter (inch): 0.750
Nominal Embedment depth (inch): 6.000
Effective Embedment depth, h_{ef} (inch): 4.640
Code report: ICC-ES ESR-2713
Anchor category: 1
Anchor ductility: No
 h_{min} (inch): 9.58
 C_{ac} (inch): 7.00
 C_{min} (inch): 1.75
 S_{min} (inch): 3.00

Base Material

Concrete: Normal-weight
Concrete thickness, h (inch): 120.00
State: Cracked
Compressive strength, f'_c (psi): 3000
 $\Psi_{c,v}$: 1.0
Reinforcement condition: B tension, B shear
Supplemental reinforcement: Not applicable
Reinforcement provided at corners: No
Ignore concrete breakout in tension: No
Ignore concrete breakout in shear: No
Ignore 6do requirement: Not applicable
Build-up grout pad: No

Base Plate

Length x Width x Thickness (inch): 10.00 x 10.00 x 0.81

Recommended Anchor

Anchor Name: Titen HD® - 3/4"Ø Titen HD, h_{nom} : 6" (152mm)
Code Report: ICC-ES ESR-2713



Input data and results must be checked for agreement with the existing circumstances, the standards and guidelines must be checked for plausibility.



Anchor Designer™
Software
 Version 2.6.6682.21

Company:	Ensign Engineering	Date:	6/11/2018
Engineer:	Alex Hawkins, P.E.	Page:	2/5
Project:			
Address:	45 W 10000 S Ste. 500		
Phone:	801-255-0529		
E-mail:	ahawkins@ensigneng.com		


Load and Geometry

Load factor source: ACI 318 Section 5.3
 Load combination: not set
 Seismic design: No
 Anchors subjected to sustained tension: Not applicable
 Apply entire shear load at front row: No
 Anchors only resisting wind and/or seismic loads: No

Strength level loads:

N_{ua} [lb]: 3180
 V_{uax} [lb]: 0
 V_{uay} [lb]: 0
 M_{ux} [ft-lb]: 0
 M_{uy} [ft-lb]: 0
 M_{uz} [ft-lb]: 0

<Figure 1>

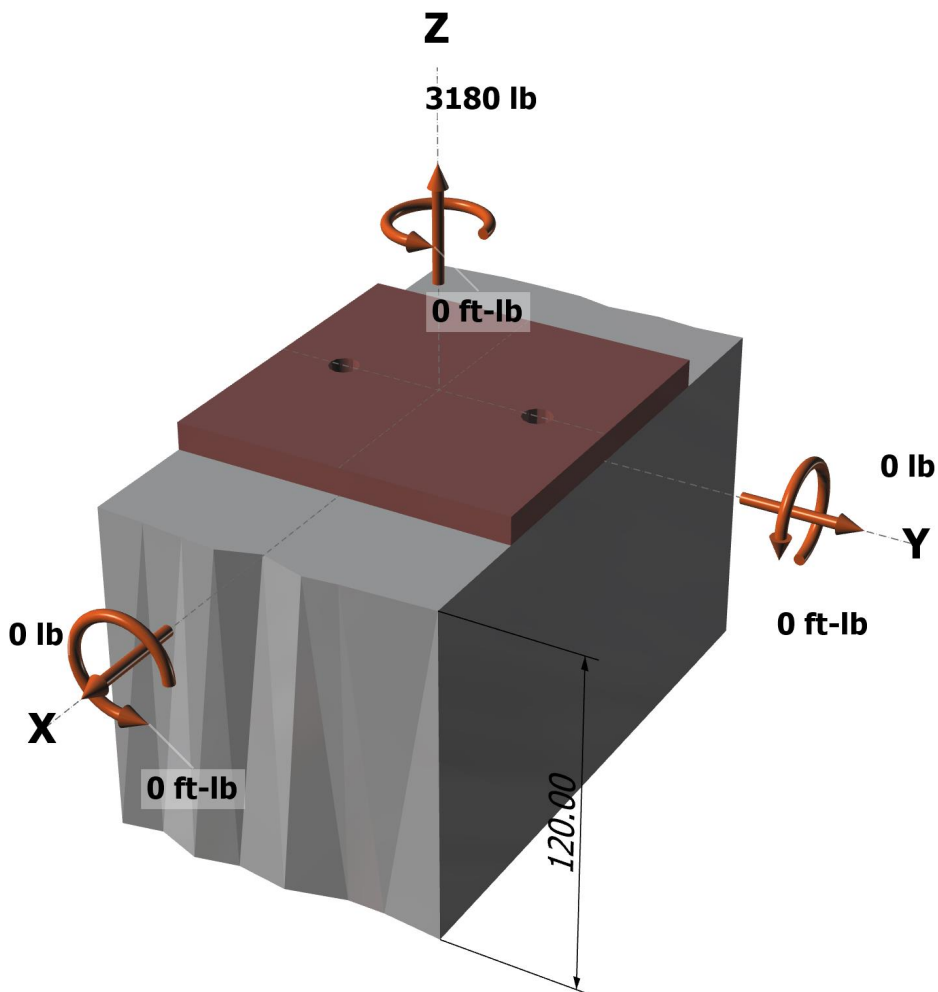


Input data and results must be checked for agreement with the existing circumstances, the standards and guidelines must be checked for plausibility.



Anchor Designer™
Software
Version 2.6.6682.21

Company:	Ensign Engineering	Date:	6/11/2018
Engineer:	Alex Hawkins, P.E.	Page:	3/5
Project:			
Address:	45 W 10000 S Ste. 500		
Phone:	801-255-0529		
E-mail:	ahawkins@ensigneng.com		

<Figure 2>

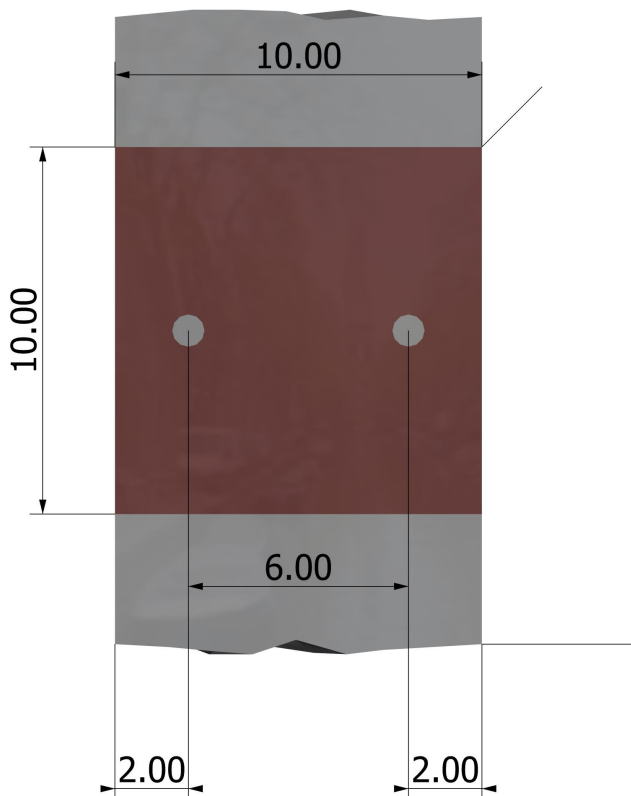


Company:	Ensign Engineering	Date:	6/11/2018
Engineer:	Alex Hawkins, P.E.	Page:	4/5
Project:			
Address:	45 W 10000 S Ste. 500		
Phone:	801-255-0529		
E-mail:	ahawkins@ensigneng.com		

3. Resulting Anchor Forces

Anchor	Tension load, N_{ua} (lb)	Shear load x, V_{uax} (lb)	Shear load y, V_{uay} (lb)	Shear load combined, $\sqrt{(V_{uax})^2+(V_{uay})^2}$ (lb)
1	1590.0	0.0	0.0	0.0
2	1590.0	0.0	0.0	0.0
Sum	3180.0	0.0	0.0	0.0

Maximum concrete compression strain (%): 0.00
 Maximum concrete compression stress (psi): 0
 Resultant tension force (lb): 3180
 Resultant compression force (lb): 0
 Eccentricity of resultant tension forces in x-axis, e'_{Nx} (inch): 0.00
 Eccentricity of resultant tension forces in y-axis, e'_{Ny} (inch): 0.00

<Figure 3>

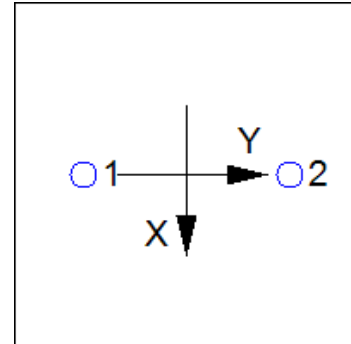

4. Steel Strength of Anchor in Tension (Sec. 17.4.1)

N_{sa} (lb)	ϕ	ϕN_{sa} (lb)
45540	0.65	29601

5. Concrete Breakout Strength of Anchor in Tension (Sec. 17.4.2)

$$N_b = k_c \lambda_a \sqrt{f_c} h_{ef}^{1.5} \text{ (Eq. 17.4.2.2a)}$$

k_c	λ_a	f_c (psi)	h_{ef} (in)	N_b (lb)
17.0	1.00	3000	4.640	9307

$$\phi N_{cbg} = \phi (A_{Nc} / A_{Nco}) \Psi_{ec,N} \Psi_{ed,N} \Psi_{c,N} \Psi_{cp,N} N_b \text{ (Sec. 17.3.1 \& Eq. 17.4.2.1b)}$$

A_{Nc} (in ²)	A_{Nco} (in ²)	$c_{a,min}$ (in)	$\Psi_{ec,N}$	$\Psi_{ed,N}$	$\Psi_{c,N}$	$\Psi_{cp,N}$	N_b (lb)	ϕ	ϕN_{cbg} (lb)
139.20	193.77	2.00	1.000	0.786	1.00	1.000	9307	0.65	3417

6. Pullout Strength of Anchor in Tension (Sec. 17.4.3)

$$\phi N_{pn} = \phi \Psi_{c,P} \lambda_a N_p (f_c / 2,500)^n \text{ (Sec. 17.3.1, Eq. 17.4.3.1 \& Code Report)}$$

$\Psi_{c,P}$	λ_a	N_p (lb)	f_c (psi)	n	ϕ	ϕN_{pn} (lb)
1.0	1.00	6820	3000	0.50	0.65	4856

Input data and results must be checked for agreement with the existing circumstances, the standards and guidelines must be checked for plausibility.



Anchor Designer™
Software
Version 2.6.6682.21

Company:	Ensign Engineering	Date:	6/11/2018
Engineer:	Alex Hawkins, P.E.	Page:	5/5
Project:			
Address:	45 W 10000 S Ste. 500		
Phone:	801-255-0529		
E-mail:	ahawkins@ensigneng.com		

11. Results

11. Interaction of Tensile and Shear Forces (Sec. D.7)?

Tension	Factored Load, N_{ua} (lb)	Design Strength, ϕN_n (lb)	Ratio	Status
Steel	1590	29601	0.05	Pass
Concrete breakout	3180	3417	0.93	Pass (Governs)
Pullout	1590	4856	0.33	Pass

3/4"Ø Titen HD, hnom:6" (152mm) meets the selected design criteria.

12. Warnings


- Designer must exercise own judgement to determine if this design is suitable.
- Refer to manufacturer's product literature for hole cleaning and installation instructions.

Beam Id: Lot # 70 - RB /


Date 17-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

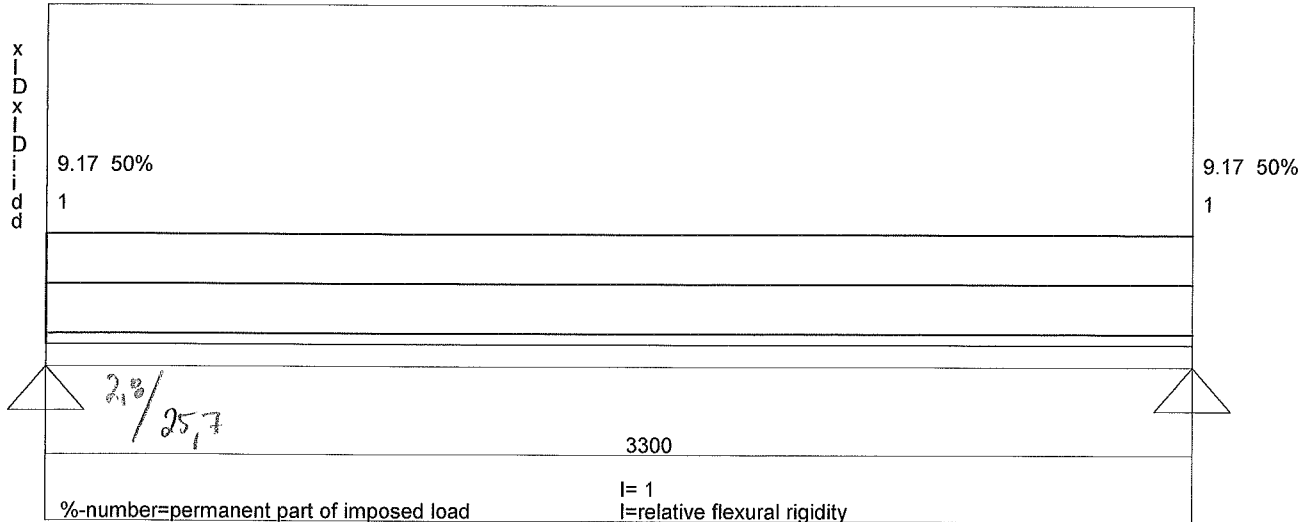

Licensed to: FINNLAMELLI OY

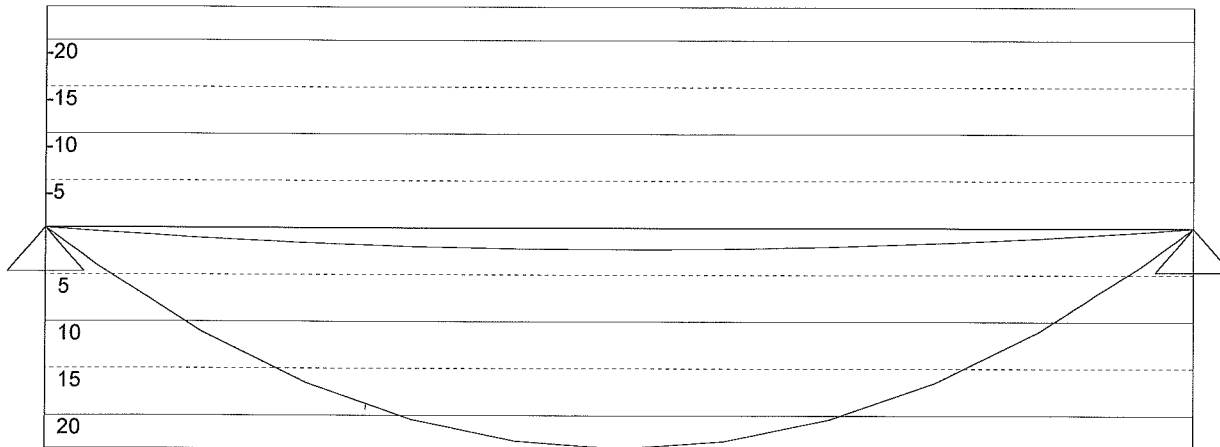

Licensed to: FINNLAMELLI OY

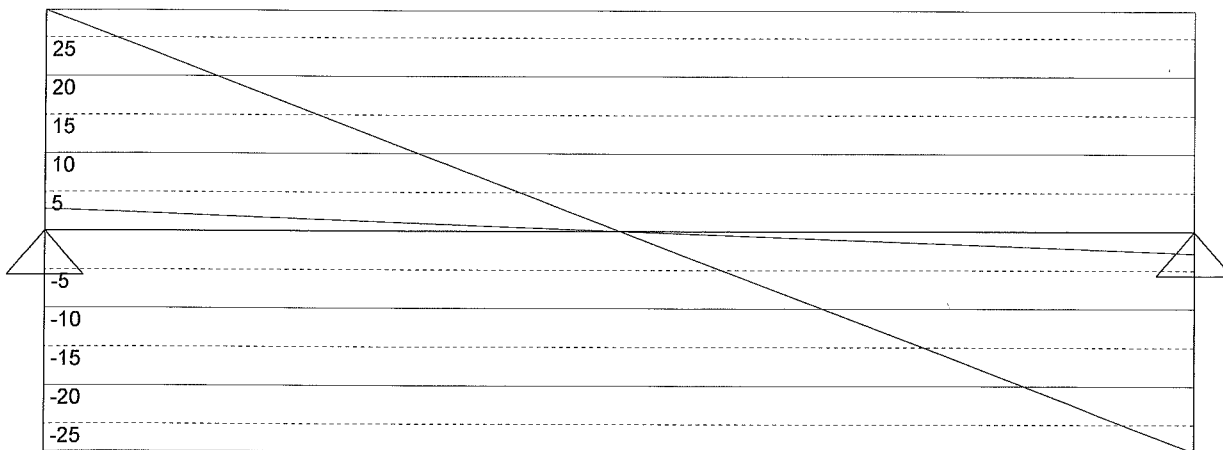

Load factor of dead load= 1 Load factor of imposed load= 1

Load width 1.7 (m) (by which the loads has been multiplied during calculation)

Max/Min reactions of beam [kN]

28,521 28,527
2,804 2,805

KER 114 x 300 B 2 Cf=1,00 Design method: Allowable stress design

Increasing factor of the allowable stress 1,03

Factored Moment/Moment capacity [kNm] 23,535 31,556 75 %

Factored shear force/shear capacity [kN] 28,521 39,737 72 %

(3) LVL 112 x 117/8 ✓

Deflection due to unfactored load (Deflection limit L/240)


10,0 mm (73 %)

Beam Id: Lot # 70 - RB 2


Date 18-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

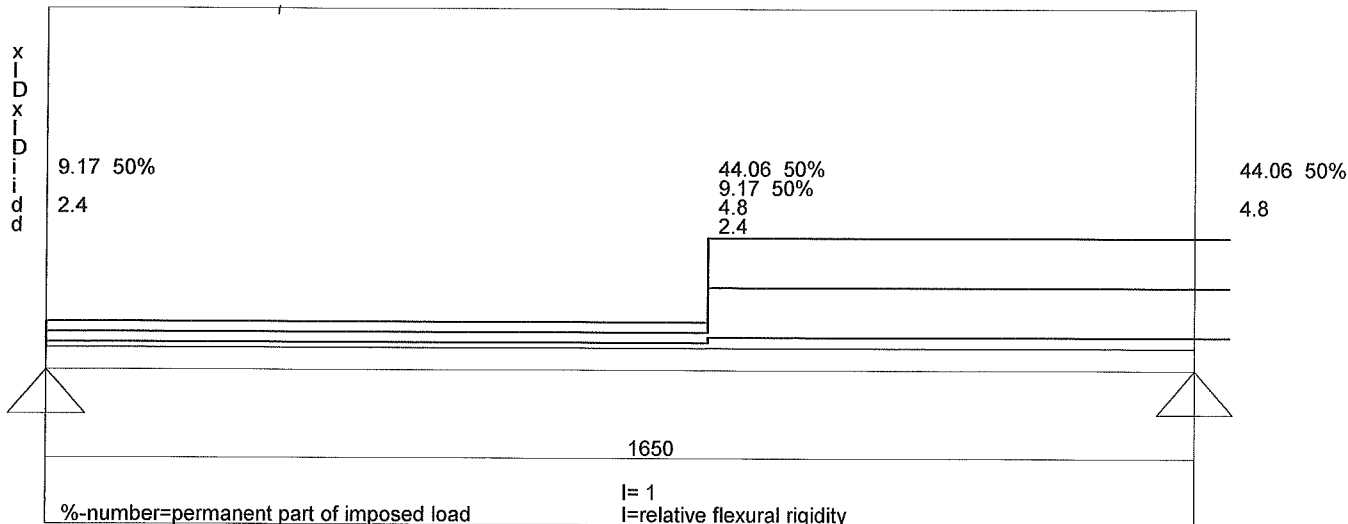

Licensed to: FINNLAMELLI OY

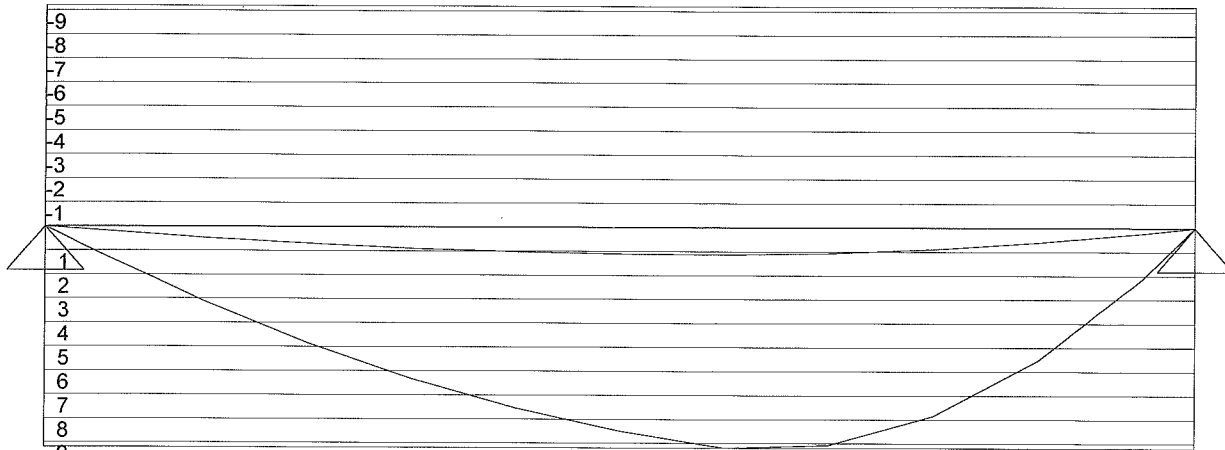

Licensed to: FINNLAMELLI OY

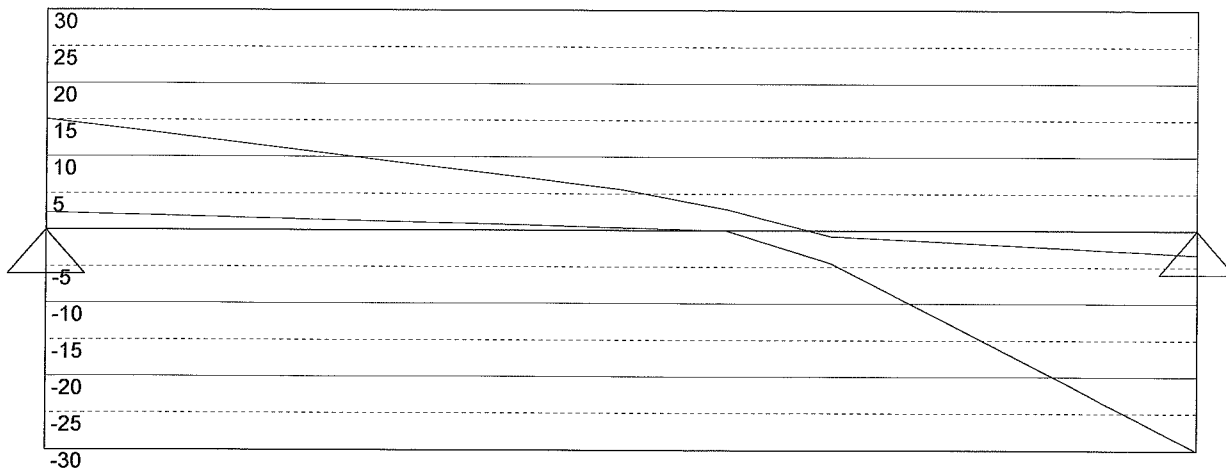

Load factor of dead load= 1 Load factor of imposed load= 1
 Load width 1 (m) (by which the loads has been multiplied during calculation)
 Max/Min reactions of beam [kN]
 15,080 30,111
 2,336 3,304

KER 114 x 300 B 2 Cf=1,00 Design method: Allowable stress design
 Increasing factor of the allowable stress 1,03
 Factored Moment/Moment capacity [kNm] 9,194 31,648 29 %
 Factored shear force/shear capacity [kN] 30,103 39,853 76 %

(3) LVL 1/2 x 11 3/8 ✓


Deflection due to unfactored load (Deflection limit L/240)
 0,9 mm (14 %)

Beam Id: Lot # 70 - RB 3


Date 18-05-2018

Structural Engineer:


Licensed to: FINNLAMELLI OY

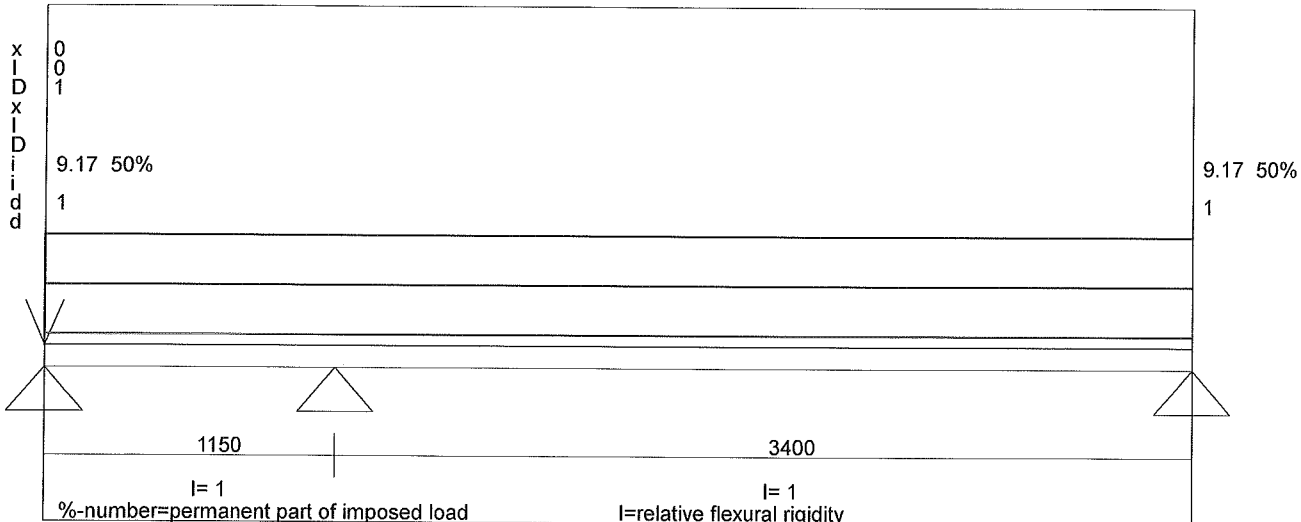

Licensed to: FINNLAMELLI OY

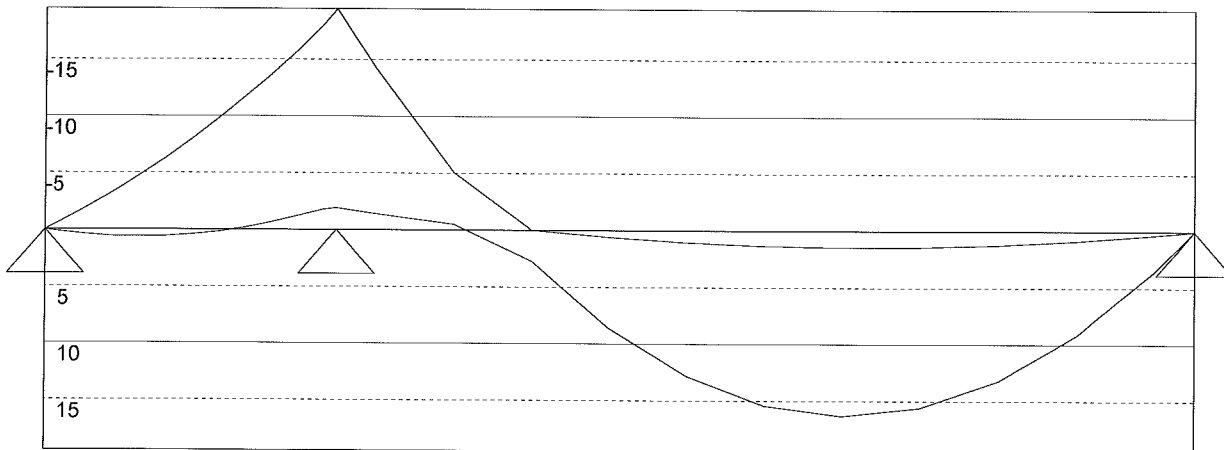

Licensed to: FINNLAMELLI OY

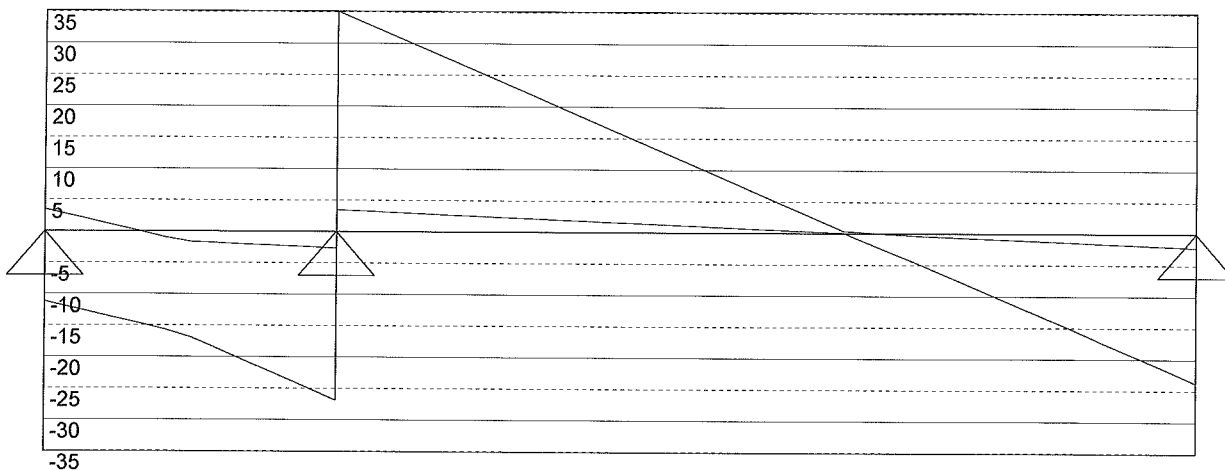

Load factor of dead load= 1 Load factor of imposed load= 1
 Load width 1.7 (m) (by which the loads
 has been multiplied during calculation)
 Max/Min reactions of beam [kN]
 4,510 61,976 23,762
 -10,184 6,094 2,231

KER 114 x 300 B 2 Cf=1,00 Design method: Allowable stress design
 Increasing factor of the allowable stress 1,03
 Factored Moment/Moment capacity [kNm] 19,462 31,556 62 %
 Factored shear force/shear capacity [kN] 35,111 39,737 88 %


(3) LVL $1\frac{1}{2} \times 11\frac{7}{8}$ ✓

Deflection due to unfactored load (Deflection limit L/240)
 0,0 mm (0 %) 6,1 mm (43 %)

Lot 70


ROOF LOADS

$SNOW = 188 \text{ psp} = 9,17 \text{ kN/m}$

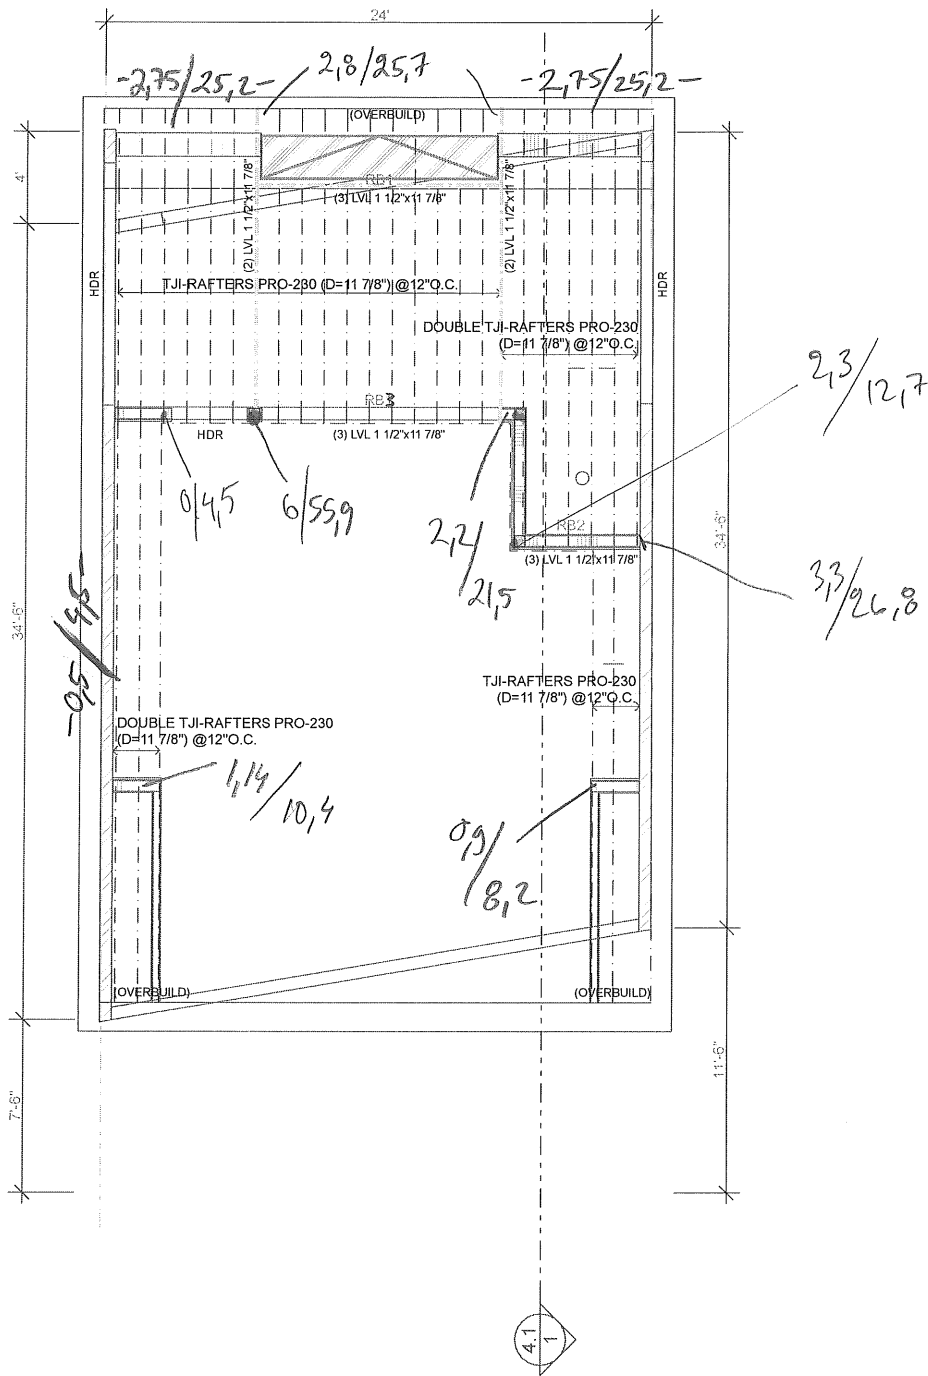

LOT 70

ROOF "LEVEL" LOADS
(FLOOR)

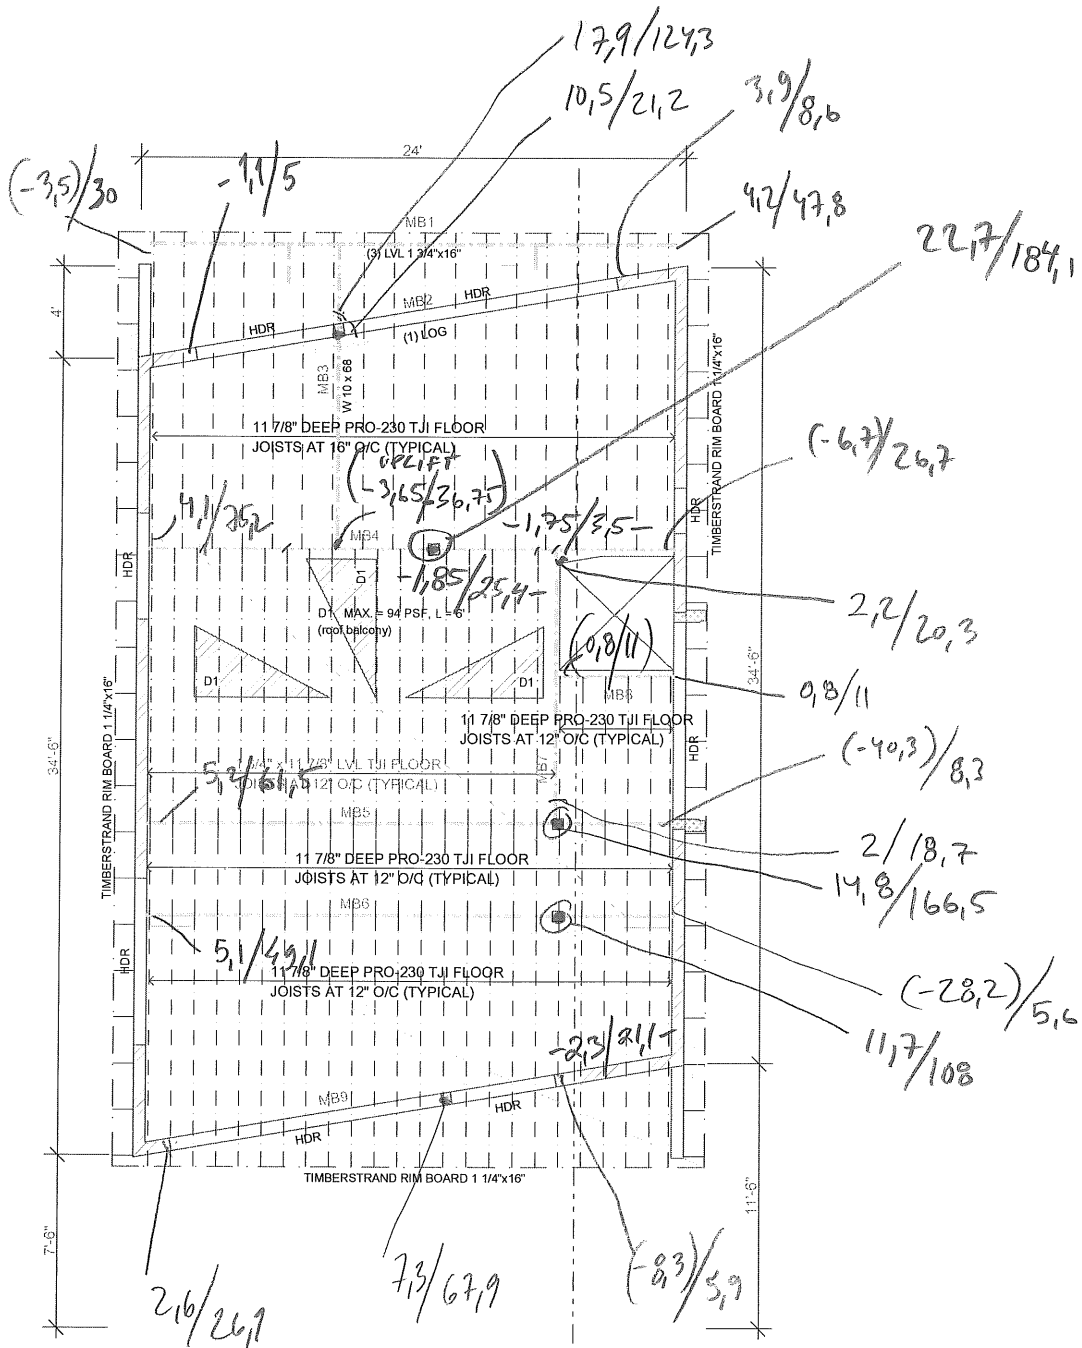


1 UPPER LEVEL FRAMING PLAN
S4



LOT 70


MAIN FLOOR LOADS

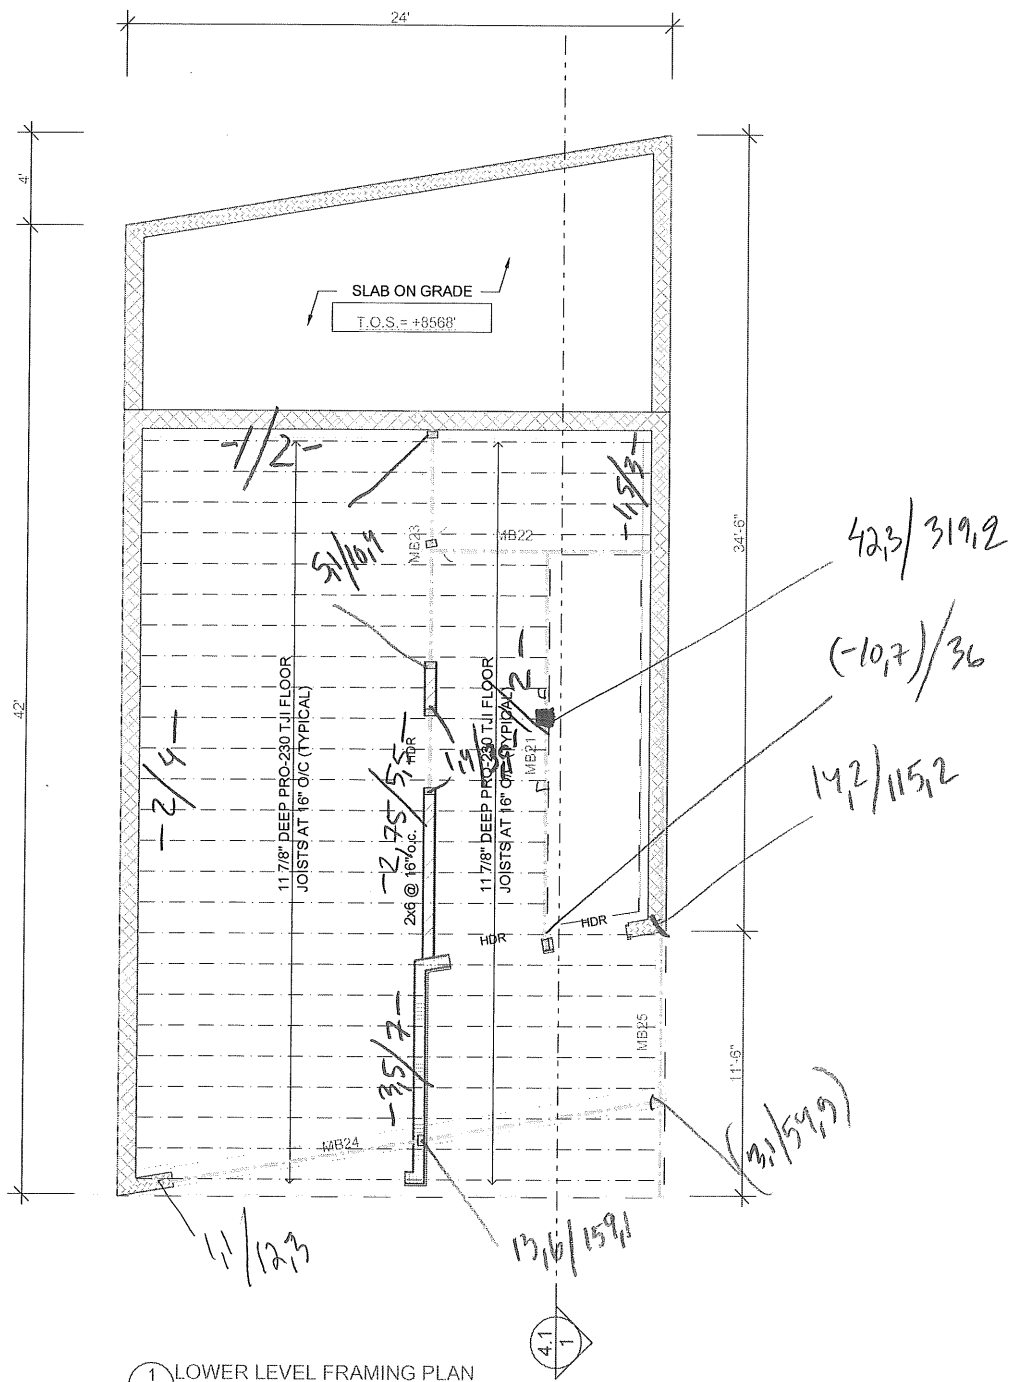

1 LOWER LEVEL FRAMING PLAN
S2

Lot 70

FOOTING LOADS

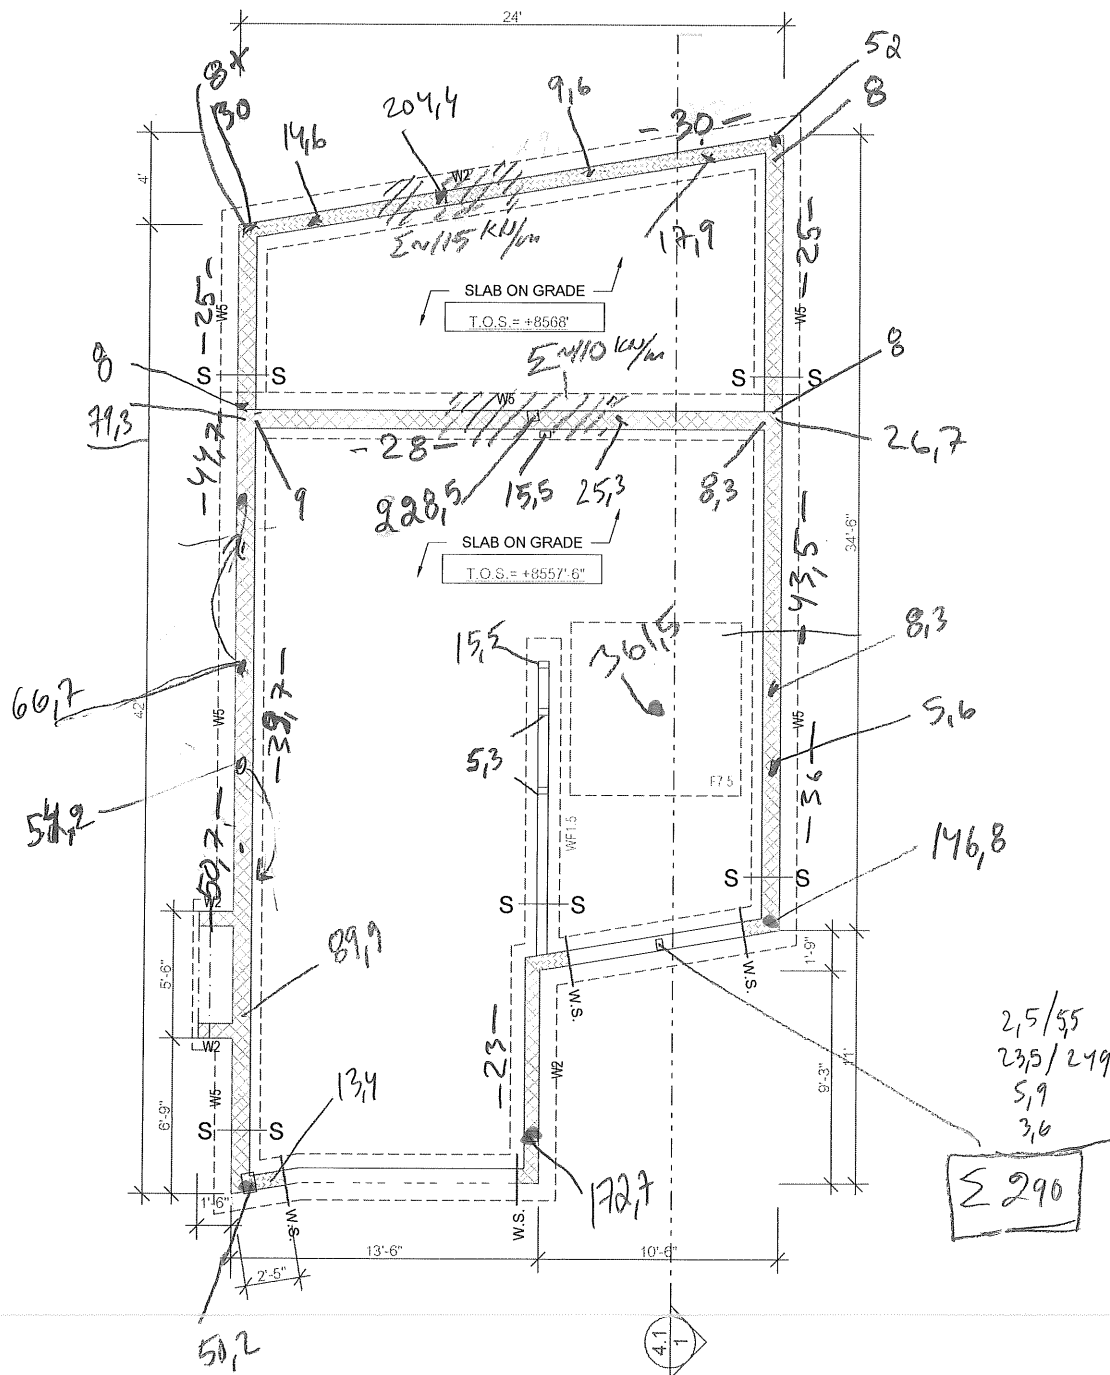

1
S1 FOOTING AND FOUNDATION PLAN

Wood Beam

File = P:\8332 Powder Mountain 70\Structural Calcs\3 Sided Diaphragms.ec6

Lic. #: KW-06004069

Licensee : ENSIGN ENGINEERING

Description : MB1

CODE REFERENCES

Calculations per NDS 2015, IBC 2015, CBC 2016, ASCE 7-10

Load Combination Set : ASCE 7-10

Material Properties

Analysis Method : Allowable Stress Design

Load Combination : ASCE 7-10

Wood Species : Trus Joist

Wood Grade : MicroLam LVL 2.0 E

Beam Bracing : Beam is Fully Braced against lateral-torsional buckling

Fb + 2,600.0 psi

Fb - 2,600.0 psi

Fc - Prll 2,510.0 psi

Fc - Perp 750.0 psi

Fv 285.0 psi


Ft 1,555.0 psi

E : Modulus of Elasticity

Ebend- xx 2,000.0 ksi

Eminbend - xx 1,016.54 ksi

Density 42.0 pcf

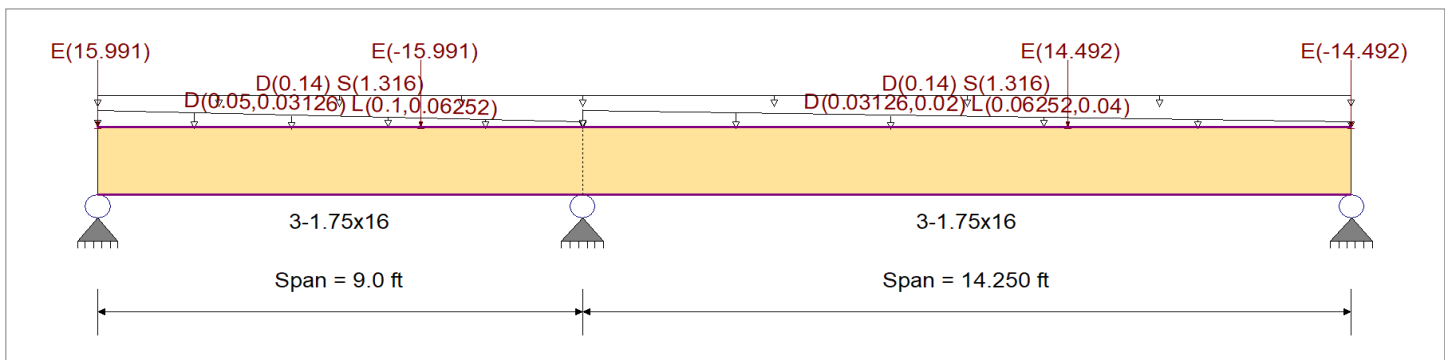

Applied Loads

Service loads entered. Load Factors will be applied for calculations.

Load for Span Number 1

Varying Uniform Load : D= 0.020->0.020, L= 0.040->0.040 ksf, Extent = 0.0 -->> 9.0 ft, Trib Width = 2.50->1.563 ft, (Floor)

Uniform Load : D = 0.020, S = 0.1880 ksf, Tributary Width = 7.0 ft, (Roof)

Point Load : E = 15.991 k @ 0.0 ft, (Hold Down)

Point Load : E = -15.991 k @ 6.0 ft, (Hold Down)

Load for Span Number 2

Varying Uniform Load : D= 0.020->0.020, L= 0.040->0.040 ksf, Extent = 0.0 -->> 14.250 ft, Trib Width = 1.563->1.0 ft, (Floor)

Uniform Load : D = 0.020, S = 0.1880 ksf, Tributary Width = 7.0 ft, (Roof)

Point Load : E = 14.492 k @ 9.0 ft, (Hold Down)

Point Load : E = -14.492 k @ 14.250 ft, (Hold Down)

Wood Beam

File = P:\8332 Powder Mountain 70\Structural Calcs\3 Sided Diaphragms.ec6

Lic. #: KW-06004069

Licensee: ENSIGN ENGINEERING

Description: MB1

DESIGN SUMMARY

Design OK

Maximum Bending Stress Ratio	=	0.573 : 1	Maximum Shear Stress Ratio	=	0.583 : 1
Section used for this span		3-1.75x16	Section used for this span		3-1.75x16
fb : Actual	=	2,293.97 psi	fv : Actual	=	191.17 psi
FB : Allowable	=	4,000.38 psi	Fv : Allowable	=	327.75 psi
Load Combination		+D+0.750L+0.750S+0.5250E	Load Combination		+D+S
Location of maximum on span	=	8.996 ft	Location of maximum on span	=	9.000 ft
Span # where maximum occurs	=	Span # 2	Span # where maximum occurs	=	Span # 1
Maximum Deflection					
Max Downward Transient Deflection		0.328 in	Ratio =		521 >=360
Max Upward Transient Deflection		0.000 in	Ratio =		0 <360
Max Downward Total Deflection		0.341 in	Ratio =		501 >=240
Max Upward Total Deflection		0.000 in	Ratio =		0 <240

Maximum Forces & Stresses for Load Combinations

Load Combination	Segment Length	Span #	Max Stress Ratios								Moment Values			Shear Values				
			M	V	C _d	C _{FN}	C _i	C _r	C _m	C _t	C _L	M	fb	F'b	V	fv	F'v	
D Only																		
Length = 9.0 ft	1		0.078	0.084	0.90	0.962	1.00	1.00	1.00	1.00	1.00	3.29	176.15	2250.22	0.00	0.00	0.00	0.00
Length = 14.250 ft	2		0.078	0.084	0.90	0.962	1.00	1.00	1.00	1.00	1.00	3.29	176.15	2250.22	0.00	0.00	0.00	0.00
+D+L						0.962	1.00	1.00	1.00	1.00	1.00			0.00	0.00	0.00	0.00	0.00
Length = 9.0 ft	1		0.095	0.100	1.00	0.962	1.00	1.00	1.00	1.00	1.00	4.41	236.29	2500.24	1.60	28.56	285.00	285.00
Length = 14.250 ft	2		0.095	0.100	1.00	0.962	1.00	1.00	1.00	1.00	1.00	4.41	236.29	2500.24	1.60	28.56	285.00	285.00
+D+S						0.962	1.00	1.00	1.00	1.00	1.00			0.00	0.00	0.00	0.00	0.00
Length = 9.0 ft	1		0.539	0.583	1.15	0.962	1.00	1.00	1.00	1.00	1.00	28.92	1,549.25	2875.28	10.71	191.17	327.75	327.75
Length = 14.250 ft	2		0.539	0.583	1.15	0.962	1.00	1.00	1.00	1.00	1.00	28.92	1,549.25	2875.28	10.71	191.17	327.75	327.75
+D+0.750L						0.962	1.00	1.00	1.00	1.00	1.00			0.00	0.00	0.00	0.00	0.00
Length = 9.0 ft	1		0.071	0.075	1.25	0.962	1.00	1.00	1.00	1.00	1.00	4.13	221.26	3125.30	1.50	26.80	356.25	356.25
Length = 14.250 ft	2		0.071	0.075	1.25	0.962	1.00	1.00	1.00	1.00	1.00	4.13	221.26	3125.30	1.50	26.80	356.25	356.25
+D+0.750L+0.750S						0.962	1.00	1.00	1.00	1.00	1.00			0.00	0.00	0.00	0.00	0.00
Length = 9.0 ft	1		0.435	0.470	1.15	0.962	1.00	1.00	1.00	1.00	1.00	23.35	1,251.08	2875.28	8.63	154.02	327.75	327.75
Length = 14.250 ft	2		0.435	0.470	1.15	0.962	1.00	1.00	1.00	1.00	1.00	23.35	1,251.08	2875.28	8.63	154.02	327.75	327.75
+D+0.70E						0.962	1.00	1.00	1.00	1.00	1.00			0.00	0.00	0.00	0.00	0.00
Length = 9.0 ft	1		0.368	0.237	1.60	0.962	1.00	1.00	1.00	1.00	1.00	27.47	1,471.41	4000.38	6.05	108.05	456.00	456.00
Length = 14.250 ft	2		0.452	0.260	1.60	0.962	1.00	1.00	1.00	1.00	1.00	33.77	1,809.27	4000.38	6.64	118.62	456.00	456.00
+D+0.750L+0.750S+0.5250E						0.962	1.00	1.00	1.00	1.00	1.00			0.00	0.00	0.00	0.00	0.00
Length = 9.0 ft	1		0.382	0.462	1.60	0.962	1.00	1.00	1.00	1.00	1.00	28.52	1,527.67	4000.38	11.79	210.55	456.00	456.00
Length = 14.250 ft	2		0.573	0.462	1.60	0.962	1.00	1.00	1.00	1.00	1.00	42.82	2,293.97	4000.38	11.79	210.55	456.00	456.00
+0.60D						0.962	1.00	1.00	1.00	1.00	1.00			0.00	0.00	0.00	0.00	0.00
Length = 9.0 ft	1		0.026	0.028	1.60	0.962	1.00	1.00	1.00	1.00	1.00	1.97	105.69	4000.38	0.72	12.93	456.00	456.00
Length = 14.250 ft	2		0.026	0.028	1.60	0.962	1.00	1.00	1.00	1.00	1.00	1.97	105.69	4000.38	0.72	12.93	456.00	456.00
+0.60D+0.70E						0.962	1.00	1.00	1.00	1.00	1.00			0.00	0.00	0.00	0.00	0.00
Length = 9.0 ft	1		0.365	0.247	1.60	0.962	1.00	1.00	1.00	1.00	1.00	27.24	1,459.31	4000.38	6.31	112.67	456.00	456.00
Length = 14.250 ft	2		0.438	0.249	1.60	0.962	1.00	1.00	1.00	1.00	1.00	32.70	1,751.62	4000.38	6.36	113.48	456.00	456.00

Overall Maximum Deflections

Load Combination	Span	Max. "-" Defl	Location in Span	Load Combination	Max. "+" Defl	Location in Span
+D+0.750L+0.750S+0.5250E	1	0.0000	0.000	E Only	-0.1262	4.978
	2	0.3407	7.881		0.0000	4.978

Vertical Reactions

Support notation : Far left is #1

Values in KIPS

Load Combination	Support 1	Support 2	Support 3
Overall MAXimum	9.568	22.533	8.514
Overall MINimum	9.568	-3.539	-6.029
D Only	0.462	2.588	0.936
+D+L	0.731	3.521	1.196
+D+S	3.536	22.533	8.514
+D+0.750L	0.663	3.288	1.131
+D+0.750L+0.750S	2.969	18.247	6.814



Ensign Engineering
 45 West 10000 South, Suite 500
 Sandy, Utah 84070
 P: (801) 255-0529

Project Title: Powder Mountain
 Engineer: Alex Hawkins
 Project ID: 8332
 Project Descr:

Printed: 1 AUG 2018, 2:11PM

Wood Beam

File = P:\8332 Powder Mountain 70\Structural Calcs\3 Sided Diaphragms.ec6

Lic. # : KW-06004069

Licensee : ENSIGN ENGINEERING

Description : MB1

Vertical Reactions

Support notation : Far left is #1

Values in KIPS

Load Combination	Support 1	Support 2	Support 3
+D+0.70E	7.159	0.111	-3.284
+D+0.750L+0.750S+0.5250E	7.992	16.389	3.649
+0.60D	0.277	1.553	0.562
+0.60D+0.70E	6.975	-0.924	-3.659
L Only	0.269	0.933	0.260
S Only	3.074	19.945	7.578
E Only	9.568	-3.539	-6.029

Steel Beam

File = P:\8332 Powder Mountain 70\Structural Calcs\3 Sided Diaphragms.ec6

Lic. #: KW-06004069

Licensee : ENSIGN ENGINEERING

Description : MB3

Load Combination	Segment Length	Span #	Max Stress Ratios		Summary of Moment Values						Summary of Shear Values			
			M	V	Mmax +	Mmax -	Ma Max	Mnx	Mnx/Omega	Cb	Rm	Va Max	Vnx	Vnx/Omega
Dsgn. L = 9.50 ft	9.50 ft	1	0.018	0.010										
Dsgn. L = 4.00 ft	4.00 ft	2	0.018	0.010		-3.89	3.89	355.42	212.82	1.00	1.00	1.01	146.64	97.76
+D+0.750L+0.750S+0.5250E														
Dsgn. L = 9.50 ft	9.50 ft	1	0.322	0.176		-68.43	68.43	355.42	212.82	1.00	1.00	17.21	146.64	97.76
Dsgn. L = 4.00 ft	4.00 ft	2	0.322	0.176		-68.43	68.43	355.42	212.82	1.00	1.00	17.21	146.64	97.76
+0.60D														
Dsgn. L = 9.50 ft	9.50 ft	1	0.030	0.016		-6.31	6.31	355.42	212.82	1.00	1.00	1.60	146.64	97.76
Dsgn. L = 4.00 ft	4.00 ft	2	0.030	0.016		-6.31	6.31	355.42	212.82	1.00	1.00	1.60	146.64	97.76
+0.60D+0.70E														
Dsgn. L = 9.50 ft	9.50 ft	1	0.002	0.001	0.34		0.34	355.42	212.82	1.00	1.00	0.09	146.64	97.76
Dsgn. L = 4.00 ft	4.00 ft	2	0.001	0.001	0.31		0.31	355.42	212.82	1.00	1.00	0.10	146.64	97.76

Overall Maximum Deflections

Load Combination	Span	Max. "-" Defl	Location in Span	Load Combination	Max. "+" Defl	Location in Span
	1	0.0000	0.000	+D+S	-0.0792	5.510
+D+S	2	0.2451	4.000		0.0000	5.510

Vertical Reactions

Support notation : Far left is #1

Values in KIPS

Load Combination	Support 1	Support 2	Support 3
Overall MAXimum	-9.411	32.217	
Overall MINimum	0.090	-0.030	
D Only	-1.012	3.870	
+D+L	-1.248	5.579	
+D+S	-9.411	32.217	
+D+0.750L	-1.189	5.152	
+D+0.750L+0.750S	-7.488	26.412	
+D+0.70E	-0.315	1.518	
+D+0.750L+0.750S+0.5250E	-6.966	24.648	
+0.60D	-0.607	2.322	
+0.60D+0.70E	0.090	-0.030	
L Only	-0.237	1.710	
S Only	-8.399	28.347	
E Only	0.995	-3.359	

Steel Beam

File = P:\8332 Powder Mountain 70\Structural Calcs\3 Sided Diaphragms.ec6

Lic. #: KW-06004069

Licensee: ENSIGN ENGINEERING

Description: MB4


CODE REFERENCES

Calculations per AISC 360-10, IBC 2015, CBC 2016, ASCE 7-10
Load Combination Set: ASCE 7-10

Material Properties

Analysis Method: Allowable Strength Design
Beam Bracing: Beam is Fully Braced against lateral-torsional buckling
Bending Axis: Major Axis Bending

Fy: Steel Yield: 50.0 ksi
E: Modulus: 29,000.0 ksi

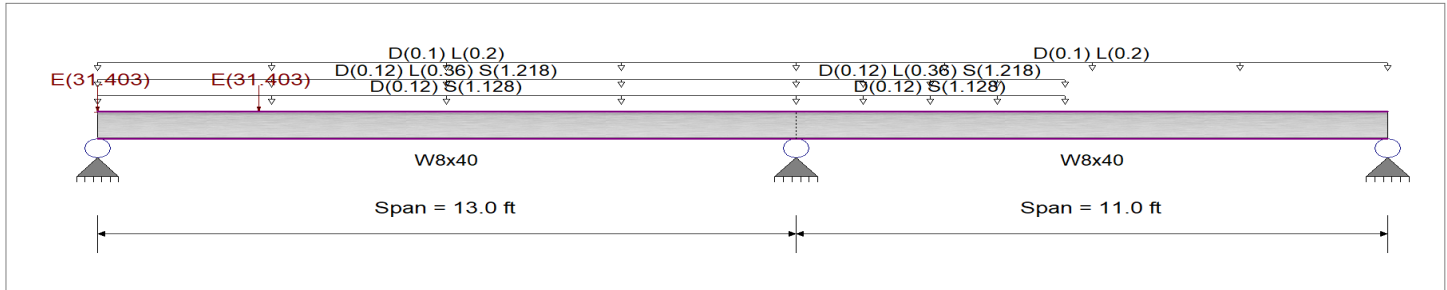

Applied Loads

Service loads entered. Load Factors will be applied for calculations.

Beam self weight NOT internally calculated and added

Load for Span Number 1

Uniform Load: D = 0.020, S = 0.1880 ksf, Tributary Width = 6.0 ft, (Roof)

Uniform Load: D = 0.020, L = 0.060, S = 0.2030 ksf, Tributary Width = 6.0 ft, (Balcony)

Uniform Load: D = 0.020, L = 0.040 ksf, Tributary Width = 5.0 ft, (Floor)

Point Load: E = 31.403 k @ 3.0 ft, (Hold Down)

Point Load: E = 31.403 k @ 0.0 ft, (Hold Down)

Load for Span Number 2

Uniform Load: D = 0.020, S = 0.1880 ksf, Extent = 0.0 ---> 5.0 ft, Tributary Width = 6.0 ft, (Roof)

Uniform Load: D = 0.020, L = 0.060, S = 0.2030 ksf, Extent = 0.0 ---> 5.0 ft, Tributary Width = 6.0 ft, (Balcony)

Uniform Load: D = 0.020, L = 0.040 ksf, Tributary Width = 5.0 ft, (Floor)

DESIGN SUMMARY

Design OK

Maximum Bending Stress Ratio =	0.648 : 1	Maximum Shear Stress Ratio =	0.423 : 1
Section used for this span	W8x40	Section used for this span	W8x40
Ma : Applied	64.303 k-ft	Va : Applied	25.135 k
Mn / Omega : Allowable	99.301 k-ft	Vn/Omega : Allowable	59.40 k
Load Combination	+D+0.750L+0.750S+0.5250E	Load Combination	+D+0.750L+0.750S+0.5250E
Location of maximum on span	3.432ft	Location of maximum on span	0.000 ft
Span # where maximum occurs	Span # 1	Span # where maximum occurs	Span # 1
Maximum Deflection			
Max Downward Transient Deflection	0.290 in	Ratio =	537 >=480
Max Upward Transient Deflection	-0.077 in	Ratio =	1,707 >=480
Max Downward Total Deflection	0.372 in	Ratio =	419 >=360
Max Upward Total Deflection	-0.069 in	Ratio =	1908 >=360

Maximum Forces & Stresses for Load Combinations

Load Combination	Segment Length	Span #	Max Stress Ratios		Summary of Moment Values						Summary of Shear Values				
			M	V	Mmax +	Mmax -	Ma Max	Mnx	Mnx/Omega	Cb	Rm	Va Max	Vnx	Vnx/Omega	
D Only															
Dsgn. L = 13.00 ft		1	0.054	0.044	4.73	-5.40	5.40	165.83	99.30	1.00	1.00	2.63	89.10	59.40	

Steel Beam

File = P:\8332 Powder Mountain 70\Structural Calcs\3 Sided Diaphragms.ec6

Lic. #: KW-06004069

Licensee : ENSIGN ENGINEERING

Description : MB4

Load Combination	Segment Length	Span #	Max Stress Ratios		Summary of Moment Values						Summary of Shear Values			
			M	V	Mmax +	Mmax -	Ma Max	Mnx	Mnx/Omega	Cb	Rm	Va Max	Vnx	Vnx/Omega
Dsgn. L = 11.00 ft		2	0.054	0.033	0.55	-5.40	5.40	165.83	99.30	1.00	1.00	1.97	89.10	59.40
+D+L														
Dsgn. L = 13.00 ft		1	0.145	0.117	12.48	-14.43	14.43	165.83	99.30	1.00	1.00	6.96	89.10	59.40
Dsgn. L = 11.00 ft		2	0.145	0.089	1.73	-14.43	14.43	165.83	99.30	1.00	1.00	5.28	89.10	59.40
+D+S														
Dsgn. L = 13.00 ft		1	0.406	0.346	38.39	-40.27	40.27	165.83	99.30	1.00	1.00	20.56	89.10	59.40
Dsgn. L = 11.00 ft		2	0.406	0.239		-40.27	40.27	165.83	99.30	1.00	1.00	14.20	89.10	59.40
+D+0.750L														
Dsgn. L = 13.00 ft		1	0.123	0.099	10.54	-12.17	12.17	165.83	99.30	1.00	1.00	5.88	89.10	59.40
Dsgn. L = 11.00 ft		2	0.123	0.075	1.44	-12.17	12.17	165.83	99.30	1.00	1.00	4.45	89.10	59.40
+D+0.750L+0.750S														
Dsgn. L = 13.00 ft		1	0.386	0.325	35.79	-38.33	38.33	165.83	99.30	1.00	1.00	19.32	89.10	59.40
Dsgn. L = 11.00 ft		2	0.386	0.229	0.44	-38.33	38.33	165.83	99.30	1.00	1.00	13.63	89.10	59.40
+D+0.750E														
Dsgn. L = 13.00 ft		1	0.509	0.293	50.59	-22.31	50.59	165.83	99.30	1.00	1.00	17.40	89.10	59.40
Dsgn. L = 11.00 ft		2	0.225	0.059		-22.31	22.31	165.83	99.30	1.00	1.00	3.51	89.10	59.40
+D+0.750L+0.750S+0.5250E														
Dsgn. L = 13.00 ft		1	0.648	0.423	64.30	-51.01	64.30	165.83	99.30	1.00	1.00	25.13	89.10	59.40
Dsgn. L = 11.00 ft		2	0.514	0.249		-51.01	51.01	165.83	99.30	1.00	1.00	14.78	89.10	59.40
+0.60D														
Dsgn. L = 13.00 ft		1	0.033	0.027	2.84	-3.24	3.24	165.83	99.30	1.00	1.00	1.58	89.10	59.40
Dsgn. L = 11.00 ft		2	0.033	0.020	0.33	-3.24	3.24	165.83	99.30	1.00	1.00	1.18	89.10	59.40
+0.60D+0.70E														
Dsgn. L = 13.00 ft		1	0.494	0.281	49.04	-20.15	49.04	165.83	99.30	1.00	1.00	16.69	89.10	59.40
Dsgn. L = 11.00 ft		2	0.203	0.046		-20.15	20.15	165.83	99.30	1.00	1.00	2.72	89.10	59.40

Overall Maximum Deflections

Load Combination	Span	Max. "-" Defl	Location in Span	Load Combination	Max. "+" Defl	Location in Span
+D+0.750L+0.750S+0.5250E	1	0.3723	5.668		0.0000	0.000
	2	0.0000	5.668	E Only	-0.0773	4.664

Vertical Reactions

Load Combination	Support 1	Support 2	Support 3
Overall MAXimum	53.701	38.886	-2.196
Overall MINimum	1.077	2.757	-0.173
D Only	1.794	4.594	0.331
+D+L	4.740	12.240	1.020
+D+S	14.361	34.760	-0.173
+D+0.750L	4.004	10.329	0.848
+D+0.750L+0.750S	13.429	32.953	0.470
+D+0.70E	39.385	12.505	-1.206
+D+0.750L+0.750S+0.5250E	41.622	38.886	-0.683
+0.60D	1.077	2.757	0.199
+0.60D+0.70E	38.667	10.667	-1.338
L Only	2.946	7.646	0.689
S Only	12.567	30.165	-0.504
E Only	53.701	11.301	-2.196

Support notation : Far left is #1

Values in KIPS



Ensign Engineering
 45 West 10000 South, Suite 500
 Sandy, Utah 84070
 P: (801) 255-0529

Project Title: Powder Mountain
 Engineer: Alex Hawkins
 Project ID: 8332
 Project Descr:

Printed: 12 JUN 2018, 11:24AM

Steel Column

File = P:\8332 Powder Mountain 70\Structural Calcs\3 Sided Diaphragms.ec6

Lic. #: KW-06004069

Licensee : ENSIGN ENGINEERING

Description : Steel Column

Extreme Reactions

Item	Extreme Value	Axial Reaction		X-X Axis Reaction		k	Y-Y Axis Reaction		Mx - End Moments		k-ft	My - End Moments	
		@ Base		@ Base	@ Top		@ Base	@ Top	@ Base	@ Top		@ Base	@ Top
Reaction, X-X Axis Base	Maximum		9.672										
"	Minimum		9.672										
Reaction, Y-Y Axis Base	Maximum		9.672										
"	Minimum		9.672										
Reaction, X-X Axis Top	Maximum		9.672										
"	Minimum		9.672										
Reaction, Y-Y Axis Top	Maximum		9.672										
"	Minimum		9.672										
Moment, X-X Axis Base	Maximum		9.672										
"	Minimum		9.672										
Moment, Y-Y Axis Base	Maximum		9.672										
"	Minimum		9.672										
Moment, X-X Axis Top	Maximum		9.672										
"	Minimum		9.672										
Moment, Y-Y Axis Top	Maximum		9.672										
"	Minimum		9.672										

Maximum Deflections for Load Combinations

Load Combination	Max. X-X Deflection		Distance		Max. Y-Y Deflection		Distance	
D Only	0.0000	in	0.000	ft	0.000	in	0.000	ft
+D+L	0.0000	in	0.000	ft	0.000	in	0.000	ft
+D+0.750L	0.0000	in	0.000	ft	0.000	in	0.000	ft
+0.60D	0.0000	in	0.000	ft	0.000	in	0.000	ft
L Only	0.0000	in	0.000	ft	0.000	in	0.000	ft

Steel Section Properties : HSS4x4x3/8

Depth	=	4.000 in	I xx	=	10.30 in ⁴	J	=	17.500 in ⁴
Design Thick	=	0.349 in	S xx	=	5.13 in ³			
Width	=	4.000 in	R xx	=	1.470 in			
Wall Thick	=	0.375 in	Zx	=	6.390 in ³			
Area	=	4.780 in ²	I yy	=	10.300 in ⁴	C	=	9.140 in ³
Weight	=	17.197 plf	S yy	=	5.130 in ³			
			R yy	=	1.470 in			
Ycg	=	0.000 in						

Steel Column

File = P:\8332 Powder Mountain 70\Structural Calcs\3 Sided Diaphragms.ec6

Lic. # : KW-06004069

Licensee : ENSIGN ENGINEERING

Description : Steel Column

Sketches

