

E13087-01



Steven J. Carlson, P.E.
380 North 200 West, Suite 110
Bountiful, UT 84010

Design Calculations

23 May 2013

Project

The Retreat Entry Walls
Wolf Creek
Lewis Homes

Design Codes

International Building Code 2009
ASCE 7-10 (Minimum Design Loads for Buildings and Other Structures)
ACI 318-08 (Building Code Requirements for Structural Concrete)
ACI 530-08 (Building Code Requirements for Masonry Structures)
AISC ASD 13th Ed. (Structural Steel)
ANSI / AF&PA NDS 05 (National Design Specification for Wood Construction)


Design Criteria

Concrete

Compressive Strength Slabs on Grade / Footings	2,500 PSI
Foundations	3,000 PSI
Suspended Slabs	4,000 PSI

Reinforcement

Grade 60, Yield Strength	60,000 PSI
Tensile Strength	90,000 PSI

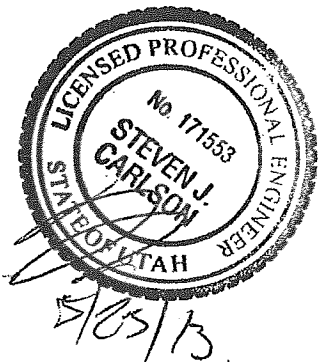

General Notes

These calculations, and accompanying plans, are for one project, at one location only. All plans and calculations should be wet stamped.

Engineering West's scope covers structural design of concrete only. Specifically excluded is geotechnical design. Even if this information is included on a stamped drawings.


Construction materials and details shall be in strict conformance with the latest edition of the International Building Code and other referenced standards. Details not in conformance with the calculations shall be approved in writing by the engineer.

Unless specifically indicated no investigation has been made by Engineering West, of the lot, or it's soil characteristics, to determine it's ability to support the structure.

Engineering West, LLC has assumed a 1,500 psf allowable soil bearing pressure. If there are any concerns with regard to the site a geo-technical specialist should be consulted. If conditions indicate a need for additional structural design, based on the soil conditions, including grade, Engineering West should be notified immediately.

The above design criteria should be reviewed and approved by the building official and contractor to assure actual conditions meet those used. Engineering West should be notified immediately of any discrepancies. Unless otherwise agreed in writing maximum total liability to Engineering West, L.L.C. will be limited to the dollar value of the engineering performed.

320 ±



DEAD MAN

020 147

1260 t

$$\begin{array}{r} 6LO + 560A \\ 4LO + 560B \end{array}$$


DEAD


THE DEAD MAN
STEEL
TO FNS.

Plot

④

PLAN (LEFT OF CENTER)

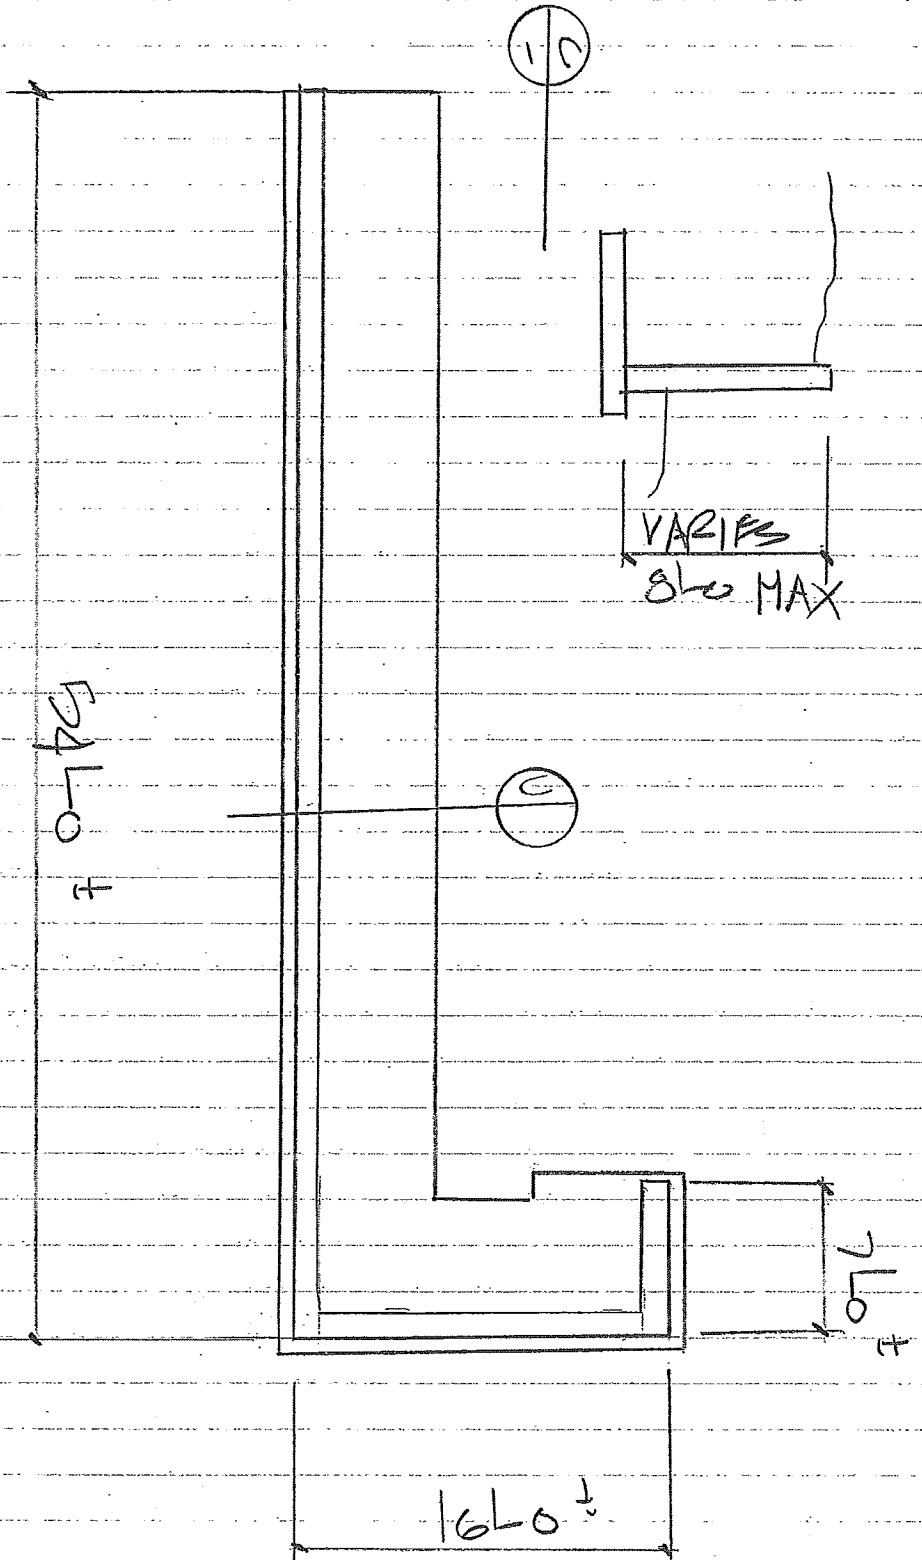

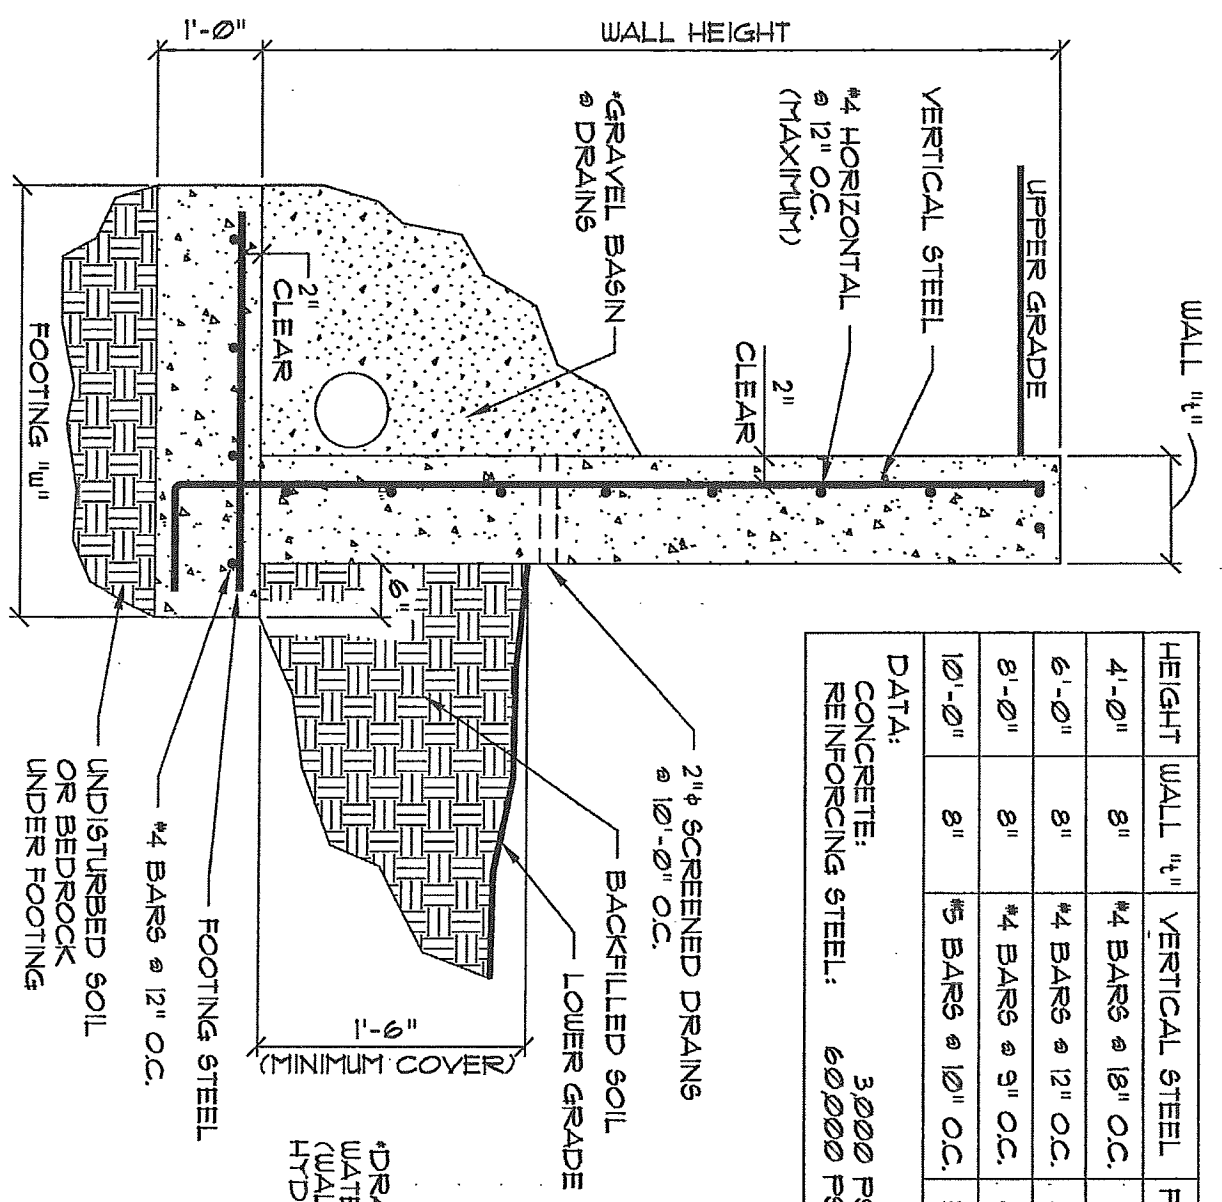

HEIGHT	WALL "t"	VERTICAL STEEL	FTG "u"	FOOTING STEEL
4'-0"	8"	#4 BARS @ 18" O.C.	2'-9"	#4 BARS @ 18" O.C.
6'-0"	8"	#4 BARS @ 12" O.C.	3'-6"	#4 BARS @ 12" O.C.
8'-0"	8"	#4 BARS @ 9" O.C.	4'-6"	#4 BARS @ 9" O.C.
10'-0"	8"	#5 BARS @ 10" O.C.	5'-6"	#5 BARS @ 10" O.C.


DATA:
 CONCRETE: 3000 PSI
 REINFORCING STEEL: 60000 PSI

*DRAIN SYSTEM MUST PREVENT WATER BUILD-UP BEHIND WALLS (WALL NOT DESIGNED FOR HYDRO-STATIC LOAD)

F1

SECTION THRU RETAINING WALL


SCALE: NONE

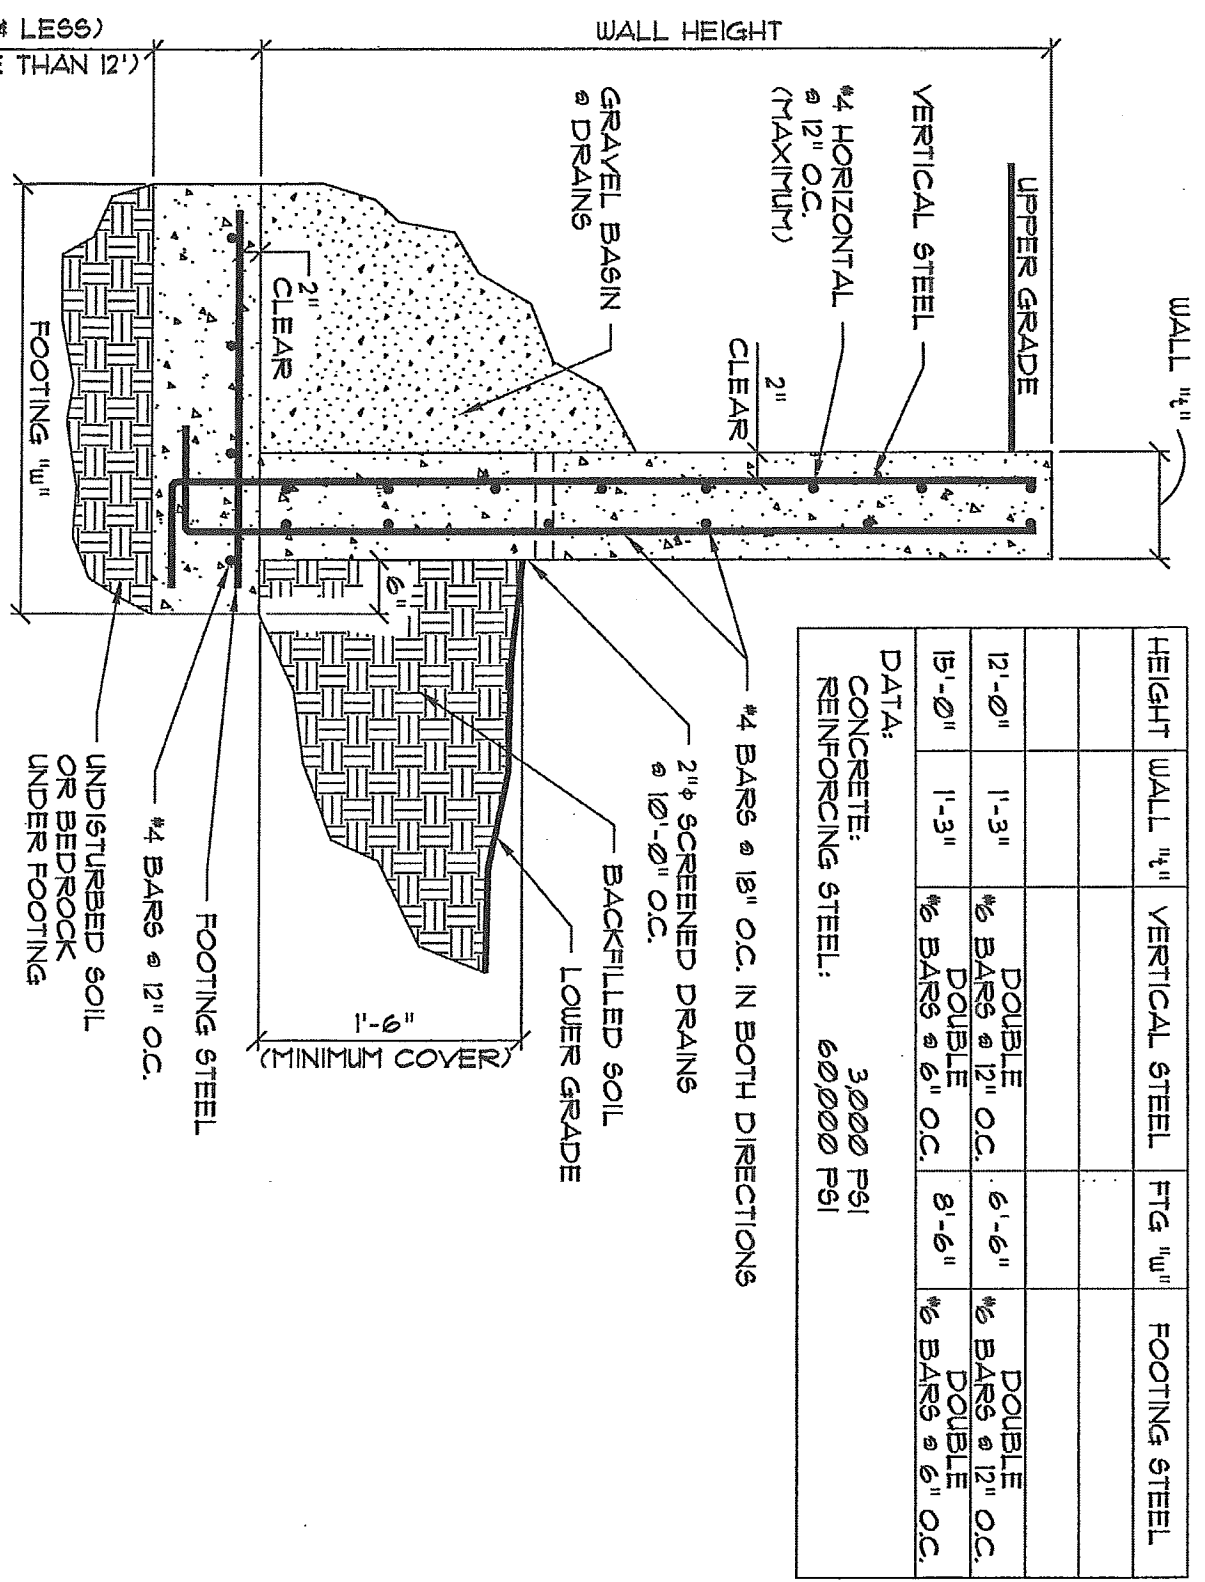

F2 SECTION THRU RETAINING WALL

SCALE: NONE


⑦

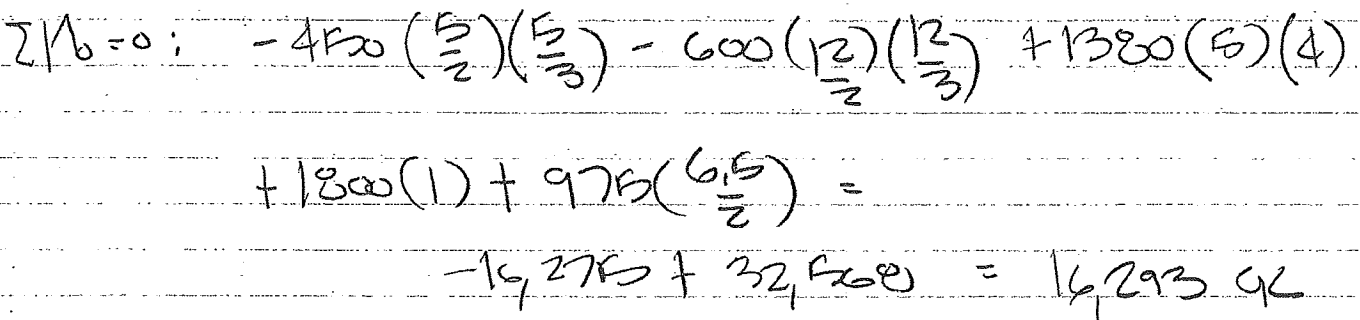

$$V_{MAX \text{ FTLG}} = 1380(5)^2/2 = \underline{17,250 \text{ FT VS}}$$

⑦

EIGHT FOOT RETAINING WALLS

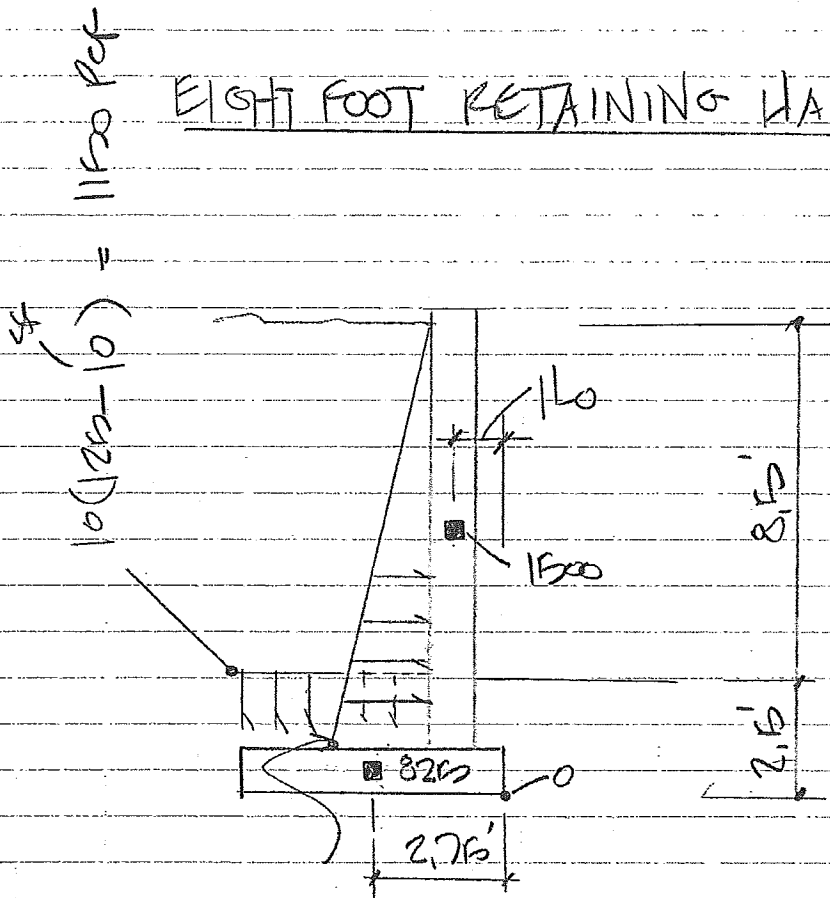

UNKNOWN SOILS

USE $w = 125 \text{ PCF}$

USE $K_a = 0.4$

$$10(125)0.4 = 500 \text{ LB/FT}$$

CHECK 10' WALL

$$\Sigma M_b = -500(10)(4\frac{1}{3}) + 1150(4)3.5 +$$

$$825(2.75) + 1500(1) = 0$$

$$+9034 \text{ LB OK}$$

$$M_{MAX} = 500(\frac{10}{2})(\frac{10}{3}) = 8,333 \text{ FT LB}$$

$$M_{MAX} = 1150(4)2.5 = 11,500 \text{ FT LB}$$

(9)

CHECK STEEL 10-0 WALLS

TRY #5 @ 10" OC.

$$q = \frac{60(0.31)}{0.86(3)10} = 0.73$$

$$M_u = 0.9(60)\left(0.31\left(\frac{12}{10}\right)\right)\left(10 - \frac{0.73}{2}\right) = 16,129 \text{ FT-LB}$$

OK

$$1.7(8333) = 14,166 \text{ FT-LB}$$

CHECK FOOTING 10-0 WALLS

SAME QS.

(10)

THIRTEEN FOOT WALLS STEEL

TRY #6 @ 10

$$q = \frac{60(0.44)}{0.85(3)10} = 1.03 \text{ ft}$$

$$M_u = 0.9(60,000)(0.44)(\frac{12}{10})(10 - \frac{1.03 \text{ ft}}{2}) = 22,520 \text{ FT LB}$$

$$1.7(16,275) = 27,668 \text{ FT LB INCREASE}$$

to
 $\text{PROV} \#6 @ 12"$

$$\text{CH 31 } q = \frac{60(0.88)}{0.85(3)12} = 1.72 \text{ ft}$$

$$M_u = 0.9(60,000)(0.88)(13 - \frac{1.72 \text{ ft}}{2}) = 48,064 \text{ FT LB}_{\text{AL}}$$