


NOTE:

- 1 - MANUFACTURED WITH MATERIALS THAT CONFORM TO THE REQUIREMENTS OF NSF STANDARD 61 RESIN LINER - DRINKING WATER SYSTEM COMPONENTS - HEALTH EFFECTS.
- 2 - TANK REQUIRES NSF LABEL.

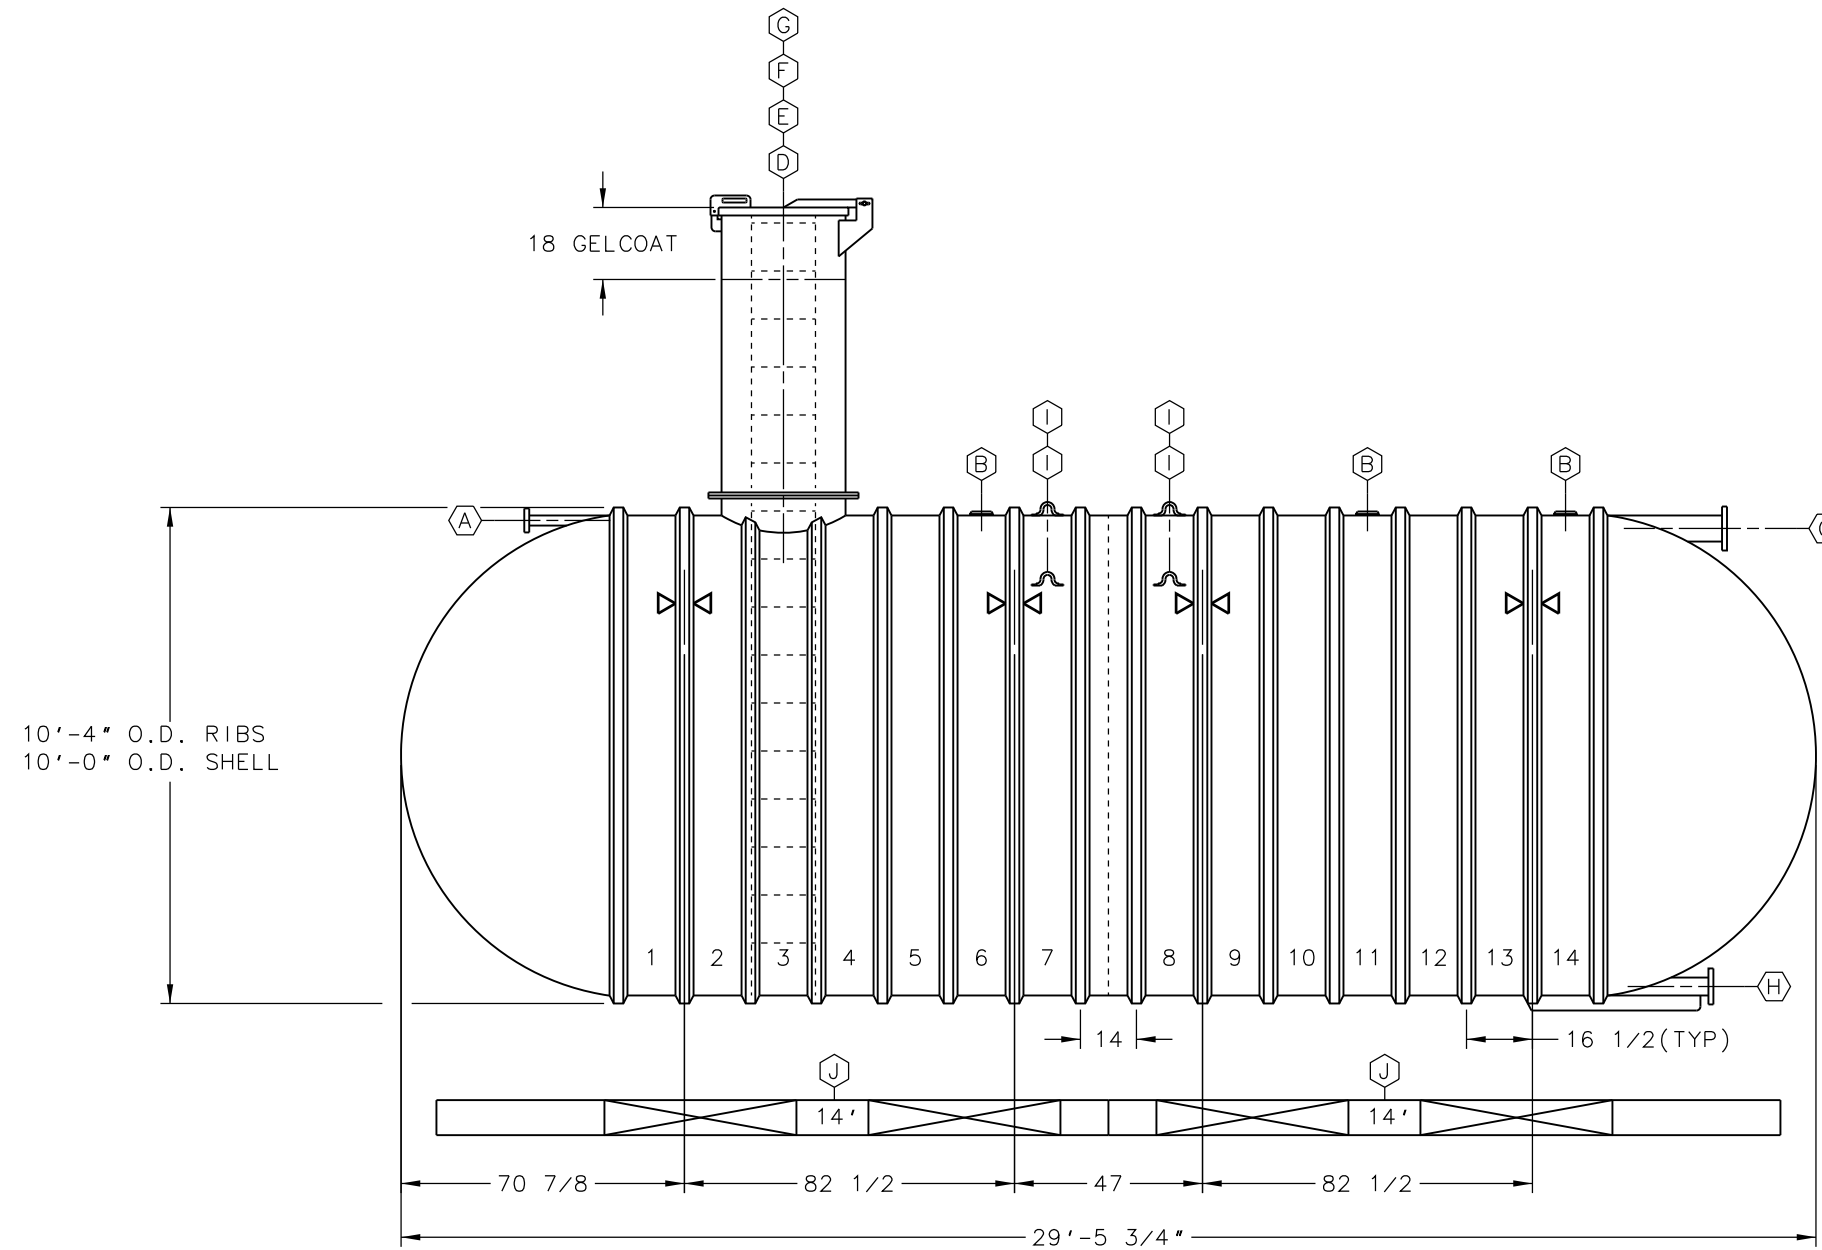

ITEM	QTY	DESCRIPTION
(A) 1	2	2" DIA (NSF) FRP FLANGED & GUSSETED TANGENTIAL NOZZLE
(B) 3	4	4" NPT SERVICE FITTING
(C) 1	6	6" DIA (NSF) FRP FLANGED & GUSSETED TANGENTIAL NOZZLE
(D) 1	30	30" DIA MANWAY WITH BLANK COVER (COVER FOR FIELD TESTING ONLY)
(E) 1	30	30" DIA x 72" HIGH MANWAY EXTENSION WITH HINGED & LOCKABLE TOP (TAN GELCOAT)
(F) 1	10	10' HIGH (NSF) FIBERGLASS LADDER (16" WIDE, TANK MOUNTED)
(G) 1	72	72" HIGH (NSF) FIBERGLASS LADDER (16" WIDE, EXTENSION MOUNTED)
(H) 1	4	4" DIA (NSF) FRP FLANGED & GUSSETED TANGENTIAL NOZZLE WITH BOTTOM SUPPORT
(I) 4	4	LIFTING LUG (2 EXTRA)
(J) 4	4	14' PREFABRICATED CONCRETE DEADMEN
(X) 4	4	HOLD DOWN STRAP LOCATION

0		REVISION DESCRIPTION	
DRN	DATE	CHK'D	DATE
-	-	-	-
 a zcl company		TITLE	
		10' DIA SW	
CAP. 15,000 GALLONS		BURTON MORGAN	
DRN	DATE	TITLE	
PRM	4-8-14	10' DIA SW	
CHK'D	DATE	CAP. 15,000 GALLONS	
JWL	4-8-14	BURTON MORGAN	
APPR'D	DATE	DR. SIZE	DR. NUMBER
JWL	4-8-14	D	645-674
SALES MANAGER	Ted Cotton	SCALE: 1/2" = 1'-0"	REV 00
INDUSTRY TYPE: M202 POTABLE WATER		SHT 1 OF 1	