



J. BRETT LAZAR, MD, MPH
Department Director

Environmental Health
Roger C. Wilde, Director
2570 Grant Avenue, Ogden, UT 84401
(801) 399-8381 FAX: (801) 399-8306


Name Mr. Robt. Painter Month 7 Day 27 Year 98

Address 1760 S. 3500W.

NO₃ WT = 47"
Monitor



3500W.
Ditch

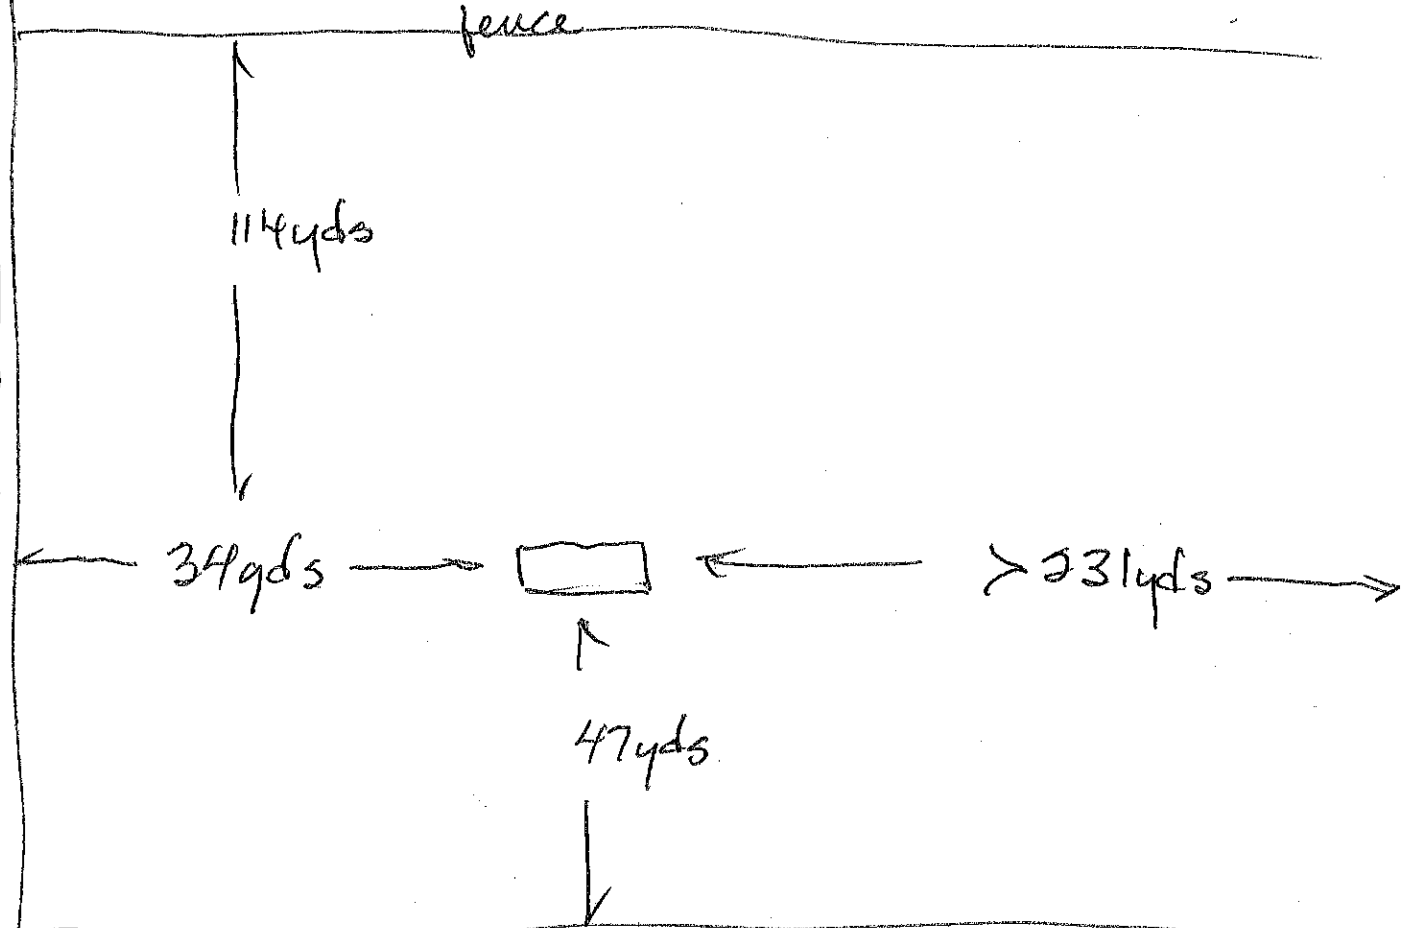

0-8" - Sandy loam T.S.
~~8-19"~~ - Silty Clayey Sand
 19-86" - Silty Clay

0% slope
 @ 16"
 Perc @ 30" +

Reeve & Associates, Inc.



PERCOLATION TESTS

Date: 04-21-14
Name of Client: Phil Hancock, 9000-B93
Location of Property: 1779 S 3500 W, West Weber, Weber County, UT

Depth to Water Table / Soil Conditions: Ground water was not encountered.

I hereby certify to the best of my knowledge that percolation tests have been conducted on the above property in accordance with requirements specified in R317, Utah Administrative Code, and that percolation rates, calculated as specified by said rule, are as follows:

Test Pit #	Perc. Test Depth	Test Hole Diameter (in)	Time Interval Used for Drop	Final Stabilized Percolation Rate Minutes/Inch
1	30"	6	30 Minutes	53.33
		6	30 Minutes	53.33

A handwritten signature in black ink, appearing to read 'J. Nate Reeve', is written over a horizontal line.

J. Nate Reeve, P.E.



WEBER-MORGAN

HEALTH DEPARTMENT September 9, 1998

J. BRETT LAZAR MD, MPH
Department Director

2570 Grant Avenue
Ogden, Utah 84401
(801) 399-8433
FAX (801) 399-8306

Robert B. Painter
3420 W. 1800 S.
Hooper, UT 84315

RE: Wastewater Site and Soils Evaluation #1550
1760 S. 3500 W. West Weber

Dear Mr. Painter:

An evaluation of the site and soils at the above-referenced address was completed by staff of this office on July 27, 1998. The exploration pit(s) are located on the enclosed plat developed during the site evaluation, along with the assigned numerical code for each exploration pit. The soil horizons, required percolation depths, actual and anticipated maximum ground water tables have been logged as follows:

Exploration Pit #1

0--8"	sandy loam TS
8-19"	silty sand
19-86"	silty clay

Observed ground water table	47"
Anticipated maximum ground water table	15"
Required percolation depth(s)	16" & 30"

Monitoring of the maximum ground water table is required in the location of the above listed exploration pits. Please complete the enclosed application for maximum ground water table monitoring and return it along with the appropriate fees by December 15, 1998. The wells should be constructed in accordance with the enclosed diagram in order to provide the most accurate water table readings possible.

Percolation tests may be completed by any individual included on the enclosed list. The stabilized percolation test results are to be submitted to this office for review prior to the recommendation for further development to the appropriate planning agency or prior to the issuance of a wastewater disposal permit.

Maternal & Child Health
2233 Grant Avenue
Ogden, Utah 84401
(801) 778-6150
FAX (801) 778-6180

Environmental Health
2570 Grant Avenue
Ogden, Utah 84401
(801) 399-8381
FAX (801) 399-8306




WIC
2233 Grant Avenue
Ogden, Utah 84401
(801) 778-6100
FAX (801) 778-6180

Emissions
855-25th Street
Ogden, Utah 84401
(801) 399-8108
FAX (801) 399-8109

If you have any further questions, contact this office at your convenience.

Sincerely,

A handwritten signature in cursive script that reads "Mary Hazard". The signature is written in dark ink and is positioned above the typed name.

Mary Hazard, LEHS, Acting Director
Wastewater Program Office

MH/jc