



WEBER COUNTY PLANNING DIVISION

Administrative Review Meeting Agenda

**January 11, 2017
4:00-5:00 p.m.**

- 1. Consideration and action on final plat approval of The Ranches at Powder Mountain Plat A, The Ranches at Powder Mountain Plat B and The Ranches at Powder Mountain Plat C including the concurrent consideration and action of The Ranches at Powder Mountain Plat A, The Ranches at Powder Mountain Plat B and The Ranches at Powder Mountain Plat C Hillside Review and access via a private right of way request.**
- 2. Consideration and action on an administrative application for final approval of the Creager Subdivision No. 2, a small subdivision consisting of 3 lots containing approximately 5.27 acres per lot.**
- 3. Consideration and action on an administrative application for approval of the Emerson Hills Phase 3 Amended.**
- 4. *Adjournment***

The meeting will be held in the Weber County Planning Division Conference Room, Suite 240, in the Weber Center, 2nd Floor, 2380 Washington Blvd., Ogden, Utah unless otherwise posted



In compliance with the American with Disabilities Act, persons needing auxiliary services for these meetings should call the Weber County Planning Commission at 801-399-8791



Staff Report for Administrative Subdivision Approval

Weber County Planning Division

Synopsis

Application Information

Application Request: Consideration and action on final plat approval of The Ranches at Powder Mountain Plat A, The Ranches at Powder Mountain Plat B and The Ranches at Powder Mountain Plat C including the concurrent consideration and action of The Ranches at Powder Mountain Plat A, The Ranches at Powder Mountain Plat B and The Ranches at Powder Mountain Plat C Hillside Review and access via a private right of way request.

Type of Decision: Administrative

Agenda Date: Wednesday, January 11, 2017

Applicant: SMHG Phase 1, LLC

Authorized Representative: Rick Everson

File Numbers: AE 2013-01
HSR 2016-02
UVS0713E
UVS0713F
UVS0713G

Property Information

Approximate Address: 7500 East Horizon Run Eden, UT

Project Area: 163.431 Acres

Zoning: DRR-1 Zone

Existing Land Use: Resort Development/Open Space

Proposed Land Use: Resort Development/Open Space

Parcel ID: 23-012-0134, 23-012-0135, 23-012-0143 (previous Parcel ID 23-012-0133), 23-128-0032, 12-128-0033

Township, Range, Section: Township 7 North, Range 2 East, Section 6

Adjacent Land Use

North:	Ski Resort	South:	Ski Resort
East:	Ski Resort	West:	Ski Resort

Staff Information

Report Presenter: Ronda Kippen
rkippen@co.weber.ut.us
801-399-8768

Report Reviewer: RG

Applicable Ordinances

- Title 101, Chapter 1, General Provisions, Section 7, Definitions
- Title 102, Chapter 1, Section 2 Administrative Authority
- Title 104 Zones, Chapter 27 Natural Hazards Overlay District
- Title 104, Zones, Chapter 28, Ogden Valley Sensitive Lands Overlay Districts
- Title 104, Chapter 29 Ogden Valley Destination and Recreation Resort Zone (DRR-1)
- Title 106, Subdivisions, Chapter 1-8 as applicable
- Title 108, Standards, Chapter 7 Supplementary and Qualifying Regulations, Section 29 Flag lot access strip, private right-of-way, and access easement standards

Development History

- A Conditional Use Permit for a PRUD was approved on April 9, 2013.
- A Conditional Use Permit Amendment for the PRUD was approved July 9, 2013.
- A rezone petition along with a Zoning Development Agreement was finalized and approved in January 2015.
- The PRUD for this area has since been vacated on July 19, 2016.

Background and Summary

The applicant has submitted a request for final plat approval of The Ranches at Powder Mountain Plat A, a small subdivision consisting of one lot; The Ranches at Powder Mountain Plat B, a small subdivision consisting of two lots; and The Ranches at Powder Mountain Plat C, a small subdivision consisting of three lots. The applications for the three subdivisions includes the concurrent consideration and action on an application for access by a private right of way as well as approval of a Hillside Review application due to the existing slopes, topography and this area being located within a potential geologic hazardous area.

The proposed subdivisions are located at approximately 7500 East Horizon Run, and are in the DRR-1 zone. The six lots were not included in the Summit Eden Phase 1A which was initially approved as a PRUD in 2013 and platted in 2014. These phases initially were proposed as Summit Eden Phase 1E, Summit Eden Phase 1F & Summit Eden Phase 1G. The applicant has renamed the development area to "The Ranches at Powder Mountain" in order to remain consistent with the Neighborhood Declaration (CC&R's) and the lot numbers in The Ranches at Powder Mountain Plat A, Plat B and Plat C are based on the original lot layout of Summit Eden Phase 1A. The applicant is desirous to continue using the previously designated lot numbers based on the private driveway easement notes that have been included on previous plats and in the CC&R's for Summit Eden Phase 1A. The private drive will provide access and frontage for all six lots in the three separate subdivisions.

A geologic and geotechnical investigation has been compiled into one report for all three subdivisions by IGES (Project No. 01628-012 dated December 20, 2016). Based on these two factors, all three applications are being combined into one review and staff report including the concurrent consideration and action on an application for access by a private right of way for all six lots as well as approval of a Hillside Review.

The Zoning Development Agreement Master Plan and the conceptual plan have identified the proposed area as an area anticipated for large residential lots. The proposed subdivisions and lots configuration are in conformance with the current zoning and the Zoning Development Agreement Master Plan (see Exhibit A) as well as the applicable subdivision requirements as required in the Uniform Land Use Code of Weber County (LUC). The requests for an alternative access, Hillside Review and the subdivision process have been thoroughly vetted and have received approval from all the applicable review agencies. The following is a brief analysis of the subdivisions, the alternative access and the Hillside Review applications.

Analysis

General Plan: The proposal conforms to the Ogden Valley General Plan by encouraging development within the existing resort-related commercial areas.

Zoning: The proposed subdivisions are located in the Ogden Valley Destination and Recreation Resort Zone more particularly described as the DRR-1 zone. The purpose and intent of the DRR-1 zone is identified in the LUC §104-29-1 as:

"The purpose of this chapter is to provide flexible development standards to resorts that are dedicated to preserving open space and creating extraordinary recreational resort experiences while promoting the goals and objectives of the Ogden Valley general plan. It is intended to benefit the residents of the county and the resorts through its ability to preserve the valley's rural character, by utilizing a mechanism that allows landowners to voluntarily transfer development rights to areas that are more suitable for growth when compared to sensitive land areas such as wildlife habitats, hazardous hillsides or prime agricultural parcels. Resorts that lie within an approved destination and recreation resort zone shall, by and large, enhance and diversify quality public recreational opportunities, contribute to the surrounding community's well-being and overall, instill a sense of stewardship for the land."

As part of the subdivision process, the proposal has been reviewed against the current subdivision ordinance in LUC §106, and the standards in the DRR-1 zone in LUC §104-29. Small subdivisions as defined in LUC §101-7 can be administratively approved per LUC §106-1-5(b)(1) and the proposal has been reviewed against the adopted zoning and subdivision ordinances to ensure that the regulations and standards have been adhered to. The proposed subdivision is in conformance with county code. The following is a brief synopsis of the review criteria and conformance with the LUC.

Lot area, frontage/width and yard regulations:

The DRR-1 Zone does not have a minimum lot area or a minimum lot width requirement per LUC §104-29-2(h) for a single family residential dwelling. The following development standards will be reviewed upon submittal for single family building permit:

- Front yard setback: 0 feet
- Side yard setback: 8 feet with a total of two required side yards of not less than 18 feet
- Rear yard setback: 10 feet
- Average building height: 35 feet

The Ranches at Powder Mountain Plat A:

The Ranches at Powder Mountain Plat A is a one lot subdivision with adequate access and frontage along Horizon Run, a dedicated private road (see Exhibit B). Lot 9R in The Ranches at Powder Mountain Plat A is a 5.27 acre lot with approximately 121.36 feet of frontage along Horizon Run. Lot 9R is considered to be a restricted or "R" lot due to the existing slopes exceeding 25%. A note to provide the required "Notice to Purchasers of Restricted (R) Lots" has been added to the plat notes to ensure adequate notification of the required Hillside Review process.

The Ranches at Powder Mountain Plat B:

The Ranches at Powder Mountain Plat B is a two lot subdivision which will gain access by the private drive identified as "Valley View Lane" (see Exhibit C). Lot 1R in The Ranches at Powder Mountain Plat B is a 33.14 acre lot. Lot 10R is a 7.58 acre lot. Plat B also dedicates a 9.08 acre open space parcel identified as Parcel OS3. Lot 1R and 10R are considered to be restricted or "R" lots due to the existing slopes exceeding 25%. A note to provide the required "Notice to Purchasers of Restricted (R) Lots" has been added to the plat notes to ensure adequate notification of the required Hillside Review process.

The Ranches at Powder Mountain Plat C:

The Ranches at Powder Mountain Plat C is a three lot subdivision which will gain access by the private drive identified as "Valley View Lane" (see Exhibit D). Lot 2 in The Ranches at Powder Mountain Plat B is a 16.99 acre lot. Lot 3R is a 8.28 acre lot and Lot 4R is a 26.02 acre lot. Lots 3R and 4R are considered to be restricted or "R" lots due to the existing slopes exceeding 25%. A note to provide the required "Notice to Purchasers of Restricted (R) Lots" has been added to the plat notes to ensure adequate notification of the required Hillside Review process.

The proposed lot configuration meets the area and width standards in the DRR-1 Zone. The proposal is in conformance with county code and the Zoning Development Agreement.

Natural Hazards Overlay Zone:: The proposed subdivision is located in a Zone "D" as determined by FEMA to be an area of undetermined flood hazards. Areas designated as Zone "D" are typically areas in which no analysis of flood hazards has been conducted.

A geologic and geotechnical investigation has taken place on The Ranches at Powder Mountain Plat A, Plat B and Plat C. The investigation was performed by IGES (Project# 01628-012 dated December 20, 2016). Lots 1R-4R, 9R and 10R are considered to have a low risk for landslides/mass movements (including slope stability) on the properties (see Exhibit E) with the exception of the upper portion of Lot 9R where the private drive intersects with Horizon Run. This area along the frontage of Horizon Run is located within a mapped landslide. During the excavation and construction of the private drive, the developer will need to adhere to the recommendations outlined in the IGES Geologic Hazards Assessment Report Project # 01628-012. A condition of approval that a geologist and geotechnical engineer are onsite during excavation to ensure the recommendations are adhered to has been added to staff's recommendations for approval.

These lots have also been investigated for rockfall, surface fault rupture, earthquake related hazards, liquefaction, debris flow and flooding hazards and shallow ground water. The rockfall, surface fault rupture, earthquake related hazards have been given a low to moderate rating due to the location of some "limited parts of the property immediately downslope of an outcrop of bedrock blocks" and the closest "active fault" being approximately 8.5 miles to the west of the property. The liquefaction, debris flow and flooding hazards and shallow ground water have all been rated as a low hazard risk in the report.

IGES concludes that the areas located in the landslide and other mass-movement areas are as such that appropriate mitigation practices can reduce the level of landslide/mass movement hazard risk to an acceptable level for development. IGES makes the following recommendations that shall be followed during the development process of these subdivisions:

- The recommendations provided in the IGES geotechnical report (2015a) and rockery design submittal (2015b) should be followed for all proposed development on the subject property, except as amended herein. As a result of the additional subsurface exploration conducted for this report, the referenced geotechnical report may be considered to encompass Lots 5R, 6R, and 119 (these three lots were not a part of the original scope in 2015).
- For those areas identified as having moderate landslide risk, overexcavation of the landslide deposits and through the slide/shear zones to competent earth materials must occur preceding the emplacement of footings. In these areas, conventional spread footings are to be founded upon competent earth materials or appropriately compacted structural fill that immediately overlies the competent bedrock. The overexcavation must extend over the entire building footprint (not just the footings), and should extend a minimum of four feet beyond the exterior foundations.
- For Lot 1R, to reduce the rockfall hazard risk to low, an earthen berm or rock wall approximately 3 feet high is recommended on the north side of the proposed structure.
- Because landslide deposits are noted on and near the property, an IGES geologist should observe the foundation excavations to assess the removal of potentially hazardous landslide deposits and to observe that the foundation footprint has been excavated down to competent, stable earth materials.

A condition of approval that a "Natural Hazards Disclosure" document will be required to be recorded to provide adequate notice of any geotechnical and geological recommendations for future property owners.

Additional design standards and requirements: The proposed subdivision does have significant slopes. Major grading has been proposed for the private access to the proposed subdivisions. As part of the request for access to the lots using a private right-of-way or access easement the applicant has demonstrated compliance with the criteria and conditions outlined in LUC §108-7-31(1)(c) which state:

"Based on substantial evidence, it shall be shown that it is unfeasible or impractical to extend a street to serve such lot/parcel. Financial adversity shall not be considered; however, circumstances that may support an approval of a private right-of-way/access easement as access to a lot/parcel may include but not be limited to unusual soil, topographic, or property boundary conditions."

The proposed private drive is shown as a 100 foot easement with an improved surface of 20 feet per LUC§108-7-29(1)(c) and will be designed to support a minimum weight of 75,000 pounds with the required turnouts for fire services. The private drive is identified as "Valley View Lane" and will provide access to all of the lots within The Ranches at Powder Mountain Plat A, Plat B and Plat C. The drive gains access from Horizon Run along the frontage of Lot 9R and Lot 117R. The private drive then runs in an easterly direction through Lot 7A and 7B (which were recently combined into one lot now known as Lot 119) and then through lots 5R and 6R. The private drive then meanders through The Ranches at Powder Mountain Plat B and Plat C. The private drive terminates on Lot 2 in The Ranches at Powder Mountain Plat C. A public utility easement will be included as part of the private drive infrastructure to provide utilities to the proposed subdivisions.

The County Engineer and Weber Fire District have reviewed and approved the engineered drawings for the private drive. The review agencies do not feel that it is necessary to extend a street to provide access for the future lots due to the existing topography.

As part of the considerations for granting access by a private right of way or access easement per LUC §108-7-31(2) the applicant will need to demonstrate that the *"lot/parcel has appropriate and legal access due to historic use, court decree, or the execution of an easement, right-of-way, or other instrument capable of conveying or granting such right;"* and requires that *"the landowner of record or authorized representative shall agree to pay a proportionate amount of the costs associated with developing a street if, at any time in the future, the county deems it necessary to have the landowner replace the private right-of-way/easement with a street that would serve as a required access to additional lots. The*

agreement shall be in the form considered appropriate and acceptable to the office of the Weber County Recorder and shall recite and explain all matters of fact, including a lot/parcel boundary description, which are necessary to make the agreement intelligible and show its successive nature." A condition of approval that the required agreements will be recorded with the final Mylar to ensure that if, at any time in the future, the County deems it necessary to have the landowners replace the private right-of-way/easement with a street that would serve the lots has been added to the staff's recommendations for approval.

There may be additional site preparation in conjunction with an approved building permit. The proposed subdivision does not require the realignment of or the creation of a new street system. With the exception of the recommended conditions identified in this staff report, additional standards and requirements are unnecessary at this time.

Culinary water and sanitary sewage disposal: Culinary and sewer services are provided by Powder Mountain Water and Sewer Improvement District. Based on the original approvals, additional proof of culinary and sanitary sewage services will only be required for two lots in The Ranches at Powder Mountain Plat C. A condition of approval has been added to staff's recommendations to ensure that adequate proof of water and sanitary sewage services are received prior to recording The Ranches at Powder Mountain Plat C.

Review Agencies: The Weber Fire District, Weber County Surveyor's Department and Weber County Engineering Division have reviewed and approved the proposed subdivisions, alternative access request and Hillside Review applications.

Tax clearance: The 2016 property taxes have been paid in full. The 2017 property taxes will be due in full on November 1, 2017.

It appears that the multiple parcels fall within three separate taxing districts. Prior to recording any of the subdivision Mylar's, the applicant will need to annex The Ranches at Powder Mountain Plat A, Plat B and Plat C boundaries into the same taxing district to ensure that a residential lot is not split between two separate taxing districts per LUC §106-2-4(l) which states: "Parcels that are split by a taxing district shall have the entire parcel annexed into that taxing district prior to the recording of the subdivision. Exceptions will be made for bond obligations by the taxing district." A condition of approval has been included in staff's recommendation to ensure that the property is annexed into one taxing district prior to recording the final Mylar.

Public Notice: The required noticing for the final subdivision plat approval has been mailed to all property owners of record within 500 feet of the subject property regarding the proposed small subdivision per noticing requirements outlined in LUC §106-1-6(c).

Staff Recommendation

Staff recommends final plat approval of The Ranches at Powder Mountain Plat A, The Ranches at Powder Mountain Plat B and The Ranches at Powder Mountain Plat C including the concurrent consideration and action of The Ranches at Powder Mountain Plat A, The Ranches at Powder Mountain Plat B and The Ranches at Powder Mountain Plat C Hillside Review and access via a private right of way request. This recommendation for approval is subject to all applicable review agency requirements and is based on the following conditions:

1. A geologist and geotechnical engineer are onsite during excavation to ensure that their recommendations are adhered to as outlined in this report.
2. A "Natural Hazards Disclosure" document will be required to be recorded to provide adequate notice of any geotechnical and geological recommendations for future property owners.
3. The required agreements will be recorded with the final Mylar to ensure that if, at any time in the future, the County deems it necessary to have the landowners replace the private right-of-way/easement with a street that would serve the lots has been added to the staff's recommendations for approval.
4. Adequate proof of water is received for two additional lots prior to recording The Ranches at Powder Mountain Plat C.
5. The property shall be annexed into one taxing district prior to recording the final Mylar.

This recommendation is based on the following findings:

1. The proposed subdivision conforms to the Ogden Valley General Plan.
2. With the recommended conditions, the proposed subdivision complies with all previous approvals and the applicable County ordinances.
3. The proposed subdivision will not be detrimental to the public health, safety, or welfare.

- The proposed subdivision will not deteriorate the environment of the general area so as to negatively impact surrounding properties and uses.

Administrative Approval

Administrative final plat approval of The Ranches at Powder Mountain Plat A, The Ranches at Powder Mountain Plat B and The Ranches at Powder Mountain Plat C including the concurrent consideration and action of The Ranches at Powder Mountain Plat A, The Ranches at Powder Mountain Plat B and The Ranches at Powder Mountain Plat C Hillside Review and access via a private right of way request, is hereby granted based upon its compliance with the Weber County Land Use Code. This approval is subject to the requirements of applicable review agencies and is based on the findings listed in this staff report.


Date of Administrative Approval: _____

Rick Grover
Weber County Planning Director


Exhibits

- Approved Conceptual Plans
- The Ranches at Powder Mountain Plat A
- The Ranches at Powder Mountain Plat B
- The Ranches at Powder Mountain Plat C
- IGES Geologic and Geotechnical Hazards Assessment Report


Map 1

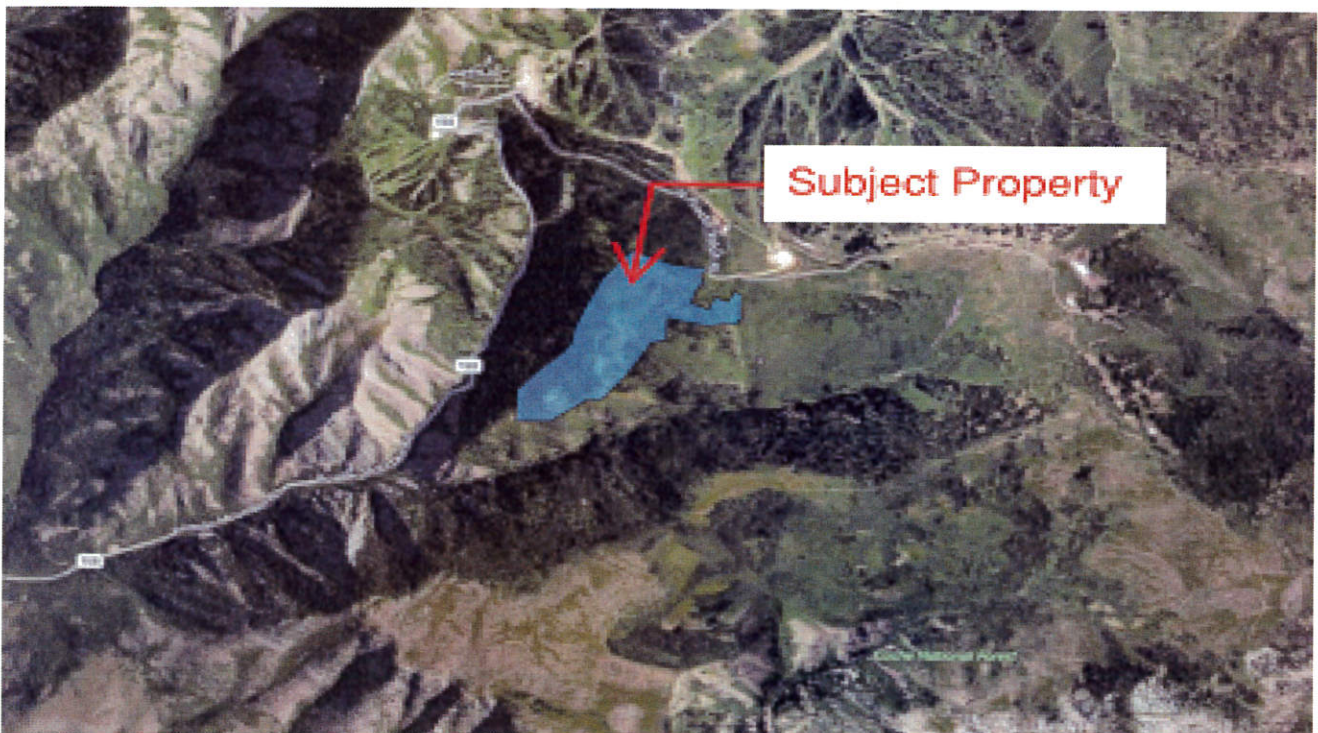

The Ridge Illustrative Plan

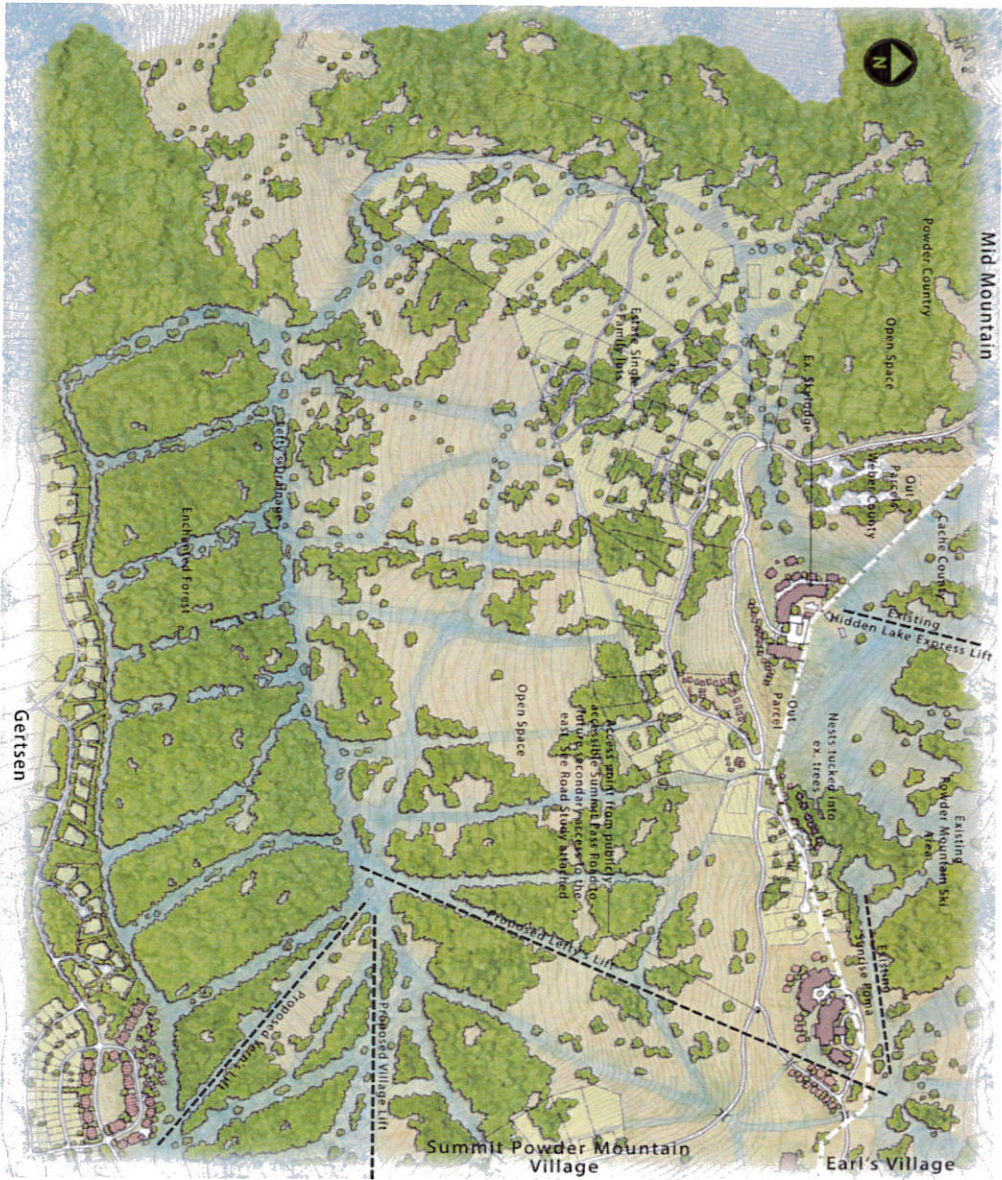

Placement of development within the Ridge area has been sensitive to the existing ski experience at Powder Mountain with future hotels and multi-family units designed to be within ski access to the existing mountain while maintaining the existing ski accesses. Single family units have been located on the mountain within existing tree massing to provide visual and physical protection as well as to maintain those important open meadow and hillside for the remainder of the Resort.

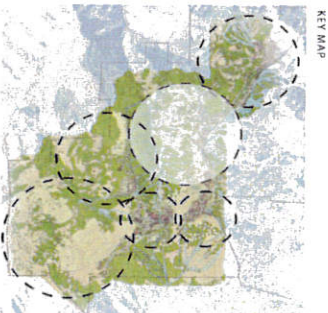

KEY MAP

THE RANCHES AT POWDER MOUNTAIN PLAT B

ALSO KNOWN AS PHASE II
 THE SOUTHWEST QUARTER OF SECTION 4, TOWNSHIP 7 NORTH, RANGE 2 EAST, SALT LAKE BASIN AND REDWOOD
 PLANNED COMMUNITY
 OCTOBER 2006

NORTHWEST CORNER SECTION 4, TOWNSHIP 7 NORTH, RANGE 2 EAST, SALT LAKE BASIN AND REDWOOD PLANNED COMMUNITY (ORDINANCE NUMBER 1749, 2001)

STATE PLANS SHOWN PER PERMITS FOR PERMITS COUNTY ROAD CONSTRUCTION

EAST 1/4 COR. SECTION 4, TOWNSHIP 7 NORTH, RANGE 2 EAST, SALT LAKE BASIN AND REDWOOD PLANNED COMMUNITY

LEGEND


- BOUNDARY LINE
- LOT LINE
- SECTION LINE
- QUARTER SECTION LINE
- ADJACENT DEED LINES
- AREA TO BE LAVED
- STREET PLACEMENTS
- FOUND NEARBY WITH PLASTIC CAP STAKES SET BEHIND SIGN PLASTIC CAP STAKES
- ADJACENT TO NEARBY LOTS
- ADJACENT TO NEARBY LOTS

CURVE TABLE

CURVE	LENGTH	BEGINN	END	CHORD	LENGTH
C1	100.00	100.00	100.00	100.00	100.00
C2	100.00	100.00	100.00	100.00	100.00
C3	100.00	100.00	100.00	100.00	100.00
C4	100.00	100.00	100.00	100.00	100.00
C5	100.00	100.00	100.00	100.00	100.00
C6	100.00	100.00	100.00	100.00	100.00
C7	100.00	100.00	100.00	100.00	100.00
C8	100.00	100.00	100.00	100.00	100.00
C9	100.00	100.00	100.00	100.00	100.00
C10	100.00	100.00	100.00	100.00	100.00
C11	100.00	100.00	100.00	100.00	100.00
C12	100.00	100.00	100.00	100.00	100.00
C13	100.00	100.00	100.00	100.00	100.00
C14	100.00	100.00	100.00	100.00	100.00
C15	100.00	100.00	100.00	100.00	100.00
C16	100.00	100.00	100.00	100.00	100.00
C17	100.00	100.00	100.00	100.00	100.00
C18	100.00	100.00	100.00	100.00	100.00
C19	100.00	100.00	100.00	100.00	100.00
C20	100.00	100.00	100.00	100.00	100.00

CURVE TABLE

CURVE	LENGTH	BEGINN	END	CHORD	LENGTH
C1	100.00	100.00	100.00	100.00	100.00
C2	100.00	100.00	100.00	100.00	100.00
C3	100.00	100.00	100.00	100.00	100.00
C4	100.00	100.00	100.00	100.00	100.00
C5	100.00	100.00	100.00	100.00	100.00
C6	100.00	100.00	100.00	100.00	100.00
C7	100.00	100.00	100.00	100.00	100.00
C8	100.00	100.00	100.00	100.00	100.00
C9	100.00	100.00	100.00	100.00	100.00
C10	100.00	100.00	100.00	100.00	100.00
C11	100.00	100.00	100.00	100.00	100.00
C12	100.00	100.00	100.00	100.00	100.00
C13	100.00	100.00	100.00	100.00	100.00
C14	100.00	100.00	100.00	100.00	100.00
C15	100.00	100.00	100.00	100.00	100.00
C16	100.00	100.00	100.00	100.00	100.00
C17	100.00	100.00	100.00	100.00	100.00
C18	100.00	100.00	100.00	100.00	100.00
C19	100.00	100.00	100.00	100.00	100.00
C20	100.00	100.00	100.00	100.00	100.00

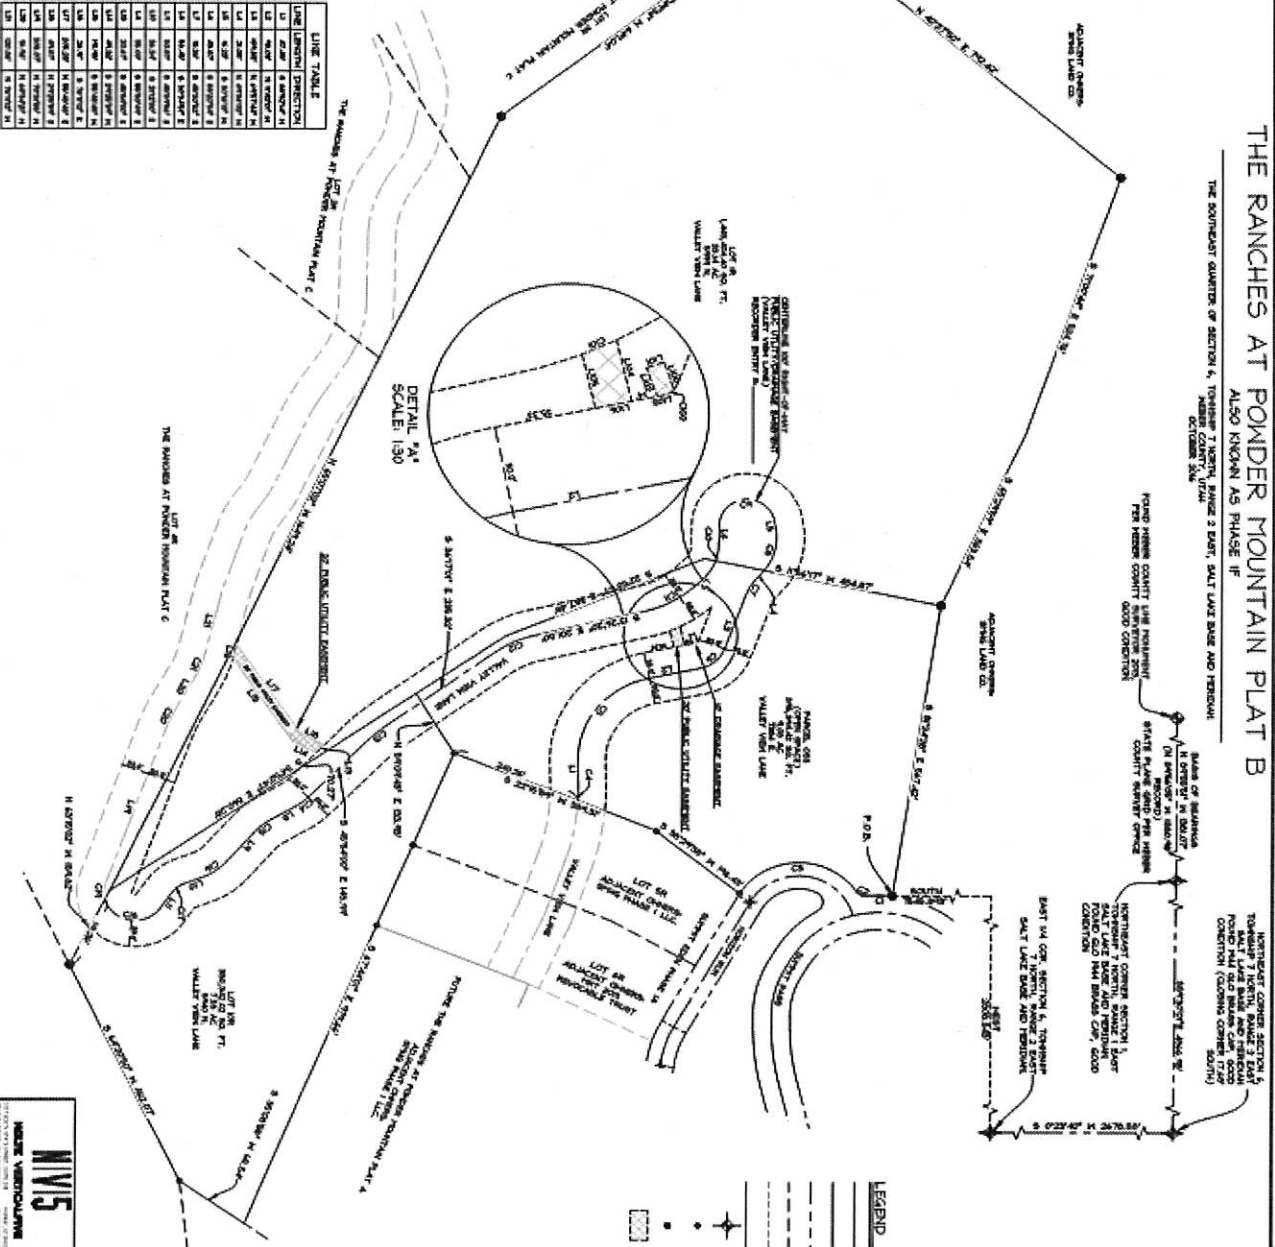

Sheet 2 of 2

DESIGNED BY: NIVS

DATE: 10/20/06

PROJECT: THE RANCHES AT POWDER MOUNTAIN PLAT B

SCALE: AS SHOWN

PLANNED COMMUNITY: THE RANCHES AT POWDER MOUNTAIN PLAT B



IGES[®]

Intermountain GeoEnvironmental Services, Inc.
12429 South 300 East, Suite 100, Draper, Utah 84020
T: (801) 748-4044 ~ F: (801) 748-4045

4153 South Commerce Drive, SLC, UT 84107
T: (801) 270-9400 ~ F: (801) 270-9401

December 20, 2016

Summit Mountain Holding Group
3632 North Wolf Creek Drive
Eden, Utah 84310

c/o Watts Enterprises
5200 South Highland Drive #101
Salt Lake City, Utah 84117
Attn: Mr. Rick Everson

IGES Project No. 01628-012

Subject: Geologic Hazards Assessment
Phase 1E, 1F, and 1G and Adjacent Areas
Summit Powder Mountain Resort
Weber County, Utah

Mr. Everson:

This letter report presents the results of the geologic hazards investigation performed by Intermountain GeoEnvironmental Services, Inc. (IGES) for the Phase 1E, 1F, and 1G property, plus selected adjacent areas, as part of the greater Powder Mountain Resort development in Weber County, Utah (Figure A-1). The report identifies the nature and associated risk of the applicable geologic hazards associated with the property, based upon the results of the literature review, site reconnaissance, and subsurface investigation conducted as part of this assessment.

INTRODUCTION

The Summit Powder Mountain project consists of developing approximately 200 of 2,000 acres of lightly forested land just south of the existing Powder Mountain Ski Resort. Powder Mountain is undergoing a major expansion that will include golf courses, ski lifts, residential, and commercial property development. Site development will include site infrastructure such as roads and bridges, retaining structures, and associated underground utilities. IGES has previously completed a preliminary geotechnical investigation for the project as a whole (IGES, 2012), as well as provided recommendations and construction observation services for several individual structures currently being developed or in planning stages. IGES also recently completed a design-level geotechnical investigation of the Summit Eden Phase 1E, 1F, and 1G project area, which included rockery design and associated slope stability analysis (IGES, 2015a, 2015b).

The Phase 1E, 1F, and 1G project is proposed to be developed within approximately one mile south of the Powder Mountain Ski Resort in Weber County, Utah (see Figure A-1, *Site Vicinity Map*). It is our understanding that the proposed development will include six large estate lots (Lots 1R, 2R, 3R, 4R, 9R, and 10R) and associated infrastructure, including roadways and

utilities, over an approximately 100-acre site. A geotechnical investigation covering these six lots and the associated roadway has been completed by IGES (2015a). As a part of this geologic hazard assessment, the study area has been expanded to include Lots 5R, 6R, and 119 (formerly Lots 7A and 7B) (see Figure A-5). The site is on a hillside with a natural gradient generally ranging between 3.5H:1V to 4H:1V; as such, access roads will be constructed with a series of cuts and fills, necessitating a series of cut slopes and fill slopes ranging in height up to 30 feet. Construction drawings prepared by NV5 illustrate a 20-foot tall, 3-tiered rockery near the entrance to the project area; this rockery is expected to have an area of roughly 10,000 square feet. The tallest rockery planned will have four tiers, accommodating a 30-foot grade change. In addition, seven smaller rockeries are planned along the private drives to accommodate access and installation of various utilities. The project area encompasses parts of the southwestern quarter of Section 6, and the northwestern quarter of Section 7, in Township 7 North, Range 2 East. The cumulative acreage for the project area is approximately 100 acres. The property is bound on all sides by undeveloped lands, though the northeastern part of the property abuts Horizon Run.

PURPOSE AND SCOPE

This study was performed as a site-specific geologic hazards assessment to identify any surficial or subsurface geologic hazards that may be extant on the property or have the capability to adversely impact the property. The study was conducted in response to the observation of landslide-indicative features in some of the test pits excavated for the recently completed geotechnical investigation on the property (IGES, 2015a). Specifically, this study was conducted to:

- Analyze the existing geologic conditions present on the property and relevant adjacent areas;
- Assess the geologic hazards that pose a risk to development across the property, and determine an associated risk for each hazard; and
- Identify the most significant geologic hazard risks, and provide recommendations for appropriate additional studies and/or mitigation practices, if necessary.
- Provide an assessment the geologic suitability of the property for development, based upon the findings of this investigation.

In order to achieve the purpose and scope outlined above, the following services were performed as part of this investigation:

- Review of available published geologic reports and maps for the subject property and surrounding areas;
- Stereoscopic review of aerial photographs and analysis of additional available aerial imagery;

- Site reconnaissance by an engineering geologist licensed in the state of Utah to map the surficial geology, determine site conditions, and assess the property for geologic hazards;
- Subsurface excavation and the logging and soil sampling of the trenches; plus index testing of representative soil samples to assist in soil classification;
- Preparation of this report, based upon the data reviewed and collected in this investigation.

REVIEW OF GEOLOGIC LITERATURE

A number of pertinent publications were reviewed as part of this investigation. Sorensen and Crittenden, Jr. (1979) provides 1:24,000 scale geologic mapping of the Huntsville Quadrangle, which is the only 1:24,000 scale mapping of the project area to date. Coogan and King (2001) provide more recent geologic mapping of the area, but at a 1:100,000 scale. An updated Coogan and King (2016) regional geologic map (1:62,500 scale) provides the most recent published geologic mapping that covers the project area. Western Geologic (2012) conducted a reconnaissance-level geologic hazard study for the greater 200-acre Powder Mountain expansion project, including the Phase 1E, 1F, and 1G area. The Western Geologic (2012) study modified some of the potential landslide hazard boundaries that had previously been mapped at a regional scale (1:100,000) by Coogan and King (2001) and Elliott and Harty (2010). The corresponding United States Geological Survey (USGS) topographic map for the Huntsville Quadrangle (2014) provides physiographic and hydrologic data for the project area. Regional-scale geologic hazard maps pertaining to landslides (Elliott and Harty, 2010; Colton, 1991), faults (Christenson and Shaw, 2008a; USGS and Utah Geological Survey (UGS), 2006), debris-flows (Christenson and Shaw, 2008b), and liquefaction (Christenson and Shaw, 2008c; Anderson et al., 1994) that cover the project area were also reviewed. The Quaternary Fault and Fold Database (USGS and Utah Geological Survey (UGS), 2006), was reviewed to identify the location of proximal faults that have had associated Quaternary-aged displacement. The geotechnical investigation for the greater Powder Mountain property performed by IGES (2012), as well as the recently completed geotechnical investigation for the Phase 1E, 1F, and 1G property (IGES, 2015a) were reviewed in detail to provide an understanding of the nature of the subsurface materials at the site and to assist in the geologic mapping of the potential landslide hazard areas.

Stereo-paired aerial imagery for the project site and recent and historic Google Earth imagery was also reviewed to assist in the identification of potential adverse geologic conditions. The aerial photographs reviewed are documented in the *References* section of this report.

General Geologic Setting

The Phase 1E, 1F, and 1G property is located in the western portion of the northern Wasatch Mountains, approximately 4 miles northeast of Ogden Valley. The Wasatch Mountains contain a broad depositional history of thick Precambrian and Paleozoic sediments that have been subsequently modified by various tectonic episodes that have included thrusting, folding, intrusion, and volcanics, as well as scouring by glacial and fluvial processes (Stokes, 1987). The uplift of the Wasatch Mountains occurred relatively recently during the Late Tertiary

Period (Miocene Epoch) between 12 and 17 million years ago (Milligan, 2000). Since uplift, the Wasatch Front has seen substantial modification due to such occurrences as movement along the Wasatch Fault and associated spurs, the development of the numerous canyons that empty into the current Salt Lake Valley and Utah Valley and their associated alluvial fans, erosion and deposition from Lake Bonneville, and localized mass movement events (Hintze, 1988).

The Wasatch Mountains, as part of the Middle Rocky Mountains Province (Milligan, 2000), were uplifted as a fault block along the Wasatch Fault (Hintze, 1988). Ogden Valley itself is a fault-bounded trough that was occupied by Lake Bonneville (Sorensen and Crittenden, Jr, 1979) before being cut through by the Ogden River and subsequently dammed to form the Pineview Reservoir. The Wasatch Fault and its associated segments are part of an approximately 230-mile long zone of active normal faulting referred to as the Wasatch Fault Zone (WFZ), which has well-documented evidence of late Pleistocene and Holocene (though not historic) movement (Lund, 1990; Hintze, 1988). The faults associated with the WFZ are all normal faults, exhibiting block movement down to the west of the fault and up to the east. The WFZ is contained within a greater area of active seismic activity known as the Intermountain Seismic Belt (ISB), which runs approximately north-south from northwestern Montana, along the Wasatch Front of Utah, through southern Nevada, and into northern Arizona. In terms of earthquake risk and potential associated damage, the ISB ranks only second in North America to the San Andreas Fault Zone in California (Stokes, 1987).

The WFZ consists of a series of ten segments of the Wasatch Fault that each display different characteristics and past movement, and are believed to have movement independent of one another (UGS, 1996). The Phase 1E, 1F, and 1G property is located approximately 8.5 miles to the east of the Weber Segment of the Wasatch Fault, which is the closest documented Holocene-aged (active) fault to the property and trends north-south along the Wasatch Front (USGS and UGS, 2006).

The property is underlain by Cambrian bedrock which comprise the upper plate of the Willard Thrust (Sorensen and Crittenden, Jr., 1979), and comprise an allocthonous¹ block of rock that has been transported eastward to its present location from the Cordilleran geosyncline² (Stokes, 1987). The Willard Thrust is believed to connect and be structurally continuous with the Charleston-Nebo Thrust, which passes through the Salt Lake Valley and beneath Strawberry Reservoir, with the two thrusts connecting near Antelope Island (Stokes, 1987).

Surficial Geology

Several extant geologic maps cover the Phase 1E, 1F, and 1G property. Sorensen and Crittenden, Jr. (1979) provides the most detailed mapping of the general geology of the area, and serves as the base map for the *Regional Geologic Map 1* shown in Figure A-2. According to Sorensen and Crittenden, Jr. (1979), the property is largely underlain by several Cambrian

¹ Allocthonous: Formed or produced elsewhere than in its present place; of foreign origin, or introduced. (AGI, 2005)

² Geosyncline: As originally defined, a mobile downwarping of the crust of the Earth, either elongate or basinlike, measured in scores of kilometers, in which sedimentary and volcanic rocks accumulate to thicknesses of thousands of meters. (AGI, 2005)

sedimentary bedrock units, with the easternmost portion of the property mantled with undifferentiated Holocene colluvium, slopewash, and landslide deposits. The Cambrian bedrock units are mapped as striking to the northwest and dipping between 15 and 35 degrees to the northeast, and as such increase in age as one passes from east to west across the property. From youngest to oldest, these bedrock units include the Worm Creek Quartzite Member (Csw) of the St. Charles Limestone, the Nounan Dolomite (Cn), the Calls Fort Shale Member of the Bloomington Formation (Cbc), and undivided Cambrian limestones (Clu), including the Limestone and Hodges Shale Members of the Bloomington Formation, the Blacksmith Limestone, and the Ute Limestone. Collective thicknesses of these units may be approximately 4,000 feet, whereas the undifferentiated Holocene sediments (Qcs-Qls) found near the eastern margin of the property may be collectively as much as 118 feet thick (Sorensen and Crittenden, Jr., 1979).

The younger sediments found on the eastern portion of the property represent the western margin of a large body of undifferentiated mass-movement deposits that extend over $\frac{1}{4}$ mile to the east of the property (Sorensen and Crittenden, Jr., 1979). Another large lobe of these undifferentiated mass-movement deposits encroaches the northern margin of the property and extends approximately $\frac{1}{2}$ mile to the north. Both of these bodies of mass-movement deposits had their contacts further delineated by Coogan and King (2001, 2016) and Western Geologic (2012) in subsequent mapping efforts. Across the Phase 1E, 1F, and 1G property, the Coogan and King (2001, 2016) and Western Geologic (2012) outline of these deposits are largely consistent with one another. Coogan and King (2016) updated their 2001 map by differentiating the previously-mapped mass-movement deposits into individual landslide deposits. These are described as “poorly sorted clay- to boulder-sized material; includes slides, slumps, and locally flows and floods; generally characterized by hummocky topography, main and internal scarps, and chaotic bedding in displaced blocks” (Coogan and King, 2016). Coogan and King (2001, 2016) also separate the undifferentiated Cambrian bedrock on the western portion of the property into the Hodges Shale Member of the Bloomington Formation, the Blacksmith Dolomite, the Ute Formation, and the Langston Dolomite. Figure A-3 is *Regional Geology Map 2*, based upon the Western Geologic (2012) mapping effort, while Figure A-4 is *Regional Geology Map 3*, based upon the most recent mapping across the property (Coogan and King, 2016).

Whereas Sorensen and Crittenden, Jr. (1979) display a series of older (pre-Tertiary), northwest-southeast trending normal faults that offset Cambrian bedrock between approximately 0.6 and 0.8 miles to the west of the property (Figure A-2), the same faults are mapped as thrust faults by Coogan and King (2001, 2016 (Figure A-4)). Both Sorensen and Crittenden, Jr. (1979) and Coogan and King (2001) map a pre-Tertiary northwest-trending normal fault, downdropped to the west, at the head of Goertsen Canyon approximately one mile southeast of the property. Coogan and King (2016) show this fault as extending to the northwest to approximately 0.15 miles south of the property. Additionally, Coogan and King (2016) show another northwest-trending bedrock normal fault, downdropped to the east, passing through the westernmost portion of the property (Figure A-4).

Hydrology

The USGS topographic map for the Huntsville Quadrangle shows that the Phase 1E, 1F, and 1G project area generally consists of highlands that are straddled by the South Fork Wolf Creek drainage to the west and an unnamed ephemeral stream drainage to the south. Both drainages flow to the southwest, with the unnamed drainage joining the South Wolf Creek drainage approximately $\frac{3}{4}$ of a mile to the southwest of the property. Streamflow from these drainages ultimately adjoin the Odgen River and empties into the Pineview Reservoir, located approximately 5.25 miles to the southwest of the property.

On the property, two small ephemeral stream drainages are found. The larger of the two drainages runs generally north-south along the easternmost portion of the property, while the smaller drainage passes generally north-south through the middle of the property. No springs have been noted on or adjacent to the property.

Groundwater depths for the property are currently unknown, but are anticipated to fluctuate both seasonally and annually. The recently completed geotechnical investigation of the property completed in the June of 2015 (IGES, 2015a) did not encounter groundwater in any of the test pits, and groundwater was not encountered in any of the trenches excavated as part of this geologic hazard assessment.

Geologic Hazards

Based upon the available geologic literature, regional-scale geologic hazard maps that cover the Phase 1E, 1F, and 1G project area have been produced for landslide, fault, debris-flow, and liquefaction hazards. The following is a summary of the data presented in these regional and other geologic hazard maps and literature.

Landslides

As discussed above, Sorensen and Crittenden, Jr. (1979) show the easternmost portion and some of the northern margin of the Phase 1E, 1F, and 1G property to contain mass-movement deposits that include shallow landslide deposits. Colton (1991) maps the outline of these deposits largely consistent with Sorensen and Crittenden, Jr. (1979), and shows the direction of slide movement for the eastern deposits to be to the south. The more detailed contact for these deposits originally mapped by Coogan and King (2001) was also used by Elliott and Harty (2010), who mapped these deposits as “landslide undifferentiated from talus and/or colluvial deposits.” Western Geologic (2012; Figure A-3) maintains the same contact outline and description for these deposits along the eastern and northern portion of the property as Coogan and King (2001). Coogan and King (2016) maintain the same contact outline for these deposits, but identify them distinctly as landslide deposits (Figure A-4).

The recent IGES geotechnical investigation of the property (IGES, 2015a) noted “chaotic, jumbled soil” in three of the 16 test pits excavated (TP-01, TP-06, and TP-14), which may be associated with landslide deposits. Two (TP-06 and TP-14) of the three test pits with this description were excavated near the southern margin of the property, while TP-01 was located in the easternmost portion of the property in the area mapped as potential landslide deposits. Notably, two additional test pits (TP-12 and TP-13) were excavated in the area mapped as

potential landslide deposits, but “chaotic, jumbled soil” was not noted in either of these test pits.

Faults

According to the Weber County Code of Ordinances, an active fault is defined as “a fault displaying evidence of greater than four inches of displacement along one or more of its traces during Holocene time (about 11,000 years ago to the present)” (Weber County, 2015). Because surface-fault-rupture hazards are only associated with active faults, it is imperative that the precise locations of active faults are known. Christenson and Shaw (2008a) show that the property is not located within a surface-fault-rupture *special study area*. As noted above, there are several inactive, pre-Tertiary bedrock faults within several miles of the property. The Quaternary Fault and Fold Database of the United States (USGS and UGS, 2006) shows four Quaternary-aged faults to be located within 5 miles of the property. This includes three faults with ages of less than 130,000 years (the James Peak Fault, located approximately 3.5 miles to the northwest of the property, the Broadmouth Canyon Faults, located approximately 4 miles to the west of the property, and the East Cache Fault Zone, located approximately 3.75 miles to the north of the property) and one fault with an age of less than 1.6 million years (the Ogden Valley Northeastern Margin Fault, located approximately 2 miles to the south of the property).

No active faults have currently been mapped on the property. The closest active fault to the property is the Weber Segment of the Wasatch Fault, located approximately 8.5 miles to the west of the property (USGS and UGS, 2006).

Debris-Flows

Christensen and Shaw (2008b) do not show the project area to be located within a debris-flow hazard special study area. No additional maps have been produced to document the debris-flow hazard associated with the property, though the description by Coogan and King (2001) for the mapped mass-movement deposits on the easternmost portion of the property include the possibility that some of the material was deposited by way of debris-flows.

Liquefaction

Christenson and Shaw (2008c) and Anderson, et al. (1994) show the project area to be within a zone of very low potential for liquefaction hazards.

REVIEW OF AERIAL IMAGERY

A series of aerial photographs covering the Phase 1E, 1F, and 1G project area were taken from the UGS Aerial Imagery Collection (UGS, 2016) and analyzed stereoscopically for the presence of adverse geologic conditions across the property. This included a review of photos collected from the years 1947, 1953, and 1963. A table displaying the details of the aerial photographs reviewed can be found in the *References* section of this report.

No geologic lineaments or fault scarps were observed in the aerial photography. However, a large curvilinear feature approximately 400 feet wide was seen to pass northwest to southeast through the western portion of the property where bedrock does not appear to be exposed at the surface. Upon referencing the geologic maps covering the property, it was noted that this feature corresponds to the mapped Calls Fort Shale Member of the Bloomington Formation, a slope-

forming geologic unit and is therefore not a potential landslide feature. This was confirmed during the site reconnaissance and field mapping.

The middle of the property was observed to have irregularly knobby, though not necessarily hummocky, topography. Test pits excavated in this vicinity in the geotechnical investigation for the property (IGES, 2015a) suggest that this irregular topography is more a product of the erosion of the carbonate bedrock than small, shallow, localized landslide deposits. Additionally, a small curvilinear feature potentially indicative of a landslide headscarp was noted approximately 400 feet to the southeast of the southeastern property margin. This feature is located within an area mapped as Nounan Dolomite.

Google Earth imagery of the property from between the years of 1993 and 2015 were also reviewed. Light-colored, near-surface bedrock was readily observed over much of the property in the more recent images, though the older images display an increased expression of the near-surface bedrock, especially in the west-central portion of the property. Surficial bedrock expression was observed to be limited in the eastern one-third of the property, especially in a northwest to southeast-trending swath of land that is fairly well-vegetated, and passes immediately east of Lot 4.

No LiDAR data for the project area was readily available to be reviewed at the time of this report.

SITE RECONNAISSANCE

Mr. Peter E. Doumit, P.G., C.P.G., of IGES conducted reconnaissance of the site and the immediate adjacent properties between June 21 and June 29, 2016. The site reconnaissance was conducted with the intent to assess the general geologic conditions present across the property, with specific interest in those areas identified in the geologic literature and aerial imagery reviews as potential geologic hazard areas. Additionally, the site reconnaissance provided the opportunity to geologically map the surficial geology of the area. Figure A-5 is a site-specific geologic map of the Phase 1E, 1F, and 1G property and adjacent areas.

In general, variously-sized boulders and cobbles were found scattered across the property, as part of a surficial geologic unit considered to be either weathered Wasatch Formation or colluvial deposits derived from weathered Wasatch Formation. These were typically subangular to subrounded, and were found to be as large as two feet in diameter. The rock clasts were found to be comprised predominantly of pink to purple massive to banded to conglomeratic quartzite, though in some areas angular clasts of Cambrian-aged dolomitic bedrock were observed as part of the colluvial detritus.

Much of the property was observed to be densely vegetated with aspen trees, grasses, or low-lying bushes, some of which showed evidence of downslope soil creep. The southern and western portion of the property exhibited common outcrops of Cambrian bedrock, which included outcrops of several different formations (see Figure A-5). No springs or hydrophilic plants indicative of shallow groundwater conditions were observed across the property, despite the site reconnaissance taking place near expected peak groundwater levels. The eastern and southeastern portions of the property contained the most irregular topography and surficial

features potentially indicative of landsliding, and these areas were subsequently investigated with subsurface excavations.

Eight different lithologic units were observed on the surface during the site reconnaissance, while an additional unit was observed only in a road cut:

Qcq: Quaternary-aged (Holocene to Pleistocene) colluvial deposits derived from weathered Wasatch Formation. This unit was the most prevalent across the property, and consisted entirely of subrounded to subangular quartzite cobbles and boulders up to several feet in diameter.

Qcb: Quaternary-aged (Holocene to Pleistocene) colluvial deposits derived from both weathered Wasatch Formation and weathered Cambrian bedrock outcrops. This unit was generally found between Cambrian bedrock outcrops and Wasatch Formation-only derived colluvial deposits in the middle portion of the property, and was also observed downslope (south) of Cambrian bedrock outcrops in the southern and western portions of the property. It consisted of a combination of cobbles and boulders of subrounded quartzite and angular limestone and dolomite up to several feet in diameter.

Qls: Quaternary-aged (Holocene to Pleistocene) landslide deposits. This unit was observed in the eastern and southeastern portions of the property, coinciding with irregular, hummocky topography and occasional small sag ponds. In some areas, small headscarps could be delineated. The unit was found to be predominantly associated with the Qcq and Qcb unit lithologies, and did not appear to involve large blocks of Cambrian bedrock units.

Tw: Tertiary-aged (Eocene to Paleocene) Wasatch Formation. This unit was observed on the ridge to the northeast of the property, and was the formation from which the quartzite boulders of the colluvial units were derived. The unit is a reddish-brown conglomerate bedrock with subrounded quartzite cobbles and boulders that commonly weathers to a sandy gravel. As such, the unit was not exposed in outcrop but rather was identified by way of its surficial weathering. It was distinguished from the Qcq unit in that it has a higher sand component and the matrix has a reddish hue.

Csd: Cambrian-aged Dolomite Member of the St. Charles Limestone. This unit was observed as a sliver of outcrop found immediately north of Horizon Run northeast of the property. The unit was a light gray to pinkish orange thickly bedded sparry, sandy dolomite. Though the unit also exhibited blocky jointing, the unit weathered with rounded edges.

Csw: Cambrian-aged Worm Creek Quartzite Member of the St. Charles Limestone. This unit was observed as a sliver of outcrop immediately north of Horizon Run northeast of the property, and along Horizon Run at the northeastern property margin. The unit was a dark gray calcareous sandstone gradational to sandy dolomite with thin shaley beds, and appeared similar in appearance to the underlying Nounan Dolomite (unit Cn).

Cn: Cambrian-aged Nounan Dolomite. This unit was observed in outcrops across much of the eastern half of the property. The unit was a thinly to thickly bedded medium gray to dark gray sparry to finely sparry sandy dolomite and limestone. In outcrop, the unit commonly exhibited

blocky jointing and weathered to a light gray color. The unit also was found to contain beds of white to very light gray coarsely sparry dolomite and light bluish gray, highly etched sparry limestone in places.

Cbc: Cambrian-aged Calls Fort Shale Member of the Bloomington Formation. This slope-forming unit was found in the southern portion of the property, and consisted of a greenish gray, thinly bedded, calcareous silty shale. It was only exposed in outcrop where roads for the geotechnical test pits had uncovered the hillside, and therefore was covered on the surface by the Qcb unit.

Cbm: Cambrian-aged Middle Limestone Member of the Bloomington Formation. This unit was observed to outcrop in the southwestern portion of the property, and typically consisted of a dark gray, mottled, thickly bedded, finely sparry to micritic limestone with some thin shaley interbeds.

Because landslide and potential landslide features were observed during the site reconnaissance, it was determined that subsurface excavations were necessary to assess the landslide hazard risk associated with the property.

SUBSURFACE INVESTIGATION

Between September 21 and September 26, 2016, seven exploration trenches were excavated at representative locations across the property, where potential landslide hazards had been identified during the site reconnaissance and field mapping (Figure A-5). The trenches were excavated to depths ranging between 10 and 15 feet below existing grade with the aid of a Caterpillar 315C tracked excavator. Detailed logs for each of the trenches are displayed in Figures A-6 through A-12. Shallow Cambrian bedrock was encountered in all seven trenches between the depths of 4 and 9 feet below existing grade, and refusal was noted in all trenches except TR-2. Groundwater was not encountered in any of the test pits. Evidence of mass-movement was observed in only TR-1 and TR-2. In general, the subsurface profile consisted of topsoil forming upon colluvial units, which was underlain by Cambrian bedrock that was commonly highly weathered at the colluvium/bedrock interface. The following geologic units were encountered in the subsurface in the exploration trenches:

A/B Soil Horizon: This topsoil unit was found to be between 1 and 3 feet thick. The unit consisted of loose to medium-stiff, slightly moist to moist, dark brown to grayish brown lean CLAY with gravel (CL) that contained abundant plant and tree roots. Most of the gravel clasts encountered were quartzite, though some dolomite bedrock clasts were encountered in this unit in TR-2, TR-4, TR-6, and TR-7. Topsoil was the matrix to the loose colluvial unit seen at the surface in TP-5. The topsoil was typically found to be forming upon an underlying colluvium unit.

Quartzite Colluvium (Qcq): This unit was found to be underlying the topsoil in TR-2 and TR-3. The unit was between 1 and 2 feet thick, and consisted of a medium-stiff to loose, moist to slightly moist, dark brown to light brown lean CLAY with gravel (CL) gradational to clayey GRAVEL (GC). Gravel and larger-sized subrounded to subangular quartzite clasts comprised between 30% and 75% of the unit, with individual clasts up to 10 inches in diameter, though

the mode clast size was 3 to 4 inches. Pinhole voids 1 to 2 mm in diameter were observed in TR-2. Plant and tree roots were common within the unit.

Bedrock Colluvium (Qcb): This unit was found to be underlying the Qcq unit in TR-3, underlying the topsoil in TR-4, and at the surface and associated with the topsoil in TR-5, TR-6, and TR-7. The unit was between 1 and 6 feet thick, and consisted of loose to very stiff, slightly moist, dark brown lean CLAY with gravel (CL) gradational to clayey GRAVEL (GC). Gravel and larger-sized clasts consisted of a combination of both quartzite and dolomite bedrock, and comprised between 25% and 60% of the unit, with individual clasts up to 1 foot in diameter.

Shallow Landslide (Ols): This unit was found to be underlying the topsoil unit in TR-1 and possibly TR-2. The unit was between 1 and 3 feet thick, and consisted of stiff to very stiff, dry, light brown lean CLAY with gravel (CL). Gravel and larger-sized clasts consisted entirely of subrounded to subangular quartzite, which comprised between 25% and 30% of the unit, with individual clasts up to 6 inches in diameter. Pinhole voids between 1 and 2 mm in diameter were abundant within the unit. The unit appeared similar to a cemented colluvial unit observed in other trenches on Powder Mountain, with the exception that this unit has a distinct slide plane immediately underlying it.

Wasatch Formation? (Tw): This unit was observed only in TR-2 underlying the Qcq unit and in contact with weathered and largely unweathered Nounan Dolomite bedrock. The unit was between 5 and 7 feet thick, and consisted of a medium dense, moist, dark reddish brown clayey SAND (SC) with gravel gradational to sandy fat CLAY with gravel (CH). Gravel and larger-sized clasts comprised between 25% and 30% of the unit, and consisted of a combination of quartzite and dolomite up to 2.5 feet in diameter. The unit is queried in that it appeared very similar to the Wasatch Formation in color and USCS classification; however, the Wasatch Formation doesn't typically contain dolomite clasts, and the unit was found to have an odd semi-vertical contact with the Nounan Dolomite.

Nounan Dolomite (Cn): This unit was observed in all seven of the exploration trenches, and extended in thickness beyond the depths of exploration. The unit typically contained several feet of highly weathered and oxidized dolomite bedrock overlying the in-situ bedrock. In one instance (TR-1), a paleosol was developed within the highly-weathered bedrock. The bedrock was a thinly bedded to massive, sparry to finely sparry, dark gray to bluish gray sandy dolomite that commonly weathered to a fine sand. Though heavily jointed with blocky jointing, many individual blocks were hard to very hard.

GEOLOGIC HAZARD ASSESSMENT

Geologic hazard assessments are necessary to determine the potential risk associated with particular geologic hazards that are capable of adversely affecting a proposed development area. As such, they are essential in evaluating the suitability of an area for development and provide critical data in both the planning and design stages of a proposed development. The geologic hazard assessment discussion below is based upon a qualitative assessment of the risk associated with a particular geologic hazard, based upon the data reviewed and collected as part of this investigation.

A “low” hazard rating is an indication that the hazard is either absent, is present in such a remote possibility so as to pose limited or little risk, or is not anticipated to impact the project in an adverse way. Areas with a low-risk determination for a particular geologic hazard do not require additional site-specific studies or associated mitigation practices with regard to the geologic hazard in question. A “moderate” hazard rating is an indication that the hazard has the capability of adversely affecting the project at least in part, and that the conditions necessary for the geologic hazard are present in a significant, though not abundant, manner. Areas with a moderate-risk determination for a particular geologic hazard may require additional site-specific studies, depending on location and construction specifics, as well as associated mitigation practices in the areas that have been identified as the most prone to susceptibility to the particular geologic hazard. A “high” hazard rating is an indication that the hazard is very capable of or currently does adversely affecting the project, that the geologic conditions pertaining to the particular hazard are present in abundance, and/or that there is geologic evidence of the hazard having occurred at the area in the historic or geologic past. Areas with a high-risk determination always require additional site-specific hazard investigations and associated mitigation practices where the location and construction specifics are directly impacted by the hazard. For areas with a high-risk geologic hazard, simple avoidance is often considered.

The following are the results of the geologic hazard assessment for the Phase 1E, 1F, and 1G property.

Landslides/Mass Movement

Landslide deposits have been mapped across the easternmost portion and northern margin of the property (Coogan and King, 2016; Western Geologic, 2012). Site reconnaissance of these areas as part of this investigation did not observe clear evidence of landsliding in these areas (scarps, hummocky topography, etc.), though uneven ground and small slope breaks were observed. The subsequent trenching performed as part of this investigation was intended to further define this landslide area. All seven trenches were spotted in locations that were considered to be potential landslide areas, based upon the site reconnaissance. However, subsurface evidence of mass-movement was only encountered in trenches TR-1 and TR-2, and the nature of the mass-movement appeared to be different in these two trenches.

In TR-1, a slickensided slide plane clay was present that had formed on the top of the weathered bedrock, dipping downslope to the southwest at approximately 16 degrees. A jumbled, shallow landslide unit was found overlying the slide plane. In TR-2, a similar, though wavy, non-planar slickensided clay was found overlying the dolomite bedrock. The nature of the surface and associated shear gave the indication of soil creep, though an odd semi-vertical contact between the bedrock and possibly the Wasatch Formation was also observed. This contact is interpreted to be depositional in nature, as a large quartzite boulder and Wasatch-like material was observed below both the slickensided clay and a weathered dolomite lens that was continuous with the bedrock (see Figure A-7). This suggests that the boulder and Wasatch-like material was originally deposited under an overhang of bedrock that subsequently weathered, and post-depositional soil creep has ensued.

Given that there are no prominent surficial features indicative of landsliding in the TR-1 and TR-2 area, the mass-movement deposits associated with these two trenches is considered to be Pleistocene in age. The approximate trace of the area affected by these deposits is exhibited in Figure A-5. The deposits are indicative of shallow and not deep-seated landsliding, affecting only up to approximately 10 feet below the existing grade. Additionally, because the deposits appear different in TR-1 and TR-2, it is likely that they represent distinct, localized events that have been highly modified. This is evidenced by a lack of geomorphic expression at the surface, and multiple feet of topsoil/colluvial cover present in these areas.

Additional landslide deposits were observed along the southern margin and just south of the southern margin of the property during the site reconnaissance (see Figure A-5). The trace of these deposits is far enough south as to not impact any of the proposed development, and these appear to be shallow slides similar to what was encountered in TR-1 and TR-2.

Given this data, the risk associated with landslide and slope stability hazards on the property is considered to be low for all areas and lots outside of the landslide outlines shown on Figure A-5, and moderate for all areas and lots located inside the landslide outlines – this finding primarily impacts Lot 6R and Lot 119, and potentially Lot 5R, Lot 8, and other lots east of the property.

Rockfall

Bedrock outcrops are found at a number of places across the property, though these outcrops largely do not extend more than 10 feet above the ground surface, and in most cases are weathering out at ground level. Additionally, bedrock blocks that have weathered off the outcrops were not observed to have been transported downslope more than approximately 50 feet. Given this data, the rockfall hazard associated with most of the property is considered to be low. The rockfall hazard is considered to be low to moderate for only those limited parts of the property immediately downslope of an outcrop.

Surface-Fault-Rupture and Earthquake-Related Hazards

A single bedrock fault (inactive) has been mapped on the property, passing through the southwestern portion of the property (Figure A-4; Coogan and King, 2016). The closest active fault to the property is the Weber Segment of the Wasatch Fault Zone, located approximately 8.5 miles to the west of the property (USGS and UGS, 2006). Given this information, the risk associated with surface-fault-rupture on the property is considered low.

The entire property is subject to earthquake-related ground shaking from a large earthquake generated along the active Wasatch Fault. Given the distance from the Wasatch Fault, the hazard associated with ground shaking is considered to be moderate. Proper building design according to appropriate building code and design parameters can assist in mitigating the hazard associated with earthquake ground shaking.

Liquefaction

The site is underlain by several different Cambrian bedrock units comprised of hard dolomite and limestone. Bedrock units such as these are not considered susceptible to liquefaction; as such, the potential for liquefaction occurring at the site is considered low.

Debris-Flows and Flooding Hazards

The property is located near the top of the ridge that drains to the south and into the South Fork of the Wolf Creek drainage, and the property is not located adjacent to any active drainages. Though several small ephemeral drainages are present on the property, the lots are not located within or adjacent to these drainages. Given these conditions, the debris-flow and flooding hazards associated with the property are considered to be low.

Shallow Groundwater

Groundwater was not encountered in any of the 16 test pits excavated as part of the geotechnical investigation (IGES, 2015), nor in the 7 trenches excavated as part of this investigation. Additionally, no springs, ponds, or hydrophilic plants indicative of shallow groundwater conditions were observed on the property during the site reconnaissance.

It is expected that groundwater levels will fluctuate both seasonally and annually; however, given the existing data, the risk associated with shallow groundwater hazards is considered low.

CONCLUSIONS AND RECOMMENDATIONS

Based upon the data collected and reviewed as part of this assessment, IGES makes the following conclusions regarding the geological hazards present at the Phase 1E, 1F, and 1G project area:

- **The Phase 1E, 1F, and 1G project appears to have geological hazards that could potentially adversely affect a portion of the development as currently proposed. Geological hazards in the form of landslides and other mass-movement processes, including soil creep, are capable of adversely affecting the lots in the northeastern part of the property. IGES concludes, however, that the geologic conditions are such that appropriate mitigation practices (discussed in the recommendations outlined below) can reduce the level of landslide/mass movement hazard risk to an acceptable level for development.**
- Landslide hazards are considered to be moderate for Lots 5R, 6R, 119, and 9R. This designation is based upon the presence of shallow landslide and/or soil creep features and associated shearing observed in TR-1 and TR-2, and the unknown northwestern extent of these deposits. Landslide hazards are considered to be low for the remaining lots on the property, including Lots 1R, 2R, 3R, 4R, and 10R.
- The preexisting landslide appears to be stable based on the current location of the slide, estimated soil strengths, current and proposed grades, and limit equilibrium slope stability analysis performed for the proposed development (IGES, 2015b). Anticipated grading (construction of homes with basements, moderate cuts and fills for grading around the homes, etc.) is not expected to alter the stability of the slope in a meaningful way. The primary concern for slope instability would be for highly localized ground movement associated with the older, concealed surficial landslide deposits identified in TR-1 and TR-2 – this primarily impacts Lots 5R, 6R, Lot 119, and potentially Lot 9R. However, this hazard can be mitigated with proper excavation and grading within the

building footprint. Consequently, the site is considered suitable for the proposed development, provided the recommendations presented in the following paragraphs are followed.

- Earthquake ground shaking is the only hazard that may potentially affect all parts of the project area and is considered to pose moderate risk, while other hazards have the potential to affect only limited portions of the project area, or pose minimal risk.
- Rockfall hazards are considered to be low to moderate for Lot 1R, and low for all other lots on the property.
- Surface-fault-rupture, liquefaction, debris-flow, flooding, and shallow groundwater hazards are considered to be low for the property.

Given the conclusions listed above, IGES makes the following recommendations:

- The recommendations provided in the IGES geotechnical report (2015a) and rockery design submittal (2015b) should be followed for all proposed development on the subject property, except as amended herein. As a result of the additional subsurface exploration conducted for this report, the referenced geotechnical report may be considered to encompass Lots 5R, 6R, and 119 (these three lots were not a part of the original scope in 2015).
- For those areas identified as having moderate landslide risk, overexcavation of the landslide deposits and through the slide/shear zones to competent earth materials must occur preceding the emplacement of footings. In these areas, conventional spread footings are to be founded upon competent earth materials or appropriately compacted structural fill that immediately overlies the competent bedrock. The overexcavation must extend over the entire building footprint (not just the footings), and should extend a minimum of four feet beyond the exterior foundations.
- For Lot 1R, to reduce the rockfall hazard risk to low, an earthen berm or rock wall approximately 3 feet high is recommended on the north side of the proposed structure.
- Because landslide deposits are noted on and near the property, an IGES geologist should observe the foundation excavations to assess the removal of potentially hazardous landslide deposits and to observe that the foundation footprint has been excavated down to competent, stable earth materials.

LIMITATIONS


The conclusions and recommendations presented in this report are based on limited geologic literature review, site reconnaissance, subsurface investigation, and our understanding of the proposed construction. It should be noted that construction activities may expose adverse geologic conditions that were hitherto unknown. Therefore, the geologic hazard classifications as denoted in this report are potentially subject to change with data collected from additional

excavations across the property. This report was prepared in accordance with the generally accepted standard of practice at the time the report was written. No warranty, expressed or implied, is made.

CLOSURE

We appreciate the opportunity to provide you with our services. If you have any questions, please contact the undersigned at your convenience at (801) 748-4044.

**Respectfully Submitted,
IGES, Inc.**

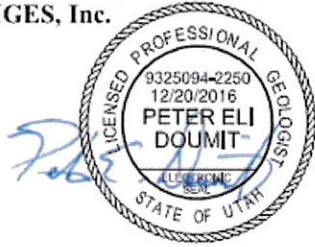

Peter E. Doumit, P.G., C.P.G.
Senior Geologist



David A. Glass, P.E.
Senior Geotechnical Engineer

Attachments:

References

- | | | |
|------------|---------------------|------------------------|
| Appendix A | Figure A-1 | Site Vicinity Map |
| | Figure A-2 | Regional Geology Map 1 |
| | Figure A-3 | Regional Geology Map 2 |
| | Figure A-4 | Regional Geology Map 3 |
| | Figure A-5 | Local Geology Map |
| | Figures A-6 to A-12 | Trench Logs |
| Appendix B | Laboratory Results | |

REFERENCES

- American Geologic Institute (AGI), 2005, Glossary of Geology, Fifth Edition, revised, Neuendorf, K.K.E., Mehl, Jr. J.P., and Jackson, J.A., editors: American Geological Institute, Alexandria, Virginia, 783 p.
- Anderson, L.R., Keaton, J.R., and Rice, J.D., 1994, Liquefaction Potential Map for the Northern Wasatch Front, Utah, Complete Technical Report: Utah Geological Survey Contract Report 94-6, 169 p.
- Christenson, G.E., and Shaw, L.M., 2008a, Liquefaction Special Study Areas, Wasatch Front and Nearby Areas, Utah: Utah Geological Survey Supplement Map to Utah Geological Survey Circular 106, 1 Plate, Scale 1:250,000.
- Christenson, G.E., and Shaw, L.M., 2008b, Surface Fault Rupture Special Study Areas, Wasatch Front and Nearby Areas, Utah: Utah Geological Survey Supplement Map to Utah Geological Survey Circular 106, 1 Plate, Scale 1:200,000.
- Colton, R.B., 1991, Landslide Deposits in the Ogden 30' x 60' Quadrangle, Utah and Wyoming: U.S. Geological Survey Open-File Report 91-297, 1 Plate, 8 p., Scale 1:100,000.
- Coogan, J.C., and King, J.K., 2001, Progress Report Geologic Map of the Ogden 30' x 60' Quadrangle, Utah and Wyoming – Year 3 of 3: Utah Geological Survey Open-File Report 380, 1 Plate, 33 p., Scale 1:100,000.
- Elliott, A.H., and Harty, K.M., 2010, Landslide Maps of Utah, Ogden 30' X 60' Quadrangle: Utah Geological Survey Map 246DM, Plate 6 of 46, Scale 1:100,000.
- Federal Emergency Management Agency [FEMA], 2015, Flood Insurance Rate Map, Weber County, Utah: Map Number 49057C0250F, Effective June 1, 2015, Not Printed.
- Giraud, R.E., and Shaw, L.M., 2007, Landslide Susceptibility Map of Utah: Utah Geological Survey Map 228DM, 1 Plate, 15 p., Scale 1:500,000.
- Hintze, L.F., 1988, Geologic History of Utah: Brigham Young University Geology Studies Special Publication 7, Provo, Utah, 202 p.
- Intermountain GeoEnvironmental Services, Inc. (IGES), 2012, Preliminary Geotechnical Investigation: Powder Mountain Resort, Weber County, Utah, IGES Project No. 01628-001, dated July 26, 2012.
- IGES, 2015a, Geotechnical Investigation: Summit Eden Phases 1E, 1F, and 1G, Summit at Powder Mountain Resort, Weber County, Utah, IGES Project No. 01628-011, dated September 30, 2015.

IGES, 2015b, Rockery Design Package, Phase 1E, 1F, and 1G – Summit Powder Mountain, Weber County, Utah, Project No. 01628-011, dated October 1, 2015.

Lund, W.R., 1990, editor, Engineering geology of the Salt Lake City metropolitan area, Utah: Utah Geological Survey Bulletin 126, 66 p.

Milligan, M.R., 2000, How was Utah’s topography formed? Utah Geological Survey, Survey Notes, v. 32, no.1, pp. 10-11.

Sorensen, M.L., and Crittenden, Jr., M.D., 1979, Geologic Map of the Huntsville Quadrangle, Weber and Cache Counties, Utah: U.S. Geological Survey Geologic Quadrangle Map GQ-1503, 1 Plate, Scale 1:24,000.

Stokes, W.L., 1987, Geology of Utah: Utah Museum of Natural History and Utah Geological and Mineral Survey Department of Natural Resources, Salt Lake City, UT, Utah Museum of Natural History Occasional Paper 6, 280 p.

U.S. Geological Survey and Utah Geological Survey, 2006, Quaternary fault and fold database for the United States, accessed 3-17-16, from USGS website: <http://earthquakes.usgs.gov/regional/qfaults>

Utah Geological Survey (UGS), 2016, Utah Geological Survey Aerial Imagery Collection <https://geodata.geology.utah.gov/imagery/>

AERIAL PHOTOGRAPHS

Data Set	Date	Flight	Photographs	Scale
1947 AAJ	August 10, 1946	AAJ 1B	88-90	1:20,000
1947 AAJ	August 10, 1946	AAJ 2B	34-35	1:20,000
1953 AAI	September 14, 1952	AAI 3K	130-131	1:20,000
1953 AAI	September 14, 1952	AAI 4K	34-36	1:20,000
1963 ELK	June 25, 1963	ELK 2	202-203	1:15,840
1963 ELK	June 25, 1963	ELK 3	57-59	1:15,840

*<https://geodata.geology.utah.gov/imagery/>


Utah Geological Survey, 1996, The Wasatch Fault: UGS Public Information Series 40, 17 p.

Weber County, 1988, Landslide Hazard Map of the Huntsville Quadrangle: Compiled by Mike Lowe, Weber/Davis Counties Geologist, 1 Plate.

Weber County, 2015, Natural Hazards Overlay Districts, Chapter 27 of the Weber County Code of Ordinances Ordinance No. 2015-22, updated from Chapter 38 of Ordinance of 1956, adopted on December 22, 2015.

Western Geologic, 2012, Report: Geologic Hazards Reconnaissance, Proposed Area 1 Mixed-Use Development, Powder Mountain Resort, Weber County, Utah, dated August 28, 2012.

APPENDIX A

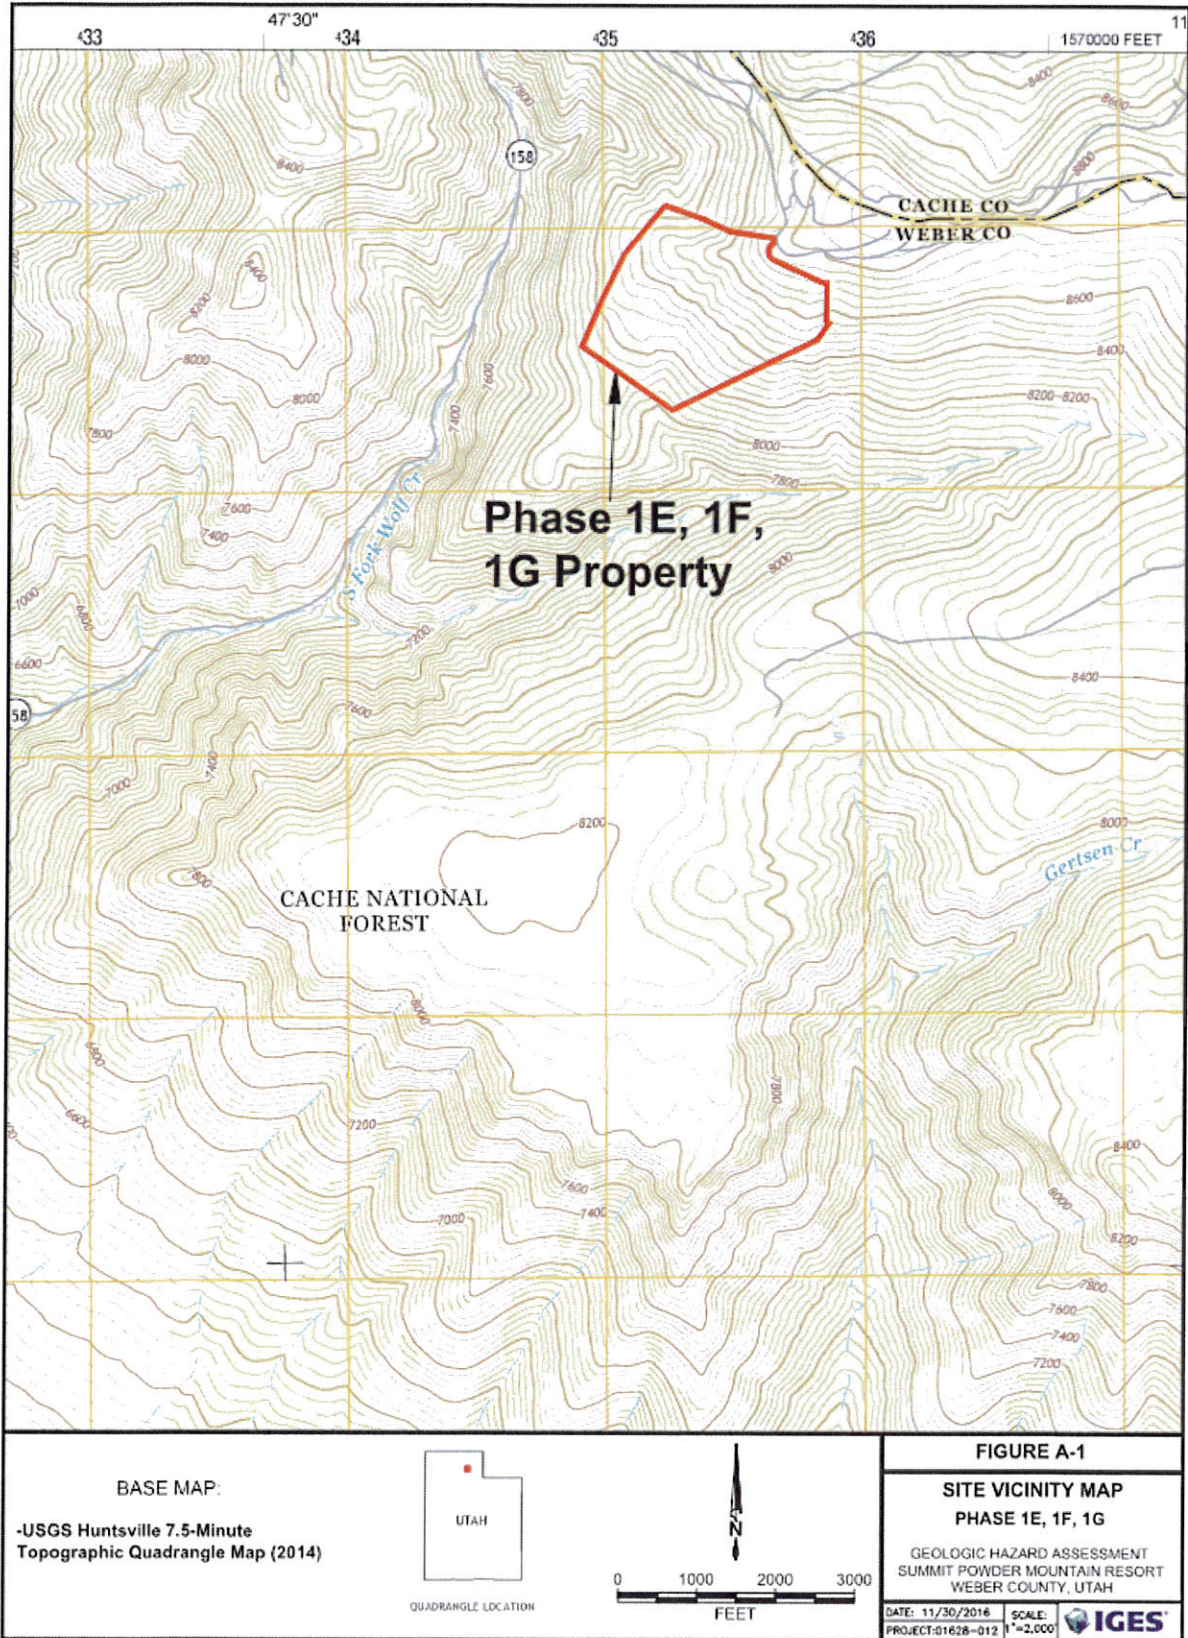

BASE MAP:
 -USGS Huntsville 7.5-Minute
 Topographic Quadrangle Map (2014)










FIGURE A-1
SITE VICINITY MAP
PHASE 1E, 1F, 1G
 GEOLOGIC HAZARD ASSESSMENT
 SUMMIT POWDER MOUNTAIN RESORT
 WEBER COUNTY, UTAH
 DATE: 11/30/2016 SCALE: 1"=2,000'
 PROJECT: 01628-012 **IGES**

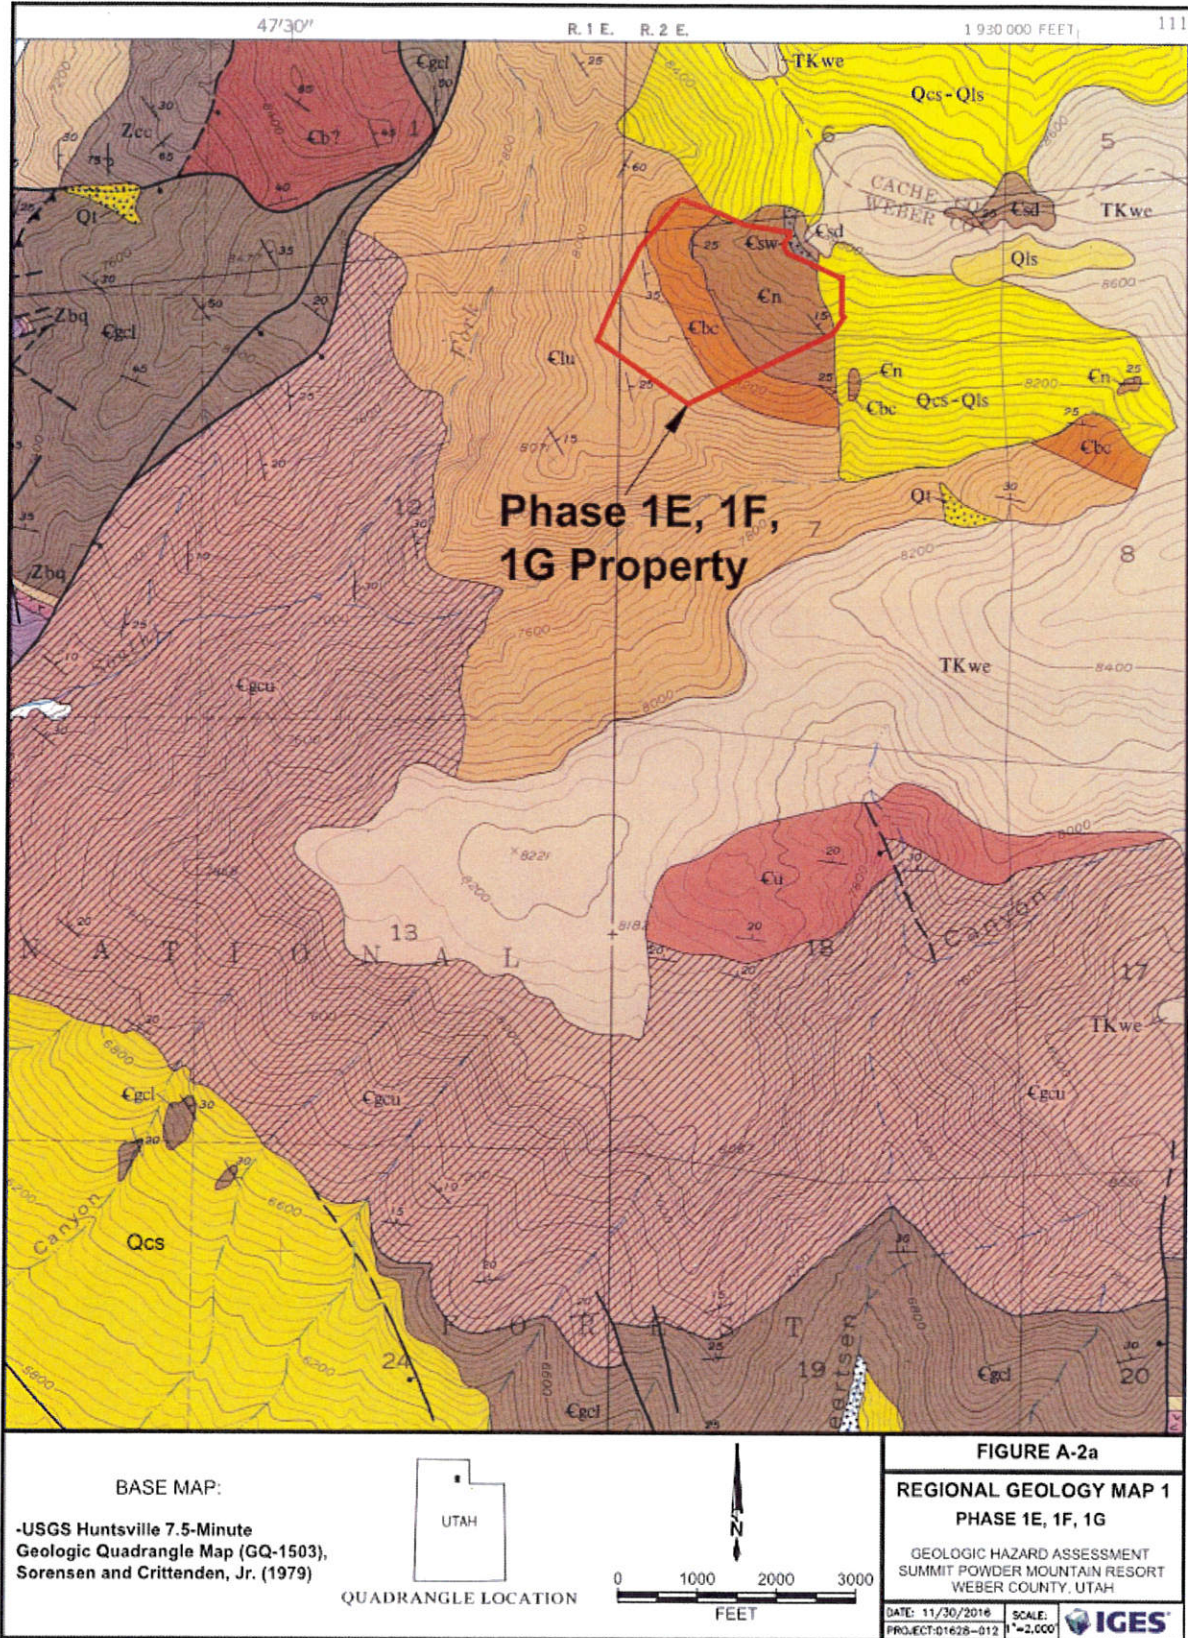

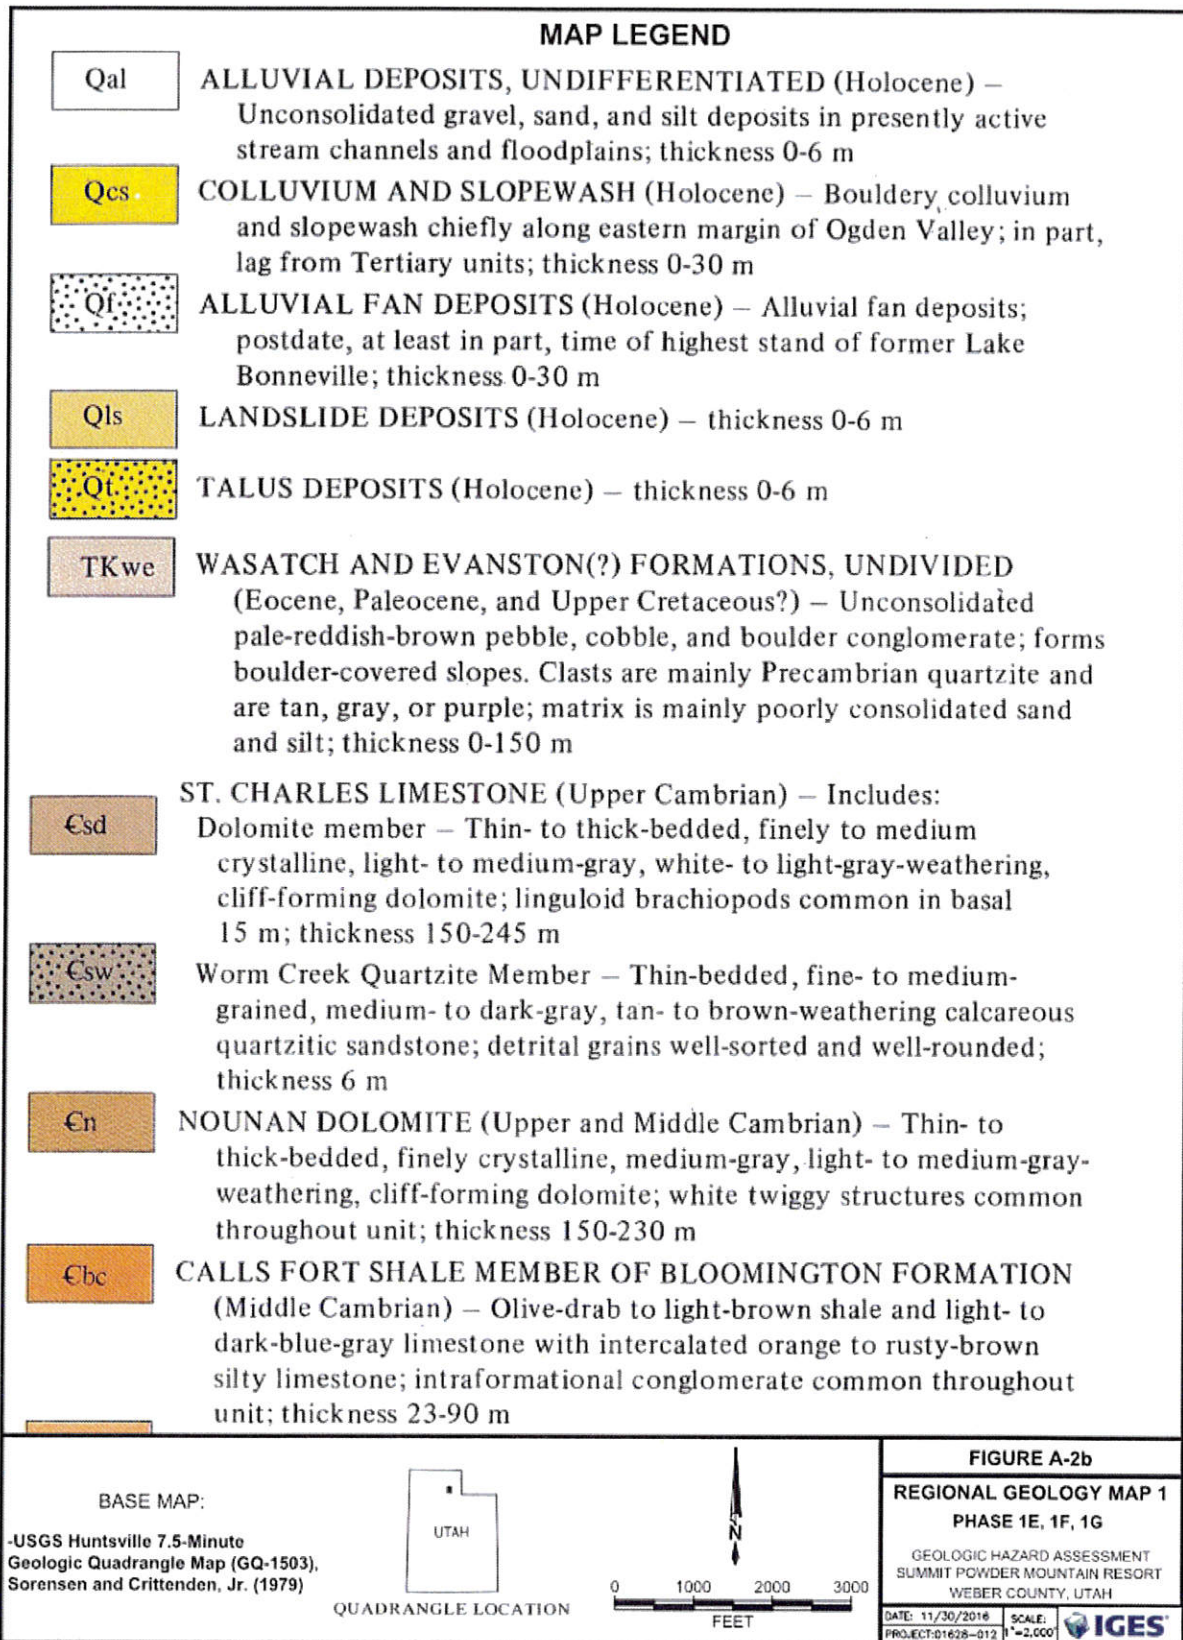

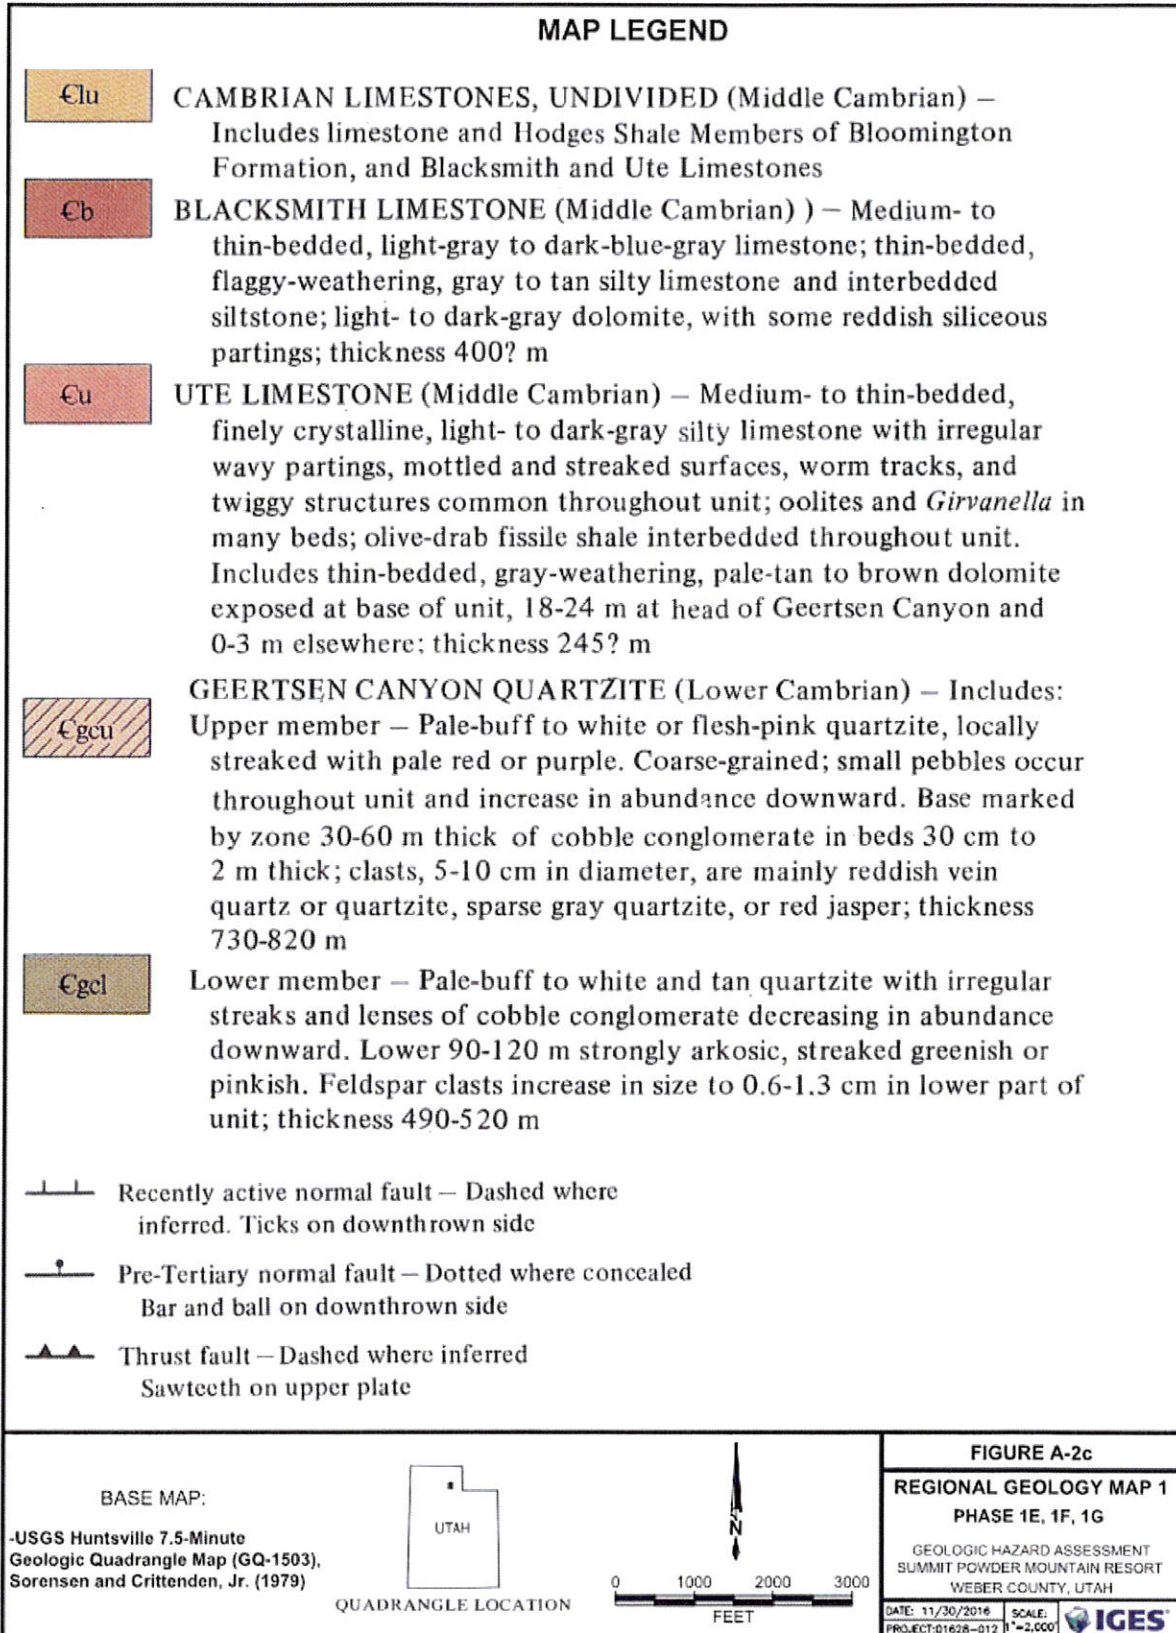

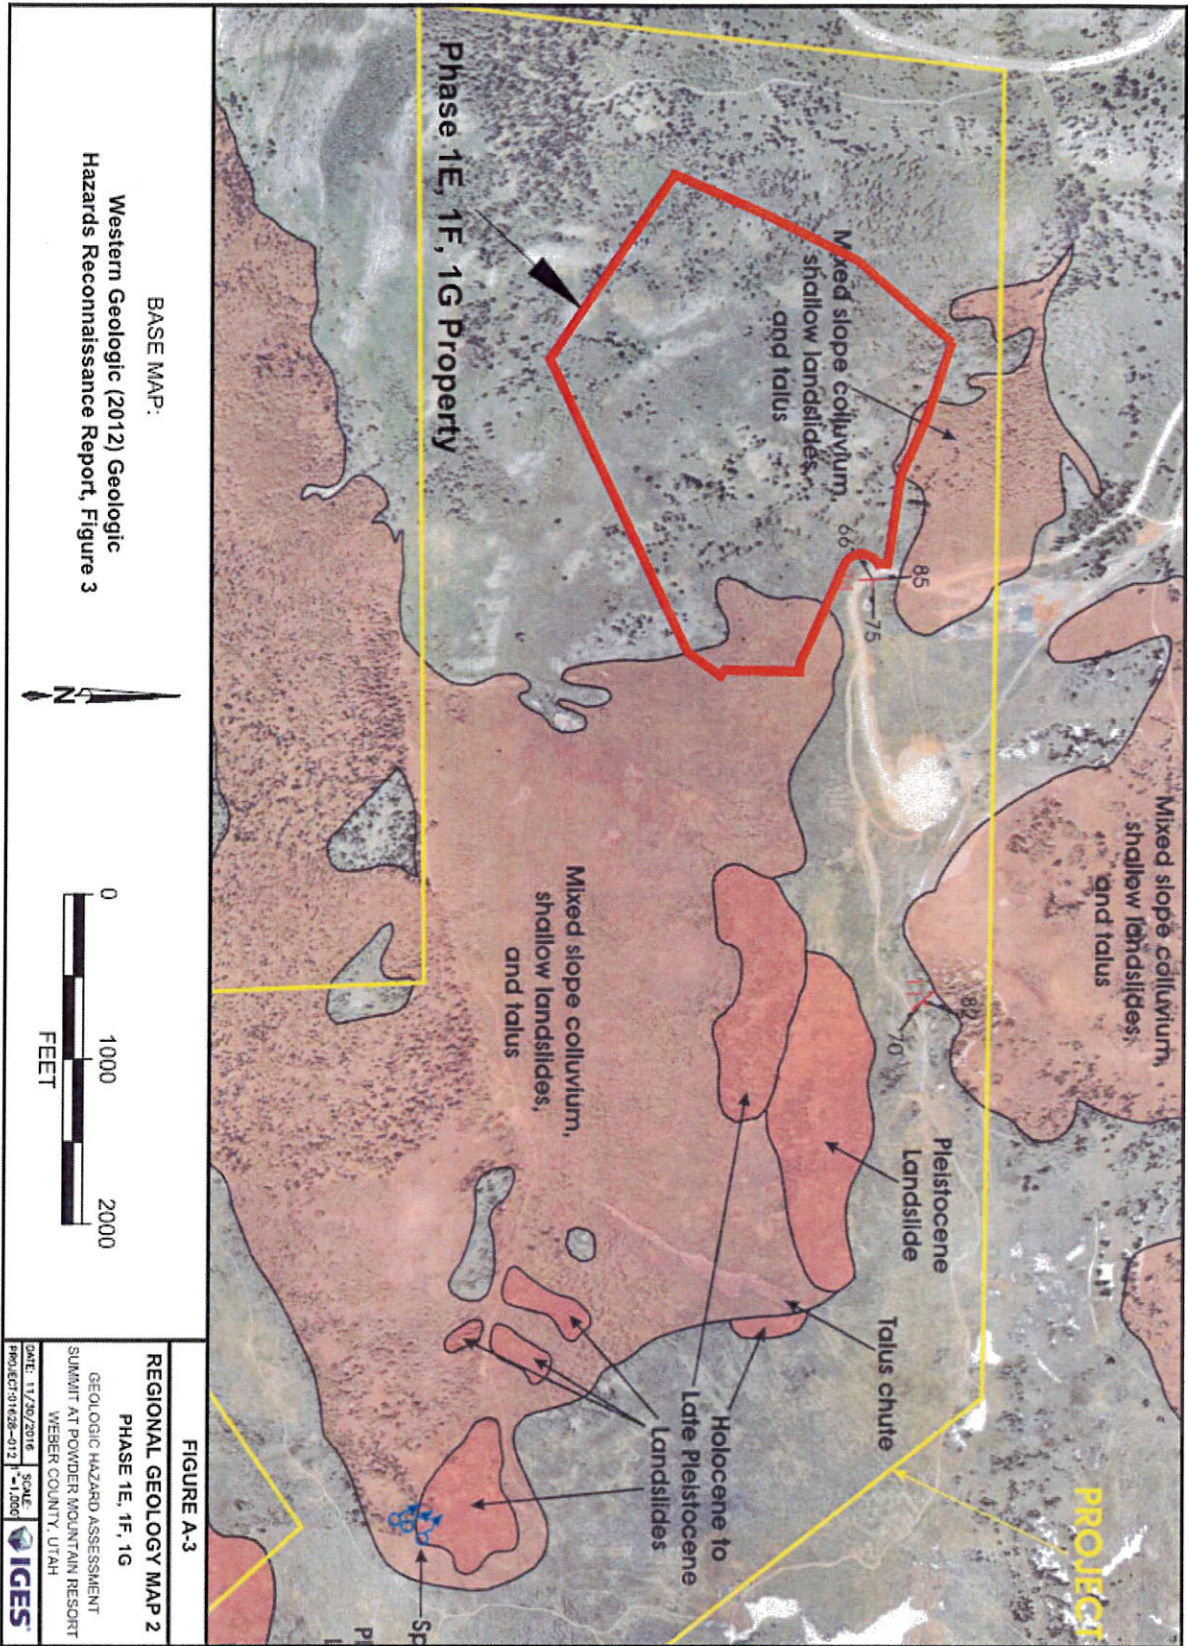

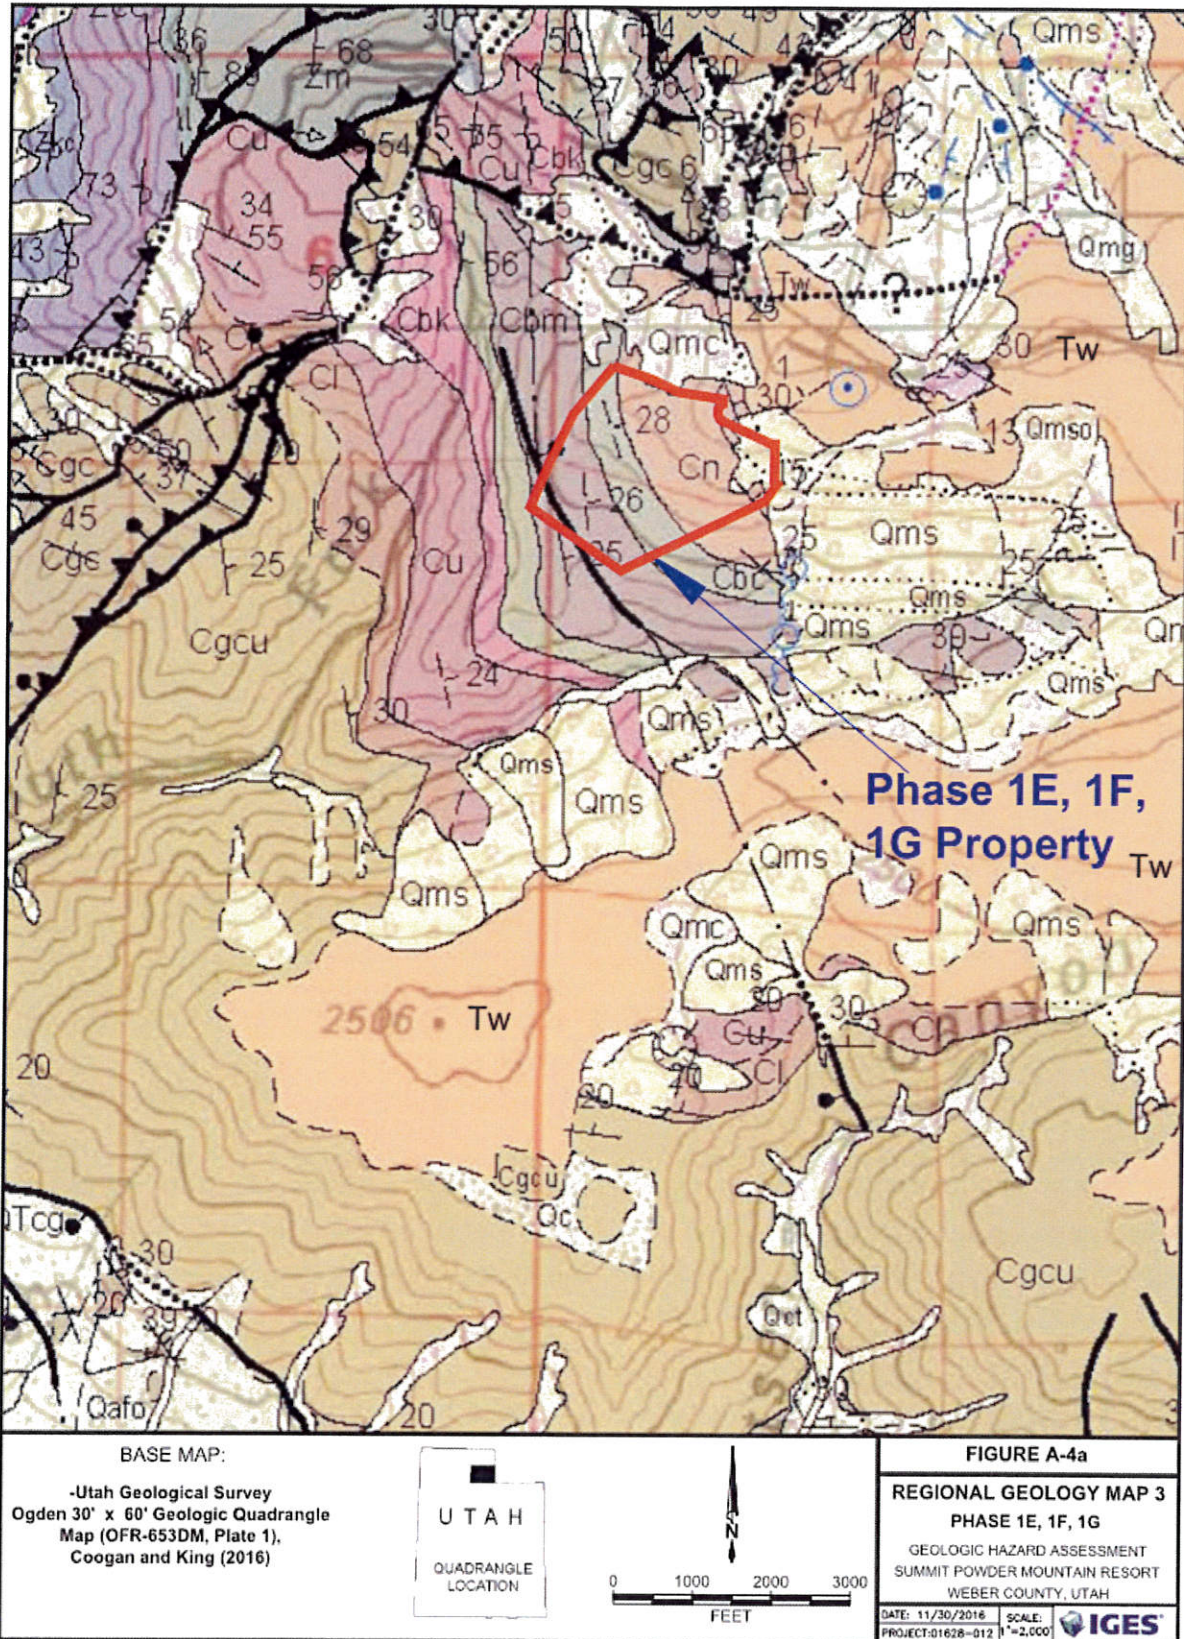

MAP LEGEND



Qmc **Landslide and colluvial deposits, undivided (Holocene and Pleistocene)** – Poorly sorted to unsorted clay- to boulder-sized material; mapped where landslide deposits are difficult to distinguish from colluvium (slopewash and soil creep) and where mapping separate, small, intermingled areas of landslide and colluvial deposits is not possible at map scale; locally includes talus and debris flow and flood deposits; typically mapped where landslides are thin (“shallow”); also mapped where the blocky or rumpled morphology that is characteristic of landslides has been diminished (“smoothed”) by slopewash and soil creep; composition depends on local sources; 6 to 40 feet (2-12 m) thick. These deposits are as unstable as other landslide units (Qms, Qmsy, Qmso).

Qms, Qms?, Qmsy, Qmsy?, Qmso, Qmso?
Landslide deposits (Holocene and upper and middle? Pleistocene) – Poorly sorted clay- to boulder-sized material; includes slides, slumps, and locally flows and floods; generally characterized by hummocky topography, main and internal scarps, and chaotic bedding in displaced blocks; composition depends on local sources; morphology becomes more subdued with time and amount of water in material during emplacement; Qms may be in contact with Qms when landslides are different/distinct; thickness highly variable, up to about 20 to 30 feet (6-9 m) for small slides, and 80 to 100 feet (25-30 m) thick for larger landslides. Qmsy and Qmso queried where relative age uncertain; Qms queried where classification uncertain. Numerous landslides are too small to show at map scale and more detailed maps shown in the index to geologic mapping should be examined.


Qms without a suffix is mapped where the age is uncertain (though likely Holocene and/or late Pleistocene), where portions of slide complexes have different ages but cannot be shown separately at map scale, or where boundaries between slides of different ages are not distinct. Estimated time of emplacement is indicated by relative-age letter suffixes with: Qmsy mapped where landslides deflect streams or failures are in Lake Bonneville deposits, and scarps are variably vegetated; Qmso typically mapped where deposits are “perched” above present drainages, rumpled morphology typical of mass movements has been diminished, and/or younger surficial deposits cover or cut Qmso. Lower perched Qmso deposits are at Qao heights above drainages (95 ka and older) and the higher perched deposits may correlate with high level alluvium (QTa₁) (likely older than 780 ka) (see table 1). Suffixes y and o indicate probable Holocene and Pleistocene ages, respectively, with all Qmso likely emplaced before Lake Bonneville transgression. These older deposits are as unstable as other slides, and are easily reactivated with the addition of water, be it irrigation or septic tank drain fields.

Qmg, Qmg?
Mass-movement and glacial deposits, undivided (Holocene and Pleistocene) – Unsorted and unstratified clay, silt, sand, and gravel; mapped where glacial deposits lack typical moraine morphology, and appear to have failed or moved down slope; also mapped in upper Strawberry Bowl (Snow Basin quadrangle) where glacial deposits have lost their distinct morphology and the contacts between them and colluvium and talus in the cirques cannot be mapped; likely less than 30 feet (9 m) thick, but may be thicker in Mantua, James Peak, North Ogden, Huntsville, and Peterson quadrangles.

Tw, Tw?
Wasatch Formation (Eocene and upper Paleocene) – Typically red to brownish-red sandstone, siltstone, mudstone, and conglomerate with minor gray limestone and marlstone locally (see Tw1); lighter shades of red, yellow, tan, and light gray present locally and more common in uppermost part, complicating mapping of contacts with overlying similarly colored Norwood and Fowkes Formations; clasts typically rounded Neoproterozoic and Paleozoic sedimentary rocks, mainly Neoproterozoic and Cambrian quartzite; basal conglomerate more gray and less likely to be red, and containing more locally derived angular clasts of limestone, dolomite and sandstone, typically from Paleozoic strata, for example in northern Causey Dam
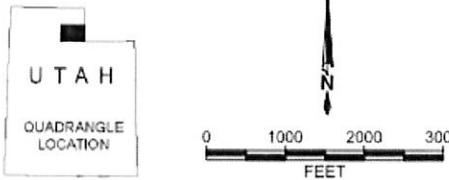
<p>BASE MAPS: -Utah Geological Survey Ogden 30' x 60' Geologic Quadrangle Map (DFR-653DM, Plate 1), Coogan and King (2016)</p>		<p>FIGURE A-4b REGIONAL GEOLOGY MAP 3 PHASE 1E, 1F, 1G GEOLOGIC HAZARD ASSESSMENT SUMMIT POWDER MOUNTAIN RESORT WEBER COUNTY, UTAH DATE: 11/30/2016 SCALE: 1"=2,000' PROJECT:01628-012 </p>
--	--	--

Project No. 01628-012
 Date 9-22-16 by PEE
 Ckd by _____ on _____

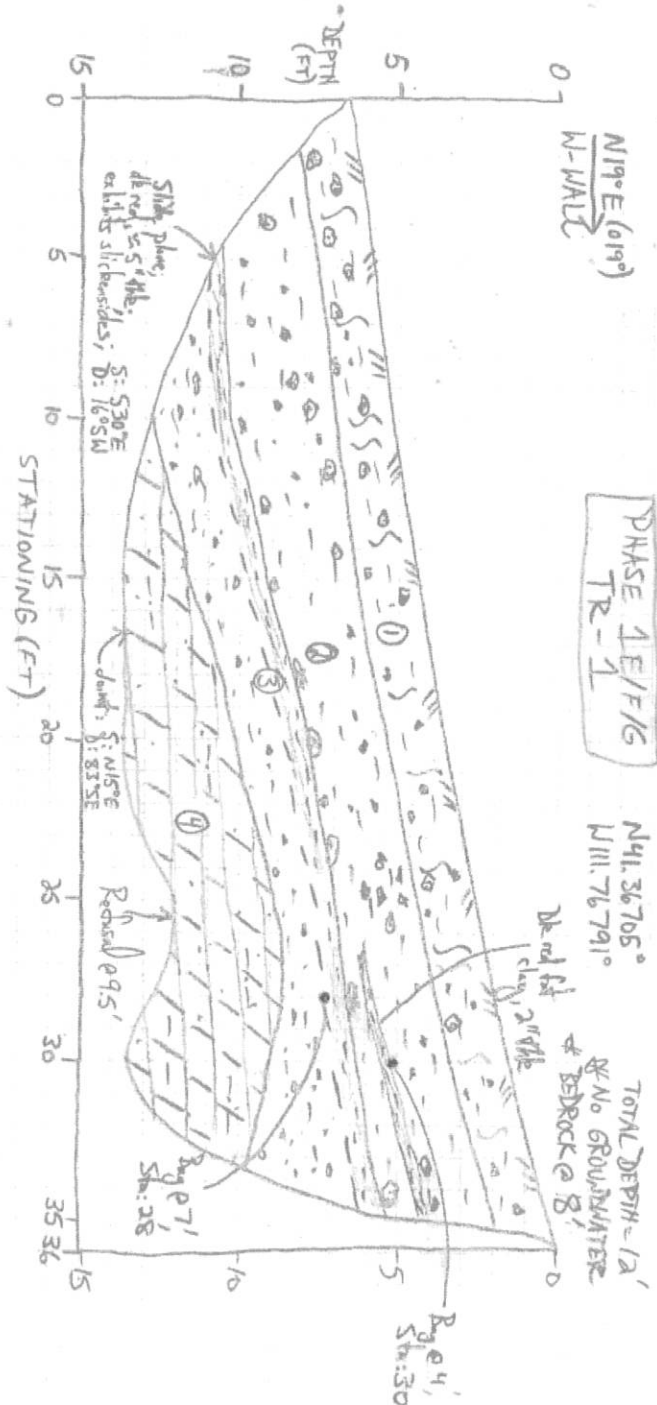

LITHOLOGIC UNIT DESCRIPTIONS:

1. AIB Soil Horizon: ~2' thick: dark yellowish brown (10YR 4/2) lean CLAY with gravel (CL), loose, slightly moist, low plasticity, massive. upper ~1' is A-Horizon with abundant plant and tree roots with less clast concentration (~15%) than underlying B-Horizon; basal ~1' is B-Horizon with clast concentration ~30-40% of unit; clasts entirely subrounded to subangular pale yellowish orange (10YR 8/6) quartzite up to 6" in diameter, though mode size is 3-4", with almost equal proportion of subrounded and subangular clasts; abundant pinholes (1-2 mm) throughout; clasts irregularly spread through unit; unit underlain by dark red slide plane; sharp, irregular basal contact.

2. Shallow Landslide: ~2-3' thick; light brown (5YR 6/4) lean CLAY with gravel (CL), stiff to very stiff, dry, low plasticity, massive; jagged expression on wall of trench; unit is identical to cemented colluvium unit seen elsewhere on Powder Mountain; blocky texture; gravel and larger-sized clasts comprise ~25-30% of unit; clasts are entirely subrounded to subangular pale yellowish orange (10YR 8/6) quartzite up to 6" in diameter, though mode size is 3-4", with almost equal proportion of subrounded and subangular clasts; abundant pinholes (1-2 mm) throughout; clasts irregularly spread through unit; unit underlain by dark red slide plane; sharp, irregular basal contact.

3. Paleosol: ~2-3' thick; dark reddish brown (10R 3/4) to dark yellowish brown (10YR 4/2); mottled appearance; sandy fat CLAY with gravel (CH), stiff, slightly moist, moderate plasticity; thickly bedded (>5"); gravel and larger-sized clasts comprise ~25-30% of unit; clasts are entirely angular, very finely sparry, thinly bedded; medium dark gray (N4) dolomite up to 5" in diameter, though mode size is 1-2"; pinholes throughout (1-2 mm diameter); uppermost ~5" is dark red slide plane that exhibits slickensides; sharp, irregular basal contact.

4. Nounan Dolomite: >4' thick; medium dark gray (N4) to medium gray (N5) silty dolomite, very finely sparry, finely bedded (< 1 cm); partly weathered/oxidized; blocky jointing; weathers to fine sand in places; bedding orientation unclear due to weathering, though upslope portion may have relic orientation of N40°W, 9°NE.


FIGURE A-6
TR-1 LOG

PHASE 1E, 1F, 1G

GEOLOGIC HAZARD ASSESSMENT
 SUMMIT POWDER MOUNTAIN
 WEBER COUNTY, UTAH

DATE: 12/12/2018 SCALE: 1" = 5'
 PROJECT: 01628-012 IGES

Project No. 01628-012
 Date 9-22-16 by PED
 Ckd by _____ on _____

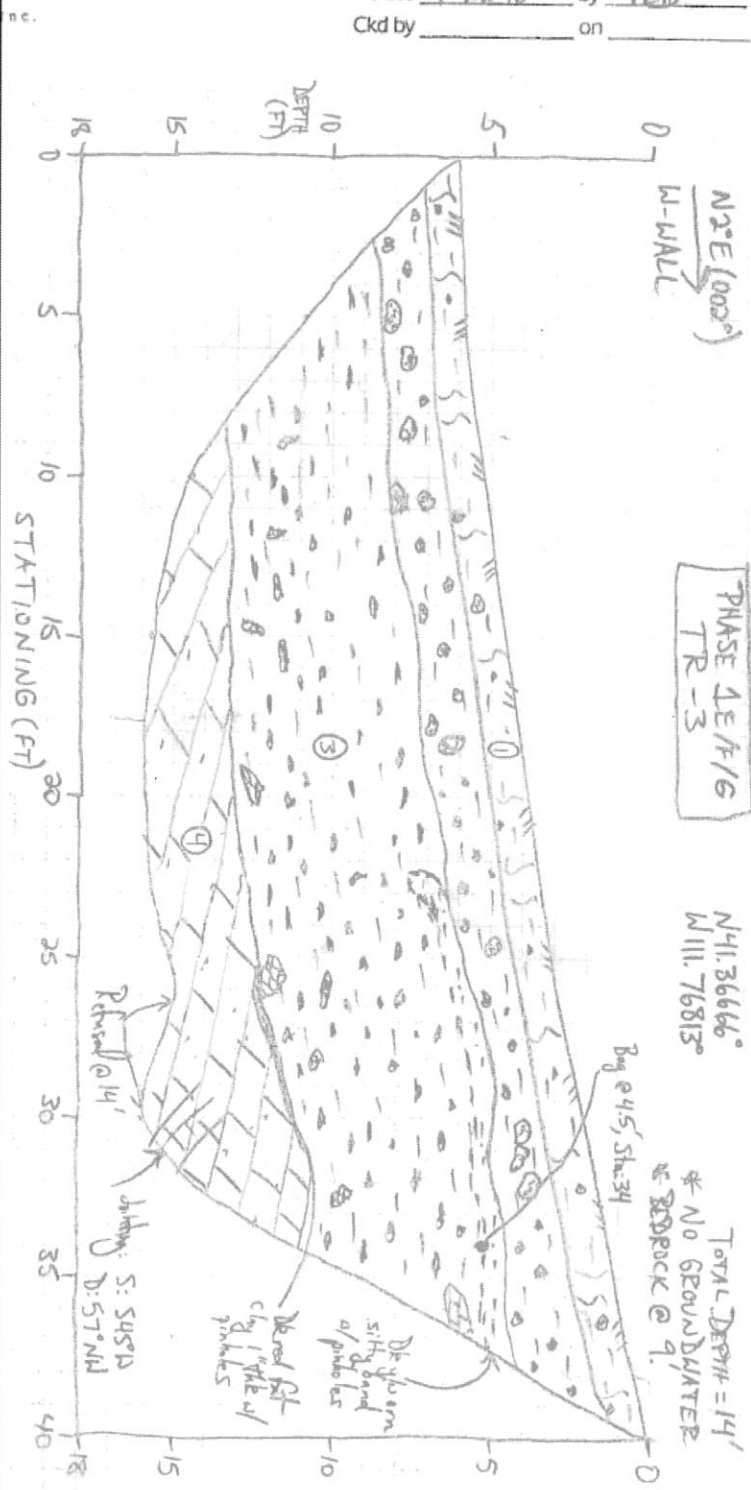

LITHOLOGIC UNIT DESCRIPTIONS:

1. **A/B Soil Horizon:** -1'-1.5' thick: dark yellowish brown (10YR 4/2) to moderate yellowish brown (10YR 5/4) lean CLAY with gravel (CL), loose, slightly moist, low plasticity, massive; gravel and larger-sized clasts comprise ~5-10% of unit; clasts entirely pale yellowish orange (10YR 8/6) subrounded to subangular quartzite up to 4" in diameter, though mode size <1"; abundant plant and tree roots, though largely restricted to uppermost ~6" of unit.

2. **Colluvium (Qcql):** ~2' thick: dark yellowish brown (10YR 4/2) to light brown (5YR 6/4) gravelly lean CLAY (CL) gradational to clayey GRAVEL (GC), medium silt to loose, slightly moist, low plasticity, massive; gravel and larger-sized clasts comprise ~50-75% of unit; matrix-supported, though locally clast-supported; clasts are entirely subrounded to subangular pale yellowish orange (10YR 8/6) quartzite up to 10" in diameter, though mode size ~4"; common plant and tree roots; sharp, wavy basal contact.

3. **Bedrock Colluvium (Qcb):** ~5-6' thick: dark reddish brown (10R 3/4) to dark, yellowish orange (10YR 6/6); silty CLAY with gravel (CL), silt to very stiff, slightly moist, low plasticity, massive; gravel and larger-sized clasts comprise ~30-50% of unit, and increase in frequency with depth; clasts are entirely angular and blocky, finely sparry, medium gray (N5) dolomite up to 1' in diameter, though mode size is ~2"; possible downslope imbrication of clasts; very similar in appearance to Wasatch Formation, except not as sandy and no quartzite; uppermost ~6"-1' is largely devoid of clasts and is ooloidal (<1 mm); may grade with depth into highly weathered bedrock; occasional to common plant and tree roots; gradational, irregular basal contact.


4. **Nouveau Dolomite:** >5' thick: medium gray (N5) to medium dark gray (N4) sandy dolomite, finely sparry to sparry, massive; partly weathered/oxidized to moderate reddish brown (10R 4/6); heavily fractured and jointed with blocky jointing; common calcite stringers and nodules; blocks are largely hard to very hard; weathers to fine sand in places; occasional plant and tree roots in fractures; discontinuous clay lens at top of unit may be indicative of soil creep; bedding orientation unclear due to weathering.

FIGURE A-8
TR-3 LOG
PHASE 1E, 1F, 1G

GEOLOGIC HAZARD ASSESSMENT
 SUMMIT POWDER MOUNTAIN
 WEBER COUNTY, UTAH

DATE: 12/13/2016 SCALE: 1" = 5'
 PROJECT: 01628-012

IGES

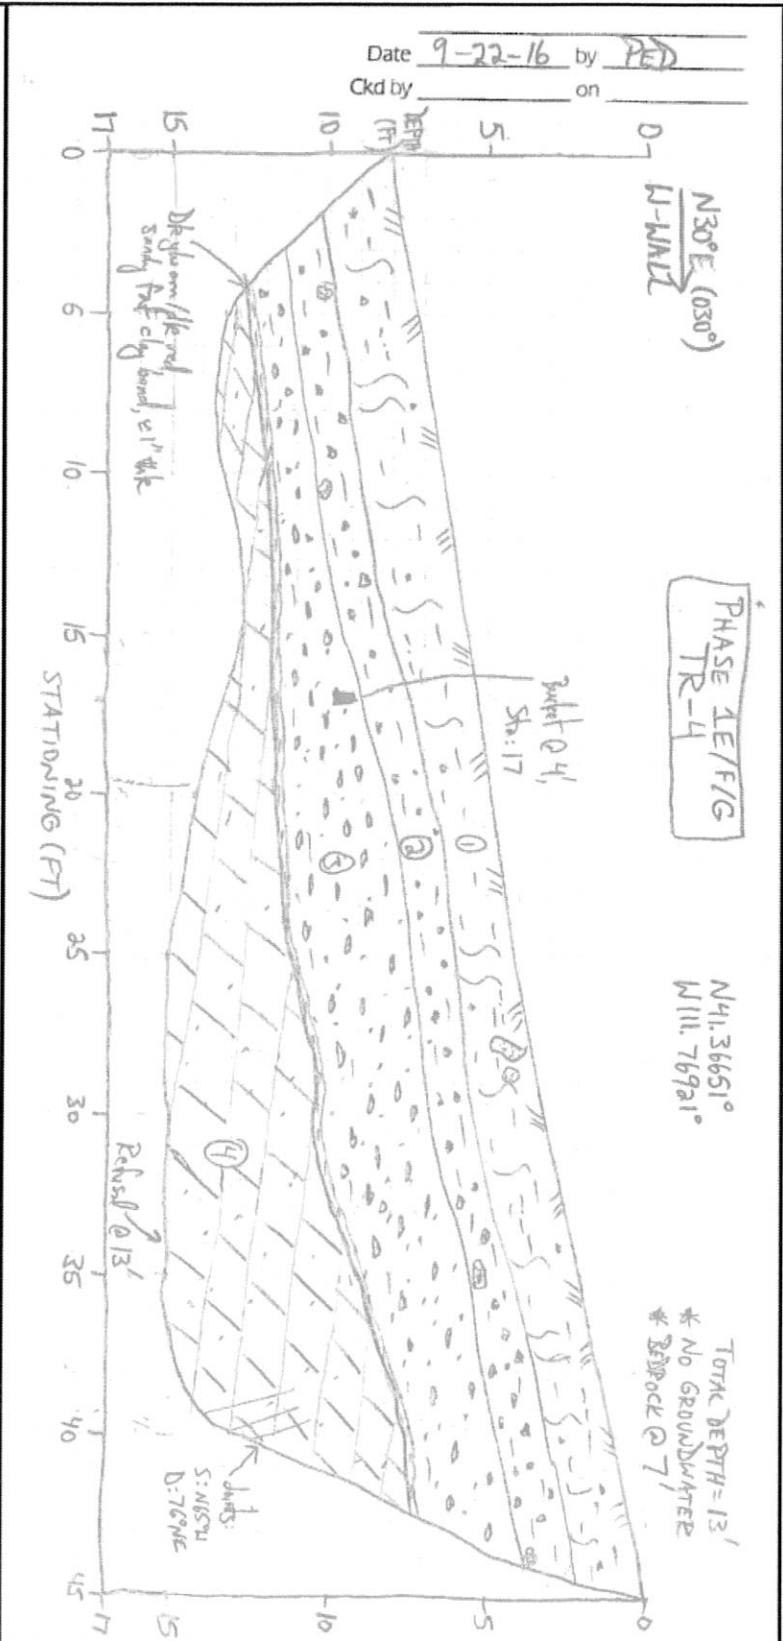

LITHOLOGIC UNIT DESCRIPTIONS:

1. AB Soil Horizon: -2.3' thick; dark yellowish brown (10YR 4/2) to dark reddish brown (10R 3/4) lean CLAY with gravel (CL), loose, slightly moist, low plasticity, massive; gravel and larger-sized clasts comprise ~5-10% of unit; clasts are ~75% pale yellowish orange (10YR 8/6) subrounded quartzite and ~25% medium gray (N5) to medium dark gray (N4) subrounded finely sparry dolomite with calcite nodules and stringers; clasts are up to 15" in diameter, though mode size <1"; abundant plant and tree roots; gradational, irregular basal contact.

2. Colluvium (Qcb): -1-1.5' thick; dark yellowish brown (10YR 4/2) to moderate reddish brown (10R 4/6) gravelly lean CLAY (CL) gradational to clayey GRAVEL (GC), loose, slightly moist, low plasticity; massive; gravel and larger-sized clasts comprise ~50-60% of unit, though matrix-supported; clasts are ~75% pale yellowish orange (10YR 8/6) subrounded quartzite and ~25% subrounded to subangular medium gray (N5) dolomite as above and white (N9) dolomitic quartzite; clasts are up to 8" in diameter, though mode size ~2-4"; common plant and tree roots; sharp, planar basal contact.

3. Highly Weathered Bedrock: ~4' thick; moderate reddish brown (10R 4/6) to dark yellowish orange (10YR 6/6) dolomite bedrock almost entirely disaggregated into clayey GRAVEL with sand (GC), medium dense, slightly moist, massive; gradational between clast and matrix-supported; sand is fine-grained, and comprised of angular grains of dolomite and quartzite; gravel and larger-sized clasts comprise ~50-80% of unit; clasts are entirely angular medium gray (N5) to medium dark gray (N4) finely sparry dolomite with abundant calcite stringers and nodules, and up to 6" in diameter, though mode size <1"; base of unit is ~1" thick dark yellowish orange to dark reddish brown (10R 3/4) sandy fat CLAY (CH) with abundant pinholes (up to 1 mm) and may represent creep surface; becomes clayey with depth; common plant and tree roots; gradational, irregular basal contact.


4. Nounan Dolomite: >6' thick; medium gray (N5) to medium dark gray (N4) sandy dolomite, finely sparry to sparry, massive; common calcite stringers and nodules; partly weathered/dolomitized; heavily fractured and jointed with blocky jointing, though still largely hard to very hard; occasional roots within fractures; bedding orientation not discernible.

FIGURE A-9
TR-4 LOG
PHASE 1E, 1F, 1G

GEOLOGIC HAZARD ASSESSMENT
 SUMMIT POWDER MOUNTAIN
 WEBER COUNTY, UTAH

DATE: 12/13/2018 SCALE: 1" = 5'
 PROJECT: 01628-012 I = 5' **IGES**

Project No. 01628-012
 Date 9-22-16 by PED
 Ckd by _____ on _____

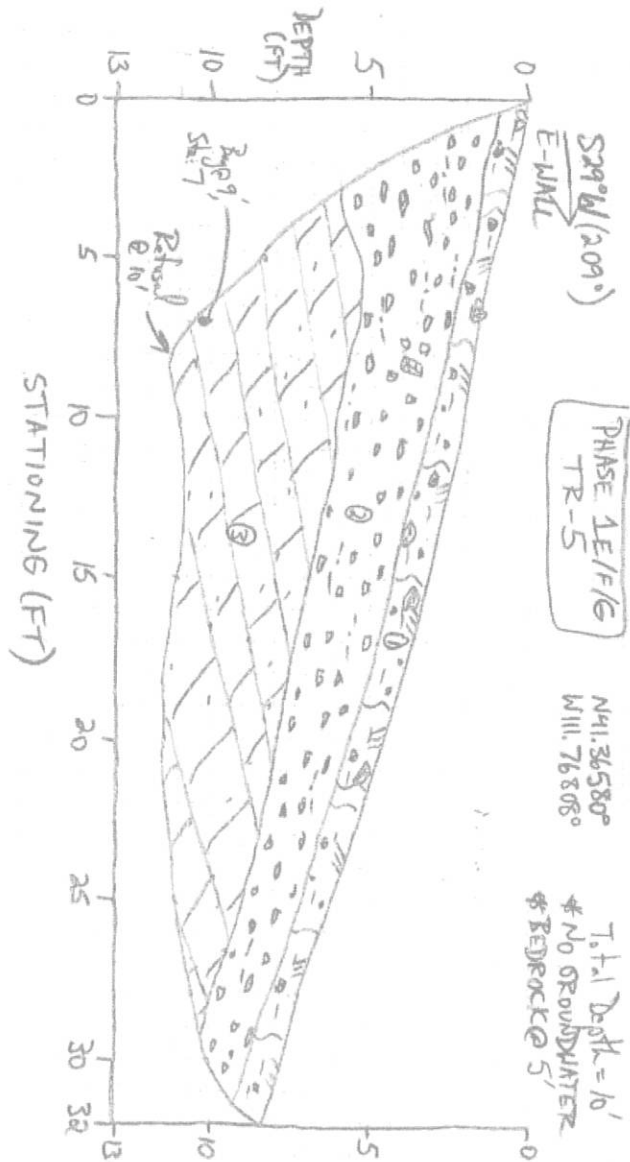

LITHOLOGIC UNIT DESCRIPTIONS:

- 1. Colluvium (Qcb):** -1-1.5' thick; dark yellowish brown (10YR 4/2) to light brown (5YR 6/4) lean CLAY with gravel (CL); loose, most, low plasticity, massive; A/B topsoil forming on and within unit such that it is indistinguishable from unit; organic-rich topsoil only in uppermost -4-6"; gravel and larger-sized clasts comprise -25-30% of unit; clasts are -80% pale yellowish orange (10YR 8/6) subrounded quartzite and -20% angular medium dark gray (N4) finely sparry dolomite to limestone with abundant calcite veining; clasts are up to 2' in diameter, though mode size -6-8"; abundant plant and tree roots; sharp, irregular basal contact.
- 2. Highly Weathered Bedrock:** -2-4' thick; moderate yellowish brown (10YR 5/4) to medium gray (N5) dolomite bedrock largely disaggregated to silty GRAVEL (GC); medium dense, slightly moist, low plasticity, massive, clast-supported; gravel and larger-sized clasts comprise -75% of unit, and are entirely angular, blocky dolomite as above up to 1' in diameter, though mode size -2-3"; silty, sandy matrix with some lean clay; common plant and tree roots; gradational, irregular basal contact.

- 3. Nounan Dolomite:** >5' thick; medium dark gray (N4) to medium gray (N5) sandy dolomite, finely sparry to sparry, massive; common white calcite veining and small (up to 5 mm) nodules; weathers to dark yellowish orange (10YR 6/6); weathers to fine sand in places; partially oxidized, though most blocks are still hard to very hard; highly fractured and jointed, though bedding and jointing are indiscernible.

* Excavator noted that this was the hardest trench to dig.

FIGURE A-10
TR-5 LOG

PHASE 1E, 1F, 1G

GEOLOGIC HAZARD ASSESSMENT
 SUMMIT POWDER MOUNTAIN
 WEBER COUNTY, UTAH

DATE: 12/13/2016 SCALE: _____
 PROJECT: 01628-012 I = 5' **IGES**


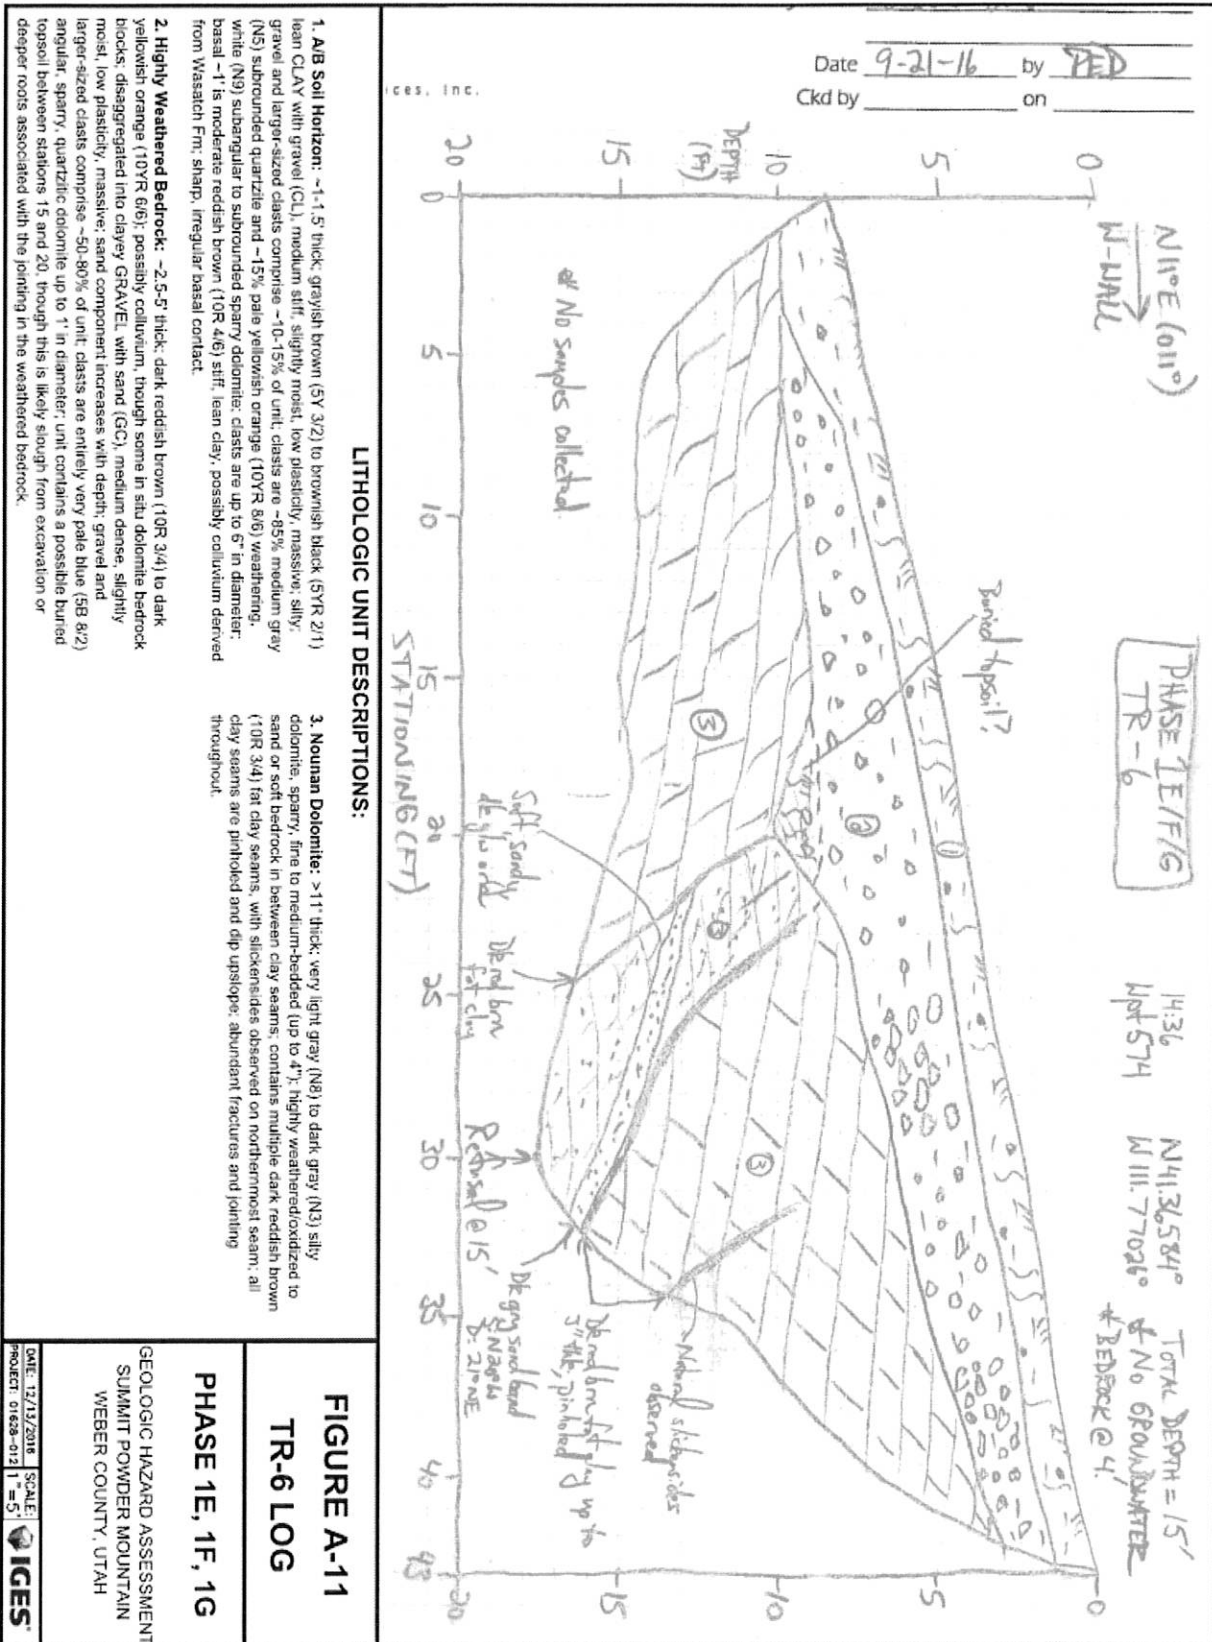


FIGURE A-11
TR-6 LOG
PHASE 1E, 1F, 1G

GEOLOGIC HAZARD ASSESSMENT
 SUMMIT POWDER MOUNTAIN
 WEBER COUNTY, UTAH

DATE: 12/13/2018 SCALE: _____
 PROJECT: 01628-012 I = 5' **IGES**

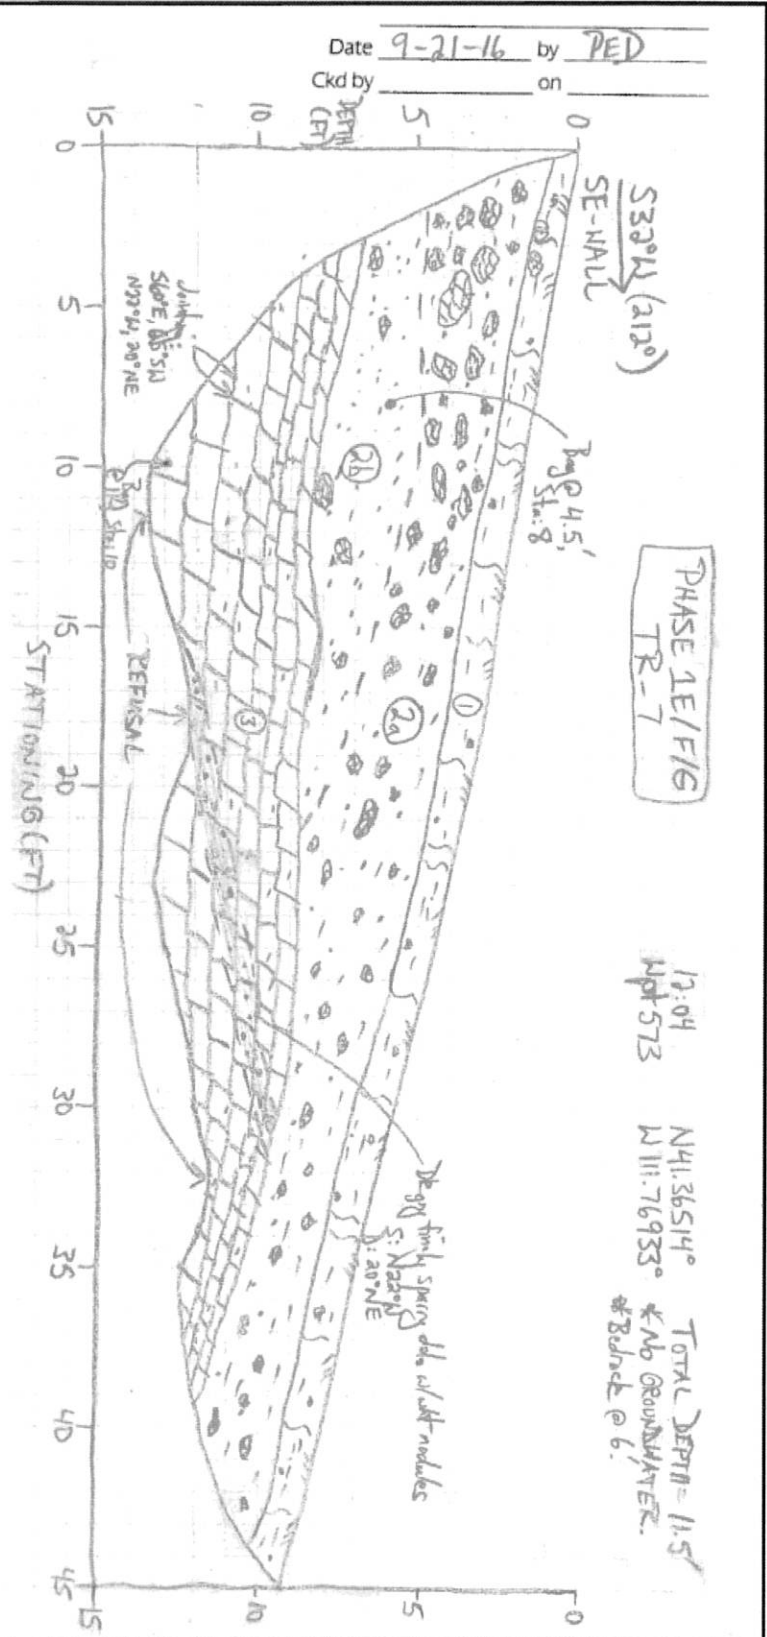

LITHOLOGIC UNIT DESCRIPTIONS:

1. A/B Soil Horizon: -1-1.5' thick; grayish brown (5Y 3/2) to brownish black (5YR 2/1) lean CLAY with gravel (CL), medium silt, slightly moist, low plasticity, massive, silty; gravel and larger-sized clasts comprise -10-15% of unit; clasts are -85% medium gray (N5) subrounded quartzite and -15% pale yellowish orange (10YR 8/6) weathering white (N9) subangular to subrounded sparry dolomite; clasts are up to 6" in diameter; basal -1' is moderate reddish brown (10R 4/6) silt; lean clay, possibly colluvium derived from Wasatch Fm.; abundant plant and tree roots; sharp, irregular basal contact.

2. Highly Weathered Bedrock: Subunit 2a: -2.5-3.5' thick; dark reddish brown (10R 3/4) to dark yellowish orange (10YR 6/6) dolomite bedrock, possibly colluvium, though some in situ blocks; largely disaggregated to clayey GRAVEL with sand (GC), medium dense, slightly moist, low plasticity; massive, sand component increases with depth; fewer clasts to south; gravel and larger-sized clasts comprise -50-80% of subunit; clasts entirely very light gray (N8) to white (N9) sparry sandy dolomite that weathers to pale yellowish orange (10YR 8/6) and dark yellowish orange; clasts are moderately hard to hard, angular to subrounded, heavily jointed, and up to 1.5' in diameter; common plant and tree roots; sharp, irregular basal contact.

2. Highly Weathered Bedrock: Subunit 2b: up to 3' thick; light gray (N7) to dark yellowish orange (10YR 6/6); well graded SAND with gravel (SW), loose, slightly moist, massive; gravel and larger-sized clasts comprise -10-15% of subunit; entirely dolomite as above up to 8" diameter; sand is medium-grained and angular, comprised of both dolomite and quartzite grains; occasional to common plant and tree roots; likely derived from soft bedrock; sharp, irregular basal contact.

3. Nonvan Dolomite: >5' thick; very pale blue (5B 8/2) sandy dolomite; sparry to finely sparry, massive; hard to very hard; partially weathered to fine-grained sand; commonly oxidized to moderate reddish brown (10R 4/6); heavily jointed with blocky jointing; contains a -1' thick dark gray (N3) finely sparry dolomite bed; becomes finely sparry with depth.

FIGURE A-12
TR-7 LOG
PHASE 1E, 1F, 1G
 GEOLOGIC HAZARD ASSESSMENT
 SUMMIT POWDER MOUNTAIN
 WEBER COUNTY, UTAH
 DATE: 12/19/2016 SCALE: 1" = 5'
 PROJECT: 01628-012 IGES

APPENDIX B

Water Content and Unit Weight of Soil

(In General Accordance with ASTM D7263 Method B and D2216)



Project: Summit - Phase 1E/F/G

No: 01628-012

Location: Powder Mountain, UT

Date: 10/10/2016

By: BSS/ET/NB

Sample Info.	Boring No.	TR-1	TR-1	TR-2				
	Sample							
	Depth	4.0'	7.0'	6.0'				
	Split	Yes	No	No				
	Split sieve	3/8"						
	Total sample (g)	3999.50						
	Moist coarse fraction (g)	1003.10						
	Moist split fraction (g)	2996.40						
	Sample height, H (in)							
	Sample diameter, D (in)							
	Mass rings + wet soil (g)							
	Mass rings/tare (g)							
	Moist unit wt., γ_m (pcf)							
Coarse Fraction	Wet soil + tare (g)	1313.48						
	Dry soil + tare (g)	1304.91						
	Tare (g)	310.40						
	Water content (%)	0.9						
Split Fraction	Wet soil + tare (g)	357.30	464.20	2069.78				
	Dry soil + tare (g)	341.12	411.15	1804.30				
	Tare (g)	124.68	126.91	409.82				
	Water content (%)	7.5	18.7	19.0				
	Water Content, w (%)	5.7	18.7	19.0				
	Dry Unit Wt., γ_d (pcf)							

Entered by: _____

Reviewed: _____

Z:\PROJECTS\01628_Powder_Mountain\012_Summit\MDs2.xlsx

Liquid Limit, Plastic Limit, and Plasticity Index of Soils

(ASTM D4318)



Project: Summit - Phase 1E/F/G

No: 01628-012

Location: Powder Mountain, UT

Date: 10/12/2016

By: BRR

Boring No.: TR-1

Sample:

Depth: 4.0'

Description: Reddish brown lean clay

Preparation method: Wet

Liquid limit test method: Multipoint



Plastic Limit

Determination No	1	2			
Wet Soil + Tare (g)	28.02	27.91			
Dry Soil + Tare (g)	27.09	27.03			
Water Loss (g)	0.93	0.88			
Tare (g)	21.53	21.75			
Dry Soil (g)	5.56	5.28			
Water Content, w (%)	16.73	16.67			

Liquid Limit

Determination No	1	2	3		
Number of Drops, N	33	26	17		
Wet Soil + Tare (g)	31.41	30.44	30.71		
Dry Soil + Tare (g)	29.37	28.56	28.56		
Water Loss (g)	2.04	1.88	2.15		
Tare (g)	21.91	22.00	21.35		
Dry Soil (g)	7.46	6.56	7.21		
Water Content, w (%)	27.35	28.66	29.82		
One-Point LL (%)		29			

Liquid Limit, LL (%)	29
Plastic Limit, PL (%)	17
Plasticity Index, PI (%)	12

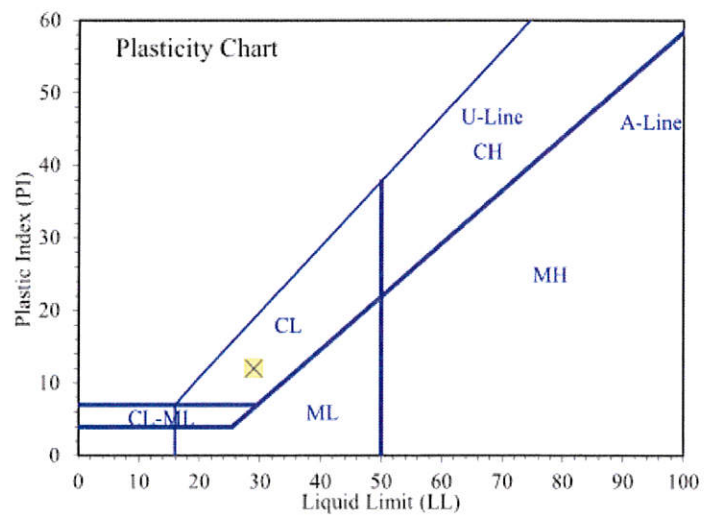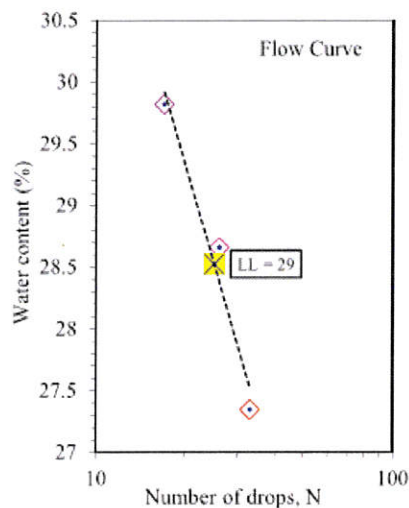

Entered by: _____
 Reviewed: _____

Z:\PROJECTS\01628_Powder_Mountain\012_Summit\ALV1.xlsm]1

Liquid Limit, Plastic Limit, and Plasticity Index of Soils

(ASTM D4318)



Project: Summit - Phase 1E/F/G

Boring No.: TR-1

No: 01628-012

Sample:

Location: Powder Mountain, UT

Depth: 7.0'

Date: 10/12/2016

Description: Reddish brown fat clay

By: BRR

Preparation method: Wet
Liquid limit test method: Multipoint



Plastic Limit

Determination No	1	2			
Wet Soil + Tare (g)	27.88	28.33			
Dry Soil + Tare (g)	26.89	27.34			
Water Loss (g)	0.99	0.99			
Tare (g)	21.56	22.08			
Dry Soil (g)	5.33	5.26			
Water Content, w (%)	18.57	18.82			

Liquid Limit

Determination No	1	2	3		
Number of Drops, N	33	26	18		
Wet Soil + Tare (g)	29.52	29.23	28.84		
Dry Soil + Tare (g)	26.98	26.76	26.47		
Water Loss (g)	2.54	2.47	2.37		
Tare (g)	22.00	22.10	22.12		
Dry Soil (g)	4.98	4.66	4.35		
Water Content, w (%)	51.00	53.00	54.48		
One-Point LL (%)		53			

Liquid Limit, LL (%)	53
Plastic Limit, PL (%)	19
Plasticity Index, PI (%)	34

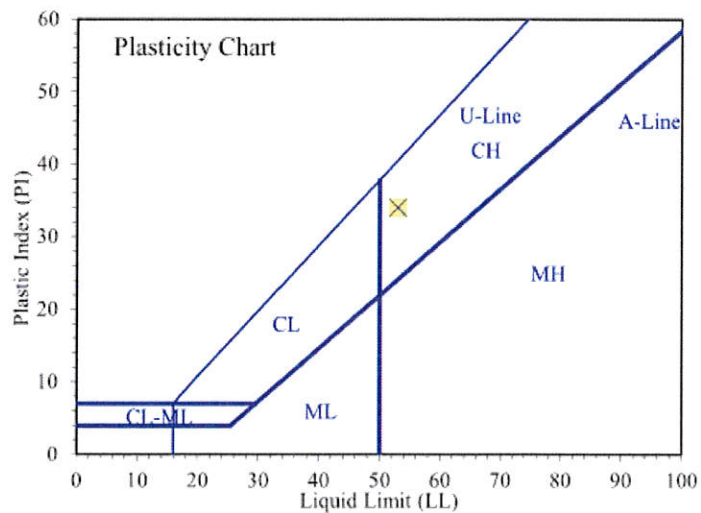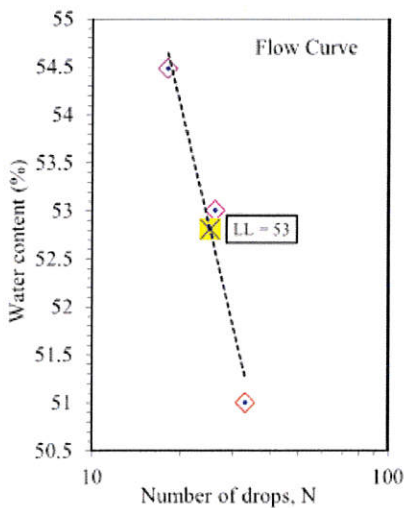

Entered by: _____
Reviewed: _____

Z:\PROJECTS\01628_Powder_Mountain\012_Summit[ALv1.xlsm]2

Amount of Material in Soil Finer than the No. 200 (75µm) Sieve
 (ASTM D1140)



Project: Summit - Phase 1E/F/G
No: 01628-012
 Location: Powder Mountain, UT
 Date: 10/11/2016
 By: BSS/ET/NB

Sample Info.	Boring No.	TR-1	TR-1	TR-2				
	Sample							
	Depth	4.0'	7.0'	6.0'				
	Split	Yes	No	No				
	Split Sieve*	3/8"						
	Method	B	B	B				
	Specimen soak time (min)	240	460	200				
	Moist total sample wt. (g)	3999.50	337.29	1659.96				
	Moist coarse fraction (g)	1003.11						
	Moist split fraction + tare (g)	357.30						
	Split fraction tare (g)	124.68						
	Dry split fraction (g)	216.44						
	Dry retained No. 200 + tare (g)	203.15	191.76	1207.41				
	Wash tare (g)	124.68	126.91	409.82				
	No. 200 Dry wt. retained (g)	78.47	64.85	797.59				
	Split sieve* Dry wt. retained (g)	994.54						
	Dry total sample wt. (g)	3782.51	284.24	1394.48				
Coarse Fraction	Moist soil + tare (g)	1313.48						
	Dry soil + tare (g)	1304.91						
	Tare (g)	310.40						
	Water content (%)	0.86						
Split Fraction	Moist soil + tare (g)	357.30	464.20	2069.78				
	Dry soil + tare (g)	341.12	411.15	1804.30				
	Tare (g)	124.68	126.91	409.82				
	Water content (%)	7.48	18.66	19.04				
	Percent passing split sieve* (%)	73.7						
	Percent passing No. 200 sieve (%)	47.0	77.2	42.8				

Entered by: _____
 Reviewed: _____

Amount of Material in Soil Finer than the No. 200 (75µm) Sieve
 (ASTM D1140)



Project: Summit - Phase 1E/F/G
No: 01628-012
 Location: Powder Mountain, UT
 Date: 10/11/2016
 By: BSS/ET/NB

Sample Info.	Boring No.	TR-1	TR-1	TR-2				
	Sample							
	Depth	4.0'	7.0'	6.0'				
	Split	Yes	No	No				
	Split Sieve*	3/8"						
	Method	B	B	B				
Specimen soak time (min)		240	460	200				
Moist total sample wt. (g)		3999.50	337.29	1659.96				
Moist coarse fraction (g)		1003.11						
Moist split fraction + tare (g)		357.30						
Split fraction tare (g)		124.68						
Dry split fraction (g)		216.44						
Dry retained No. 200 + tare (g)		203.15	191.76	1207.41				
Wash tare (g)		124.68	126.91	409.82				
No. 200 Dry wt. retained (g)		78.47	64.85	797.59				
Split sieve* Dry wt. retained (g)		994.54						
Dry total sample wt. (g)		3782.51	284.24	1394.48				
Coarse Fraction	Moist soil + tare (g)	1313.48						
	Dry soil + tare (g)	1304.91						
	Tare (g)	310.40						
	Water content (%)	0.86						
Split Fraction	Moist soil + tare (g)	357.30	464.20	2069.78				
	Dry soil + tare (g)	341.12	411.15	1804.30				
	Tare (g)	124.68	126.91	409.82				
	Water content (%)	7.48	18.66	19.04				
Percent passing split sieve* (%)		73.7						
Percent passing No. 200 sieve (%)		47.0	77.2	42.8				

Entered by: _____
 Reviewed: _____

Z:\PROJECTS\01628 Powder Mountain 012 Summit [FINES\3.xlsx]

Particle-Size Distribution (Gradation) of Soils Using Sieve Analysis

(ASTM D6913)



Project: Summit - Phase I E/F/G

Boring No.: TR-2

No: 01628-012

Sample:

Location: Powder Mountain, UT

Depth: 9.0'


Date: 10/11/2016

Description: Reddish brown clayey sand with gravel

By: NB

Split:	No	
	-	
	Moist	Dry
Total sample wt. (g):	3893.28	3050.28
Split fraction: 1.000		
<u>Water content data</u>		
Moist soil + tare (g):	-	4828.20
Dry soil + tare (g):	-	3985.20
Tare (g):	-	934.92
Water content (%):	0.0	27.6

Sieve	Accum. Wt. Ret. (g)	Grain Size (mm)	Percent Finer
8"	-	200	-
6"	-	150	-
4"	-	100	-
3"	-	75	-
1.5"	-	37.5	100.0
3/4"	182.36	19	94.0
3/8"	431.59	9.5	85.9
No.4	624.66	4.75	79.5
No.10	797.50	2	73.9
No.20	934.54	0.85	69.4
No.40	1055.13	0.425	65.4
No.60	1160.44	0.25	62.0
No.100	1270.86	0.15	58.3
No.140	1367.71	0.106	55.2
No.200	1534.38	0.075	49.7

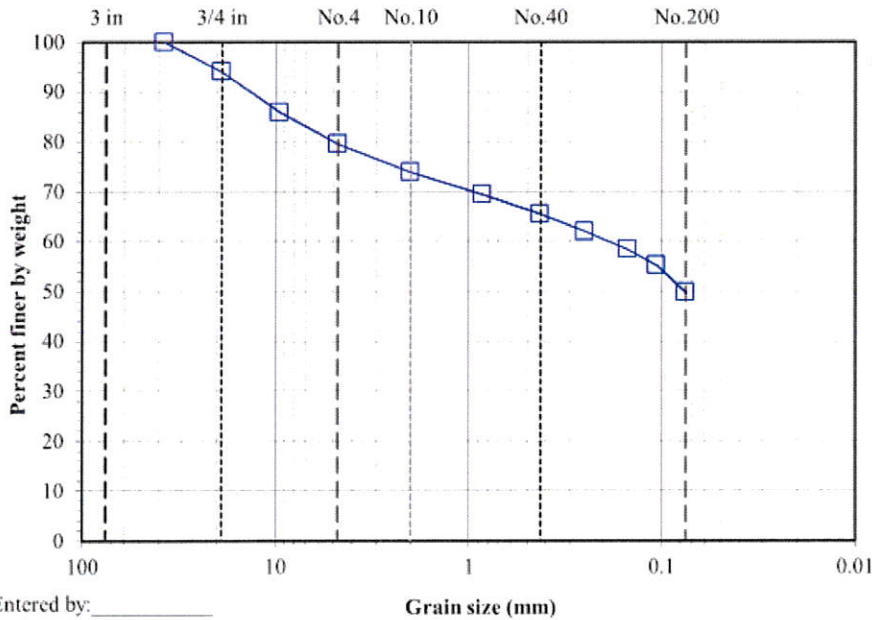

Entered by: _____
 Reviewed: _____

Z:\PROJECTS\01628_Powder_Mountain\012_Summit\GISDv2.xlsx

Particle-Size Distribution (Gradation) of Soils Using Sieve Analysis

(ASTM D6913)



Project: Summit - Phase I E/F/G

Boring No.: TR-4

No: 01628-012

Sample:

Location: Powder Mountain, UT

Depth: 4.0'


Date: 10/11/2016

Description: Reddish brown clayey gravel with sand

By: NB

Split: Yes Split sieve: 3/4" Moist Dry Total sample wt. (g): 25631.86 24726.44 +3/4" Coarse fraction (g): 11477.27 11399.00 -3/4" Split fraction (g): 1495.81 1408.40 Split fraction: 0.539	Water content data C.F.(+3/4") S.F.(-3/4")	
	Moist soil + tare (g):	12818.00 1826.68
	Dry soil + tare (g):	12736.60 1739.27
	Tare (g):	882.14 330.87
	Water content (%):	0.7 6.2

Sieve	Accum. Wt. Ret. (g)	Grain Size (mm)	Percent Finer
8"	-	200	-
6"	-	150	-
4"	-	100	100.0
3"	2386.10	75	90.4
1.5"	7534.70	37.5	69.5
3/4"	11399.00	19	53.9 ← Split
3/8"	220.76	9.5	45.5
No.4	280.36	4.75	43.2
No.10	299.77	2	42.4
No.20	312.94	0.85	41.9
No.40	340.25	0.425	40.9
No.60	414.41	0.25	38.0
No.100	602.79	0.15	30.8
No.140	747.97	0.106	25.3
No.200	898.21	0.075	19.5

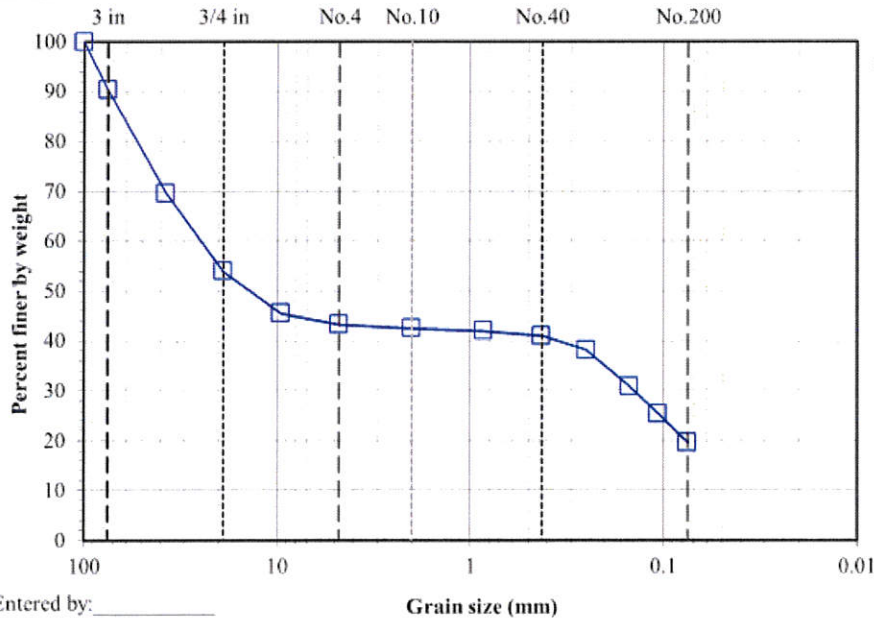

Entered by: _____
 Reviewed: _____

Z:\PROJECTS\01628_Powder_Mountain\012_Summit\GSDv2.xlsx[2]

Particle-Size Distribution (Gradation) of Soils Using Sieve Analysis

(ASTM D6913)



Project: Summit - Phase I E/F/G

Boring No.: TR-7

No: 01628-012

Sample:

Location: Powder Mountain, UT

Depth: 4.5'

Date: 10/11/2016


Description: Brown sand with silt

By: NB

Split: Yes Split sieve: 3/8" Moist Dry Total sample wt. (g): 5204.24 5125.55 +3/8" Coarse fraction (g): 277.38 275.67 -3/8" Split fraction (g): 364.17 358.48 Split fraction: 0.946	Water content data		C.F.(+3/8")	S.F.(-3/8")
	Moist soil + tare (g):	553.93	570.15	
	Dry soil + tare (g):	551.81	564.46	
	Tare (g):	210.99	205.98	
	Water content (%):	0.6	1.6	

Sieve	Accum. Wt. Ret. (g)	Grain Size (mm)	Percent Finer
8"	-	200	-
6"	-	150	-
4"	-	100	-
3"	-	75	100.0
1.5"	148.31	37.5	97.1
3/4"	238.80	19	95.3
3/8"	275.67	9.5	94.6
No.4	2.17	4.75	94.0
No.10	2.72	2	93.9
No.20	11.92	0.85	91.5
No.40	65.72	0.425	77.3
No.60	162.93	0.25	51.6
No.100	266.01	0.15	24.4
No.140	309.12	0.106	13.0
No.200	332.49	0.075	6.9

← Split

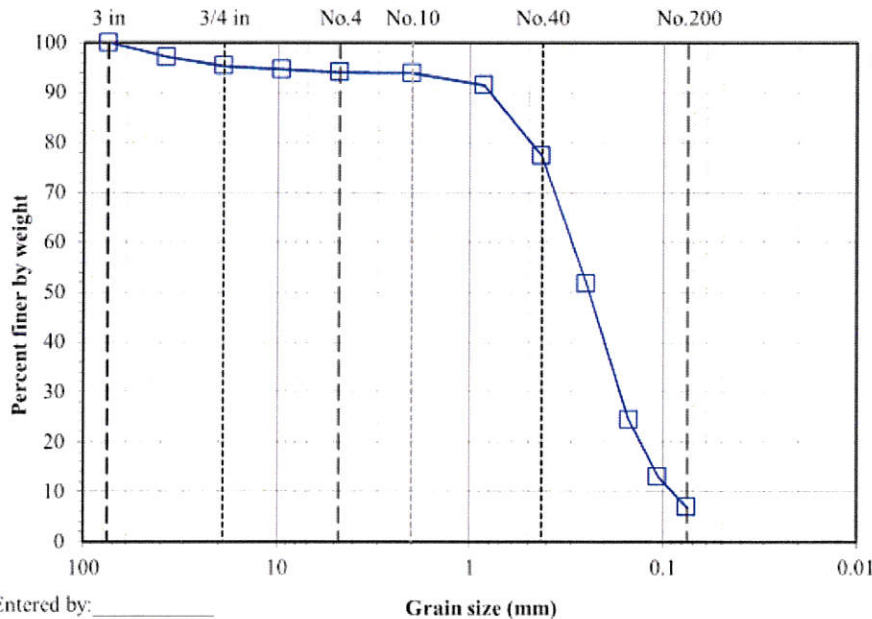

Gravel (%): 6.0
 Sand (%): 87.2
 Fines (%): 6.9

Entered by: _____
 Reviewed: _____

Z:\PROJECTS\01628_Powder_Mountain\012_Summit\GSDv2.xlsx



Staff Report for Administrative Subdivision Approval

Weber County Planning Division

Synopsis

Application Information

Application Request: Consideration and action on an administrative application for final approval of the Creager Subdivision No. 2, a small subdivision consisting of 3 lots containing approximately 5.27 acres per lot.

Type of Decision: Administrative

Agenda Date: Wednesday, January 11, 2017

Applicant: Verl and Gaye Creager

File Number: UVC 121616

Property Information

Approximate Address: 1539 North 5900 E, Eden, UT 83410

Project Area: 16.44 acres

Zoning: Agriculture Valley (AV-3) Zone, Shoreline (S-1) Zone

Existing Land Use: Agriculture

Proposed Land Use: Residential

Parcel ID: 20-002-0083

Township, Range, Section: T6N, R1E, Section 2

Adjacent Land Use

North: Agriculture Residential	South: Vacant Residential
East: 5900 E	West: Agriculture Residential

Staff Information

Report Presenter: Steve Burton
sburton@co.weber.ut.us
801-399-8766

Report Reviewer: RK

Applicable Ordinances

- Weber County Land Use Code Title 104 (Zones) Chapter 6 (AV-3 Zone)
- Weber County Land Use Code Title 104 (Zones) Chapter 10 (S-1 Zone)
- Weber County Land Use Code Title 106 (Subdivisions)

Background and Summary

Verl and Gaye Creager are requesting approval of the Creager Subdivision No. 2, a small subdivision consisting of 3 lots containing approximately 5.27 acres per lot, located at approximately 1539 North 5900 East in Eden. The proposed subdivision is located within the Agriculture Valley (AV-3) Zone and the Shoreline (S-1) Zone (See Exhibit A) The proposed subdivision has access and adequate frontage along 5900 East.

Culinary water will be provided by Eden Waterworks Company and wastewater will be controlled by individual septic systems. Prior to Creager Subdivision No. 2 being finalized and recorded, all review agency requirements must be addressed and completed.

The proposed subdivision and lot configuration are in conformance with the applicable zoning and subdivision requirements as required in the Uniform Land Use Code of Weber County (LUC). The following is a brief synopsis of the review criteria and conformance with the LUC.

Analysis

General Plan: The General Plan for Ogden Valley is intended to preserve private property rights while also preserving the rural characteristics of the Valley. As such, this proposed subdivision, in compliance with the Weber County Land Use Code, is in conformance with the Valley's General Plan.

Zoning: The subject property is located in the Agricultural Valley (AV-3) Zone and the Shoreline (S-1) Zone.

Lot area, frontage/width and yard regulations: In the LUC §104-6-6, the AV-3 zone requires a minimum lot area of 3 acres and a minimum lot width of 150'. In the LUC §104-10-4, the S-1 zone requires a minimum lot area of 5 acres and a minimum lot width of 300'. The portion of all 3 lots that fronts 5900 E is located within the AV-3 Zone and maintains the minimum lot width of 150'. All lots within the proposed subdivision maintain adequate lot area of 5 acres.

LUC § 104-1-4 outlines area requirements for parcels split by zone boundaries.

The more restrictive zone is the zone which has the larger area requirement.

(1) Where a parcel that is split by a zone boundary contains at least two-thirds of the area required for a lot in the more restrictive zone, the area from the less restrictive zone can be used to meet the total area requirement for the more restrictive zone.

(2) Where a parcel that is split by a zone boundary contains less than two-thirds of the area required for a lot in the more restrictive zone, the home must be built in the less restrictive zone. The parcel area in the more restrictive zone can be used to meet area requirements in the less restrictive zone.

As part of the subdivision process, the proposal has been reviewed for compliance with the current subdivision ordinance in LUC 106 chapter 1, and the AV-3 Zone standards in LUC 104-6-6, as well as the S-1 Zone standards in LUC 104-10. The proposed subdivision will not create any new public streets. The proposal meets the criteria for "Small Subdivisions", as defined in LUC 101-7, and can be administratively approved per LUC 106-1-5(b)(1).

Culinary water and sanitary sewage disposal: Feasibility letters have been provided for the culinary water and the sanitary sewer for the proposed subdivision. The culinary water for the proposed subdivision will be provided by Eden Water Works Company. The sanitary sewage disposal will be individual waste water treatment systems. All review agency requirements must be addressed and completed prior to this subdivision being recorded.

Review Agencies: To date, the proposed subdivision has not been reviewed by the Engineering Division or the Surveying Division. The applicant will need to submit a revised plat with all agencies conditions met prior to recording the final Mylar.

Additional Design Standards: The proposed subdivision does not require the realignment of or the creation of a new street system. Deferrals for curb and gutter, and sidewalk will be required as outlined in LUC 106-4-2 (e) and (f).

Tax Clearance: There are no outstanding tax payments related to this parcel.

Public Notice: A notice has been mailed not less than seven calendar days before final approval to all property owners of record within 500 feet of the subject property regarding the proposed small subdivision per noticing requirements outlined in LUC §106-1-6.

Staff Recommendations

Staff recommends final approval of the Creager Subdivision No. 2, a small subdivision consisting of 3 lots containing approximately 5.27 acres each. This recommendation is subject to all review agency requirements and based on the following conditions:

1. A deferral agreement for curb and gutter, and sidewalks must be filed and recorded with the final Mylar.
2. An "Onsite Wastewater Disposal System Deed Covenant and Restriction to Run with the Land" must be filed and recorded with the final Mylar.

This recommendation is based on the following findings:

1. The proposed subdivision conforms to the Ogden Valley General Plan.
2. With the recommended conditions, the proposed subdivision complies with applicable county ordinances.
3. The proposed subdivision will not be detrimental to public health, safety, or welfare.
4. The proposed subdivision will not deteriorate the environment of the general area so as to negatively impact surrounding properties and uses.

Administrative Approval


Administrative final approval of the Creager Subdivision No. 2 is hereby granted based upon its compliance with the Weber County Land Use Code. This approval is subject to the requirements of applicable review agencies and the conditions of approval listed in this staff report.

Date of Administrative Approval: Wednesday, January 11, 2017.


Rick Grover
Weber County Planning Director

Exhibits

- A. Plat Map
- B. Feasibility and Will Serve letter

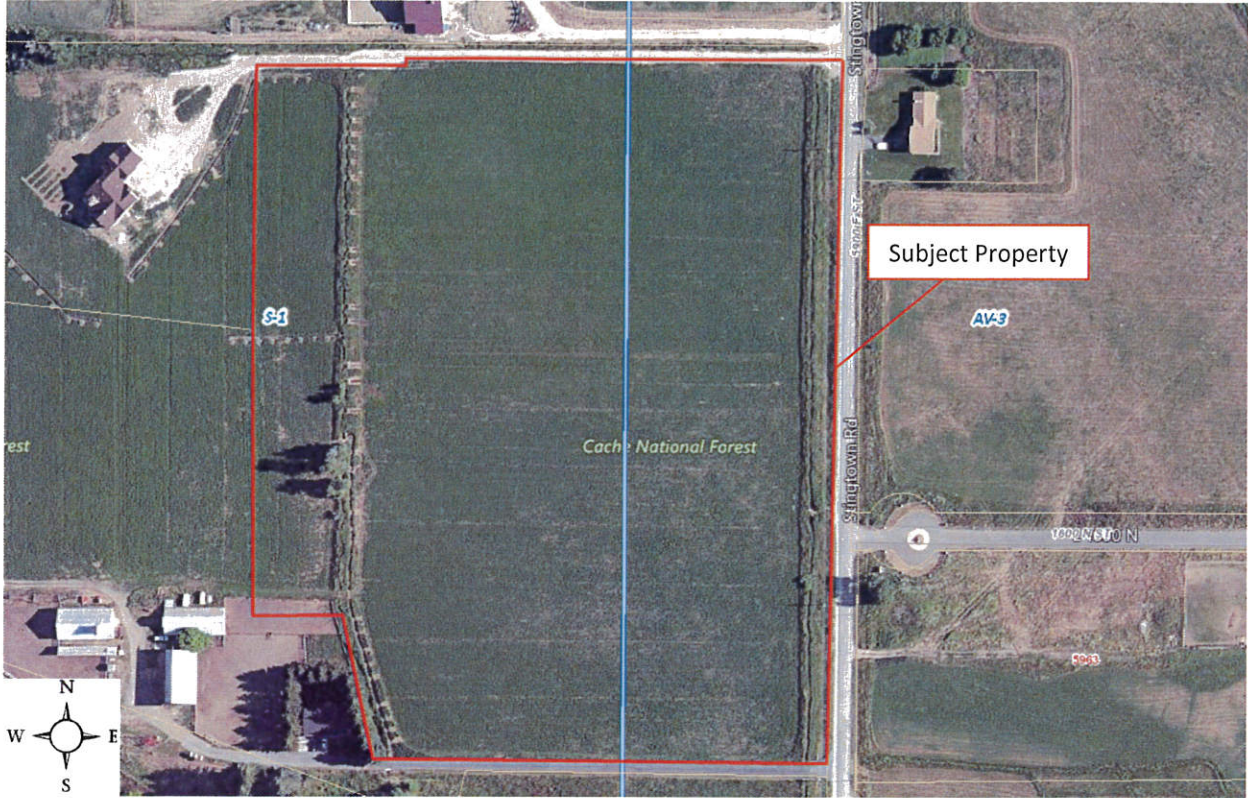

Area Map 2

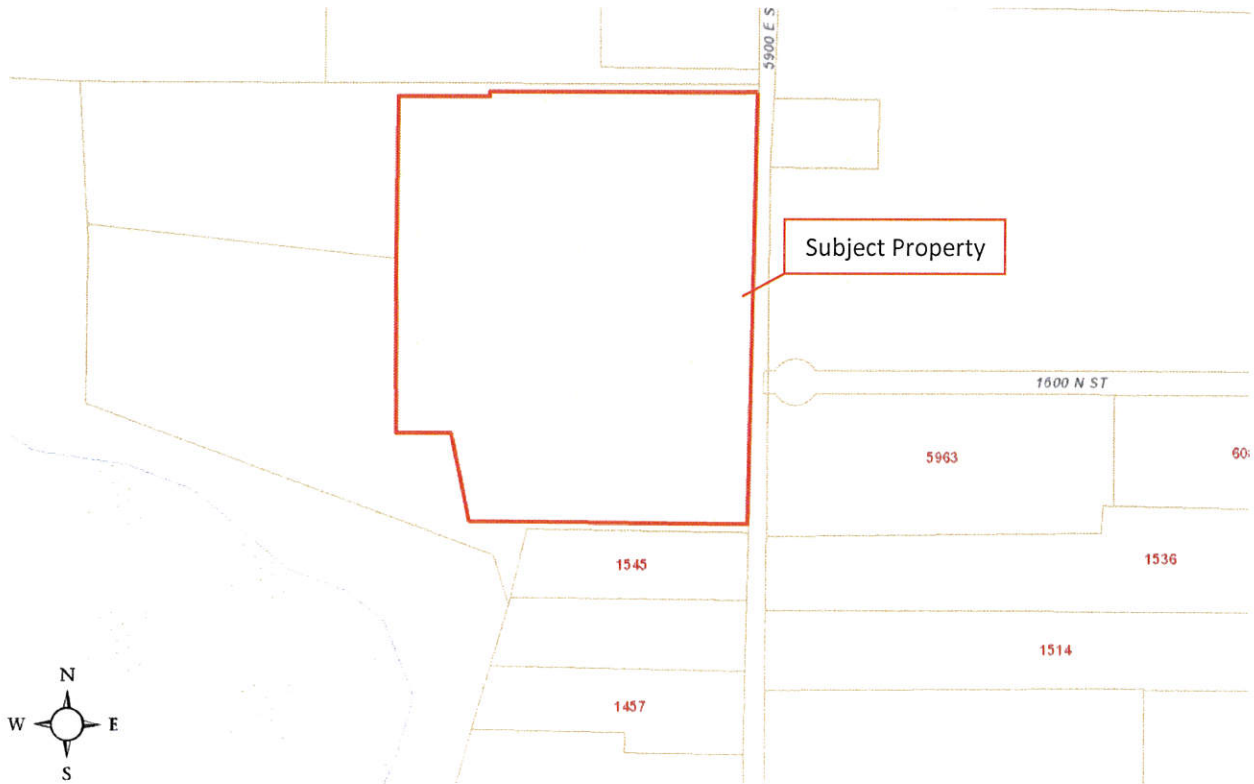

BRIAN W. BENNION, M.P.A., L.E.H.S.
Health Officer/Executive Director

December 7, 2016



Weber County Planning Commission
2380 Washington Blvd.
Ogden, UT 84401

RE: Creager Subdivision, Lots 1-4
Approx 1627 N 5900 E
Parcel #20-002-0083
Soil log #14257 & #14422

Gentlemen:

The soil and percolation information for the above-referenced lots have been reviewed. Culinary water will be provided by Eden Water District, an extension of an existing approved non-community water system. **A letter from the water supplier is required prior to issuance of a permit.**

DESIGN REQUIREMENTS

Lot 1: Existing Home

Lots 2, 3&4: Anticipated ground water tables not to exceed 42 inches, fall within the range of acceptability for the utilization of a Conventional System as a means of wastewater disposal. Maximum trench depth is limited to 18 inches. The absorption system is to be designed using a maximum loading rate of 0.65 gal/sq. ft. /day as required for the sandy loam, granular structure soil horizon.


Plans for the construction of any wastewater disposal system are to be prepared by a Utah State certified individual and submitted to this office for review prior to the issuance of a Wastewater Disposal permit.

All subdivision plats submitted for review are to show the location of exploration pits and percolation tests as well as the documented soil horizons and percolation rates. Mylars submitted for signature without this information will be returned.

Each on-site individual wastewater disposal system must be installed in accordance with R317-501 through R317-513, Utah Administrative Code, Individual Wastewater Disposal Systems and Weber-Morgan District Health Department Rules. Final approval will be given only after an on-site inspection of the completed project and prior to the accomplishment of any backfilling.

Please be advised that the conditions of this letter are valid for a period of 18 months. At that time the site will be re-evaluated in relation to rules in effect at that time.

Sincerely,

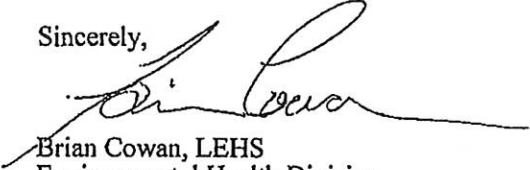
Brian Cowan, LEHS
Environmental Health Division
801-399-7160
BC/gk

WEBER-MORGAN HEALTH DEPARTMENT SUBDIVISION APPLICATION

FEE SCHEDULE: \$132.00 PLUS \$66.00/HR. OVER TWO HOURS

SUBDIVISION AND PROPERTY INFORMATION

Subdivision Name: Creager Subdivision No. 2		
Previous Name(s): Creager Family Trust		
Approximate Address: 1627N. 5900E. and 1671N. 5900E. and ^{1579N. 5900E.}		Number of lots: 3
City: Eden	State: Utah	Zip: 84310
Culinary Water Provider: Eden Waterworks		
Land Serial Number(s):		

PROPERTY OWNER CONTACT INFORMATION

Name of Property Owner(s) Verl and Gaye Creager		
Mailing Address: 1539 N. 5900E.		City: Eden
State: Utah	Zip Code: 84310	Phone: 801-745-3042
Fax: 801-745-3042	Email: vandacreager@gmail.com	

AUTHORIZED REPRESENTATIVE/ENGINEER CONTACT INFORMATION

Name:		
Address:		Phone:
City:	State:	ZIP Code:
Email:		

INFORMATION REQUIRED (IF APPLICABLE)

Preliminary Plat Submitted:	Topography:
Soil Evaluation(s):	Water table Monitoring:
Septic and wellhead location for existing infrastructure:	Percolations Results:
Location of nearest sewer and public water systems (Zone 2 delineation):	
Square footage and slopes of each proposed lot outside of any easements:	

SIGNATURES

I understand that this document is a guide for the submittal of information that may be required for approval of a new subdivision. Additional information may be required during the course of plan review. Completion of these requirements is not an assertion of the ability to subdivide.

Signature of applicant: <i>Verl A. Creager</i>	Date: 10-13-16
Signature of Authorized Representative: <i>Gaye L. Creager</i>	Date:

OFFICE USE

RECEIVED BY:	PAID:	DATE:
--------------	-------	-------

**EDEN WATER WORKS COMPANY
PO BOX 13
EDEN, UTAH 84310
801-791-1772**

October 14, 2016

Weber County Planning Commission
2380 Washington Boulevard
Ogden, Utah 84401

To Whom It May Concern:

Re: Lot #2 Creager Subdivision
1671 N 5900 E
Eden, Utah 84310
Proposed property

The Eden Water Works Company would like to inform you of the availability of water for the proposed property above. Shares of class "D" stock in the Company are available for purchase.

It is mandatory that the following conditions be met:

1. Proof of secondary water rights assigned to property.
2. Purchase Eden Water Works Company share to include item #3.
3. Additional cost of replacement water from Weber Basin Water.
4. Pay applicable hookup fees.
5. **Prior to occupancy**, meter must be installed and tested.
Failure to do so will result in a \$50.00 fine for the first week and \$100.00/week thereafter.
6. Satisfy the Impact to EWWC system and Potential Impact Fees

Upon the purchase of stock and when these conditions are met and verified by a member of the Board of Trustees or its designated representative, the Board will be pleased to make the connection to the Company water system.

Sincerely,



Board of Trustees
Eden Water Works Company

EDEN WATER WORKS COMPANY
PO BOX 13
EDEN, UTAH 84310
801-791-1772
edenwaterworks@gmail.com

October 14, 2016

Weber Morgan Health Department
477 23rd Street
Ogden, UT 84401

Regarding: Lot #2 Creager Subdivision, 1671 N 5900 E Eden, UT

To Whom It May Concern:

Please accept this letter as confirmation that subject to Share of Stock and applicable fees being paid, Eden Water Works Company will serve culinary water to the property located @ 1671 N 5900 E Eden, UT.

If you have any questions or need further information you may contact the office at 801-791-1772.

Sincerely,

A handwritten signature in blue ink that reads "Annette Story". The signature is written in a cursive style.

Board of Trustees
Eden Water Works Company

**EDEN WATER WORKS COMPANY
PO BOX 13
EDEN, UTAH 84310
801-791-1772**

October 14, 2016

Weber County Planning Commission
2380 Washington Boulevard
Ogden, Utah 84401

To Whom It May Concern:

Re: Lot #3 Creager Subdivision
1627 N 5900 E
Eden, Utah 84310
Proposed property

The Eden Water Works Company would like to inform you of the availability of water for the proposed property above. Shares of class "D" stock in the Company are available for purchase.

It is mandatory that the following conditions be met:

1. Proof of secondary water rights assigned to property.
2. Purchase Eden Water Works Company share to include item #3.
3. Additional cost of replacement water from Weber Basin Water.
4. Pay applicable hookup fees.
5. **Prior to occupancy**, meter must be installed and tested.
Failure to do so will result in a \$50.00 fine for the first week and \$100.00/week thereafter.
6. Satisfy the Impact to EWWC system and Potential Impact Fees

Upon the purchase of stock and when these conditions are met and verified by a member of the Board of Trustees or its designated representative, the Board will be pleased to make the connection to the Company water system.

Sincerely,



Board of Trustees
Eden Water Works Company

EDEN WATER WORKS COMPANY
PO BOX 13
EDEN, UTAH 84310
801-791-1772
edenwaterworks@gmail.com

October 14, 2016

Weber Morgan Health Department
477 23rd Street
Ogden, UT 84401

Regarding: Lot #3 Creager Subdivision, 1627 N 5900 E Eden, UT

To Whom It May Concern:

Please accept this letter as confirmation that subject to Share of Stock and applicable fees being paid, Eden Water Works Company will serve culinary water to the property located @ 1627 N 5900 E Eden, UT.

If you have any questions or need further information you may contact the office at 801-791-1772.

Sincerely,



Board of Trustees
Eden Water Works Company

**EDEN WATER WORKS COMPANY
PO BOX 13
EDEN, UTAH 84310
801-791-1772**

October 14, 2016

Weber County Planning Commission
2380 Washington Boulevard
Ogden, Utah 84401

To Whom It May Concern:

Re: Lot #4 Creager Subdivision
1579 N 5900 E
Eden, Utah 84310
Proposed property

The Eden Water Works Company would like to inform you of the availability of water for the proposed property above. Shares of class "D" stock in the Company are available for purchase.

It is mandatory that the following conditions be met:

1. Proof of secondary water rights assigned to property.
2. Purchase Eden Water Works Company share to include item #3.
3. Additional cost of replacement water from Weber Basin Water.
4. Pay applicable hookup fees.
5. **Prior to occupancy**, meter must be installed and tested.
Failure to do so will result in a \$50.00 fine for the first week and \$100.00/week thereafter.
6. Satisfy the Impact to EWWC system and Potential Impact Fees

Upon the purchase of stock and when these conditions are met and verified by a member of the Board of Trustees or its designated representative, the Board will be pleased to make the connection to the Company water system.

Sincerely,



Board of Trustees
Eden Water Works Company

EDEN WATER WORKS COMPANY
PO BOX 13
EDEN, UTAH 84310
801-791-1772
edenwaterworks@gmail.com

October 14, 2016

Weber Morgan Health Department
477 23rd Street
Ogden, UT 84401

Regarding: Lot #4 Creager Subdivision, 1579 N 5900 E Eden, UT

To Whom It May Concern:

Please accept this letter as confirmation that subject to Share of Stock and applicable fees being paid, Eden Water Works Company will serve culinary water to the property located @ 1579 N 5900 E Eden, UT.

If you have any questions or need further information you may contact the office at 801-791-1772.

Sincerely,



Board of Trustees
Eden Water Works Company



Staff Report for Administrative Subdivision Approval

Weber County Planning Division

Synopsis

Application Information

Application Request: Consideration and action on an administrative application for approval of the Emerson Hills Phase 3 Amended.

Type of Decision: Administrative

Agenda Date: Wednesday, January 11, 2017

Applicant: Kevin Parkinson

File Number: UVL 111816

Property Information

Approximate Address: 6523 N North Fork RD, Eden

Project Area: 5.44 Acres

Zoning: Forest (F-5) Zone

Existing Land Use: Single Family Dwelling

Proposed Land Use: Residential

Parcel ID: 16-287-0001

Township, Range, Section: Township 7N, Range 1W, Section 1

Adjacent Land Use

North:	Forest/Residential	South:	Forest/Residential
East:	Residential	West:	Forest

Staff Information

Report Presenter: Felix Lleverino
fleverino@co.weber.ut.us
801-399-8767

Report Reviewer: RK

Applicable Ordinances

- Title 104 (Zones) Chapter 9 (F-5 Zone)
- Title 104 (Zones) Chapter 27 (Natural Hazards Overlay District)
- Title 106 (Subdivisions)
- Title 108 (Standards) Chapter 22 (Natural Hazard Areas)
- Title 101 (General Provisions) Section 7 (Definitions)

Background and Summary

The applicant, Kevin Parkinson, is requesting final approval of this amendment to an already approved subdivision that was granted final approval on March 25, 2008. This amendment will expand the buildable area within lot 12 of the original plat. As part of the County Surveyor's comments it required that the lot be renumbered to lot 13.

The specific buildable area has been designated due to topography and ground water. The site specific geologic report that was conducted by Gordon Geotechnical Engineering, Inc. has stated that "The proposed buildable area expansion is suitable from a geologic standpoint." This quote is taken from page 3 of the Geologic Reconnaissance Study. The entire report has been attached as Exhibit D.

The width and area of lot 13 exceed the minimum requirements for the Forest (F-5) Zone. This lot also conforms to the subdivision requirements including adequate frontage and access along a dedicated public road as required in the Uniform Land Use Code of Weber County (LUC). The following is an analysis of the subdivision amendment proposal.

Analysis

General Plan: This buildable area expansion within Emerson Hills Phase 3 Amended is in harmony with the Ogden Valley General Plan by implementing developments that preserve natural, agricultural and open spaces within the valley.

Zoning: The property is located in the F-5 Zone. The purpose of this zone is stated below, and can be found in LUC §104-6-1

"The intent of the forest zones is to protect and preserve the natural environment of those areas of the county that are characterized by mountainous, forest or naturalistic land, and to permit development compatible to the preservation of these areas."

Lot Area, Frontage Width and Yard Regulations: The area and width of lot 13 exceeds the minimum requirements for a lot within the F-5 Zone. LUC 108-9-1

The Yard Regulations for the F-5 zone are as follows:

Front: 30 feet

Side: 20 feet

Rear: 30 feet

The Minimum width and area for the F-5 Zone are as follows:

300 feet in width

5 acres in area

Natural Hazards Overlay Districts: A site specific geologic report was conducted by Gordon Geotechnical Engineering, Inc. The report gave an analysis on the following potential geologic hazards affiliated with the site:

Slope Stability and Landslide Hazard: "A review of Utah Geological Survey Landslide Maps (Elliott and Harty 2010) identified no known landslide deposits at the site. Additionally, the engineering geology report for the subdivision including a reconnaissance site and aerial photograph review identified no indication of slope failure at the site." This quote is taken from page 3 of the Geologic reconnaissance study (see Exhibit D).

Flood Plain: "A review of FEMA flood insurance maps indicates that the majority if the site is located in Zone X, which is defined as the area of minimal flood hazard. The buildable area expansion is located well beyond 100 feet away from Zone A, which is defined as the area of the 100-year flood event." This quote is taken from page 4 of the Geologic reconnaissance study (see Exhibit D).

Shallow Groundwater: "Groundwater was encountered in our geotechnical study at a depth if 10 feet below the ground surface. Although the ground water level is expected to fluctuate one to two feet with the flow of the river, it is not expected to affect any future construction at the site."

"The recommendations for the floor slabs and foundation subdrains will be the same as per our geotechnical study for the site." This quote is taken from page 4 of the Geologic reconnaissance study (see Exhibit D).

Small Subdivision: The LUC §101-1-7 defines "small subdivision" as "A subdivision consisting of five (5) or fewer lots and for which no streets will be created or realigned." This subdivision consists of one lot and no new streets are being created or realigned. Stated in the LUC § 106-1-5(b),(1) "The land use authority who, for the purposes of this section, shall be the planning commission, for their review and decision in compliance with applicable ordinances." Based on these requirements, this subdivision qualifies for administrative approval as a small subdivision.

Culinary Water: Durfee Creek Homeowners Association will be providing culinary water services to lot 13 of the Emerson Hills Phase 3 Amended.

Sanitary System: Lot 13 of Emerson Hills Phase 3 Amended will be serviced by a private septic system.

Review Agencies: The proposed subdivision has been reviewed by Surveying, Planning and Engineering. The Planning Division anticipates that the items in each review can be sufficiently addressed by the applicant.

Tax Clearance: There is no record of past delinquent tax history and no outstanding tax bills on these parcels.

Public Notice: Noticing requirements, according to LUC § 106-1-6(c), have been met by mailing notices out to all property owners of record within 500 feet of the subject property.

Staff Recommendations

Staff recommends final plat approval of the Emerson Hills Phase 3 Amended, consisting of one lot. This recommendation for approval is based on the applicant providing a site specific geologic study and meeting all subdivision requirements.

This recommendation is based on the following findings:

1. The proposed subdivision conforms to the Ogden Valley General Plan.
2. The proposed subdivision complies with the applicable County ordinances.

Administrative Approval

Administrative final approval of Emerson Hills Phase 3 Amended is hereby granted based upon its compliance with the Weber County Land Use Code. This approval is subject to the requirements of applicable review agencies and the conditions of approval listed in this staff report.

Date of Administrative Approval: January 11, 2016


Rick Grover
Weber County Planning Director

Area Map




Exhibits

- A. Emerson Hills Phase 3 Amended
- B. Original Emerson Hills Phase 3 Plat
- C. Recorders Plat
- D. Geologic Report

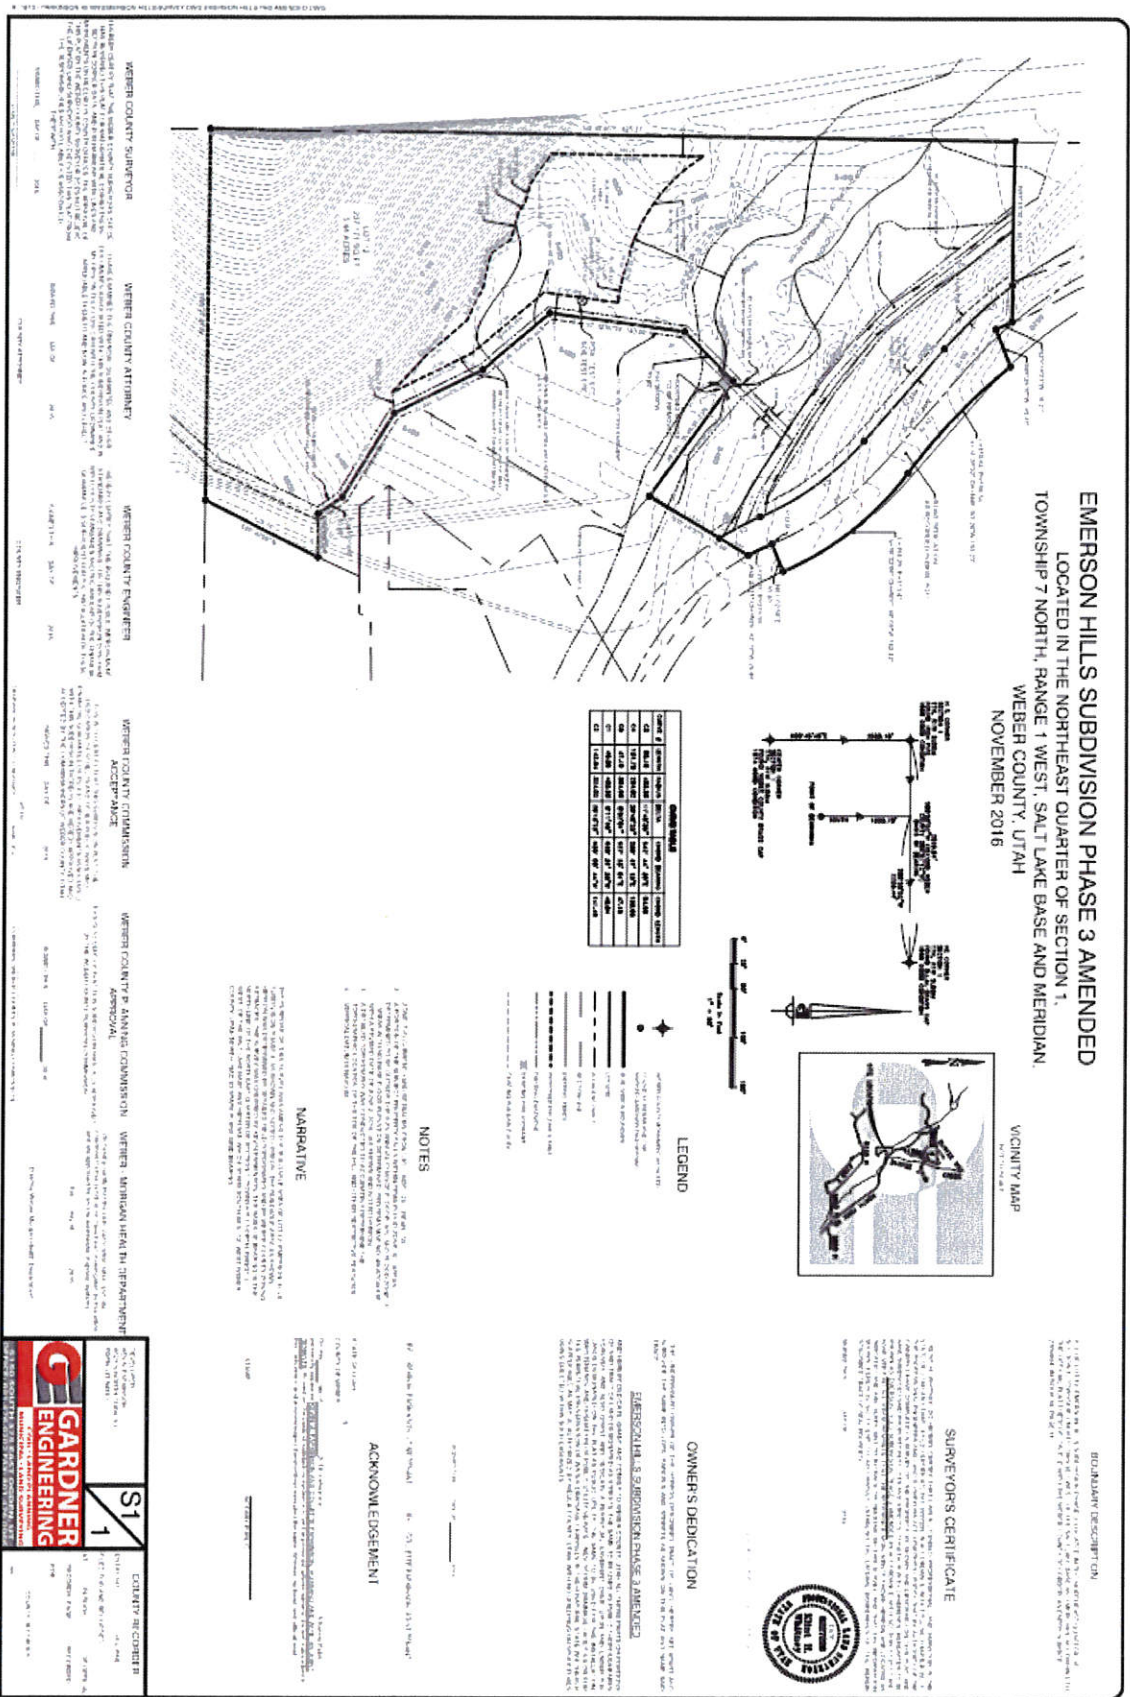

11-69

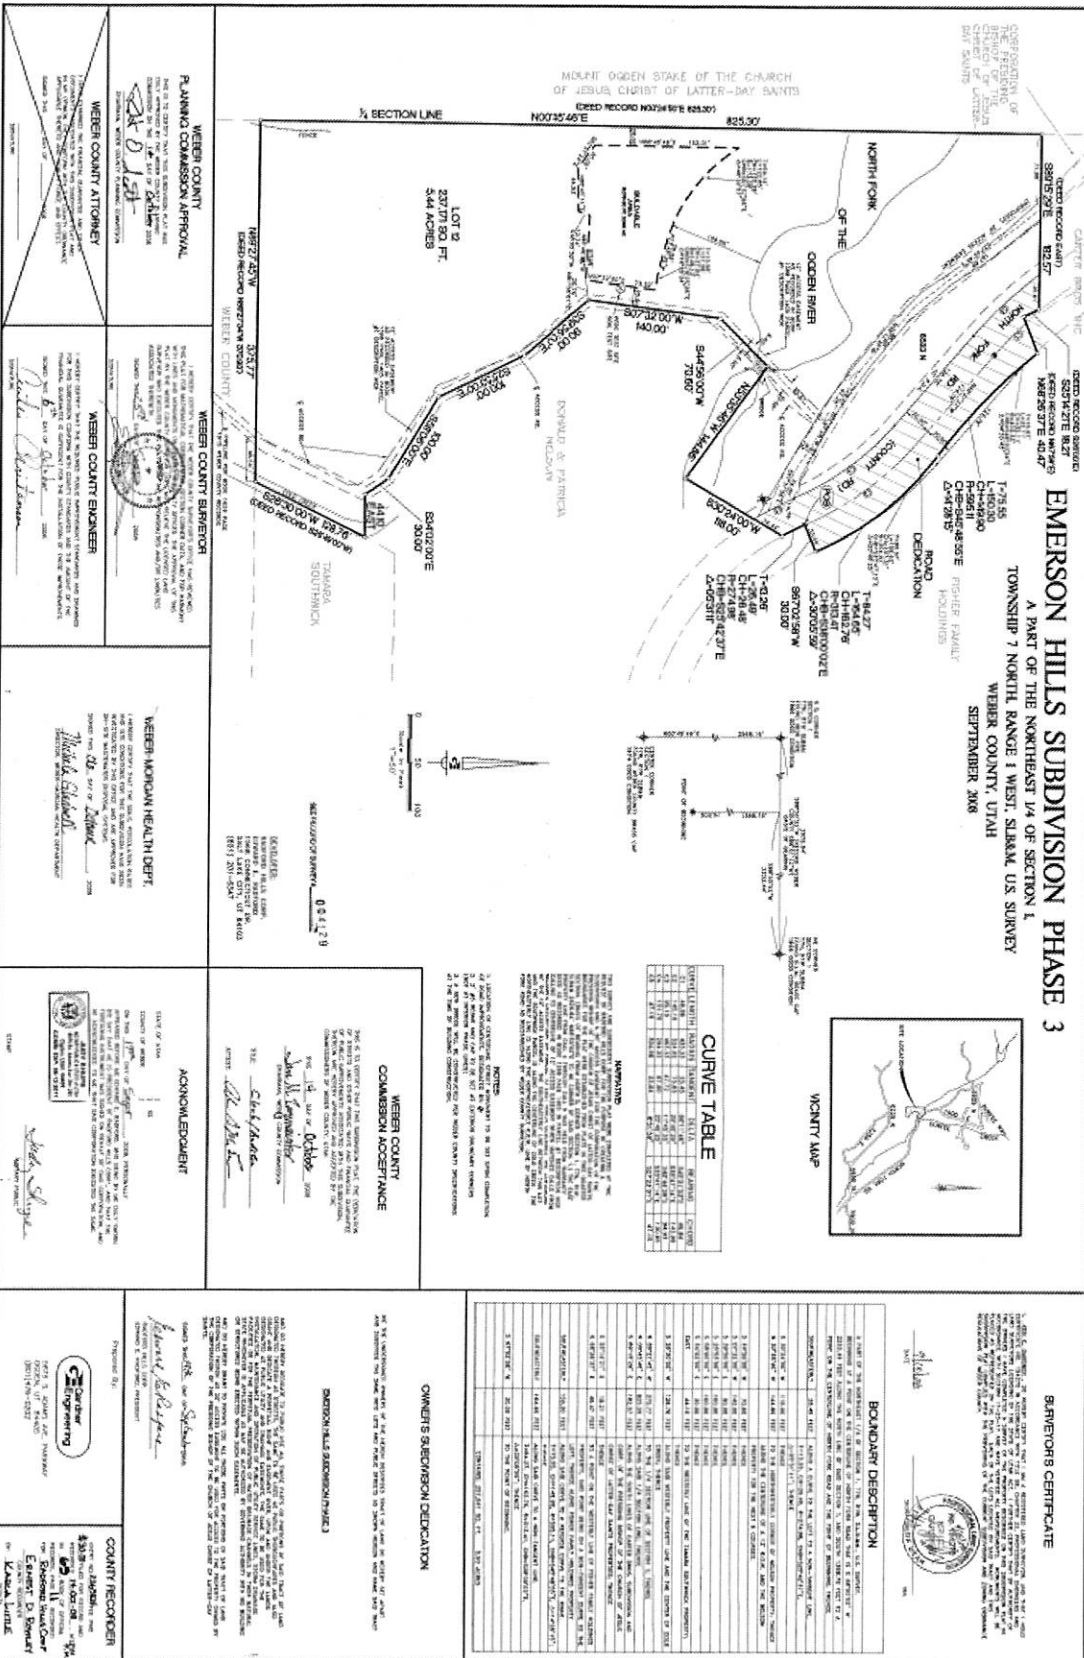

PART OF THE NE.1/4, OF SECTION 1, T.7N., R.1W., S.L.B. & M.
EMERSON HILLS SUBDIVISION PHASE 3

287


TAXING UNIT: 410

IN WEBER COUNTY
SCALE 1" = 80'

SEE PAGE 1

SEE PAGE 1

SEE PAGE 1

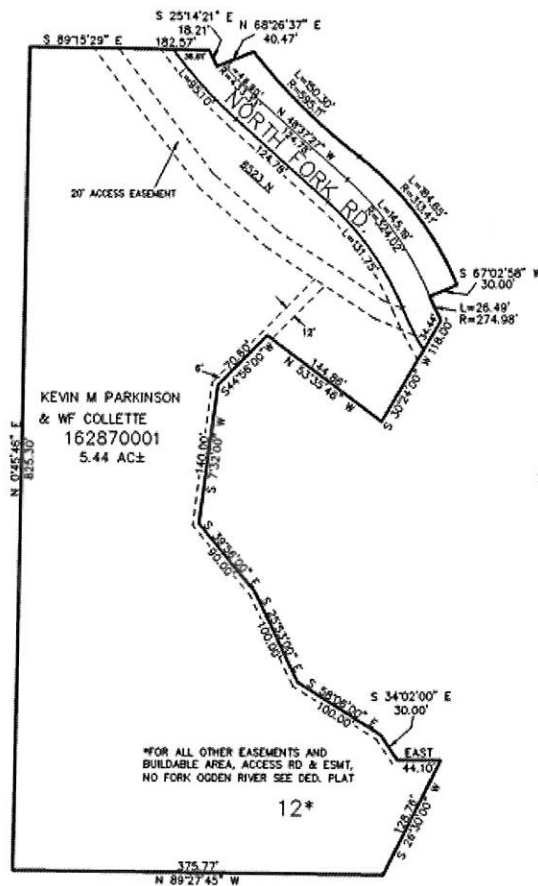

10' UTILITY & DRAINAGE EASEMENTS EACH
SIDE OF PROPERTY LINES AS INDICATED
BY DASHED LINES EXCEPT AS OTHERWISE
SHOWN.

FOR COMPLETE ENG DATA SEE
ORIGINAL DEDICATION PLAT IN
BOOK 69, PAGE 11 OF RECORDS.



REPORT
GEOLOGIC RECONNAISSANCE STUDY
BUILDABLE AREA EXPANSION
EMERSON HILLS SUBDIVISION LOT #12
LIBERTY, UTAH

September 23, 2016

Job No. 406-01A-16

Prepared for:
Distinct Homes, LLC
2490 Wall Avenue
Ogden, Utah 84401

Prepared by:
Gordon Geotechnical Engineering, Inc.
4426 South Century Drive, Suite 100
Salt Lake City, Utah 84123
Tel: 801-327-9600
Fax: 801-327-9601
www.gordongeotech.com

September 23, 2016
Job No. 406-01A-16

Distinct Homes, LLC
2490 Wall Avenue
Ogden, Utah 84401

Attention: Mr. Kevin Parkinson

Ladies and Gentlemen:

Re: Report
Geologic Reconnaissance Study
Buildable Area Expansion
Emerson Hills Subdivision Lot #12
Liberty, Utah

1. INTRODUCTION

1.1 GENERAL

This report presents the results of our geologic reconnaissance study performed for the proposed expansion of the buildable area at Lot #12, Emerson Hills Subdivision in Liberty, Utah. The general location of the site with respect to major topographic features and existing facilities, as of 1991 and 1998, is presented on Figure 1, Vicinity Map. A detailed location of the site showing existing roadways and surrounding facilities, on an air photograph base, is presented on Figure 2, Area Map. A more detailed layout of the site showing the existing buildable area and proposed expansion is presented on Figure 3, Site Plan.

Gordon Geotechnical Engineering, Inc. (G²) previously performed a geotechnical and geologic hazards study for the site dated August 12, 2016¹.

1.2 OBJECTIVES AND SCOPE

The objectives and scope of our study were planned in discussions between Mr. Kevin Parkinson or Distinct Homes, LLC and Mr. Patrick Emery of G².

¹ "Report, Geotechnical and Geologic Hazards Study, Proposed Single-Family Residential Structure, Emerson Hills Subdivision Lot #12, Liberty, Utah," G² Job No. 406-001-16, Dated August 12, 2016.

In general, the objectives of this study were to:

1. Evaluate the potential for geologic hazards or geologic concerns associated with the proposed buildable area expansion including landslides, shallow groundwater, expansive soil and rock, radon, flooding, and earthquakes.

In accomplishing these objectives, our scope has included the following:

1. A reconnaissance site visit.
2. A review of available geologic maps, and engineering geologic report.
3. An office program consisting of the correlation of available data, geologic analyses, and the preparation of this summary report.

1.3 PROFESSIONAL STATEMENTS

Supporting data upon which our recommendations are based are presented in subsequent sections of this report. Recommendations presented herein are governed by the physical properties of the soils encountered in the previously completed exploration test pits, measured and projected groundwater conditions, and the layout and design data discussed in Section 2., Proposed Buildable Area Expansion, of this report. If subsurface conditions other than those described in this report are encountered and/or if design and layout changes are implemented, G² must be informed so that our recommendations can be reviewed and amended, if necessary.

Our professional services have been performed, our findings developed, and our recommendations prepared in accordance with generally accepted engineering principles and practices in this area at this time.

2. PROPOSED BUILDABLE AREA EXPANSION

The existing buildable area, identified on the subdivision plat, has been defined according to USGS quad maps and the proper setback distances defined by Weber County.

The proposed expansion extends to the southeast from the southern boundary of the existing buildable area. The irregularly-shaped area is confined by the toe of the alluvial terrace slope to the west and a 20-foot setback from the property line to the east.

3. SITE CONDITIONS

3.1 SURFACE

The overall site consists of an irregular-shaped parcel of vacant land containing 5.44 acres. The site is located north of the town of Liberty, Utah on the west side of North Fork Road near

the confluence of Durfee Creek and the North Fork of the Ogden River. Vegetation consists of a heavy growth of grasses, weeds, and shrubs as well as several large river birch, willow, and cottonwood trees.

The overall topography in the area slopes down to the east/southeast with a total relief of approximately 130 feet across the site. The slopes vary significantly across the lot from nearly flat, to a grade of approximately 25 percent in the buildable area, and approximately 64 percent along the 130+ foot tall river-carved slope on the southern portion of the lot.

The surface of the proposed buildable area expansion is mostly flat and heavily vegetated with shrubs and large trees.

Our review of geologic maps, indicate that the surficial geology in this area consists of primarily alluvial terrace and floodplain deposits from the Pleistocene era. The site is situated within an alluvial valley associated with the North Fork of the Ogden River. The geologic materials consist of predominantly rounded sand and gravel with numerous cobbles and small boulders.

Representative photographs of the site area are shown on Figure 4, Photographs.

4. DISCUSSIONS AND RECOMMENDATIONS

4.1 SUMMARY OF FINDINGS

Based upon our reconnaissance site visit, geologic map review, hazard report review, and conditions encountered in our geotechnical study, we find the proposed buildable area expansion to be suitable from a geologic standpoint. Detailed discussion on the potential geologic hazards is provided in the following sections.

4.2 GEOLOGIC HAZARDS

4.2.1 Slope Stability and Landslide Hazard

A review of Utah Geological Survey Landslide Maps (Elliott and Harty, 2010) identified no known landslide deposits at the site. Additionally, the engineering geology report for the subdivision² including a reconnaissance site visit and aerial photograph review identified no indication of slope failure at the site.

During our reconnaissance site visit, the slopes at the site were closely investigated and no signs of past or imminent slope failure were identified.

² "Report, Engineering Geology Reconnaissance and Evaluation, Proposed Emerson Hills Subdivision, North Fork Ogden River, Ogden Valley, Town of Liberty, Weber County, Utah", AGRA Earth & Environmental Job No. 7-817-000855, Dated May 20, 1997.

The geologic materials comprising the slopes were likely deposited concurrently with the high stand of Lake Bonneville, approximately 15,000 years ago (Crittenden and Sorensen 1985a,b). Thus, the slopes at the site are stable in their current state despite being subjected to multiple seismic events. The slope stability and landslide hazard is considered "low".

Where site development requires significant earthwork modification to existing slopes, we recommend the pertinent geotechnical/slope stability studies be conducted.

4.2.2 Rockfall Hazard

No significant loose boulders were identified on the surface of the slopes at the site. Rockfall hazard is considered "low".

4.2.3 Flooding (FEMA Flood Plain)

A review of FEMA flood insurance maps indicates that the majority of the site is located in Zone X, which is defined as the area of minimal flood hazard. The buildable area expansion is located well beyond 100 feet away from Zone A, which is defined as the area of the 100-year flood event.

4.2.4 Shallow Groundwater

Groundwater was encountered in our geotechnical study at a depth of 10 feet below the ground surface. Although the groundwater level is expected to fluctuate one to two feet with the flow of the river, it is not expected to affect any future construction at the site.

The recommendations for floor slabs and foundation subdrains will be the same as per our geotechnical study for the site.

4.2.5 Expansive Soil and Rock


The coarse granular and occasional interbedded sandy silt soils encountered at the site do not exhibit moisture sensitive characteristics.

4.2.6 Indoor Radon-Hazard

A review of the Radon-Hazard Potential map for Ogden Valley (Solomon, 1996) indicates that the site is located within an area having "high" radon-hazard potential. Radon-hazard determination takes into account several factors including the source and nature of the geologic materials, and results from nearby indoor radon tests. The soils encountered at the site are highly permeable and are sourced primarily from nearby Precambrian bedrock units which contain trace amounts of Uranium. Indoor radon tests in the area have shown levels greater than 4 pCi/L.

Distinct Homes, LLC

Job No. 406-01A-16
Geologic Reconnaissance Study
September 23, 2016




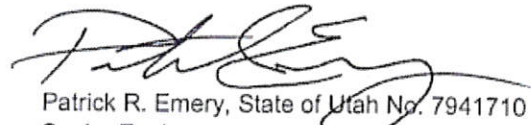
We appreciate the opportunity of providing this service for you. If you have any questions or require additional information, please do not hesitate to contact us.

Respectfully submitted,

Gordon Geotechnical Engineering, Inc.

Reviewed by:


Jordan K. Culp, EIT
Staff Geological Engineer



Patrick R. Emery, State of Utah No. 7941710
Senior Engineer

JKC/PRE:sn

Encl. Figure 1, Vicinity Map
Figure 2, Area Map
Figure 3, Site Plan
Figure 4, Photographs


Addressee (3 + email)



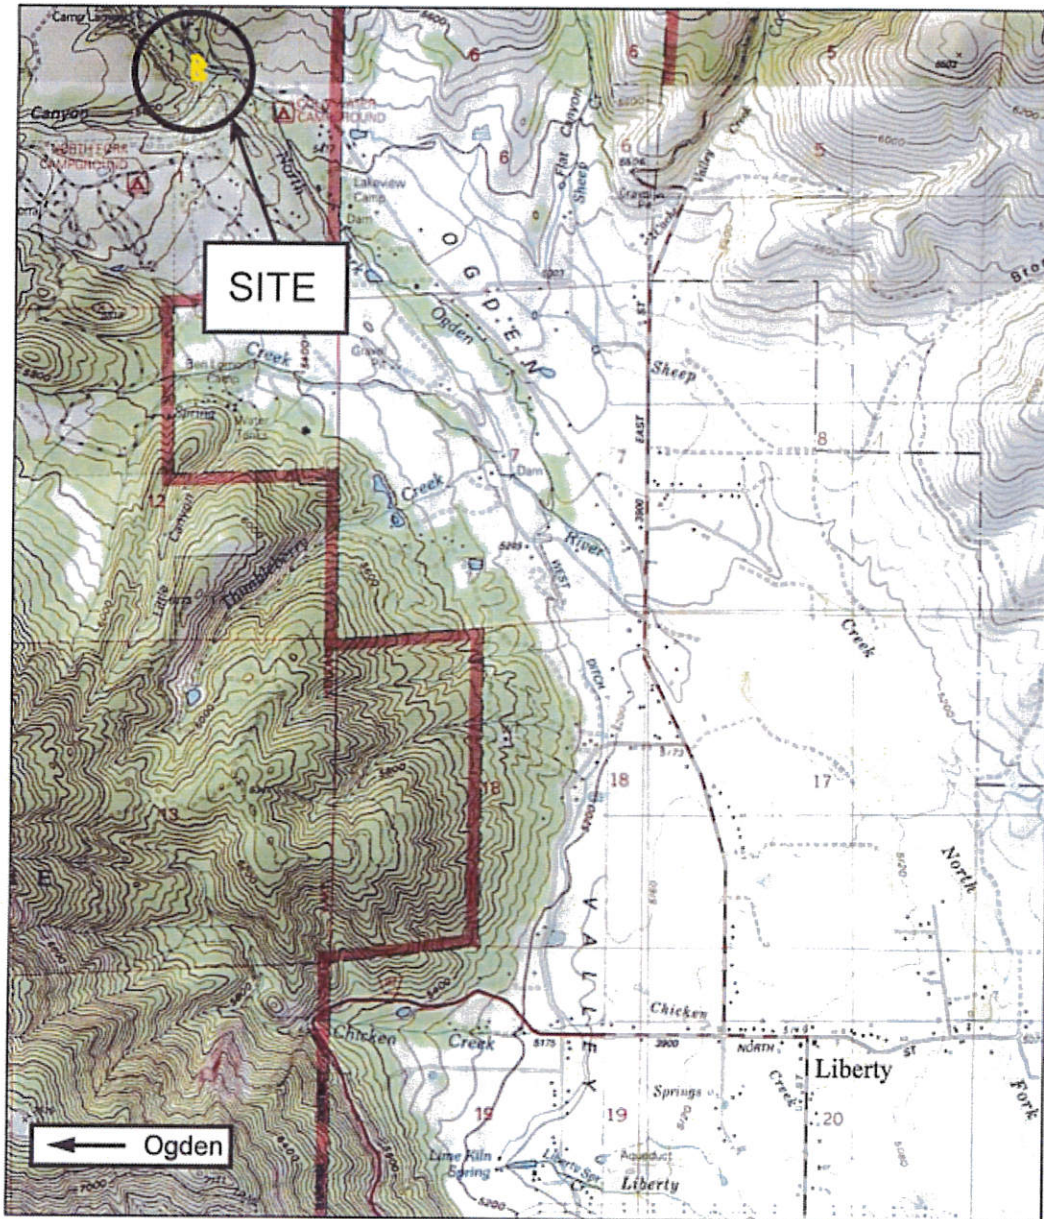

REFERENCE:
USGS 7.5 MINUTE TOPOGRAPHIC QUADRANGLE MAPS
TITLED "NORTH OGDEN, UTAH", DATED 1998
AND "HUTNSVILLE, UTAH", DATED 1991

**FIGURE 1
VICINITY MAP**

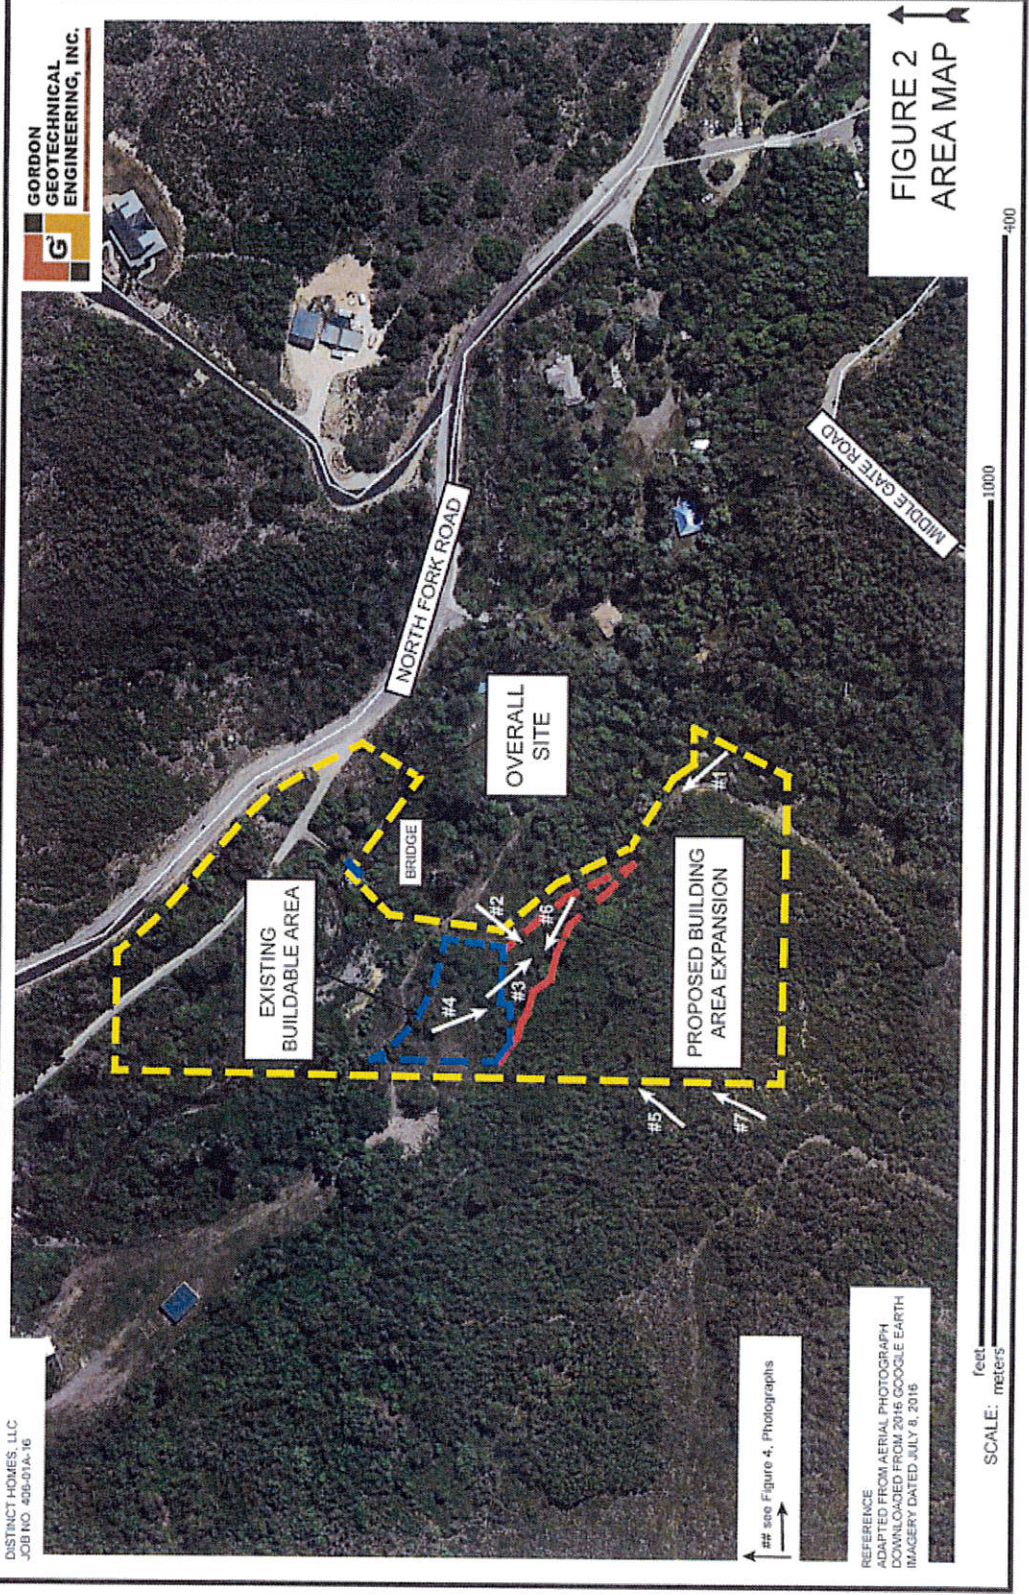



#1 View of roadcut exposed geologic materials comprising the slopes at the site.



#2 Facing southwest from the buildable area expansion toward the heavily vegetated slope.



#3 Facing southeast across the proposed building area expansion.




#4 Facing southeast, overall buildable area.

Locations and direction, see Figure 2, Area Map

FIGURE 4 PHOTOGRAPHS



#5 Facing northeast from the top of the 130+ foot slope.

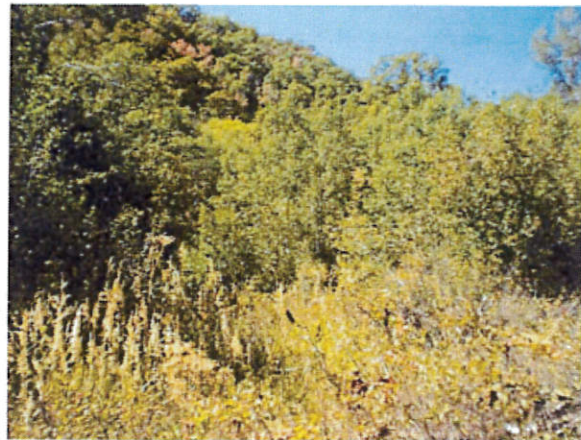


#6 Facing northwest, buildable area.



#7 Facing northeast from the top of the large slope across the rest of the subdivision.

FIGURE 4 PHOTOGRAPHS (CONT.)

Locations and direction, see Figure 2, Area Map

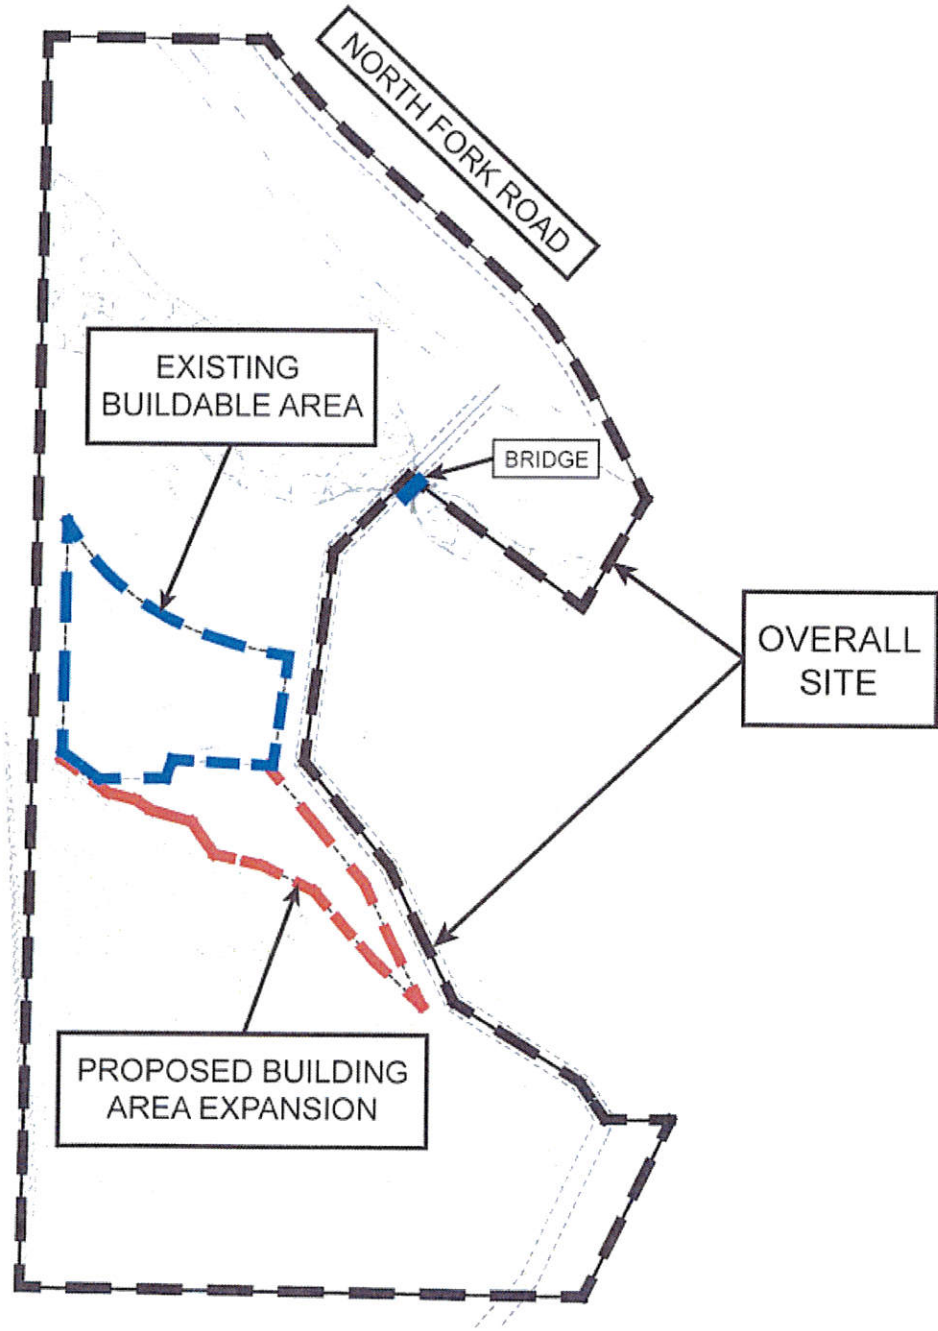

REFERENCE:
ADAPTED FROM DRAWING ENTITLED
"TOPOGRAPHIC SITE PLAN FOR KEVIN PARKINSON"
BY GARDNER ENGINEERING, NOT DATED

NOT TO SCALE



**FIGURE 3
SITE PLAN**