
Terakee Village 2

A part of the Northwest Quarter of Section 21, T6N, R2W, SLB&M, U.S. Survey Weber County, Utah September 2018 Developer:
Terakee Properties LP
Brad Blanch, General Partner
PO Box 14016
Ogden, Utah 84412
(801) 668-8565

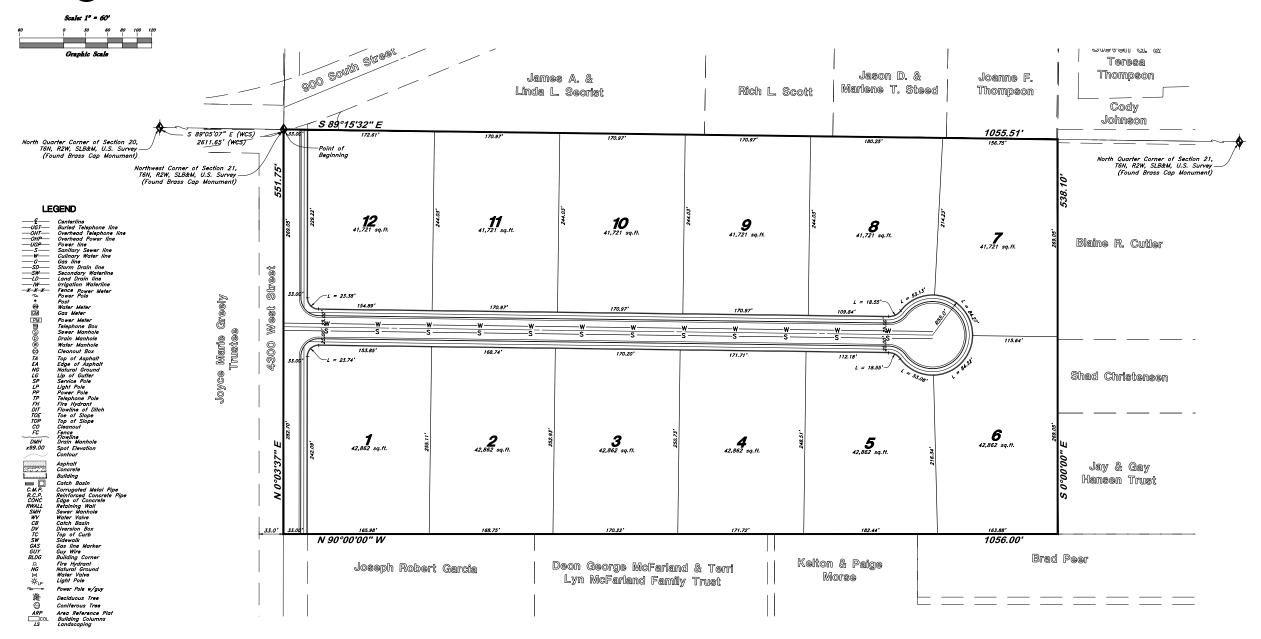

Notes:

- 1. Subdivision will be connected to Central Weber Sanitary Sewer via 900 South design submitted with Terakee Village PRUD.
- 2. 50 foot private right of way to be maintained by Terakee Farms; standard rural street cross-section shown on page two.


Project Engineer: Great Basin Engineering Andy Hubbard 5746 South 1475 East, #200 South Ogden, Utah 84403 (801) 394-4515

DNC Z 0 Z 4 m 4 ORE, Preliminary Plan

24 Sept, 2018

.
W:\16N719 TERAKEE VILLAGE\Dwgs\16N719 - Prelim New-1.dwg, 9/27/2018 1:49:45 PM, JFelt, 1:1


STANDARD RURAL ROADWAY SECTION

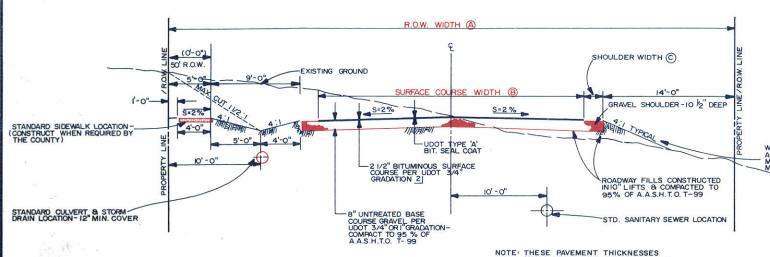

SHALL BE CONSIDERED AS MINIMUMS
AND MAY BE INCREASED BY THE COUNTY
ENGINEER WHEN SUBGRADE C.BR. IS
LESS THAN IO OR WHEN A GREATER
DEPTH IS NECESSARY TO PROVIDE
SUFFICIENT STABILITY. DESIGNER MAY
SUBMIT AN ALTERNATIVE PAVEMENT DESIGN
BASED ON A DETAILED SOILS ANALYSIS FOR
APPROVAL BY THE COUNTY ENGINEER.

STREET DESIGNATION	R.O.W. WIDTH	SURFACE COURSE WIDTH (B)	SHOULDER WIDTH (C)
I MINOR AND/OR PRIVATE ROADWAYS	50'	24'	4'
STANDARD RESIDENTIAL	60'	24'	4'
COLLECTOR	66'	28'	5'
2 MINOR ARTERIAL	80'	44' (30') 3	4'_3
2 MAJOR ARTERIAL	IOO' (CONSULT	COUNTY ENGINEER FOR SPECIFIC	REQUIREMENTS)

- I) MINOR STREET PERMITTED UPON SPECIAL PERMISSION BY THE COUNTY PLANNING COMMISSION. WHERE SIDEWALK IS NECESSARY, MUST HAVE 60' ROW.
- 2 COUNTY ENGINEER SHALL PROVIDE PAVEMENT DESIGN ON ARTERIAL STREETS-WIDTH MAY VARY PER CO. ENGINEER.
- THIS WIDTH MAY BE USED AT THE DIRECTION OF THE COUNTY ENGINEER WHEN FULL WIDTH ASPHALT PAVING IS NOT NECESSARY.

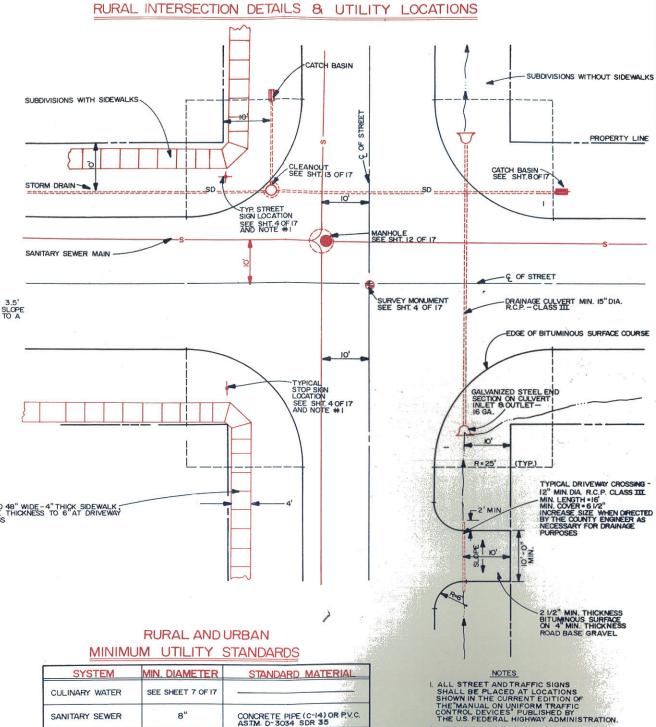

SYSTEM	MIN. DIAMETER	STANDARD MATERIAL	
CULINARY WATER	SEE SHEET 7 OF 17	with the second	
SANITARY SEWER	8"	CONCRETE PIPE (C-I4) OR P.V.C. ASTM. D-3034 SDR 35	
STORM DRAINS	15"	REINFORCED CONC. PIPE 6 CLASS III (AST.M. C-76)	
DRIVEWAY CROSSING	12" <u>5</u>	REINFORCED CONC. PIPE 6 CLASS III (AS.T.M. C-76)	
SECONDARY WATER	4" 4	DUCTILE IRON CL-5I OR ASTM PVC-CLASS 200 PSI	

- 4 REFER TO INDIVIDUAL WATER DISTRICT STANDARDS FOR SPECIFIC MIN. SIZE & MATERIAL STANDARD.
- 5 INCREASE SIZE WHEN DIRECTED BY THE COUNTY ENGINEER AS NECESSARY FOR DRAINAGE PURPOSES

6 CORRUGATED METAL PIPE ACCEPTABLE

_					
		200	CCALE	1 1	SUBMITTED A
			- SCALE	DESIGNED K. John	12+ 1 C-11
					PROJECT ENGINEER
				DRAWN G. BENFORD	RECOMMENDED
	11/1/2	1920		SUFFRIEND & Lett	No the State of th
, D	ATE DV	DECODIDATION		CHECKED VILL	- HOVEL I CONTRACTOR

REV DATE BY

4470 R.C.E. NO. TWA. Vanguage 2186 8/23/80

JAMES M. MONTGOMERY CONSULTING ENGINEERS, INC. 3901 WASHINGTON BLVD. OGDEN, UTAH 84403

PPROVED		W		
	DATE	PUBLIC		
PPROVED		RURAL S		
	DATE			

EBER COUNTY SHEET WORKS STANDARDS STREET STANDARDS F 17 SHEETS

2. SECONDARY WATER MAINS AND LAND DRAINS TO BE LOCATED IN FRONT OR REAR YARD EASEMENTS.

3 SEE SHEET 7 OF 17 FOR CULINARY WATER LOCATION DETAILS.

PROPERTY LINE