

PENDING FILE AREA

N S
 E W
 Morgan LPP

WEBER-MORGAN DISTRICT HEALTH DEPARTMENT
DIVISION OF ENVIRONMENTAL HEALTH
2570 Grant Ave., Ogden, Utah 84401

PERMIT NUMBER 91-54

FEE PAID \$ 30.00

RECORD OF INDIVIDUAL WASTEWATER DISPOSAL SYSTEM

Part I - Application

Date 4-22-90

Construction Address 3788 EAST ABBEYON DR City or Town WOODIC VALLEY

Subdivision ABBAYON PHASE 2 Lot Number 8

Owner or Applicant GARY ALKINGTON Phone 782-2161

Mailing Address 957E 3025 WO Zip Code 84310

Contractors Dean MORRIN Mortgage Sponsor _____

Culinary Water Supply WOODIC VALLEY Number of Bedrooms 3

EXPERIMENTAL SYSTEM AGREEMENT

The Weber-Morgan District Health Department will issue a permit to allow an Experimental Wastewater Disposal System at the construction site listed above, based on the following conditions:

1. System to be installed as per approved plans.
2. Owner(s) are responsible if system should fail.
3. Owner will immediately replace system with an approved wastewater disposal system if failure occurs.
4. Owner must allow semi annual inspections of the system.

I AGREE TO THE ABOVE-LISTED CONDITIONS

Date _____ Owner _____

Part II - Code Requirements

Culinary Water: If Public, Letter Received If Private, Approved by Department

Land Use Permit #: _____ Tax ID #: _____ Plot Plan Provided:

Water Table: 48 Percolation Rate: 48 Septic Tank Capacity: 1000 Gallons

Secondary Treatment: Drainfield Seepage Pit LPP System

Total Absorption Area: 990 Square Feet


Remarks/Restrictions:

- Legal description of property attached (for LPP).
- Maximum depth of bottom of drainfields from original ground surface: 24 Inches.
- Call before rock is added to pit.
- Home not to be occupied until culinary water supply approved (agreement attached).
- Other _____

PART III - INSTALLED SYSTEM

Absorption Area: _____ Square Feet Drainfield Wall Area LPP

Septic Tank Capacity: _____ Gallons Date of Final Approval/Rejection _____

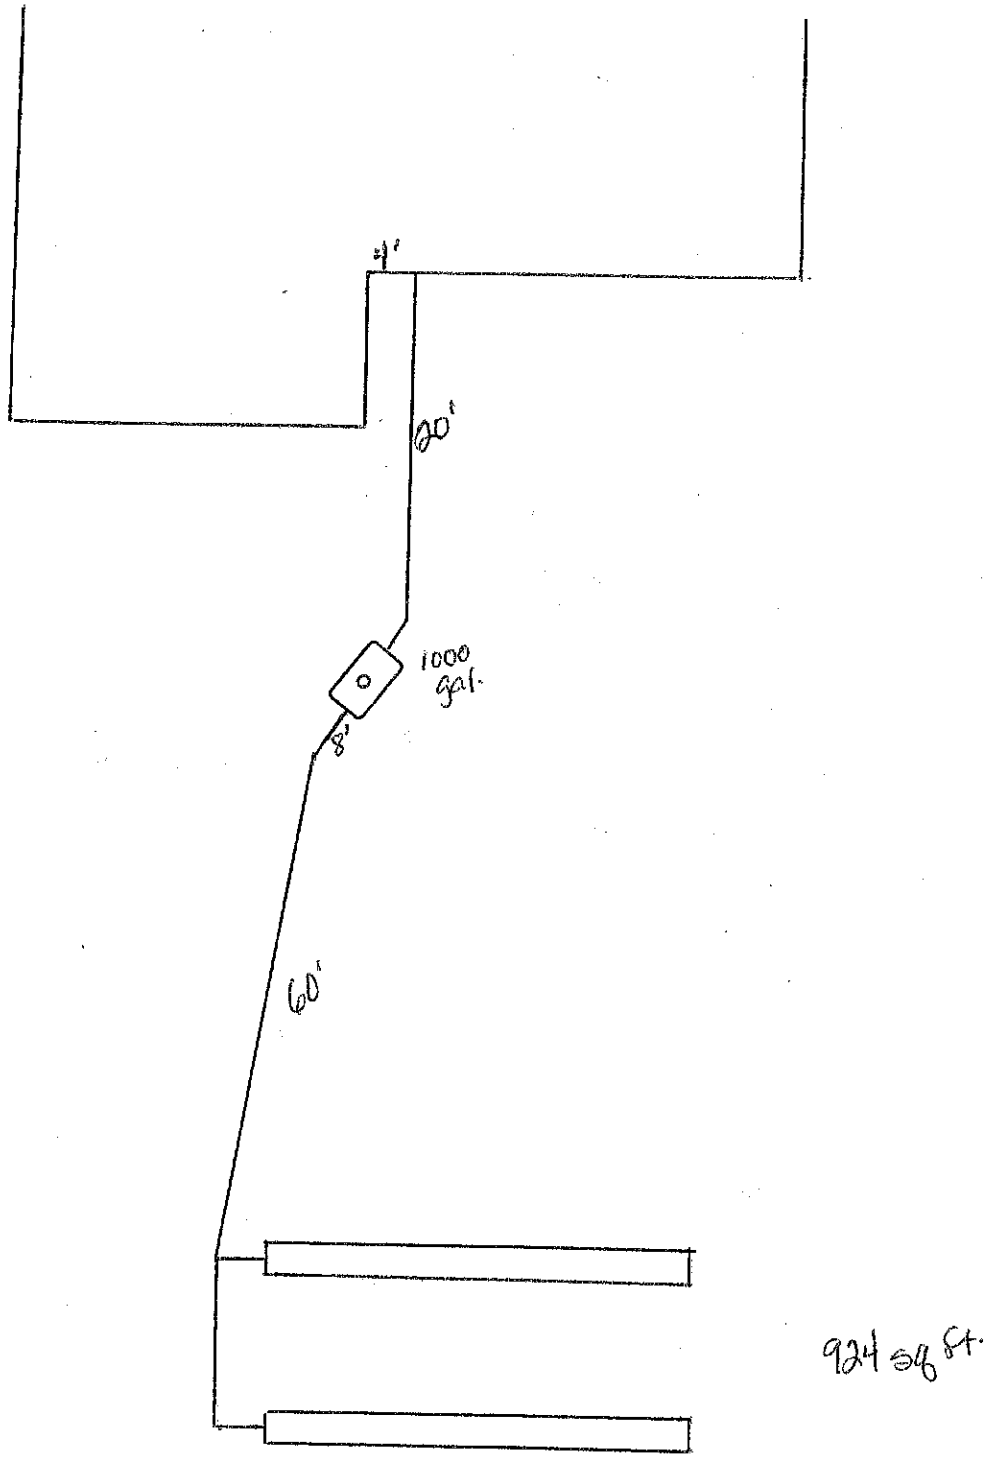

Inspector's Sketch.....

Environmental Health Specialist