



Carl Shupe <cshupe001@gmail.com>

OWS - Green Hills Subdivision Zone Two GWPZ - 437 N Maple St Huntsville - Parcel ID 21-091-0001

Gary Hebert <basinbumb@gmail.com>

Thu, Jan 28, 2021 at 10:38 AM

To: Greenhills Water <greenhillswd@gmail.com>, Leslie Stitt <lesliestitt@yahoo.com>, cshupe001@gmail.com

Cc: Steven Benjamin <utahfixbiz@gmail.com>, Michael & Jean Brill <brilloclan@msn.com>

Carl,

We've discussed briefly and don't see any roadblocks to the request. Of course the county will need to sign off on the design.

Typical pump-up design approved by the county for connection to our system consists of a gravity feed from the residence to a solids tank (1250 gal min) which then gravity feeds to a pump tank.

I'm not a civil engineer but obviously the entry into our system will require some form of air gap (likely insertion to the higher portion of our East side tank)

Next scheduled board meeting is 15 Feb 7PM.

Zoom link:

<https://us02web.zoom.us/j/82295487049?pwd=MXREZEFxZ2tKdnNYSlVKWmIBeUo5QT09>

Thanks,

Gary

801.814.8928

basinbumb@gmail.com

On Wed, Jan 27, 2021 at 10:13 AM Greenhills Water <greenhillswd@gmail.com> wrote:

----- Forwarded message -----

From: **Carl Shupe** <cshupe001@gmail.com>

Date: Mon, Jan 25, 2021 at 1:10 PM

Subject: Fwd: OWS - Green Hills Subdivision Zone Two GWPZ - 437 N Maple St Huntsville - Parcel ID 21-091-0001



To: Greenhills Water <greenhillswd@gmail.com>

Cc: Julie Panushka <jpanslc@gmail.com>

Gary,

I've been contacted by Julie Panushka, owner of 437 N Maple St. This parcel may have been broken off during the early subdivision approval process of Green Hills. Julie believes she has rights to a culinary water connection that will be provided by the Greenhills Water & Sewer District.

The Weber Morgan Health Department has required Ms. Panushka to obtain a variance for septic or sewer prior to the development of this lot. The property is entirely impinged by a Greenhills District drinking water well GPZ Two. I proposed potentially that they tie into the Green Hills Sewer District. They would need to install an individual Prelos Processor unit, see attached, and a pressure line up to the Bus Stop Septic tank. Is this something the District would consider? What would she need to do to get on the agenda for a board meeting to discuss this proposal?

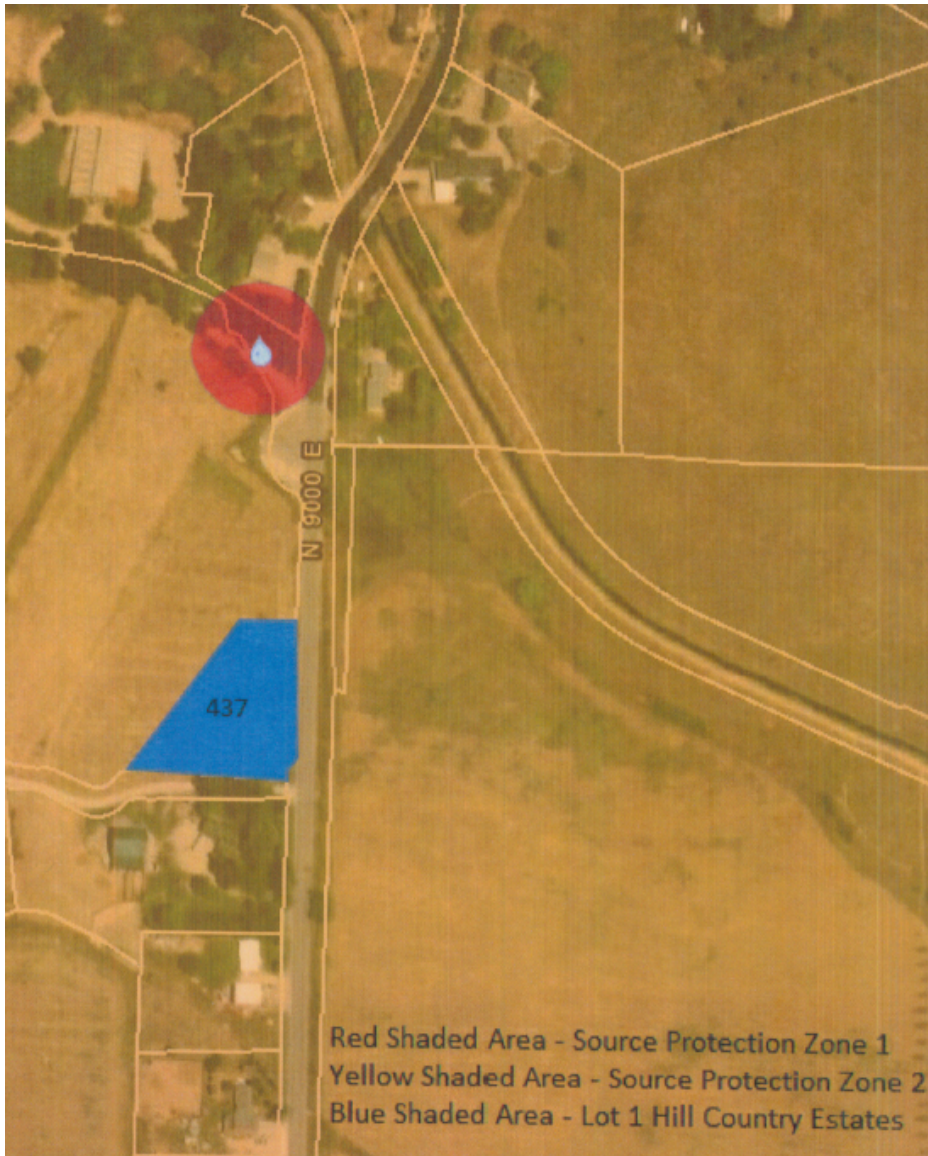

Carl R. Shupe

DOPL Licensed Environmental Health Scientist 5630685-2001
DWQ Certified Onsite Wastewater Level 3 00464-OSP-3

Mailing Address
P. O. Box 199
Huntsville, Utah 84317

Electronic Contact Information
cshupe001@gmail.com
801-814-3036