


Plot Date: 1/4/2022 1:42 PM Plotted By: Erick Christensen
Date Created: 1/4/2022 JUB: C:\CENTRAL\CLIENTS\BONA VISTA\PROJECT SIB: 20-139 BONA VISTA HOT SPRINGS ANKASTING DESIGN CAD\SHEET S-101X.DWG

TANK FOUNDATION PLAN
SCALE: 1/8" = 1'-0"

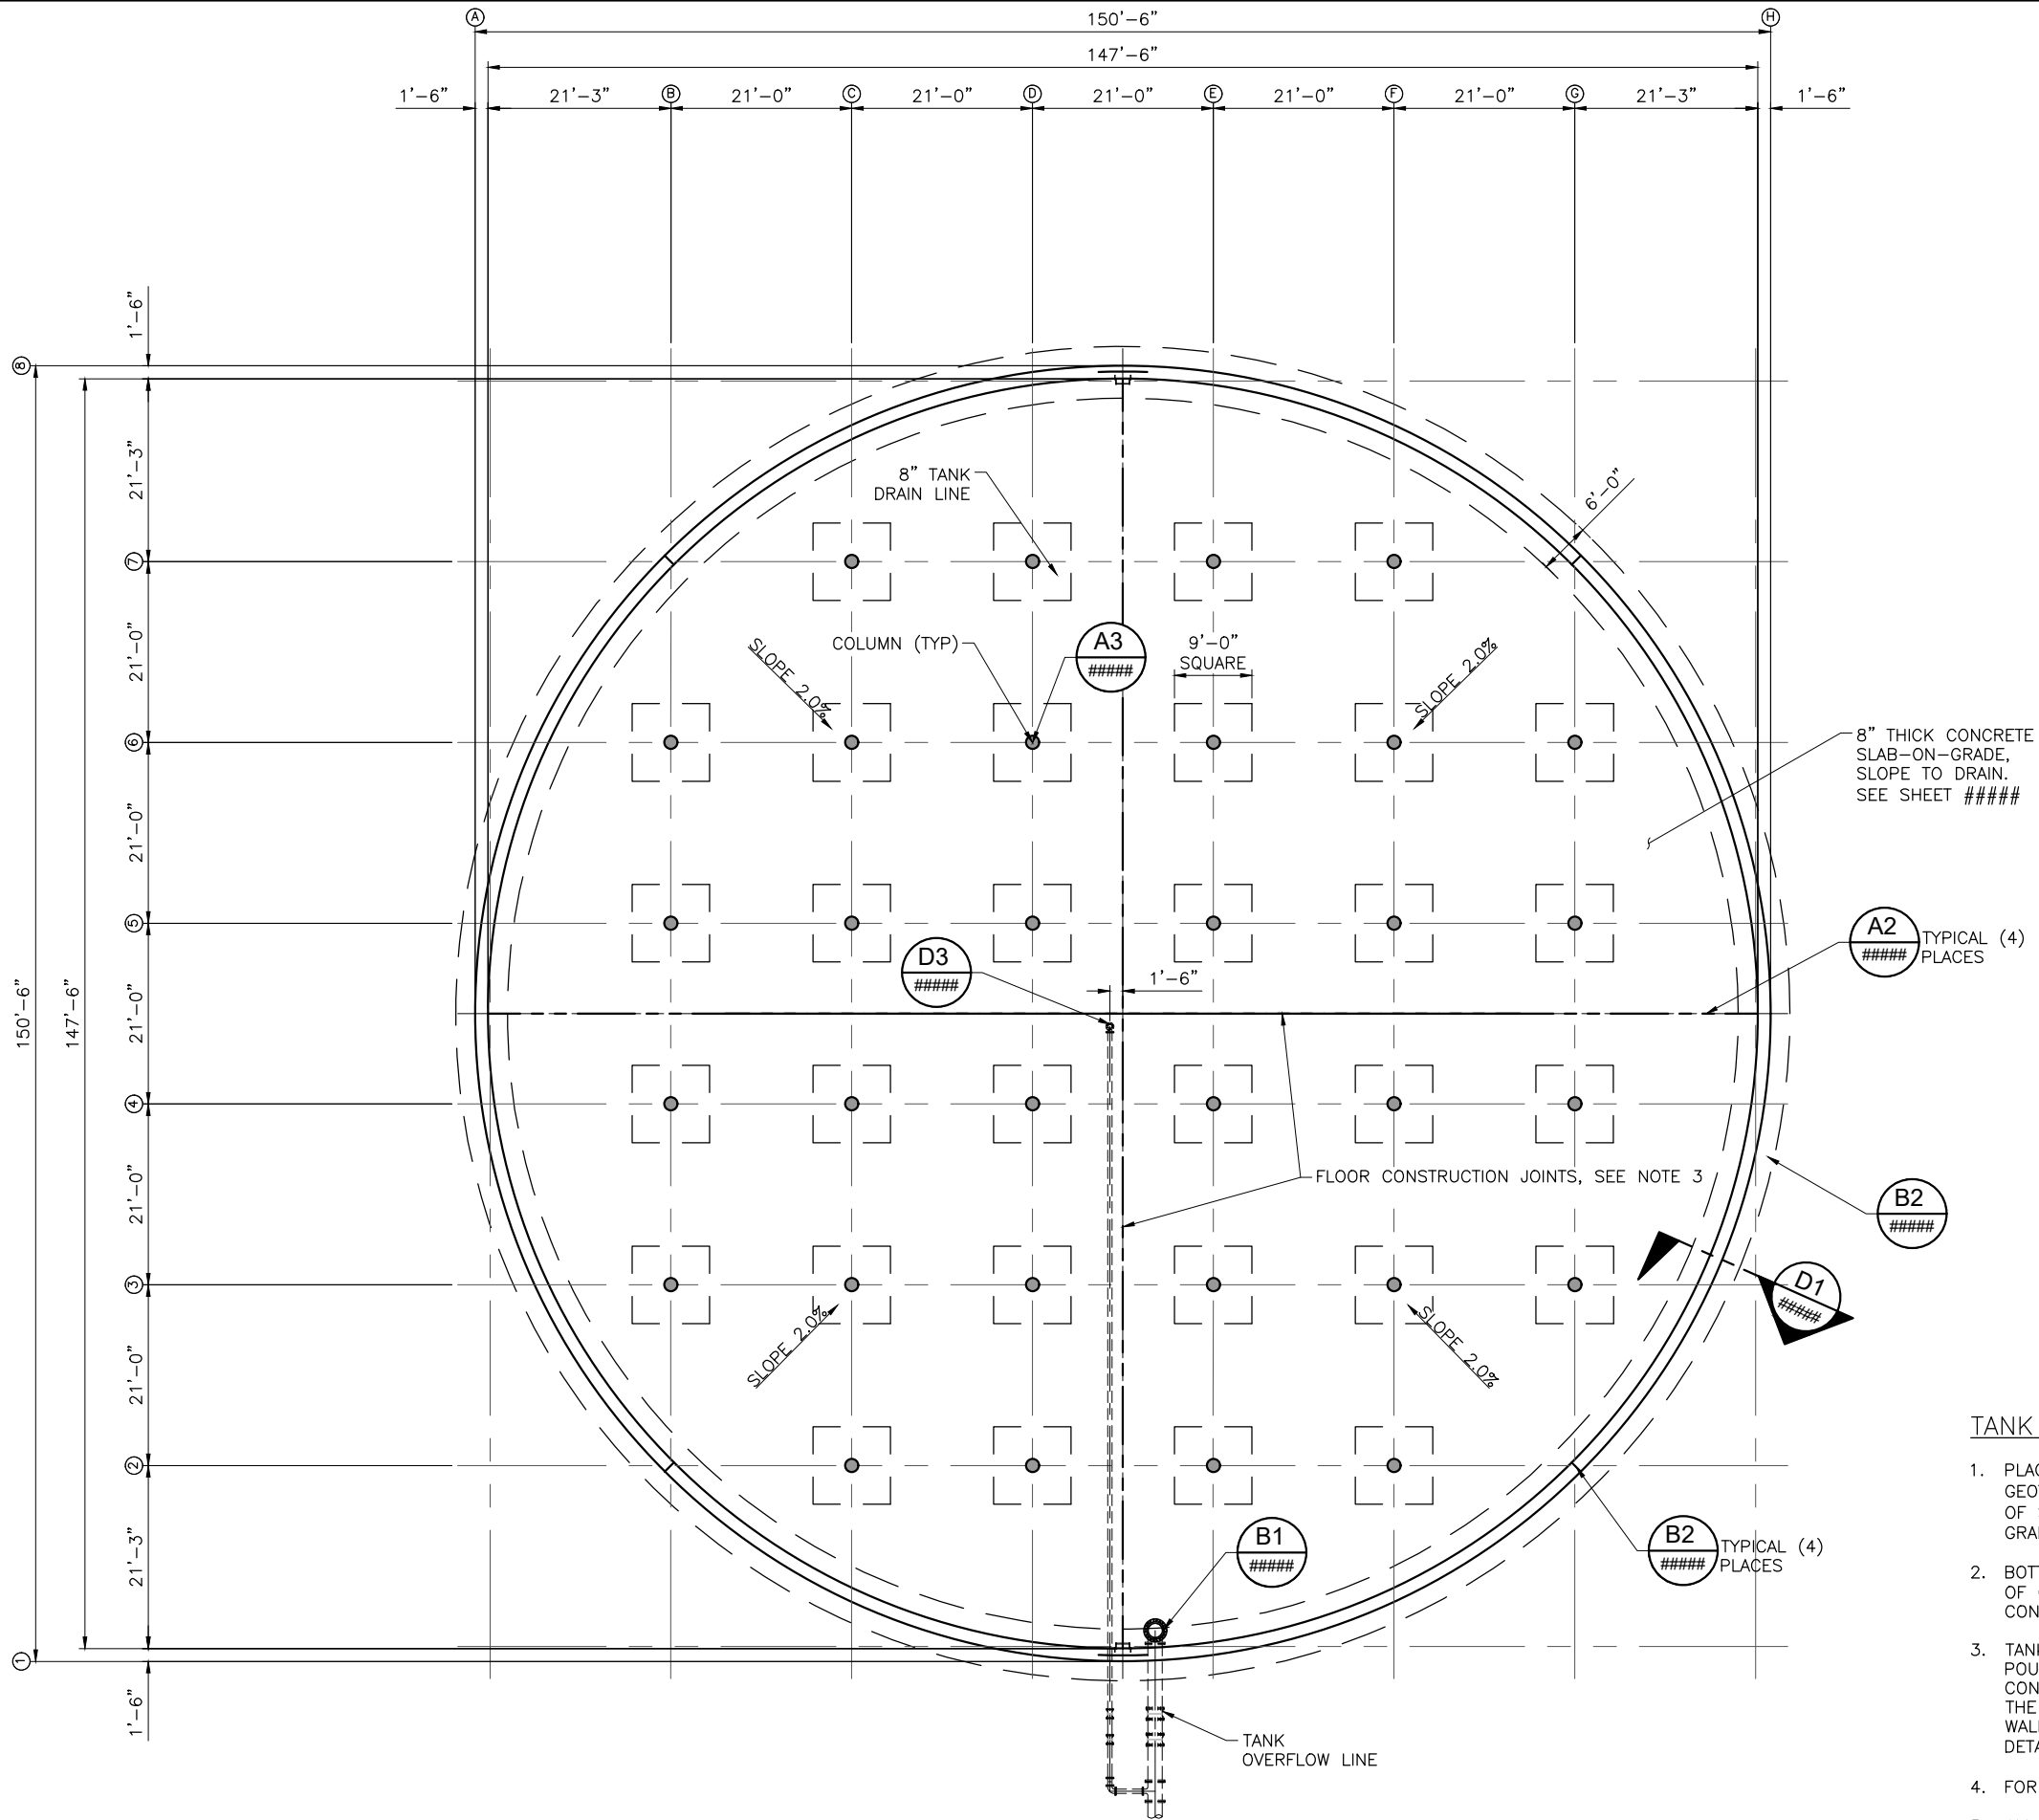

TANK FLOOR AND FOOTING NOTES:

1. PLACE 6" MIN. OF FREE DRAINING GRANULAR MATERIAL AND GEOTEXTILE FABRIC BENEATH ENTIRE FOUNDATION OVER 24" OF STRUCTURAL FILL. SEE SHEETS ##### AND #####. GRADATION PER SPECIFICATIONS.
2. BOTTOM BARS SHALL BE 3" MINIMUM CLEAR FROM BOTTOM OF CONCRETE. CENTER SLAB ON GRADE REINFORCING IN CONCRETE SLAB ON GRADE.
3. TANK FLOOR IS TO BE PLACED IN A MINIMUM OF FOUR POURS. IF CONSTRUCTION JOINT LOCATIONS ARE MODIFIED CONSTRUCTION JOINT LOCATIONS SHALL BE APPROVED BY THE ENGINEER PRIOR TO CONSTRUCTION. SEE THE TANK WALL FOOTING AND FLOOR SLAB CONSTRUCTION JOINT DETAIL. (A2/#####)
4. FOR PIPING SEE SHEETS M-101, #####, AND #####.
5. ALL SURFACES, PIPING, MISCELLANEOUS METAL FABRICATIONS, AND RELATED COMPONENTS WITHIN THE TANK INTERIOR, OR IN CONTACT WITH WATER, SHALL BE NSF 61 APPROVED.



J-U-B ENGINEERS, INC.

J-U-B ENGINEERS, INC.
466 North 900 West
Kaysville, Utah 84037
Phone: 801.547.0393
Fax: 801.547.0397
www.jub.com

PRELIMINARY PLANS	NOT FOR CONSTRUCTION	REUSE OF DRAWINGS JUB SHALL RETAIN ALL COMMON LAW, STATUTORY, COPYRIGHT AND PATENT RIGHTS IN THIS DRAWING. NO PART OF THIS DRAWING SHALL BE REUSED WITHOUT JUB'S PRIOR WRITTEN CONSENT. ANY REUSE WITHOUT WRITTEN CONSENT BY JUB WILL BE AT CLIENT'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO JUB.	REVISION	
			NO.	DATE
HOT SPRINGS TANK BONA VISTA WATER IMPROVEMENT DISTRICT		DESCRIPTION		
		BY		
		APR		
		DATE		
		NO.		
TANK FOUNDATION PLAN		SHEET NUMBER: S-101		