

EQUIPMENT GROUNDING CONDUCTORS

0011000	10110
FUSE OR CB	SIZE
SIZE	(COPPER)
SIZE 15	(COPPER) 14 12 10
20 30 40	12
30	10
40	10
60	10 8 6 4 3
100	8
200 300 400 500	6
300	4
400	3
500	2
600	1 1
800	1/0
1000	1/0 2/0
1200	3/0 4/0 250 350
1600	4/0
2000	250
2500	350

GROUNDING ELECTRODE CONDUCTOR SERVICE ENTRANCE OR SEPARATELY DERIVED SYSTEM

WIRE
SIZE
#8
#6
#4
#2
1/0

#### **GENERAL NOTES:**

- 1. VERIFY ALL EQUIPMENT DIMENSIONS AND LOCATIONS BEFORE BEGINNING ROUGH—IN. CONSULT ALL APPLICABLE CONTRACT DRAWINGS AND SHOP DRAWINGS TO ENSURE NEC CODE CLEARANCE REQUIRED AROUND ALL ELECTRICAL EQUIPMENT.
- 2. CONTRACTOR SHALL VERIFY ALL ELECTRICAL LOADS (VOLTAGE, PHASE, CONNECTION REQUIREMENTS, ETC.) OF EQUIPMENT FURNISHED BEFORE BEGINNING ROUGH—IN.
- 3. SEE APPLICABLE SHOP DRAWINGS FOR ROUGH—IN LOCATION OF ALL EQUIPMENT, WIRING DEVICES, ETC.
- 4. THE ELECTRICAL CONTRACTOR SHALL NOTIFY AND COOPERATE WITH THE MECHANICAL CONTRACTOR SUCH THAT NO PIPING, OR EQUIPMENT FOREIGN TO THE OPERATION OF THE ELECTRICAL EQUIPMENT SHALL BE PERMITTED TO BE INSTALLED IN, ENTER OR PASS THROUGH ELECTRICAL ROOMS OR SPACES; OR ABOVE OR BELOW ELECTRICAL EQUIPMENT IN THE OTHER AREAS.
- 5. ALL PENETRATIONS OF FLOORS, WALLS AND CEILINGS SHALL BE SEALED WITH APPROVED MATERIAL.
- 6. FOR PACKAGE EQUIPMENT PROVIDED ON THE PROJECT, SOME CONDUITS AND WIRES ARE SHOWN ON THE DRAWINGS, BUT IT IS EXPECTED THAT SOME ADDITIONAL CONDUITS AND WIRES MAY BE REQUIRED BY EQUIPMENT MANUFACTURERS TO COMPLETE INSTALLATION. IT IS INCUMBENT UPON THE GENERAL CONTRACTOR TO COORDINATE THIS REQUIREMENT WITH HIS SUBCONTRACTORS TO MAKE SURE THAT EQUIPMENT SUPPLIER PROVIDED ALL NECESSARY ELECTRICAL INFORMATION TO ELECTRICAL SUBCONTRACTOR FOR INCLUSION WHETHER SHOWN OR NOT SHOWN ON THE DRAWINGS.
- 7. IF OTHER THAN FIRST NAMED EQUIPMENT IS USED, IT SHALL BE CAREFULLY CHECKED FOR ELECTRICAL REQUIREMENTS AND CONTROL REQUIREMENTS OF ALTERNATE EQUIPMENT. SHOULD CHANGES OR ADDITIONS OCCUR IN ELECTRICAL WORK, OR THE WORK OF OTHER CONTRACTORS BE REVISED BY THE ALTERNATE EQUIPMENT, THE COST OF ALL CHANGES SHALL BE BORNE BY THE CONTRACTOR.
- 8. IT IS THE ELECTRICAL SUBCONTRACTOR'S RESPONSIBILITY TO DELIVER THE COMPLETE SET OF PLANS IN ORDER TO INSURE THAT ALL ITEMS RELATED TO ELECTRICAL POWER AND CONTROL SYSTEMS ARE COMPLETELY ACCOUNTED FOR.
- 9. ALL EQUIPMENT DIMENSIONS SHOWN ON PLANS AND ELEVATIONS ARE APPROXIMATE ONLY. THE CONTRACTOR SHALL USE THE SHOP DRAWINGS FOR PROPER LAYOUT, FOUNDATION AND PAD, ETC. FOR FINAL INSTALLATION WITHOUT ANY ADDITIONAL COST TO THE OWNER.
- 10. THE DRAWINGS DIAGRAMMATICALLY INDICATE THE DESIRED LOCATION AND ARRANGEMENT OF OUTLETS, CONDUIT RUNS, EQUIPMENT AND OTHERS ITEMS. DETERMINE EXACT LOCATIONS IN THE FIELD BASED ON PHYSICAL SIZE AND ARRANGEMENT OF EQUIPMENT, FINISHED ELEVATIONS, AND OTHERS OBSTRUCTIONS. LOCATIONS SHOWN ON THE DRAWINGS, HOWEVER, SHALL BE ADHERED TO AS CLOSELY AS POSSIBLE.



AL SYMBOLS
NOTES


PROJECT 347-13-01.01 PROMER 347-13-01.01 PROMER DESIGN

APPROJECT AP

ELECTRICAL SYMBC AND NOTES

DRAWING NO. E-1SHEET 1 OF 5

P:\Weber County\Powder Mountain\Summit Sewage Lift Stations\2.0 - Design Phase\2.7 Drawings\Sht\Ridge Nests\3471301RN\_E-01.dwg Nov27,2013 - 10:25am

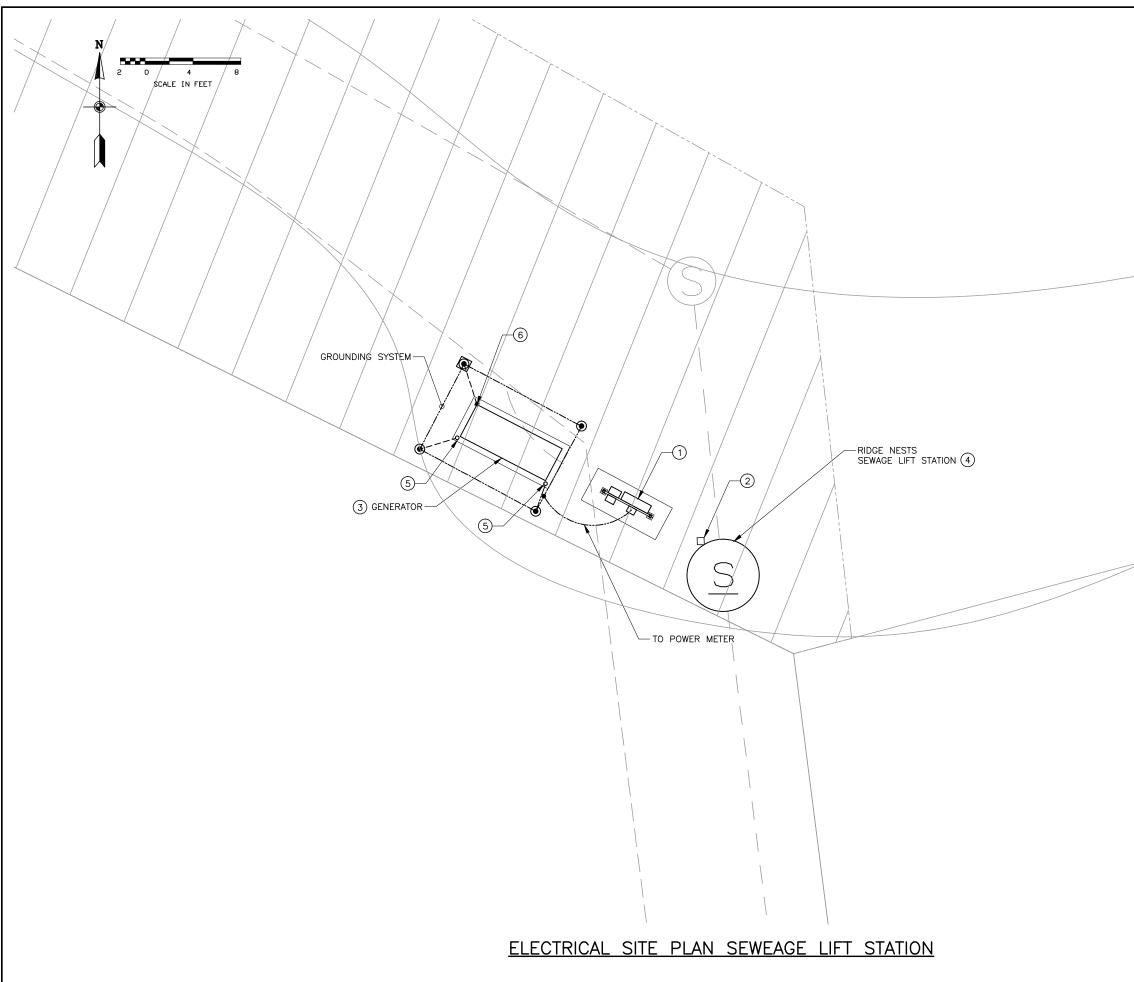

#### **GENERAL NOTES:**

- 1. THE GROUNDING SYSTEM SHALL HAVE A GROUND RING OF 2/0 AWG BARE COPPER BURIED NOT LESS THAN 30" BELOW THE EARTH'S SURFACE. CONNECT REBAR TO THE GROUND RING VIA 2/0 AWG BARE COPPER GROUND CABLE (GROUND RISERS). EQUIPMENT AND MISCELLANEOUS METALWORK SHALL BE CONNECTED TO THE GROUND RING WITH 2/0 AWG BARE COPPER GROUND CABLE. 2/0 AWG CONDUCTOR FROM GROUND RING SHALL CONNECT TO GENERATOR, METER BASE, AND AUTOMATIC TRANSFER SWITCH. THE GROUND RING SHALL BE A MINIMUM OF 2 FEET FROM GENERATOR FOUNDATION WHERE POSSIBLE. REFER TO DETAILS E-5001, E-5002, E-5003.
- 2. DRAWING SHOWS TYPICAL LOCATIONS OF GROUNDING SYSTEM COMPONENTS.
- 3. DRAWING SHOWS APPROXIMATE LOCATIONS AND MINIMUM NUMBER OF RISERS AND GROUNDING CONNECTIONS TO BE INSTALLED.
- 4. REFER TO POWER ONE-LINE DIAGRAM FOR GENERATOR SIZE AND CONDUIT AND CONDUCTOR SIZES.
- 5. REFER TO POWER ONE—LINE DIAGRAM FOR PUMP SIZES AND QUANTITY. FOR CONDUIT AND CONDUCTOR SIZES REFER TO POWER ONE—LINE DIAGRAM AND CONTROL BLOCK DIAGRAM.

## **KEY NOTES:**

- 1) SEWAGE LIFT STATION CONTROL PANEL, AUTOMATIC TRANSFER SWITCH, POWER METER, AND POWER PANEL. REFER TO POWER ONE-LINE DIAGRAM AND CONTROL BLOCK DIAGRAM FOR SIZES AND MORE INFORMATION. REFER TO DETAIL E-5073 FOR MOUNTING INFORMATION.
- 2 JUNCTION BOX TO CONNECT PUMP CABLES AND LEVEL SWITCHES REFER TO DETAIL E-5201
- (3) STANDBY GENERATOR WITH CONCRETE PAD AND GROUND SYSTEM. THE GENERATOR PAD SHALL BE SIZED BY CONTRACTOR FOR GENERATOR REFER TO DETAIL E-5081, APPROXIMATE SIZE IS 9 FEET LONG
- 4 REFER TO CIVIL DRAWINGS FOR LOCATION AND MECHANICAL DRAWINGS FOR SECTION VIEW OF LIFT
- (5) CONNECT TO REBAR.
- (6) CONNECT TO GENERATOR.

Bowen Collins & Associates, Inc.

			_	٧.		
MO(CC)	~	MAX NAX	SIEWARI	1/3/1/3/1/3/1/3/1/3/1/3/1/3/1/3/1/3/1/3	STATE OF USAN	1
				ر	RIPTION	

	7	_	_	_	
				DESCRIPTION	REVISIONS
				NO. DATE REV. BY	
				DATE	
				NO.	
		SCALE	N	RAWING	

NESTS STEWART

CHECKED D. RIDGE


DESIGN D.

DRAWN D.

ELECTRICAL SITE PLAN SEWAGE LIFT STATION RIDGE NESTS 日 S

DRAWING NO.

SHEET 2 OF 5

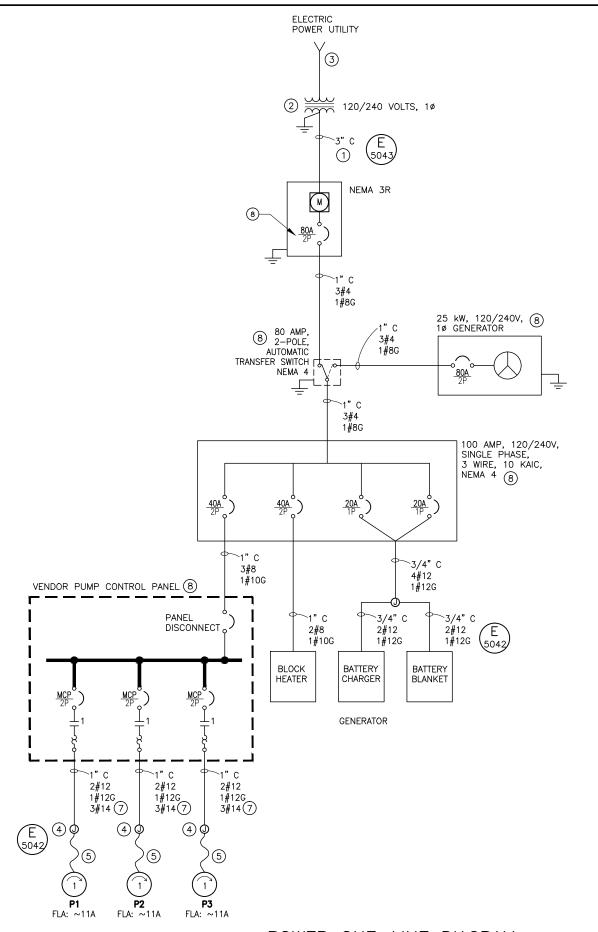


# POWER ONE-LINE DIAGRAM

## **GENERAL NOTES:**

1. REFER TO SITE PLAN FOR EQUIPMENT LOCATION.

### **KEY NOTES:**

- 1) CONTRACTOR SHALL PROVIDE AND INSTALL CONDUIT IN ACCORDANCE WITH ROCKY MOUNTAIN POWER REQUIREMENTS. CONDUCTORS SHALL BE INSTALLED BY ROCKY MOUNTAIN POWER.
- 2) PROVIDED AND INSTALLED BY ROCKY MOUNTAIN POWER.
- (3) PROVIDED AND INSTALLED BY DEVELOPER.
- 4 HAZARDOUS LOCATION JUNCTION BOX AND CONDUIT SEAL REFER TO DETAIL E-5201.
- (5) MANUFACTURER'S CABLE.
- PROVIDE AND INSTALL AN INTRINSICALLY SAFE BARRIER FOR EACH LEVEL SWITCH. THE LEVEL SWITCHES SHALL BE MADE FOR LOW ENERGY CIRCUITS TO BE USED IN A HAZARDOUS LOCATION, ANCHOR SCIENTIFIC TYPE GSI GOLD OR EQUAL.
- 7) 3#14 CONDUCTORS ARE FOR MOTOR ALARM SIGNALS.
- VANDAL PROOF PADLOCKABLE ENCLOSURE.

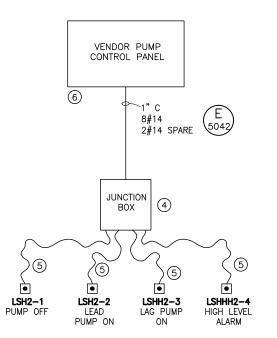

CONTROL BLOCK DIAGRAM

Collins lates, Inc. Bowen (
& Associa


MMIT AT POWDER MOUNTA


# DIAGRAM LIFT STATION POWER -LINE DIAGRAM


**EWER** ONE

 $\overline{S}$ DRAWING NO.

SHEET 3 OF 5

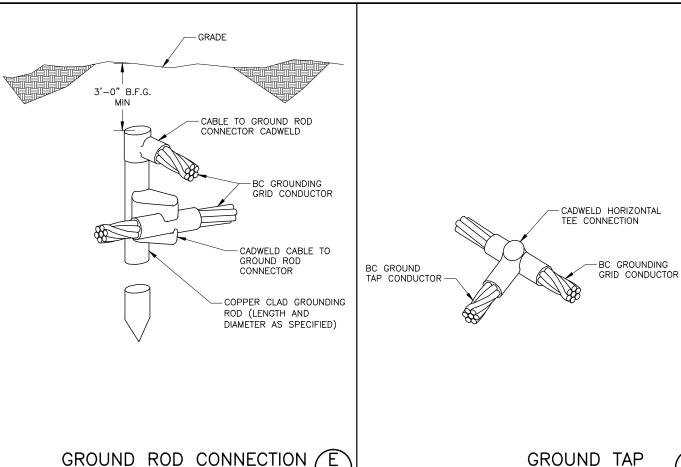

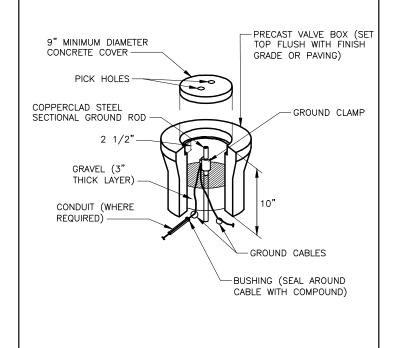

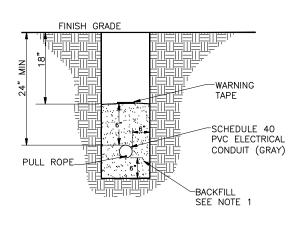

#### NOTES:

E 5003

- 1. BACKFILL MATERIAL SHALL BE TYPE A,B, OR C COMPACTED TO 95% PER ASTM D 1557.
- 2. BACKFILL SHALL PASS THROUGH A 3/4" SIEVE.

CONDUIT TRENCH DETAIL SCALE: NTS



Bowen Collins & Associates, Inc.


, o

WDER MOUNTAIL
NESTS

RIDGE

GROUND ROD CONNECTION E 5001


)

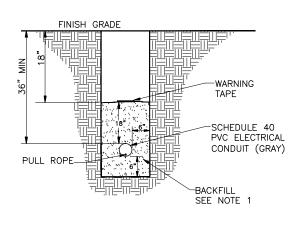

#### NOTES:

- 1. BACKFILL MATERIAL SHALL BE TYPE A,B, OR C COMPACTED TO 95% PER ASTM D 1557.
- 2. BACKFILL SHALL PASS THROUGH A 3/4" SIEVE.

ROCKY MOUNTAIN POWER
CONDUIT TRENCH DETAIL
SCALE: NTS

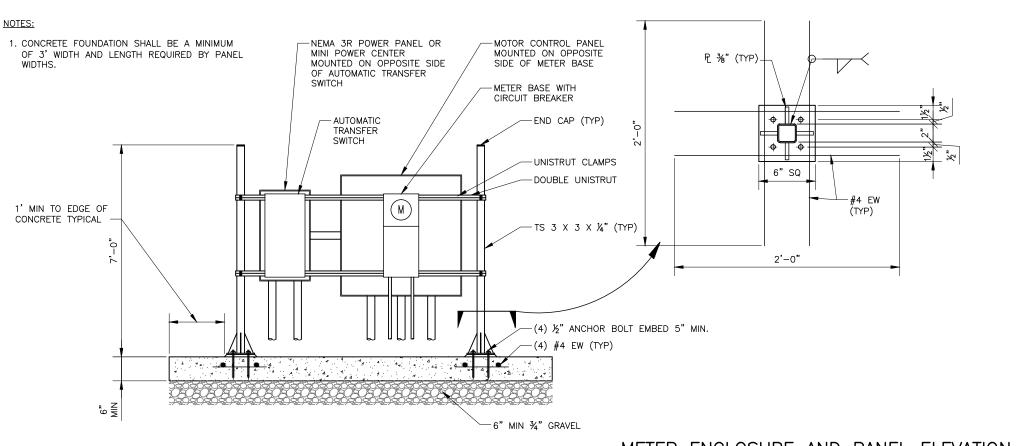

GROUND ROD AND WELL

E 5002

METER ENCLOSURE AND PANEL ELEVATION SCALE: NTS

DRAWING NO.


GE-1

SHEET 4 OF 5

DETAIL

ELECTRICAL

P:\Weber County\Powder Mountain\Summit Sewage Lift Stations\2.0 - Design Phase\2.7 Drawings\Sht\Ridge Nests\3471301RN\_GE-01.dwg Nov27,2013 - 10:24am

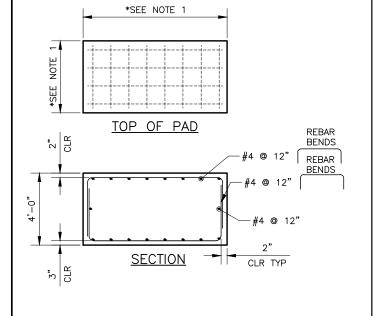


#### NOTES:

1. THE LENGTH AND WIDTH OF THE GENERATOR PAD WILL BE SIZED AS NEEDED TO ACCOMMODATE THE GENERATOR WITH AN ADDITIONAL EIGHT INCHES OF SPACE ON ALL SIDES. ANCHOR GENERATOR TO CONCRETE PAD WITH FOUR 5/8" EPOXY ANCHORS, MINIMUM 4" EMBEDDED INTO CONCRETE



## **KEY NOTES:**

- 1 DETAIL SHOWS INFORMATION FOR CABLE, SOME OF THE EQUIPMENT MAY HAVE CONDUIT CONNECTING TO THE JUNCTION BOX. THE CONDUITS WILL CONNECT DIRECTLY TO THE CROUSE—HINDS GUE OR GUB BOX.
- (2) CROUSE—HINDS CGBS OR EBY CLASS 1 DIVISION 1 GROUP D CABLE CONNECTOR.
- $\begin{tabular}{lll} \hline \end{tabular}$  CROUSE-HINDS GUE OR GUB CLASS 1 DIVISION 1 GROUP D JUNCTION BOX.
- (4) CROUSE-HINDS EZS CONDUIT SEALING FITTING.

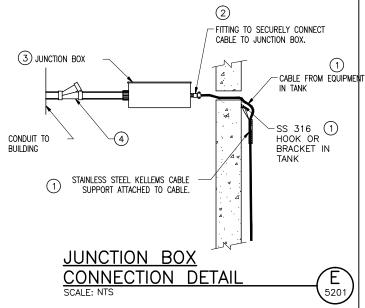

		(	■ Bowen Collins	#	CONSULTING ENGINEERS			
	Morca do	DOUGLAS	XWW.	SIEWARI A			N S JAKE OF COL	11-27-2013
						NOIEdiaDSau		REVISIONS
						NO DATE BEV BY	NO.	
			VERIFY SCALE	VERIFY SCALE BAR IS ONE INCH ON ORIGINAL DRAWING				
SUMMIT AT POWDER MOUNTAIN RIDGE NESTS POWDER MOINTAIN LE	RIDGE NESTS POWDER MOUNTAIN, UT	REVIEW		CHECKED D. SIEWARI		APPROVED J. BECKMAN		
		DESIGN		DESIGN I. BIRD		NUMBER 34/-13-01.01 DRAWN D. LAMPH		
				1				-13-01.01
ELECTRICAL IL DETAILS					PRO IFCT - 1-2	NUMBER 34,		
ELECTRICA					DAIE: NOVEMBER 2013			
SH	HEE		E 5	_	2 0F	). 	5	

ngs\Sht\Ridge Nests\3471301RN\_GE=02.dwg Nov27,2013 =