

**Project Narrative/Notes/Revisions**


- 1) 11/8/13 RH - COMPLETED DESIGN FOR CLIENT & CITY REVIEW.
- 2) 1/14/14 ST - PROVIDED RETENTION PONDS/CURB & GUTTER.
- 3) 3/10/14 ST - UPDATED PER COUNTY COMMENTS
- 4) 5/2/14 ST - UPDATED PER COUNTY COMMENTS
- 5) 9/4/14 ST - UPDATED PER COUNTY COMMENTS
- 6) 10/9/14 ST - UPDATED PER COUNTY COMMENTS
- 7) 11/03/14 RH - REVISED SEWER OUTLET.
- 8) 11/25/14 ST - REVISED PER HOOPER IRRIGATION COMPANY COMMENTS
- 9) 2/18/15 ST - UPDATED PER COUNTY COMMENTS
- 10) 3/10/15 ST - UPDATED PER COUNTY COMMENTS
- 11) 5/19/15 ST - UPDATED SW AND DETENTION BASIN
- 12) 3/31/16 TP - UPDATED SW AND DETENTION BASIN

# MALLARD SPRINGS SUBDIVISION Improvement Plans



WEBER COUNTY, UTAH  
SEPTEMBER 2014



Vicinity Map  
NOT TO SCALE

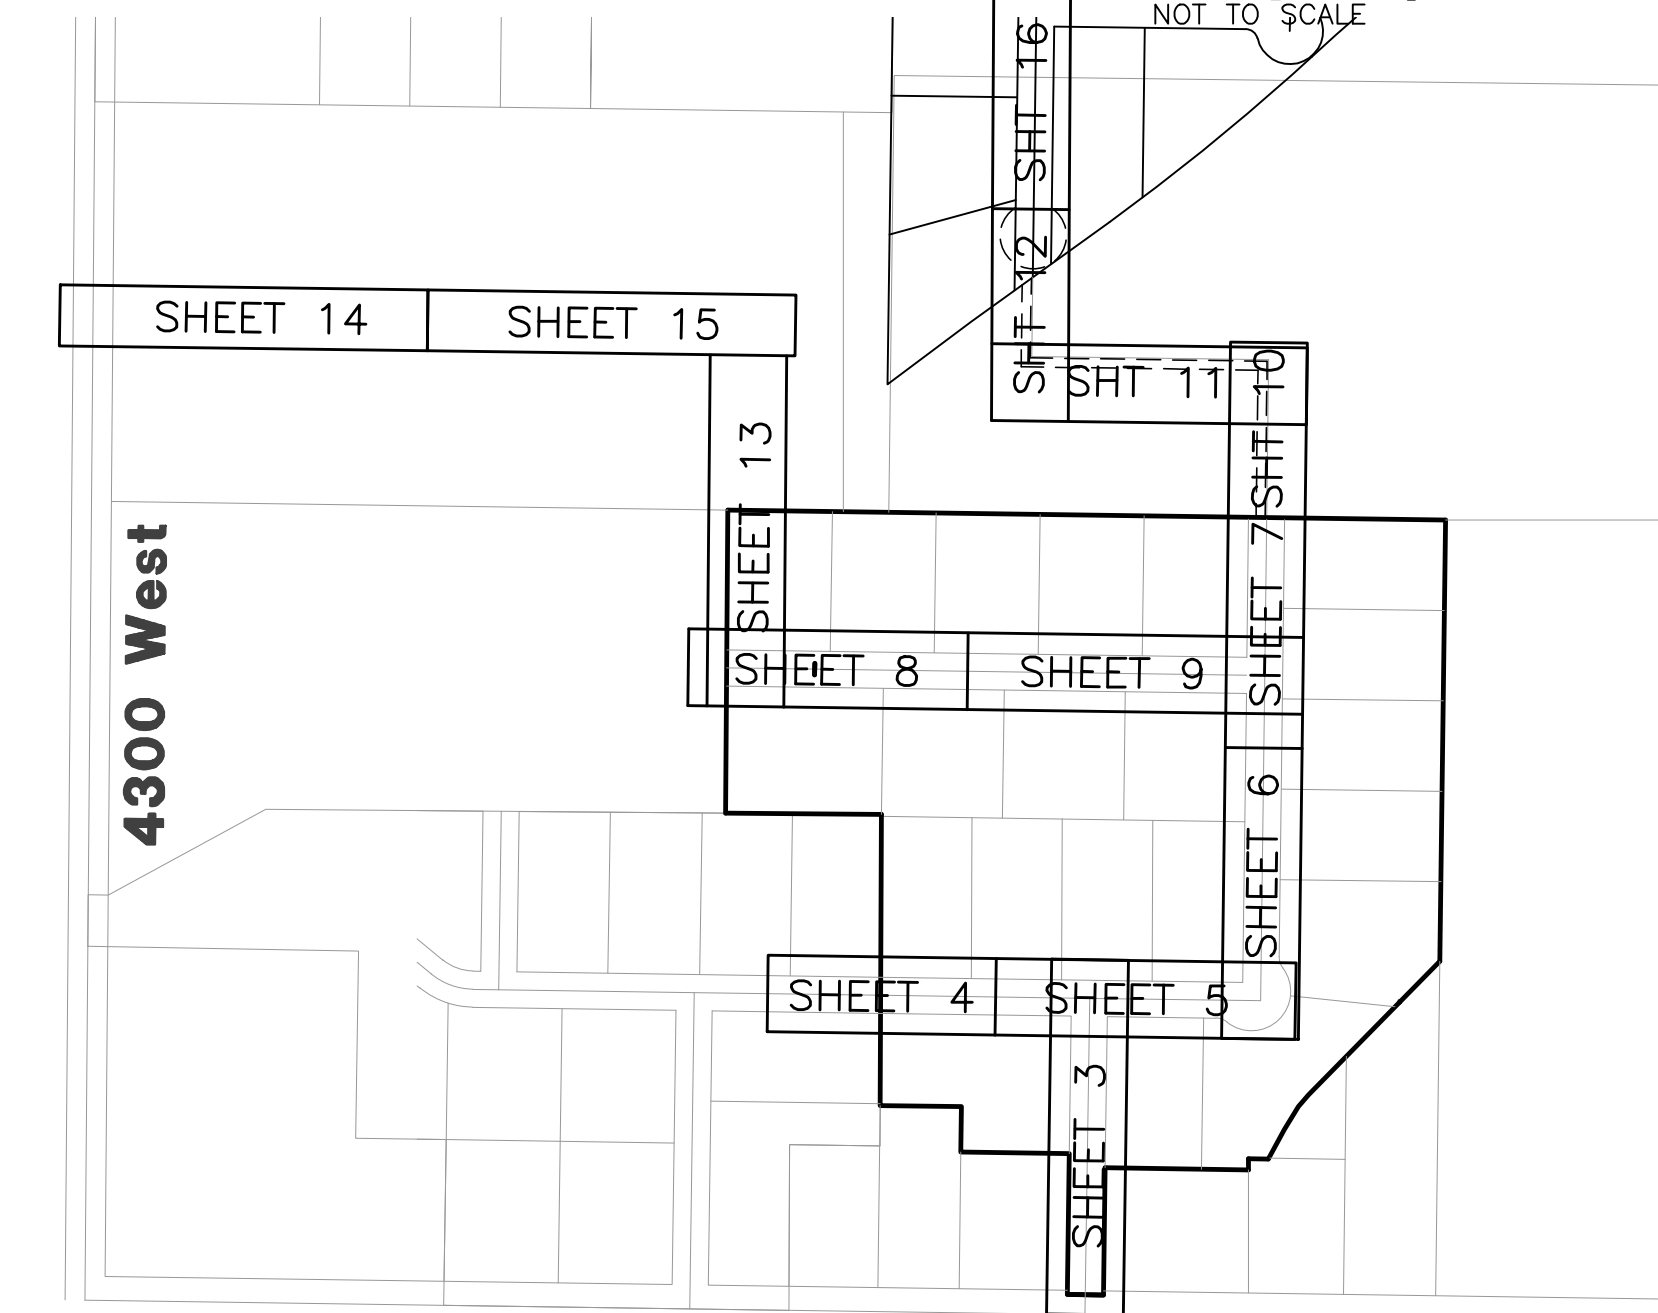

Sheet Index Key Map  
NOT TO SCALE

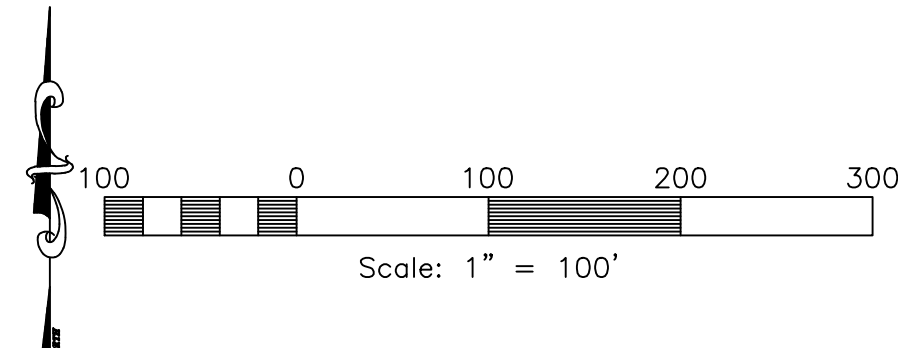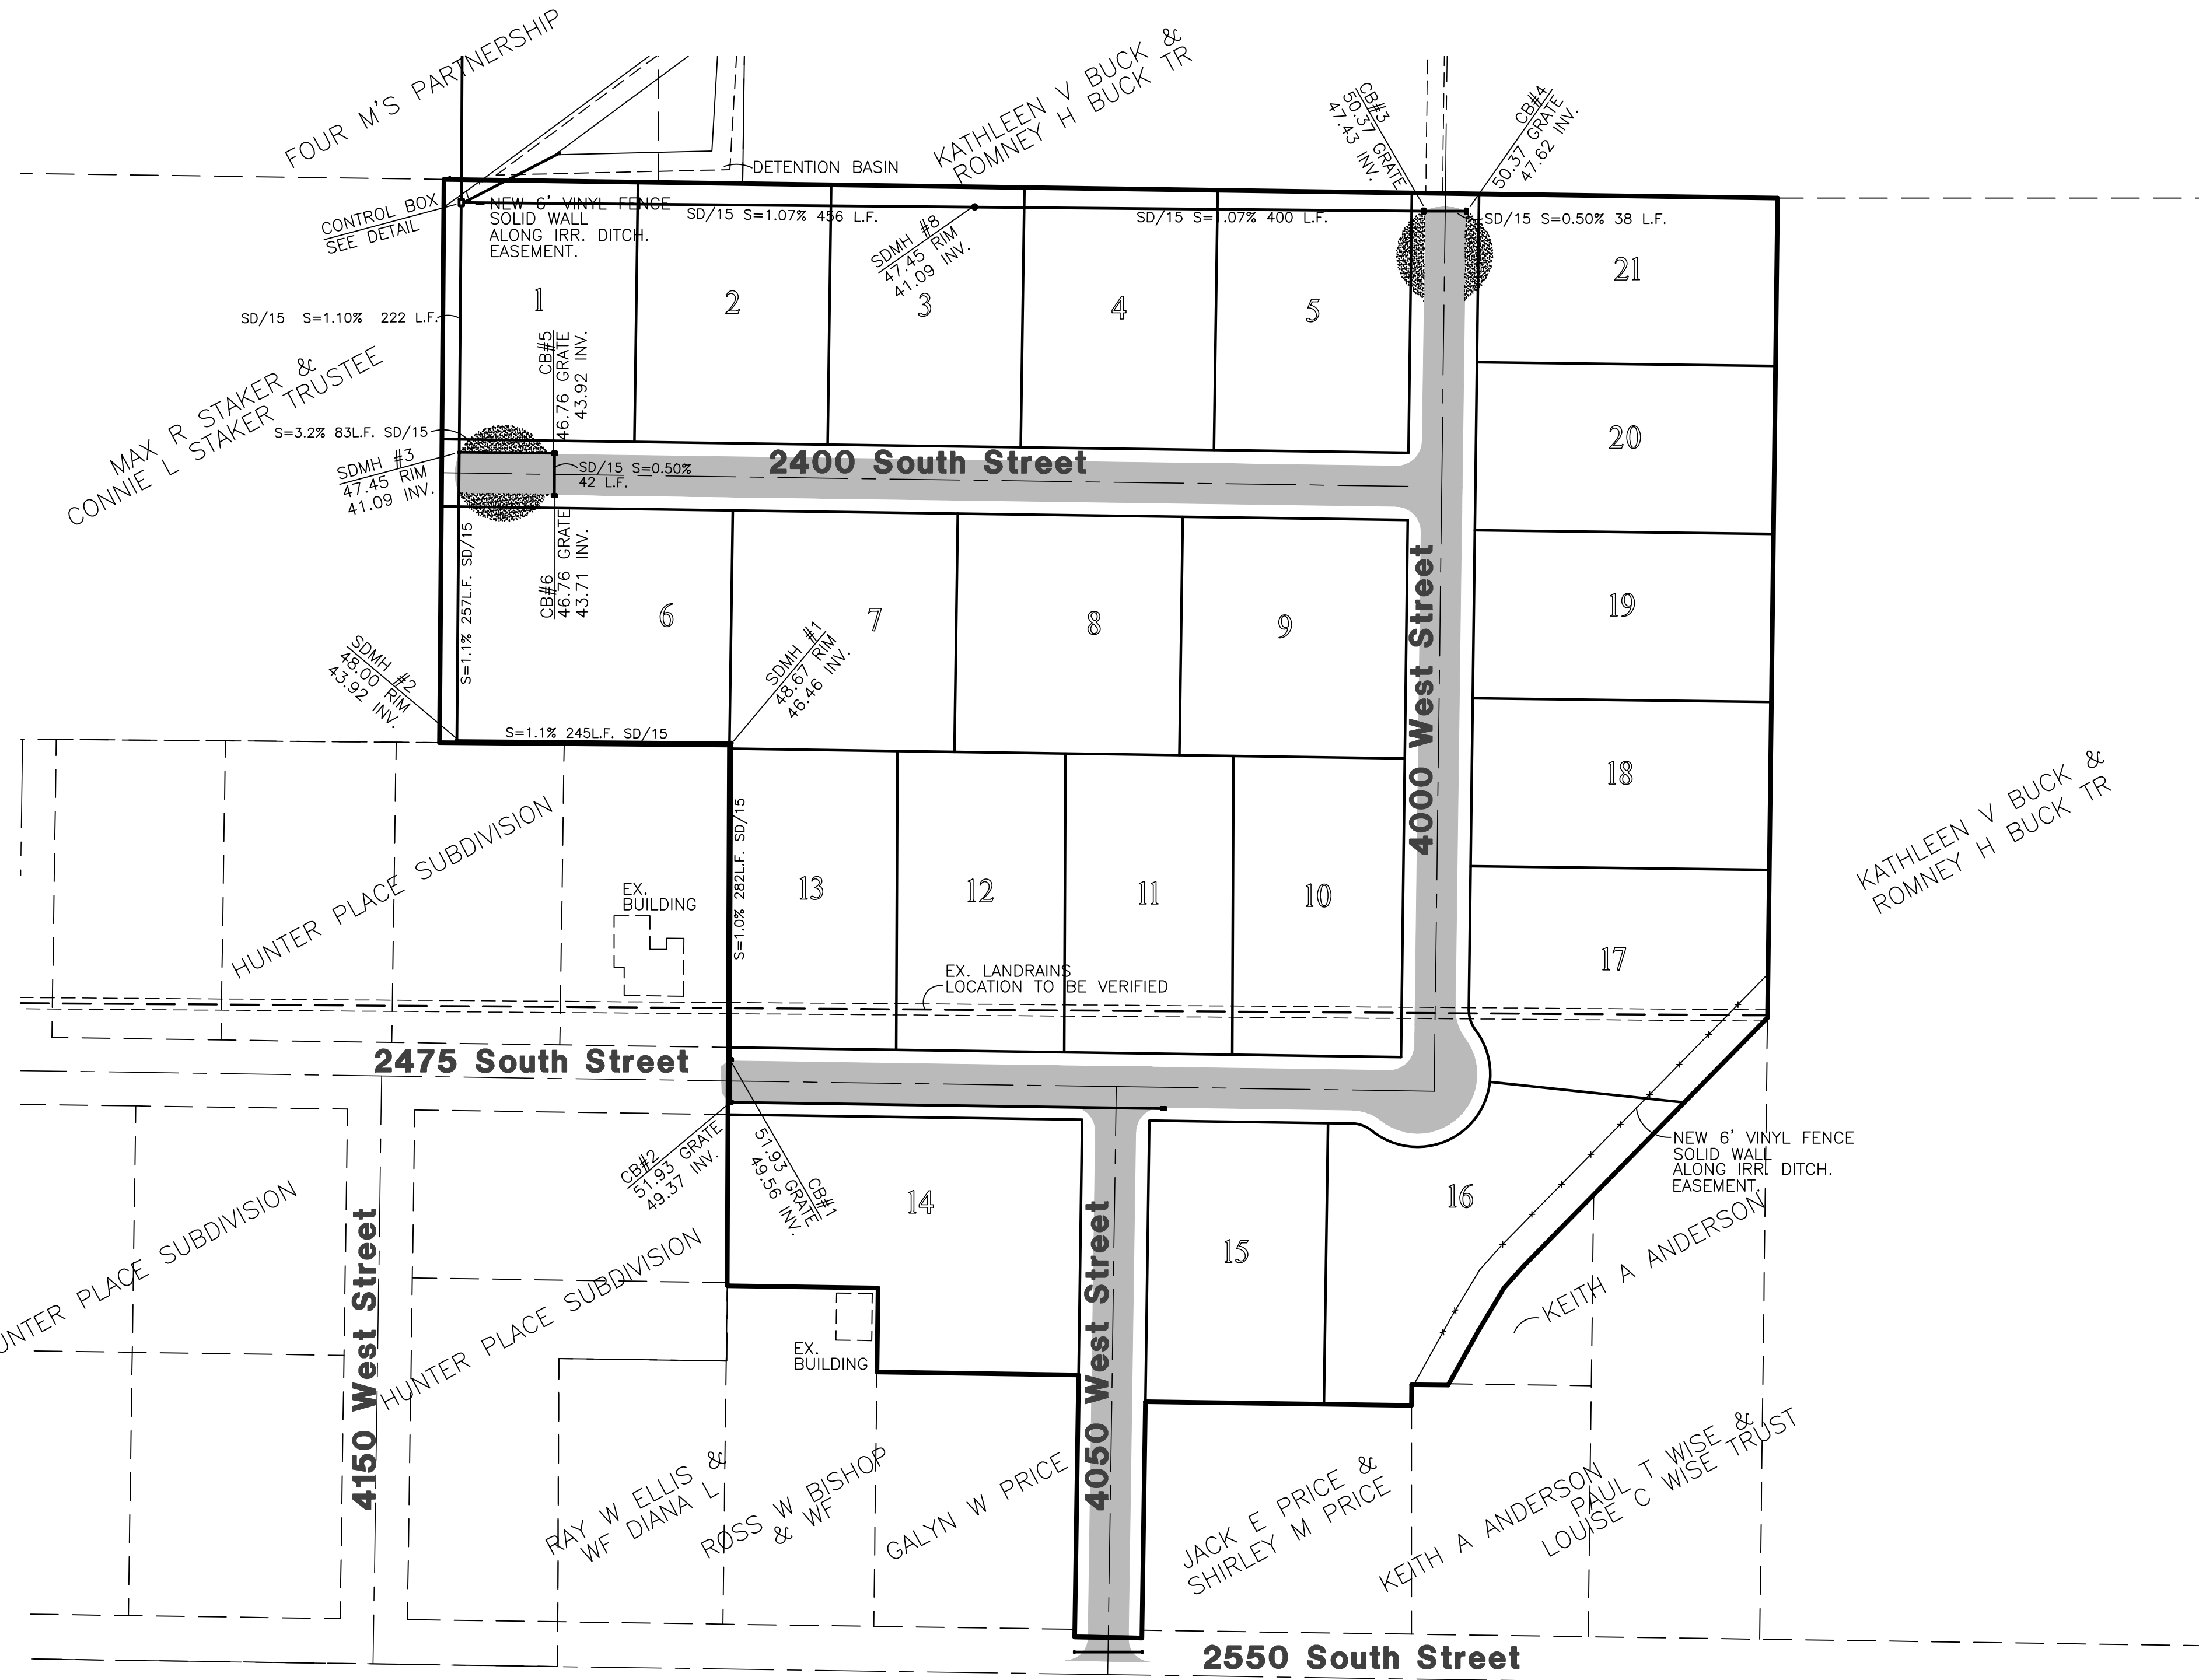

**Sheet Index**

- Sheet 1 - Cover/Index Sheet
- Sheet 2 - Notes/Legend/Street Cross-Section
- Sheet 3 - 4050 West Street 5+50.00 - 11+00.00
- Sheet 4 - 2475 South Street 16+00.00 - 20+00.00
- Sheet 5 - 2475 South Street 20+00.00 - 25+00.00
- Sheet 6 - 4000 West Street 10+00.00 - 14+50.00
- Sheet 7 - 4000 West Street 14+50.00 - 18+32.19
- Sheet 8 - 2400 South Street 20+00.00 - 24+50.00
- Sheet 9 - 2400 South Street 24+50.00 - 30+00.00
- Sheet 10 - 4000 West Street 18+32.19 - 21+00.00
- Sheet 11 - 2325 South Street 21+00.00 - 25+00.00
- Sheet 12 - 4075 West Street 24+77.13 - 26+55.00
- Sheet 13 - 4075 West Street 26+55.00 - 32+50.00
- Sheet 14 - Sanitary Sewer/Storm Drain 5+00.00 - 11+00.00
- Sheet 15 - Sanitary Sewer/Storm Drain 10+00.00 - 18+00.00
- Sheet 16 - Sanitary Sewer/Storm Drain 18+00.00 - 22+00.00
- Sheet 17 - Storm Water Pollution Prevention Plan Exhibit
- Sheet 18 - Storm Water Pollution Prevention Plan Details
- Sheet 19 - Overall Grading Plan
- Sheet 20 - Detention Design

**Engineer's Notice To Contractors**

THE EXISTENCE AND LOCATION OF ANY UNDERGROUND UTILITY PIPES OR STRUCTURES SHOWN ON THESE PLANS WERE OBTAINED FROM AVAILABLE INFORMATION PROVIDED BY OTHERS. THE LOCATIONS SHOWN ARE APPROXIMATE AND SHALL BE CONFIRMED IN THE FIELD BY THE CONTRACTOR, SO THAT ANY NECESSARY ADJUSTMENT CAN BE MADE IN ALIGNMENT AND/OR GRADE OF THE PROPOSED IMPROVEMENT. THE CONTRACTOR IS REQUIRED TO CONTACT THE UTILITY COMPANIES AND TAKE DUE PRECAUTIONARY MEASURE TO PROTECT ANY UTILITY LINES SHOWN, AND ANY OTHER LINES OBTAINED BY THE CONTRACTOR'S RESEARCH, AND OTHERS NOT OF RECORD OR NOT SHOWN ON THESE PLANS.

**Developer Contact:**

Doug Hamblin  
Hamblin Investments  
1613 North 2000 West  
Clinton, Utah, 84015  
PH: (801) 731-7703

Blue Stakes Location Center

**Call: Toll Free**  
**1-800-662-4111**  
Two Working Days Before You Dig



DATE	DESCRIPTION
9-30-14	ST County Comments
10-9-14	ST County Comments
11-3-14	RH Sewer Revisions
11-24-14	ST HIC Comments
2-18-15	ST County Comments
5-9-15	ST County Comments
3-31-16	TP Detention Update

**Mallard Springs Subdivision**  
WEBER COUNTY, UTAH  
**Cover/Index Sheet**

Revised: 5-18-15



**Project Info.**

Engineer:	J. NATE REEVE, P.E.
Drafter:	R. HANSEN
Begin Date:	NOVEMBER 4, 2013
Name:	MALLARD SPRINGS SUBDIVISION
Number:	3442-A30

Sheet	<b>20</b>
<b>1</b>	Sheets



**General Notes:**

1. ALL CONSTRUCTION MUST STRICTLY FOLLOW THE STANDARDS AND SPECIFICATIONS SET FORTH BY: THE DESIGN ENGINEER, GOVERNING UTILITY MUNICIPALITY, GOVERNING CITY OR COUNTY (IF UN-INCORPORATED), INDIVIDUAL PRODUCT MANUFACTURERS, AND THE AMERICAN PUBLIC WORKS ASSOCIATION (APWA). THE ORDER LISTED ABOVE IS ARRANGED BY SENIORITY. IF A CONSTRUCTION PRACTICE IS NOT SPECIFIED BY ANY OF THE LISTED SOURCES, CONTRACTOR MUST CONTACT DESIGN ENGINEER FOR DIRECTION.
2. CONTRACTOR TO STRICTLY FOLLOW COUNTY STANDARDS FOR THIS PROJECT. ALL GRADING INCLUDING BUT NOT LIMITED TO CUT, FILL, COMPACTION, ASPHALT SECTION, SUBBASE, TRENCH EXCAVATION/BACKFILL, SITE GRUBBING, RETAINING WALLS AND FOOTINGS MUST BE COMPLY WITH ALL WEBER COUNTY ENGINEERING STANDARDS.
3. TRAFFIC CONTROL, STRIPING & SIGNAGE TO CONFORM TO CURRENT GOVERNING AGENCIES TRANSPORTATION ENGINEER'S MANUAL AND MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES.
4. ANY AREA OUTSIDE THE LIMIT OF WORK THAT IS DISTURBED SHALL BE RESTORED TO ITS ORIGINAL CONDITION AT NO COST TO OWNER.
5. CONSULT ALL OF THE DRAWINGS AND SPECIFICATIONS FOR COORDINATION REQUIREMENTS BEFORE COMMENCING CONSTRUCTION.
6. AT ALL LOCATIONS WHERE EXISTING PAVEMENT ABUTS NEW CONSTRUCTION, THE EDGE OF THE EXISTING PAVEMENT SHALL BE SAWCUT TO A CLEAN, SMOOTH EDGE.
7. ALL CONSTRUCTION AND MATERIALS SHALL BE IN ACCORDANCE WITH THE MOST RECENT, ADOPTED EDITION OF ADA ACCESSIBILITY GUIDELINES.
8. PRIOR TO STARTING CONSTRUCTION, THE CONTRACTOR SHALL BE RESPONSIBLE FOR MAKING SURE THAT ALL REQUIRED PERMITS AND APPROVALS HAVE BEEN OBTAINED. NO CONSTRUCTION OR FABRICATION SHALL BEGIN UNTIL THE CONTRACTOR HAS RECEIVED THOROUGHLY REVIEWED PLANS AND OTHER DOCUMENTS APPROVED BY ALL OF THE PERMITTING AUTHORITIES.
9. CONTRACTOR IS RESPONSIBLE FOR SCHEDULING AND NOTIFYING ENGINEER OR INSPECTING AUTHORITY 48 HOURS IN ADVANCE OF COVERING UP ANY PHASE OF CONSTRUCTION REQUIRING OBSERVATION.
10. ANY WORK IN THE PUBLIC RIGHT-OF-WAY WILL REQUIRE PERMITS FROM THE APPROPRIATE CITY, COUNTY OR STATE AGENCY AND TO DO THE TYPE OF WORK COMPLIANT IN THE PLANS AND SPECIFICATIONS. CONTRACTOR SHALL BE SKILLED AND REGULARLY ENGAGED IN THE GENERAL CLASS AND TYPE OF WORK CALLED FOR IN THE PLANS AND SPECIFICATIONS.
11. CONTRACTOR SHALL INSPECT THE SITE OF THE WORK PRIOR TO BIDDING TO SATISFY HIMSELF BY PERSONAL EXAMINATION OR BY SUCH OTHER MEANS AS HE MAY PREFER OF THE LOCATIONS OF THE PROPOSED WORK AND OF THE ACTUAL CONDITIONS OF AND AT THE SITE OF WORK. IF, DURING THE COURSE OF HIS EXAMINATION, A BIDDER FINDS FACTS OR CONDITIONS WHICH APPEAR TO HIM TO BE IN CONFLICT WITH THE LETTER AND SPIRIT OF THE PROJECT PLANS AND SPECIFICATIONS, HE SHALL CONTACT THE ENGINEER FOR ADDITIONAL INFORMATION AND EXPLANATION BEFORE SUBMITTING HIS BID. SUBMISSION OF A BID BY THE CONTRACTOR SHALL CONSTITUTE ACKNOWLEDGMENT THAT, IF AWARDED THE CONTRACT, HE HAS RELIED AND IS RELYING ON HIS OWN EXAMINATION OF (1) THE SITE OF THE WORK, (2) ACCESS TO THE SITE AND MATTERS RELEVANT TO THE FULFILLMENT OF THE WORK AND ON HIS OWN KNOWLEDGE OF EXISTING FACILITIES ON AND IN THE VICINITY OF THE SITE OF THE WORK TO BE CONSTRUCTED UNDER THIS CONTRACT. THE INFORMATION PROVIDED BY THE ENGINEER IS NOT INTENDED TO BE A SUBSTITUTE FOR, OR A SUPPLEMENT TO, THE INDEPENDENT VERIFICATION BY THE CONTRACTOR TO THE EXTENT SUCH INDEPENDENT INVESTIGATION OF SITE CONDITIONS IS DEEMED NECESSARY OR DESIRABLE BY THE CONTRACTOR. CONTRACTOR SHALL ACKNOWLEDGE THAT HE HAS NOT RELIED SOLELY UPON OWNER-OR ENGINEER-FURNISHED INFORMATION REGARDING SITE CONDITIONS IN PREPARING AND SUBMITTING HIS BID.
12. CONTRACTOR SHALL BE RESPONSIBLE TO PROVIDE ALL WATER, POWER, SANITARY FACILITIES AND TELEPHONE SERVICES AS REQUIRED FOR THE CONTRACTOR'S USE DURING CONSTRUCTION.
13. CONTRACTOR SHALL BE HELD RESPONSIBLE FOR ANY FIELD CHANGES MADE WITHOUT PRIOR WRITTEN AUTHORIZATION FROM THE OWNER, ENGINEER, AND/OR GOVERNING AGENCIES.
14. CONTRACTOR SHALL EXERCISE DUE CAUTION AND SHALL CAREFULLY PRESERVE BENCH MARKS, CONTROL POINTS, REFERENCE POINTS AND ALL SURVEY STAKES, AND SHALL BEAR ALL EXPENSES FOR REPLACEMENT AND/OR ERRORS CAUSED BY THEIR UNNECESSARY LOSS OR DISTURBANCE.
15. CONTRACTOR SHALL ASSUME SOLE AND COMPLETE RESPONSIBILITY FOR JOBSITE CONDITIONS DURING THE COURSE OF CONSTRUCTION OF THIS PROJECT, INCLUDING SAFETY OF ALL PERSONS AND PROPERTY. THIS REQUIREMENT SHALL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS. THE CONTRACTOR SHALL DEFEND, INDEMNIFY AND HOLD THE OWNER AND ENGINEER HARMLESS FROM ANY AND ALL LIABILITY, REAL OR ALLEGED, IN CONNECTION WITH THE PERFORMANCE OF WORK ON THE PROJECT, EXCEPTING FOR LIABILITY ARISING FROM THE SOLE NEGLIGENCE OF THE OWNER OR THE ENGINEER.
16. CONTRACTOR SHALL BE RESPONSIBLE FOR ADEQUATELY SCHEDULING INSPECTION AND TESTING OF ALL FACILITIES CONSTRUCTED UNDER THIS CONTRACT. ALL TESTING AND INSPECTION SHALL BE PAID FOR BY THE OWNER. ALL RE-TESTING AND/OR RE-INSPECTION SHALL BE PAID FOR BY THE CONTRACTOR.
17. IF EXISTING IMPROVEMENTS TO BE DISTURBED AND/OR REMOVED FOR THE PROPER PLACEMENT OF IMPROVEMENTS TO BE CONSTRUCTED BY THESE PLANS, THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTING EXISTING IMPROVEMENTS FROM DAMAGE. COST OF REPLACING OR REPAIRING EXISTING IMPROVEMENTS SHALL BE INCLUDED IN THE UNIT PRICE BID FOR ITEMS REQUIRING REMOVAL AND/OR REPLACEMENT. THERE WILL BE NO EXTRA COST DUE TO THE CONTRACTOR FOR REPLACING OR REPAIRING EXISTING IMPROVEMENTS.
18. WHENEVER EXISTING FACILITIES ARE REMOVED, DAMAGED, BROKEN, OR CUT IN THE INSTALLATION OF THE WORK COVERED BY THESE PLANS OR SPECIFICATIONS, SAID FACILITIES SHALL BE REPLACED AT THE CONTRACTOR'S EXPENSE WITH MATERIALS EQUAL TO OR BETTER THAN THE MATERIALS USED IN THE ORIGINAL EXISTING FACILITIES. THE FINISHED PRODUCT SHALL BE SUBJECT TO THE APPROVAL OF THE OWNER, THE ENGINEER, AND THE RESPECTIVE REGULATORY AGENCY.
19. CONTRACTOR SHALL MAINTAIN A NEATLY MARKED SET OF FULL-SIZE AS-BUILT RECORD DRAWINGS SHOWING THE FINAL LOCATION AND LAYOUT OF ALL STRUCTURES AND OTHER FACILITIES. AS-BUILT RECORD DRAWINGS SHALL REFLECT CHANGE ORDERS, ACCOMMODATIONS, AND ADJUSTMENTS TO ALL IMPROVEMENTS CONSTRUCTED. WHERE NECESSARY, SUPPLEMENTAL DRAWINGS SHALL BE PREPARED AND SUBMITTED BY THE CONTRACTOR. PRIOR TO ACCEPTANCE OF THE PROJECT, THE CONTRACTOR SHALL DELIVER TO THE ENGINEER ONE SET OF NEATLY MARKED AS-BUILT RECORD DRAWINGS SHOWING THE INFORMATION REQUIRED ABOVE. AS-BUILT RECORD DRAWINGS SHALL BE REVIEWED AND THE COMPLETE AS-BUILT RECORD DRAWING SET SHALL BE CURRENT WITH ALL CHANGES AND DEVIATIONS REDLINED AS A PRECONDITION TO THE FINAL PROGRESS PAYMENT APPROVAL AND/OR FINAL ACCEPTANCE.
20. WHERE THE PLANS OR SPECIFICATIONS DESCRIBE PORTIONS OF THE WORK IN GENERAL TERMS BUT NOT IN COMPLETE DETAIL, IT IS UNDERSTOOD THAT ONLY THE BEST GENERAL PRACTICE IS TO PREVENT AND THAT ONLY MATERIALS AND WORKMANSHIP OF THE HIGHEST QUALITY ARE TO BE USED.
21. CONTRACTOR SHALL BE SKILLED AND REGULARLY ENGAGED IN THE GENERAL CLASS AND TYPE OF WORK CALLED FOR IN THE PROJECT PLANS AND SPECIFICATIONS. THEREFORE, THE OWNER IS RELYING UPON THE EXPERIENCE AND EXPERTISE OF THE CONTRACTOR. PRICES PROVIDED WITHIN THE CONTRACT DOCUMENTS SHALL INCLUDE ALL LABOR AND MATERIALS NECESSARY AND PROPER FOR THE WORK CONTEMPLATED AND THAT THE WORK BE COMPLETED IN ACCORDANCE WITH THE TRUE INTENT AND PURPOSE OF THESE PLANS AND SPECIFICATIONS. THE CONTRACTOR SHALL BE COMPETENT, KNOWLEDGEABLE AND HAVE SPECIAL SKILLS IN THE NATURE, EXTENT AND INHERENT CONDITIONS OF THE WORK TO BE PERFORMED. CONTRACTOR SHALL ALSO ACKNOWLEDGE THAT THERE ARE CERTAIN PECULIAR AND INHERENT CONDITIONS EXISTENT IN THE CONSTRUCTION OF THE PARTICULAR FACILITIES WHICH MAY CREATE, DURING THE CONSTRUCTION PROGRAM, UNUSUAL OR UNSAFE CONDITIONS HAZARDOUS TO PERSONS, PROPERTY AND THE ENVIRONMENT. CONTRACTOR SHALL BE AWARE OF SUCH PECULIAR RISKS AND HAVE THE SKILL AND EXPERIENCE TO FORESEE AND TO ADOPT PROTECTIVE MEASURES TO ADEQUATELY AND SAFELY PERFORM THE CONSTRUCTION WORK WITH RESPECT TO SUCH HAZARDS.
22. CONTRACTOR SHALL BE RESPONSIBLE FOR THE REMOVAL OF ALL STRIPING AND/OR PAVEMENT MARKINGS NECESSARY TO THE EXISTING STRIPING INTO FUTURE STRIPING. METHOD OF REMOVAL SHALL BE BY GRINDING OR SANDBLASTING.
23. CONTRACTOR SHALL PROVIDE ALL SHORING, BRACING, SLOPING OR OTHER PROVISIONS NECESSARY TO PROTECT WORKMEN FOR ALL AREAS TO BE EXCAVATED TO A DEPTH OF 4 FEET OR MORE. FOR EXCAVATIONS 4 FEET OR MORE IN DEPTH, THE CONTRACTOR SHALL COMPLY WITH LOCAL, STATE AND NATIONAL SAFETY CODES, ORDINANCES OR REQUIREMENTS FOR EXCAVATION AND TRENCHES.
24. ALL EXISTING GATES AND FENCES TO REMAIN UNLESS OTHERWISE NOTED ON PLANS. PROTECT ALL GATES AND FENCES FROM DAMAGE.

**Utility Notes:**

1. CONTRACTOR SHALL COORDINATE LOCATION OF NEW "DRY UTILITIES" WITH THE APPROPRIATE UTILITY COMPANY, INCLUDING BUT NOT LIMITED TO: TELEPHONE SERVICE, GAS SERVICE, POWER SERVICE.
2. EXISTING UTILITIES HAVE BEEN SHOWN ON THE PLANS USING A COMBINATION OF ON-SITE SURVEYS (BY OTHERS). PRIOR TO COMMENCING ANY WORK, IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO HAVE EACH UTILITY COMPANY LOCATE IN THE FIELD, THEIR MAIN AND SERVICE LINES 48 HOURS IN ADVANCE OF PERFORMING ANY EXCAVATION WORK. THE CONTRACTOR SHALL RECORD THE BLUE STAKES ORDER NUMBER AND FURNISH ORDER NUMBER TO OWNER AND ENGINEER PRIOR TO ANY EXCAVATION. IT WILL BE THE CONTRACTOR'S SOLE RESPONSIBILITY TO DIRECTLY CONTACT ANY OTHER UTILITY COMPANIES THAT ARE NOT MEMBERS OF BLUE STAKES. IT SHALL BE THE CONTRACTOR'S SOLE RESPONSIBILITY TO PROTECT ALL EXISTING UTILITIES SO THAT NO DAMAGE RESULTS TO THEM DURING THE PERFORMANCE OF THIS CONTRACT. ANY REPAIRS NECESSARY TO DAMAGED UTILITIES SHALL BE PAID FOR BY THE CONTRACTOR. THE CONTRACTOR SHALL BE REQUIRED TO COOPERATE WITH OTHER CONTRACTORS AND UTILITY COMPANIES INSTALLING NEW STRUCTURES, UTILITIES AND SERVICE TO THE PROJECT.
3. CONTRACTOR SHALL PUT HOLE ALL UTILITIES TO DETERMINE IF CONFLICTS EXIST PRIOR TO BEGINNING ANY EXCAVATION. NOTIFY ENGINEER OF ANY CONFLICTS. CONTRACTOR SHALL VERIFY LOCATION AND INVERTS OF EXISTING UTILITIES TO WHICH NEW UTILITIES WILL BE CONNECTED. PRIOR TO COMMENCING ANY EXCAVATION WORK THE CONTRACTOR SHALL NOTIFY ALL UTILITY COMPANIES IN ACCORDANCE WITH THE REQUIRED PROCEDURES.
4. CARE SHOULD BE TAKEN IN ALL EXCAVATIONS DUE TO POSSIBLE EXISTENCE OF UNRECORDED UTILITY LINES. EXCAVATION REQUIRED WITHIN PROXIMITY OF EXISTING UTILITY LINES SHALL BE DONE BY HAND. CONTRACTOR SHALL REPAIR ANY DAMAGE TO EXISTING UTILITY LINES OR STRUCTURES INCURRED DURING CONSTRUCTION OPERATIONS AT HIS EXPENSE.
5. ALL VALVES AND MANHOLE COVERS SHALL BE RAISED OR LOWERED TO MEET FINISHED GRADE.
6. CONTRACTOR SHALL GROUT AT CONNECTION OF PIPE TO BOX WITH NON-SHRINKING GROUT, INCLUDING PIPE VOIDS LEFT BY CUTTING PROCESS, TO A SMOOTH FINISH.
7. CONTRACTOR SHALL GROUT WITH NON-SHRINK GROUT BETWEEN GRADE RINGS AND BETWEEN BOTTOM OF INLET LID FRAME AND TOP OF CONCRETE BOX.
8. SILT AND DEBRIS IS TO BE CLEANED OUT OF ALL STORM DRAIN BOXES. CATCH BASINS ARE TO BE MAINTAINED IN A CLEANED CONDITION AS NEEDED UNTIL AFTER THE FINAL BOND RELEASE INSPECTION.
9. CONTRACTOR SHALL CLEAN ASPHALT, TAR OR OTHER ADHESIVES OFF OF ALL MANHOLE LIDS AND INLET GRATES TO ALLOW ACCESS.
10. EACH TRENCH SHALL BE EXCAVATED SO THAT THE PIPE CAN BE LAID TO THE ALIGNMENT AND GRADE TO LOCATE A NEARBY HYDRANT FOR USE AND TO INSTALL TEMPORARY METER. CONSTRUCTION WATER COST TO BE INCLUDED IN BID.
11. ALL TRENCHES SHALL BE DRAINED SO THE PIPE LAYING MAY TAKE PLACE IN DE-WATERED CONDITIONS.
12. CONTRACTOR SHALL PROVIDE AND MAINTAIN AT ALL TIMES AMPLE MEANS AND DEVICES WITH WHICH TO REMOVE PROMPTLY AND TO PROPERLY DISPOSE OF ALL WATER ENTERING THE TRENCH EXCAVATION.
13. MAINTAIN A MINIMUM 18" VERTICAL SEPARATION DISTANCE BETWEEN ALL UTILITY CROSSINGS.
14. CONTRACTOR SHALL START INSTALLATION AT LOW POINT OF ALL NEW GRAVITY UTILITY LINES.
15. ALL BOX END FITTINGS MUST BE GRADED AND WRAPPED.
16. UNLESS SPECIFICALLY NOTED OTHERWISE, MAINTAIN AT LEAST 2 FEET OF COVER OVER ALL STORM DRAIN LINES AT ALL TIMES (INCLUDING DURING CONSTRUCTION).
17. ALL WATER LINES SHALL BE INSTALLED A MINIMUM OF 60" BELOW FINISHED GRADE.
18. ALL SEWER LINES AND SEWER SERVICES SHALL HAVE A MINIMUM SEPARATION OF 10 FEET, PIPE EDGE TO PIPE EDGE. FROM THE WATER LINES, IF A 10 FOOT SEPARATION CAN NOT BE MAINTAINED, THE SEWER LINE AND WATER LINE SHALL BE LAID IN SEPARATE TRENCHES AND THE BOTTOM OF THE WATER LINE SHALL BE AT LEAST 18" ABOVE THE TOP OF THE SEWER LINE.
19. CONTRACTOR SHALL INSTALL THRUST BLOCKING AT ALL WATERLINE ANGLE POINTS AND TEES.
20. ALL UNDERGROUND UTILITIES SHALL BE IN PLACE PRIOR TO INSTALLATION OF CURB, GUTTER, SIDEWALK AND STREET PAVING.
21. CONTRACTOR SHALL INSTALL MAGNETIC LOCATING TAPE CONTINUOUSLY OVER ALL NONMETALLIC PIPE.

**Erosion Control General Notes:**

THE CONTRACTOR TO USE BEST MANAGEMENT PRACTICES FOR PROVIDING EROSION CONTROL FOR CONSTRUCTION OF THIS PROJECT. ALL MATERIAL AND WORKMANSHIP SHALL CONFORM TO GOVERNING AGENCIES ORDINANCES AND ALL WORK SHALL BE SUBJECT TO INSPECTION BY THE COUNTIES. ALSO, INSPECTORS WILL HAVE THE RIGHT TO CHANGE THE FACILITIES AS NEEDED.

CONTRACTOR SHALL KEEP THE SITE WATERED TO CONTROL DUST. CONTRACTOR TO LOCATE A NEARBY HYDRANT FOR USE AND TO INSTALL TEMPORARY METER. CONSTRUCTION WATER COST TO BE INCLUDED IN BID.

WHEN GRADING OPERATIONS ARE COMPLETED AND THE DISTURBED GROUND IS LEFT "OPEN" FOR 14 DAYS OR MORE, THE AREA SHALL BE FURROWED PARALLEL TO THE CONTOURS.

THE CONTRACTOR SHALL MODIFY EROSION CONTROL MEASURES TO ACCOMMODATE PROJECT PLANNING.

ALL ACCESS TO PROPERTY WILL BE FROM PUBLIC RIGHT-OF-WAYS. THE CONTRACTOR IS REQUIRED BY STATE AND FEDERAL REGULATIONS TO PREPARE A STORM WATER POLLUTION PREVENTION PLAN AND FILE A "NOTICE OF INTENT" WITH THE GOVERNING AGENCIES.

**Maintenance:**

ALL BEST MANAGEMENT PRACTICES (BMP'S) SHOWN ON THIS PLAN MUST BE MAINTAINED AT ALL TIMES UNTIL PROJECT CLOSE-OUT.

THE CONTRACTOR'S RESPONSIBILITY SHALL INCLUDE MAKING BI-WEEKLY CHECKS ON ALL EROSION CONTROL MEASURES TO DETERMINE IF REPAIR OR SEDIMENT REMOVAL IS NECESSARY. CHECKS SHALL BE DOCUMENTED AND COPIES OF THE INSPECTIONS KEPT ON SITE.

SEDIMENT DEPOSITS SHOULD BE REMOVED AFTER EACH RAINFALL. THEY MUST BE REMOVED WHEN THE LEVEL OF DEPOSITION REACHES APPROXIMATELY ONE-HALF THE HEIGHT OF BARRIER.


SEDIMENT TRACKED ONTO PAVED ROADS MUST BE CLEANED UP AS SOON AS PRACTICAL, BUT IN NO CASE LATER THAN THE END OF THE NORMAL WORK DAY. Y. THE CLEAN UP WILL INCLUDE SWEEPING OF THE TRACKED MATERIAL, PICKING IT UP, AND DEPOSITING IT TO A CONTAINED AREA.

**EXPOSED SLOPES:**


ANY EXPOSED SLOPE THAT WILL REMAIN UNTOUCHED FOR LONGER THAN 14 DAYS MUST BE STABILIZED BY ONE OR MORE OF THE FOLLOWING METHODS:  
 A) Spraying DISTURBED AREAS WITH A TACKIFIER VIA HYDROSEED  
 B) TRACKING STRAW PERPENDICULAR TO SLOPES  
 C) INSTALLING A LIGHT-WEIGHT, TEMPORARY EROSION CONTROL BLANKET

—W— = PROPOSED CULINARY WATER LINE	□ = EXISTING CATCH BASIN	L.F. = LINEAR FEET
—EX.W— = EXISTING CULINARY WATER LINE	⊙ = EXISTING SPRINKLER	NG = NATURAL GRADE
—SS— = PROPOSED SANITARY SEWER LINE	⊕ = PLUG W/ 2" BLOW-OFF	O.C. = ON CENTER
—EX.SS— = EXISTING SANITARY SEWER LINE	● = AIR-VAC ASSEMBLY	PC = POINT OF CURVE
—SD— = PROPOSED STORM DRAIN LINE	⌋ = PROPOSED REDUCER	PRC = POINT OF REVERSE CURVE
—EX.SD— = EXISTING STORM DRAIN LINE	⌋ = PLUG & BLOCK	PRVC = POINT OF REVERSE VERTICAL CURVE
—LD— = PROPOSED LAND DRAIN LINE	⊖ = STREET LIGHT	PT = POINT OF TANGENT
—EX.LD— = EXISTING LAND DRAIN LINE	— = SIGN	PP = POWER/UTILITY POLE
—SW— = PROPOSED SECONDARY WATER LINE	BLDG = BUILDING	P.U.E. = PUBLIC UTILITY EASEMENT
—EX.SW— = EXISTING SECONDARY WATER LINE	BVC = BEGIN VERTICAL CURVE	R/C = REBAR & CAP
—IRR— = PROPOSED IRRIGATION LINE	C&G = CURB & GUTTER	RCB = REINFORCED CONCRETE BOX
—EX.IRR— = EXISTING IRRIGATION LINE	CB = CATCH BASIN	RCP = REINFORCED CONCRETE PIPE
—OHP— = EXISTING OVERHEAD POWER LINE	C.F. = CUBIC FEET	RIM = RIM OF MANHOLE
—TEL— = EXISTING TELEPHONE LINE	C.F.S. = CUBIC FEET PER SECOND	R.O.W. = RIGHT-OF-WAY
—GAS— = EXISTING NATURAL GAS LINE	CL = CENTERLINE	SD = STORM DRAIN
—PAV— = EXISTING EDGE OF PAVEMENT	DI = DUCTILE IRON	SS = SANITARY SEWER
—X—X—X— = FENCE LINE	EP = EDGE OF PAVEMENT	SW = SECONDARY WATER
—M—M—M— = MASONRY BLOCK/RETAINING WALL	EVC = END VERTICAL CURVE	TBC = TOP BACK OF CURB
—D—D—D— = DITCH/SWALE FLOWLINE	FC = FENCE CORNER	TOE = TOE OF SLOPE
● = PROPOSED FIRE HYDRANT	FF = FINISH FLOOR	TOP = TOP OF SLOPE
○ = EXISTING FIRE HYDRANT	FFE = FINISH FLOOR ELEVATION	TOW = TOP OF WALL
○ = PROPOSED MANHOLE	FG = FINISHED GRADE	TSW = TOP OF SIDEWALK
○ = EXISTING MANHOLE	FH = FIRE HYDRANT	VPI = VERTICAL POINT OF INTERSECT.
● = PROPOSED SEWER CLEAN-OUT	FL = FLOW LINE	W = CULINARY WATER
● = PROPOSED GATE VALVE	GB = GRADE BREAK	WM = WATER METER
● = EXISTING GATE VALVE	HDPPE = HIGH DENSITY POLYETHYLENE PIPE	— = PROPOSED PAVEMENT
■ = PROPOSED WATER METER	— = INVERT	— = PROPOSED CONCRETE
■ = EXISTING WATER METER	IRR = IRRIGATION	
■ = PROPOSED CATCH BASIN	LD = LAND DRAIN	

**Master Legend**

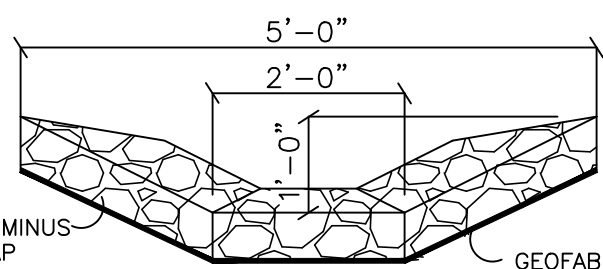

**Emergency Spillway**  
SCALE: NONE

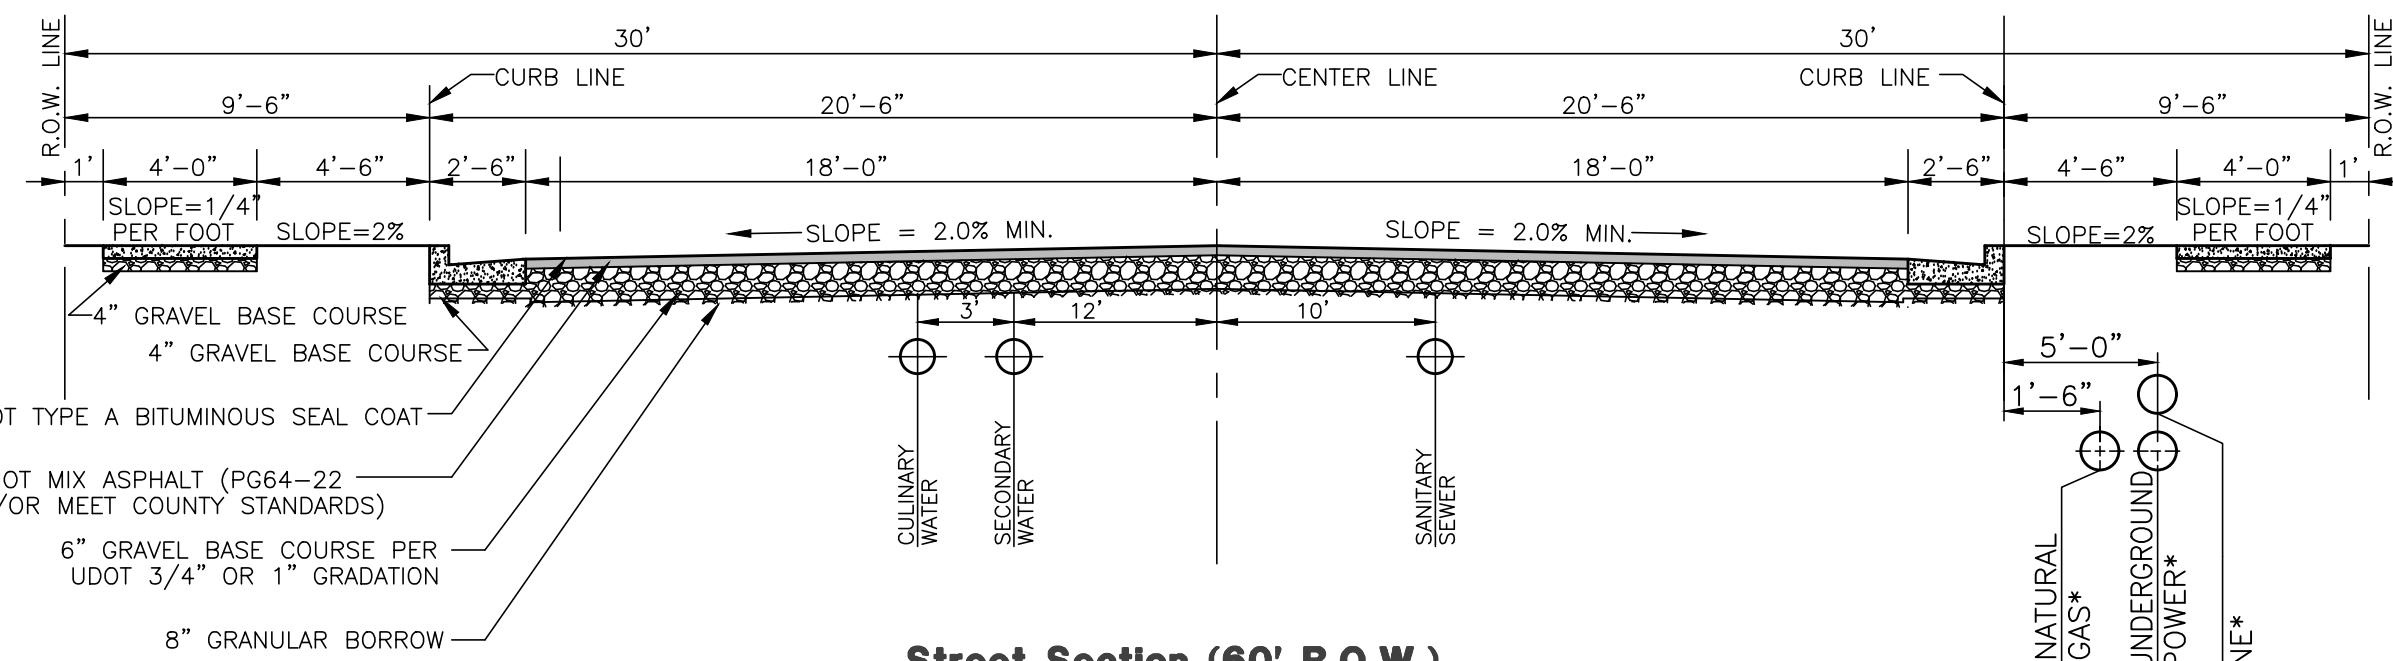

**Street Section (60' R.O.W.)**

\*VERIFY LOCATION WITH PHONE, GAS AND POWER COMPANIES.

**General Notes**

1. ALL CONSTRUCTION ON THIS PROJECT SHALL CONFORM TO THE DEVELOPMENT STANDARDS OF WEBER COUNTY AND THE STANDARD DRAWINGS CONTAINED THEREIN. WEBER COUNTY PUBLIC WORKS REQUIREMENTS SHALL BE MET.
2. THE LOCATION OF EXISTING UTILITIES SHOWN ARE APPROXIMATE ONLY AND THE CONTRACTOR SHALL VERIFY THE LOCATION AND ELEVATION OF ALL UTILITIES SHOWN OR NOT SHOWN ON THESE PLANS.
3. THE STREET STRUCTURAL CROSS SECTION IS PER WEBER COUNTY DETAILS CONTAINED WITHIN THESE PLANS.
4. WATER LINE PIPE SHALL BE PVC C-900 CLASS 200. WASHOUT ASSEMBLIES SHALL CONSIST OF A KUPFERLE FOUNDRY CO. 2" BLOW-OFF HYDRANT (OR COUNTY-APPROVED EQUIV.).
5. SECONDARY WATER LINE SHALL BE PVC C-900 CLASS 200. ALL SECONDARY WATER VALVE LIDS SHALL BE STAMPED "IRRIGATION". ALL SECONDARY WATER SHALL BE CONSTRUCTED TO MEET THE REQUIREMENTS OF THE HOOPER IRRIGATION COMPANY.
6. NO DRAINAGE FROM THE DEVELOPMENT SHALL BE ALLOWED INTO THE CANAL SYSTEM AND THAT ALL CONSTRUCTION BE DONE IN ACCORDANCE WITH HOOPER IRRIGATION COMPANY STANDARDS.

**Reeve & Associates, Inc.**  
 692 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403  
 TEL: (801) 901-5100 FAX: (801) 901-2666 www.reeve-assoc.com  
 CIVIL ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

DATE	DESCRIPTION
9-30-14	ST. County Comments
10-9-14	ST. County Comments
11-3-14	RH. Sewer Revisions
11-24-14	ST. HIC Comments
2-18-15	ST. County Comments
5-9-15	ST. County Comments
3-31-16	TP. Detention Update

**Mallard Springs Subdivision**  
 WEBER COUNTY, UTAH  
**Notes/Legend/ Street Cross-Section**

**Revised: 5-18-15**


REGISTERED PROFESSIONAL ENGINEER  
 375328  
 J. NATE REEVE  
 STATE OF UTAH

**Project Info.**  
 Engineer: J. NATE REEVE, P.E.  
 Drafter: R. HANSEN  
 Begin Date: NOVEMBER 4, 2013  
 Name: MALLARD SPRINGS SUBDIVISION  
 Number: 3442-A30

Sheet **20**  
 2 Sheets



**Key Map** NOT TO SCALE

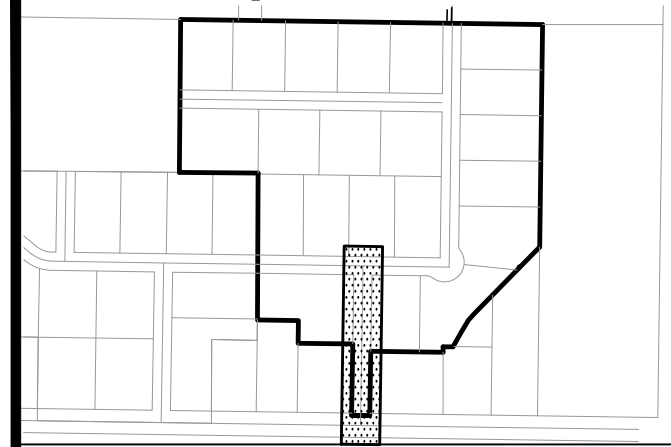

**Construction Notes:**

- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
- 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.

**CULINARY WATER**

W/8 - 8" PVC C-900 CLASS 200 WATER

**SANITARY SEWER**

SS/8 - 8" ASTM D3034 SDR 35 SEWER  
SS/12 - 12" ASTM D3034 SDR 35 SEWER

**STORM DRAIN**



SD/15 - 15" RCP STORM DRAIN

**SECONDARY WATER**


SW/8 - 8" PVC C-900 SECONDARY WATER LINE

**Canal Crossing Notes**

- 1) ANY CROSSING OF THE HOOPER IRR. CANALS MUST OBTAIN A LICENSE AGREEMENT.
- 2) THE SEWER LINE MUST BE INSTALLED IN AN 18" STEEL CASING EXTENDING 4'-0" BEYOND HIGH BANK BOTH SIDES OF THE CANAL ACCORDING TO HOOPER IRR. COMPANY STANDARD DETAILS.
- 3) NO DRAINAGE FROM THE DEVELOPMENT IS ALLOWED INTO THE CANAL SYSTEM.
- 4) ALL CONSTRUCTION TO BE DONE IN ACCORDANCE WITH HOOPER IRR. COMPANY STANDARDS.

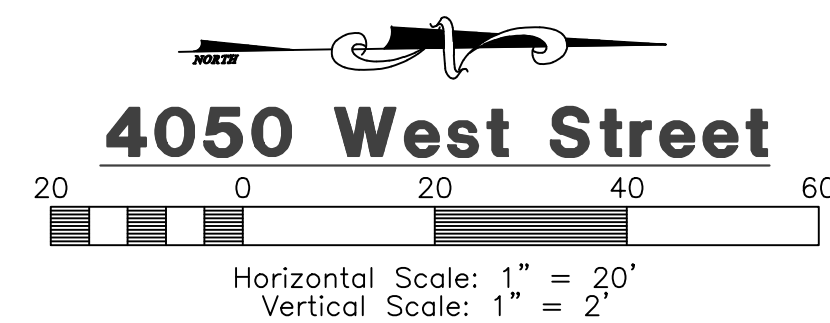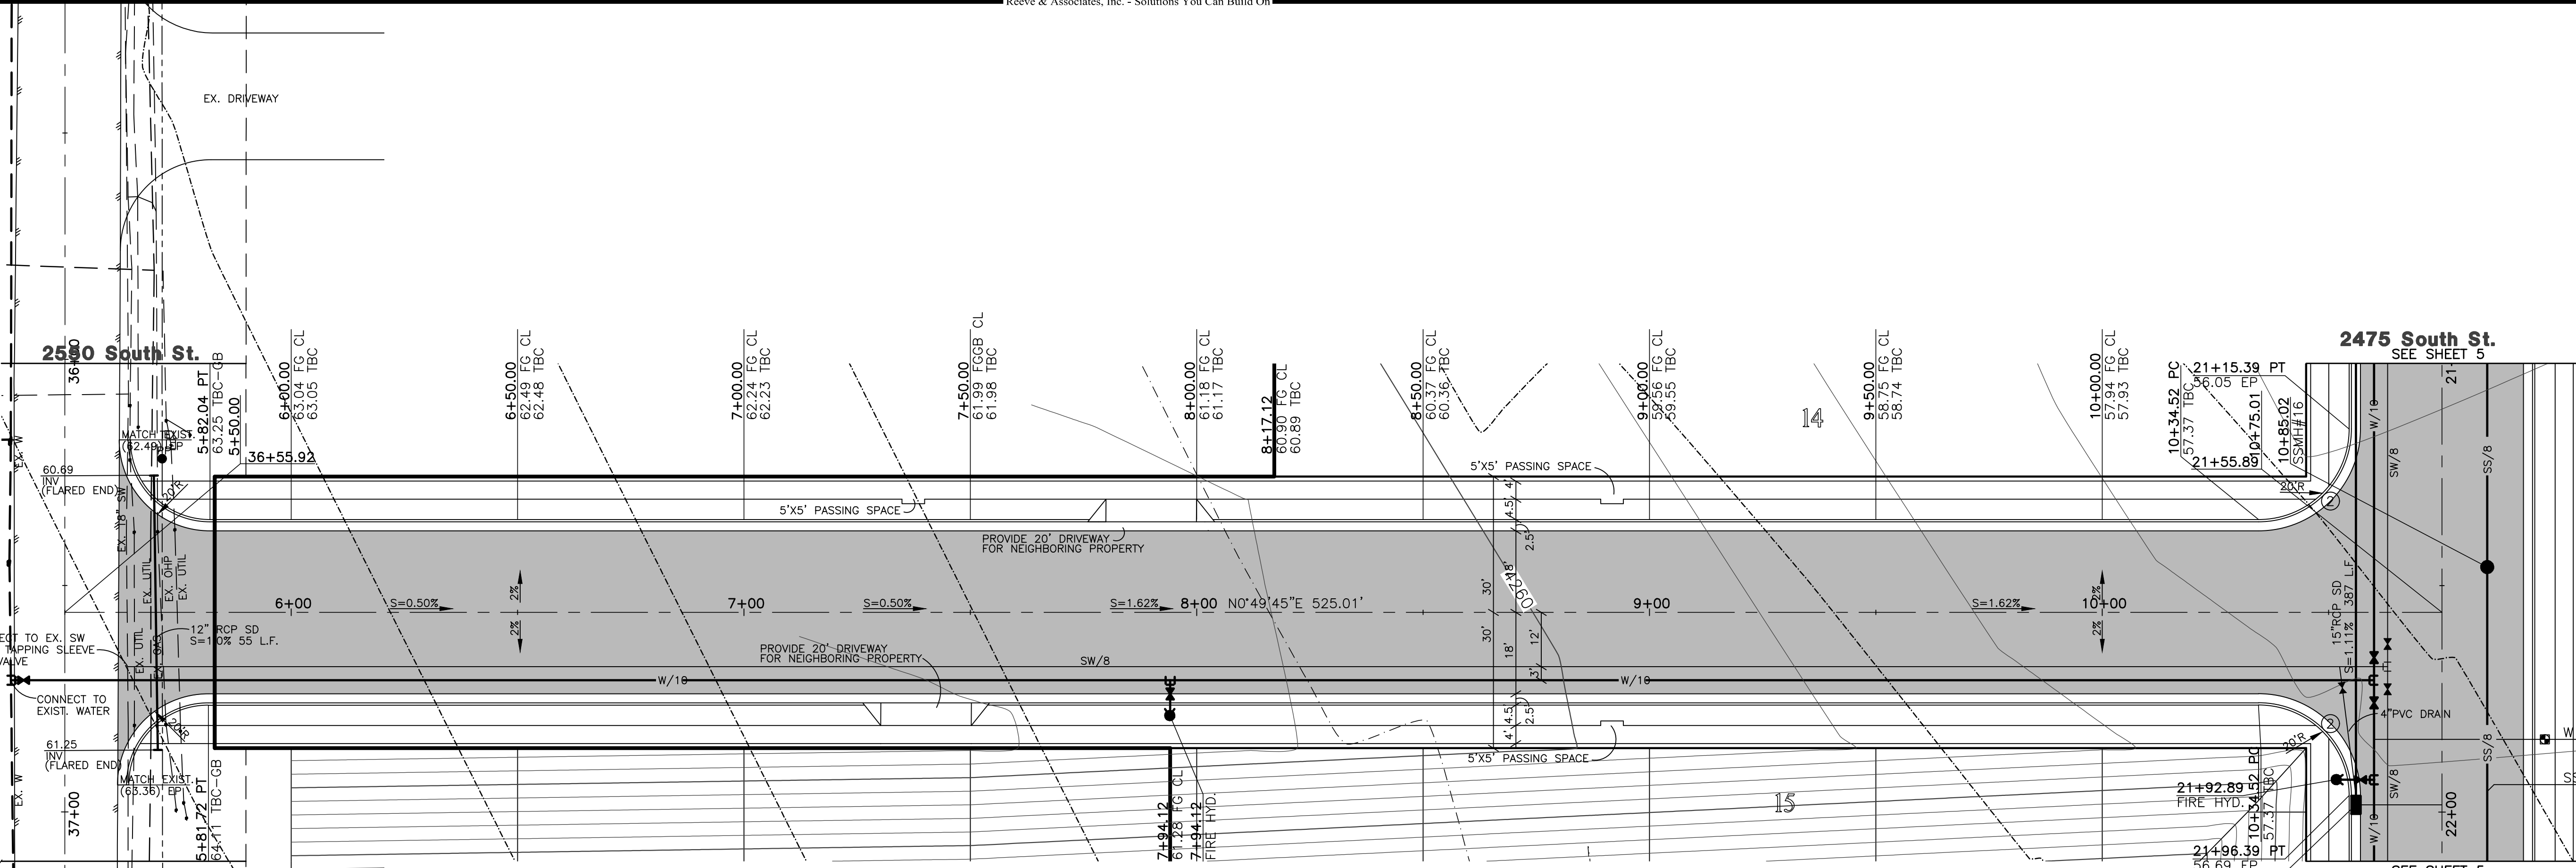

Blue Stakes Location Center  
**Call: Toll Free**  
**1-800-662-4111**  
Two Working Days **2026** You Dig

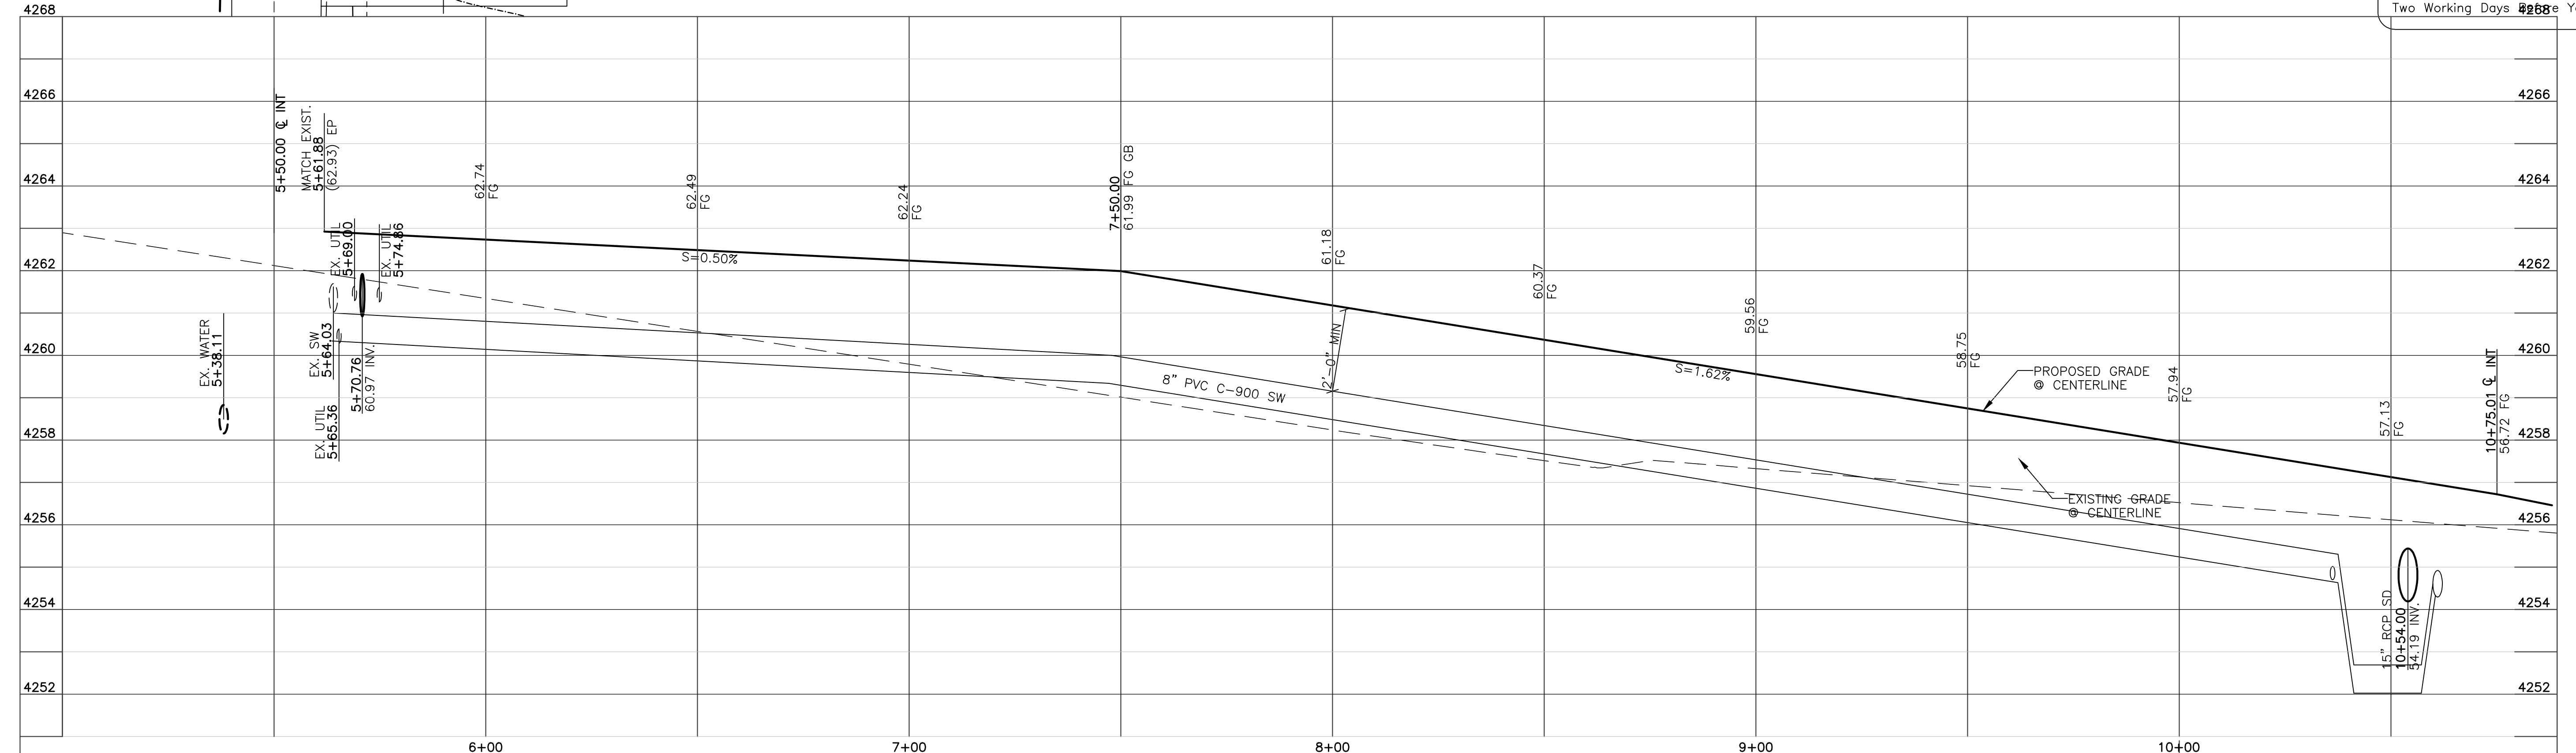

**Reeve & Associates, Inc.**  
920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403  
TEL: (801) 921-3100 FAX: (801) 621-2666 www.reeve-assoc.com  
TRA REGISTERED PROFESSIONAL ENGINEER UTAH

**REVISIONS**

DATE	DESCRIPTION
9-30-14	ST County Comments
10-9-14	ST County Comments
11-3-14	RH Sewer Revisions
11-24-14	ST HIC Comments
2-18-15	ST County Comments
5-9-15	ST County Comments
3-31-16	TP Detention Update

**Mallard Springs Subdivision**  
WEBER COUNTY, UTAH  
**4050 West Street**  
**5+50.00 - 11+00.00**




**Revised: 5-18-15**

REGISTERED PROFESSIONAL ENGINEER  
375328  
J. NATE REEVE  
STATE OF UTAH

**Project Info.**  
Engineer: J. NATE REEVE, P.E.  
Drafter: R. HANSEN  
Begin Date: NOVEMBER 4, 2013  
Name: MALLARD SPRINGS SUBDIVISION  
Number: 3442-A30

Sheet **20**  
**3** Sheets



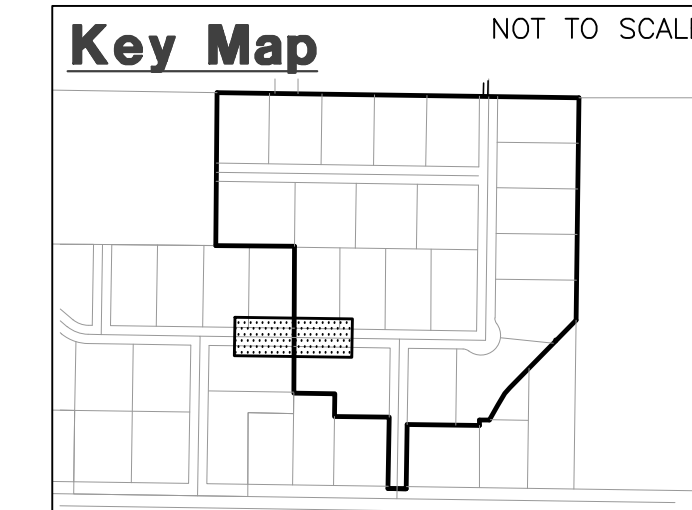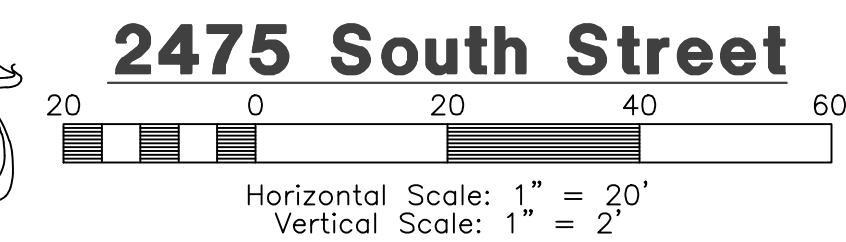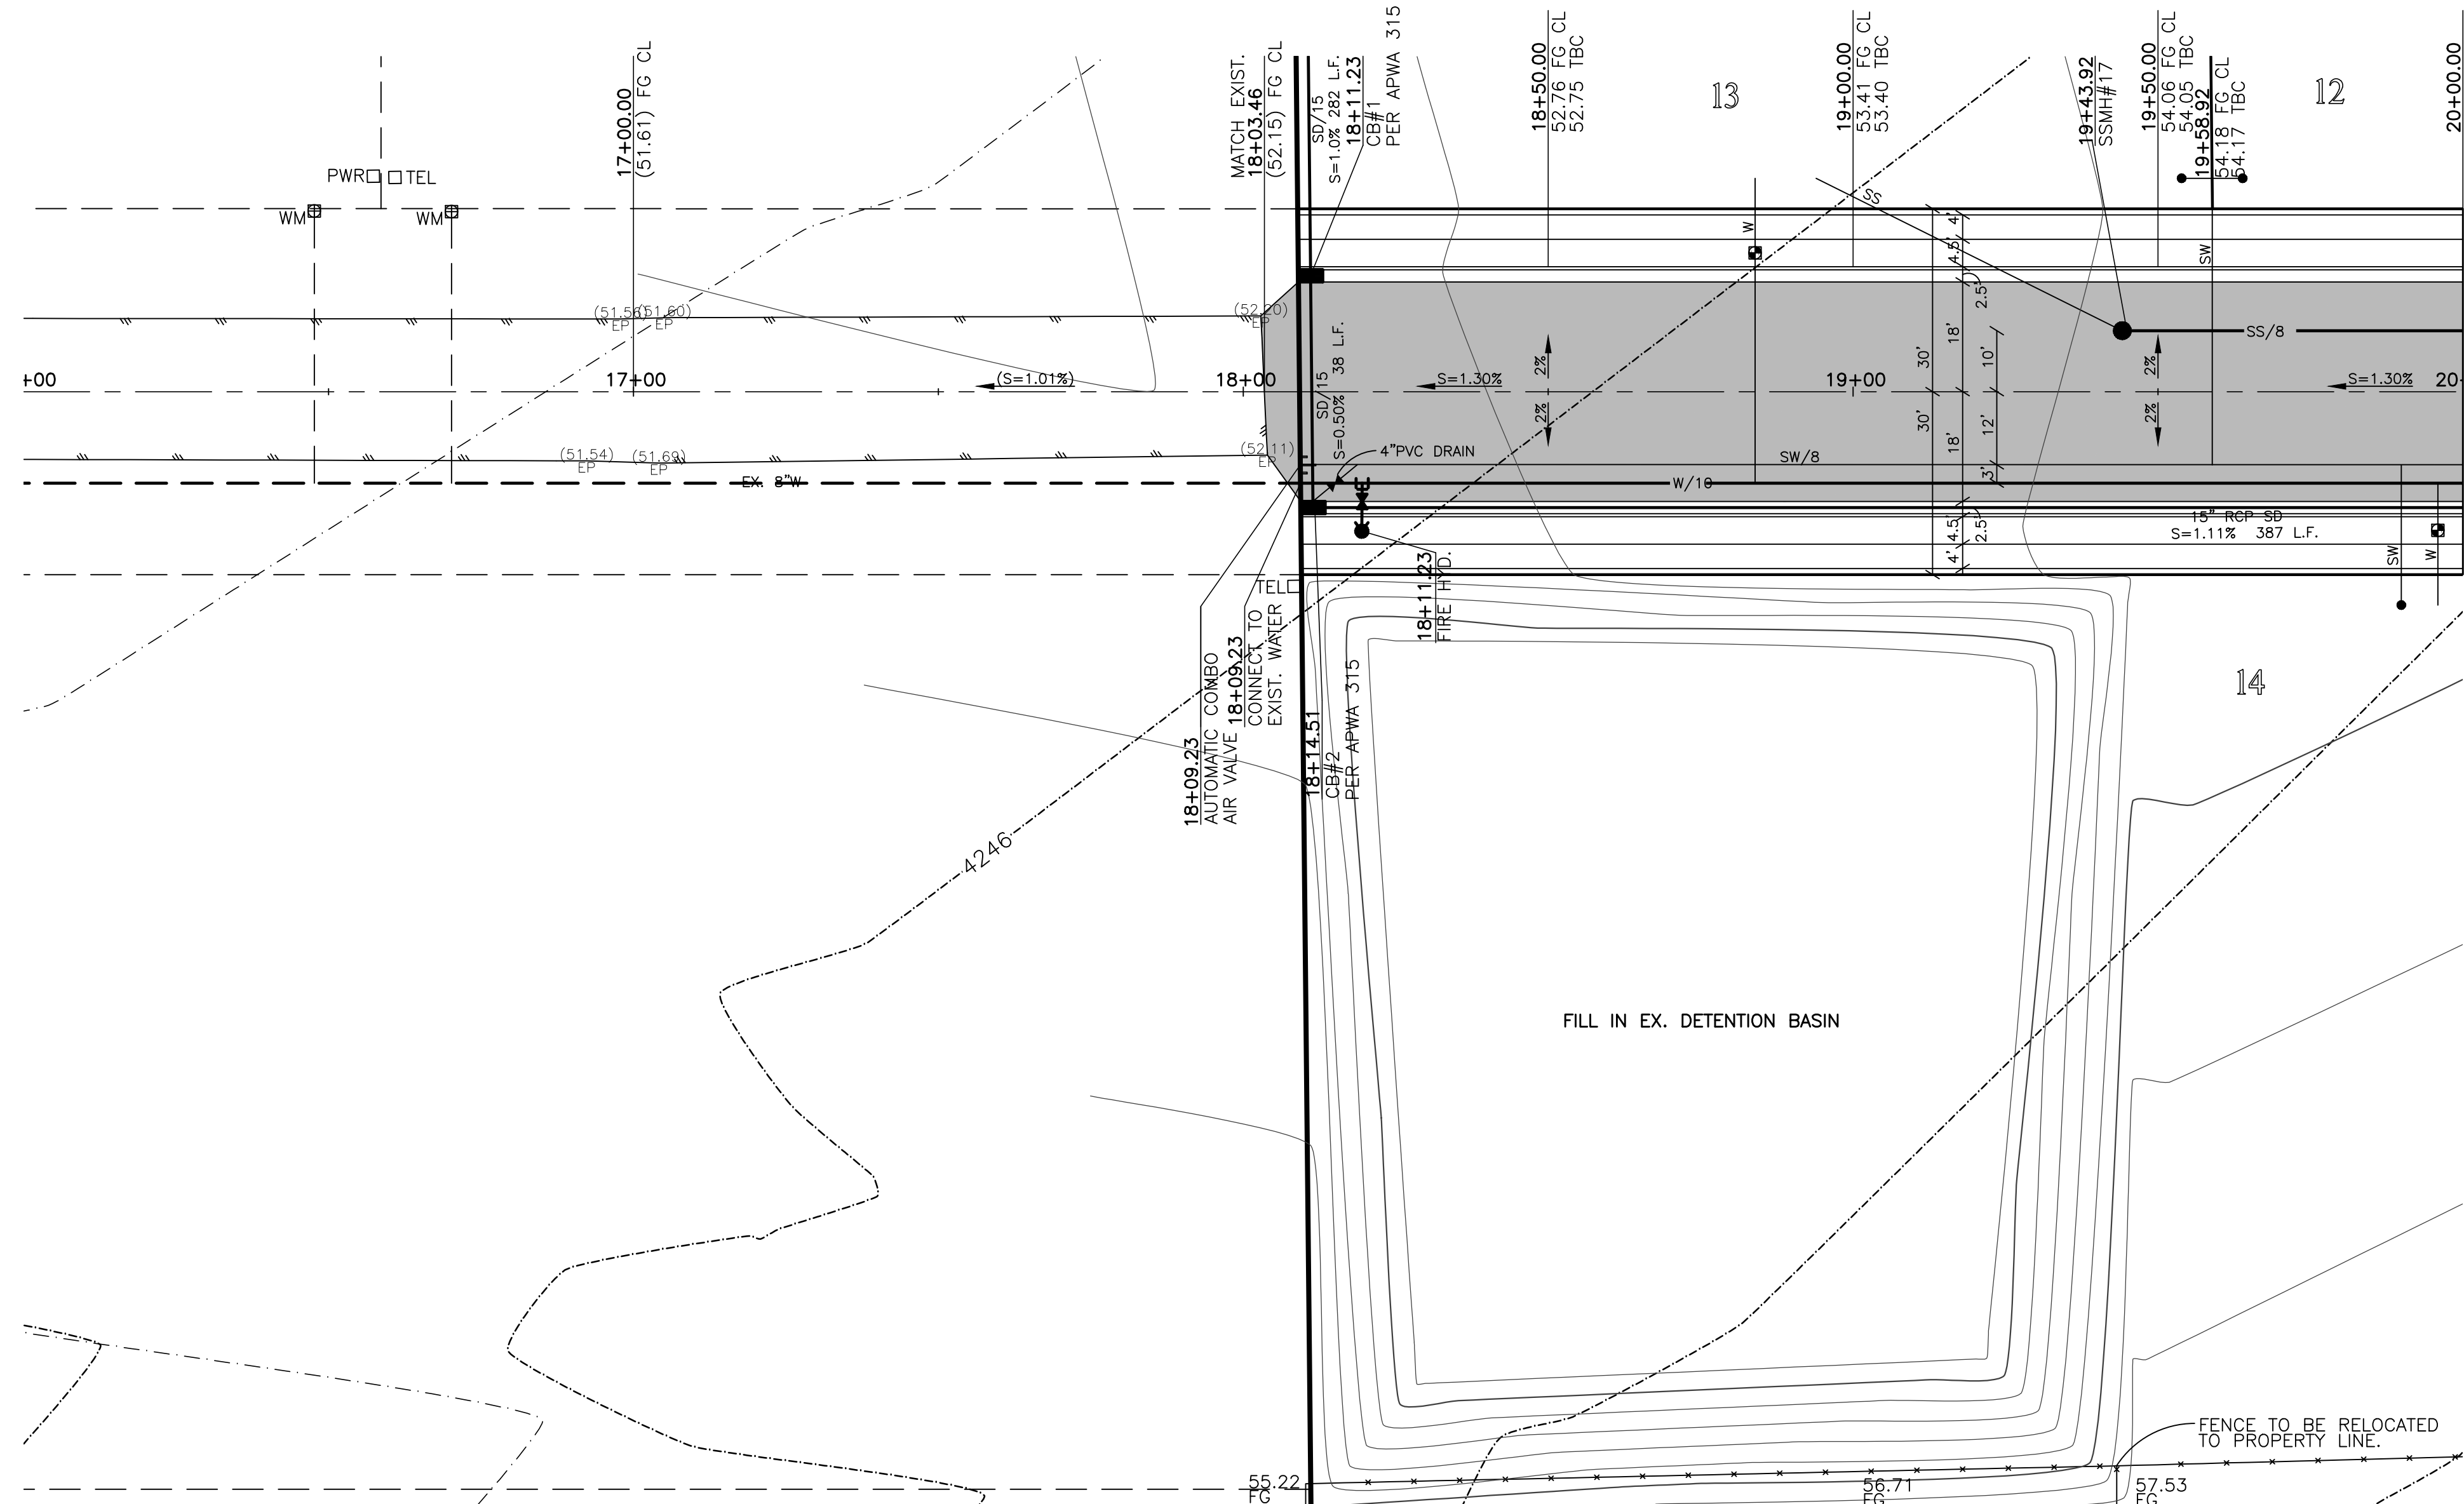

**Construction Notes:**

- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
- 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.

**CULINARY WATER**

W/8 - 8" PVC C-900 CLASS 200 WATER

**SANITARY SEWER**

SS/8 - 8" ASTM D3034 SDR 35 SEWER  
 SS/12 - 12" ASTM D3034 SDR 35 SEWER

**STORM DRAIN**

SD/15 - 15" RCP STORM DRAIN


**SECONDARY WATER**

SW/8 - 8" PVC C-900 SECONDARY WATER LINE

**Canal Crossing Notes**

- 1) ANY CROSSING OF THE HOOPER IRR. CANALS MUST OBTAIN A LICENSE AGREEMENT.
- 2) THE SEWER LINE MUST BE INSTALLED IN AN 18" STEEL CASING EXTENDING 4'-0" BEYOND HIGH BANK BOTH SIDES OF THE CANAL ACCORDING TO HOOPER IRR. COMPANY STANDARD DETAILS.
- 3) NO DRAINAGE FROM THE DEVELOPMENT IS ALLOWED INTO THE CANAL SYSTEM.
- 4) ALL CONSTRUCTION TO BE DONE IN ACCORDANCE WITH HOOPER IRR. COMPANY STANDARDS.

Reeve & Associates, Inc. - Solutions You Can Build On

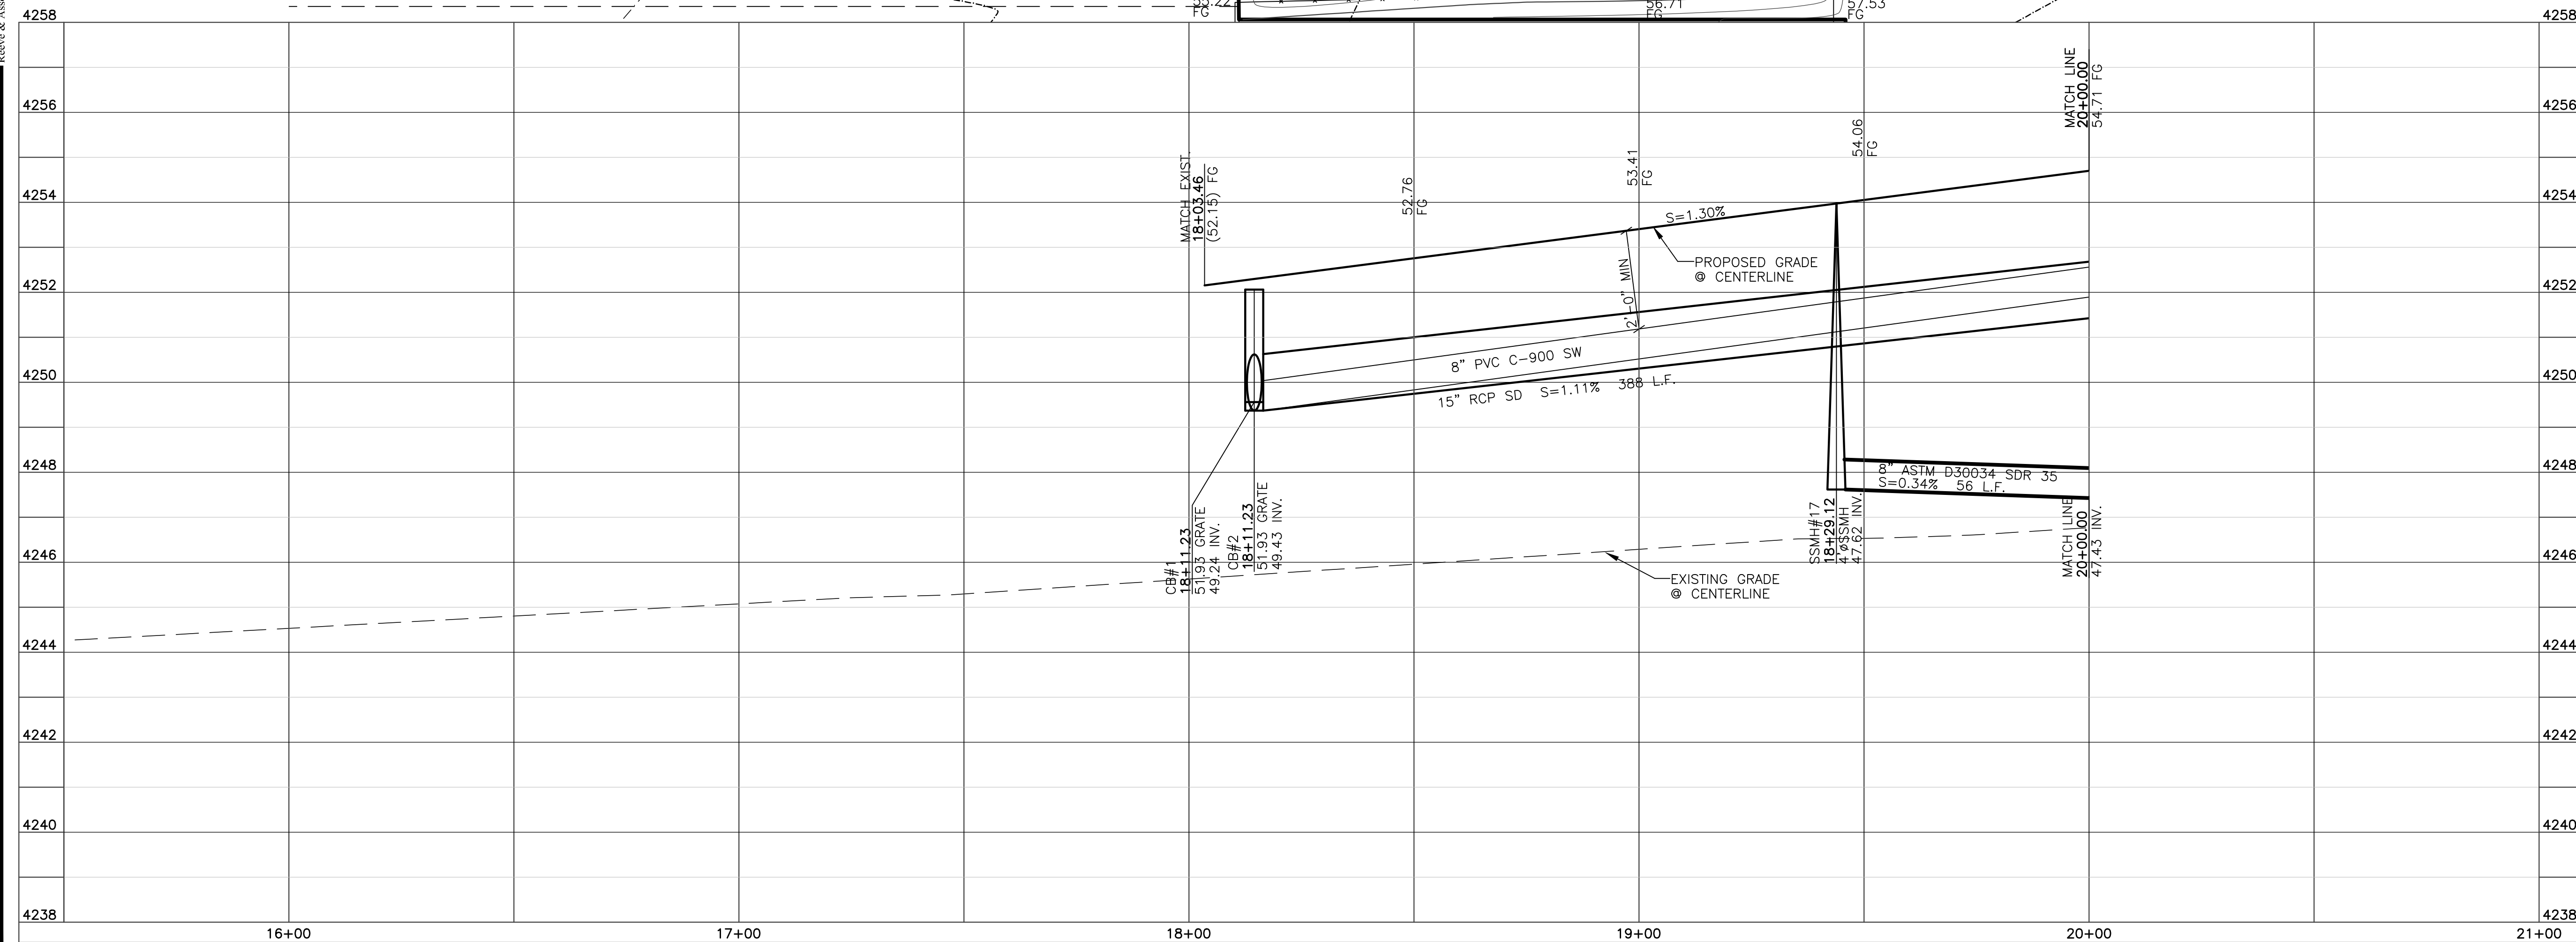

Revised: 5-18-15


Reeve & Associates, Inc. - Solutions You Can Build On

**Reeve & Associates, Inc.**  
 920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403  
 TEL: (801) 621-3100 FAX: (801) 621-2666 www.reeve-associates.com  
 CIVIL ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

DATE	DESCRIPTION
9-30-14	ST. County Comments
10-9-14	ST. County Comments
11-3-14	RH. Sewer Revisions
11-24-14	ST. HIC Comments
2-18-15	ST. County Comments
5-9-15	ST. County Comments
3-31-16	TP. Detention Update

**Mallard Springs Subdivision**  
 WEBER COUNTY, UTAH

**2475 South Street**  
**16+00.00 - 20+00.00**



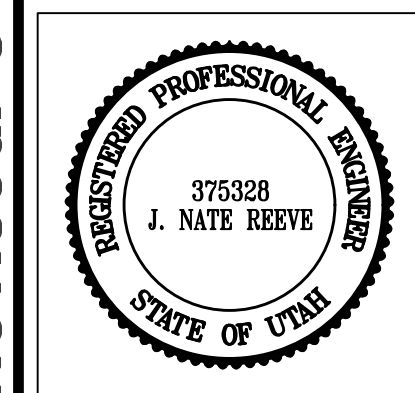


**Project Info.**

Engineer: J. NATE REEVE, P.E.  
 Drafter: R. HANSEN  
 Begin Date: NOVEMBER 4, 2013  
 Name: MALLARD SPRINGS SUBDIVISION  
 Number: 3442-A30

Blue Stakes Location Center  
**Call: Toll Free 1-800-662-4111**  
 Two Working Days Before You Dig



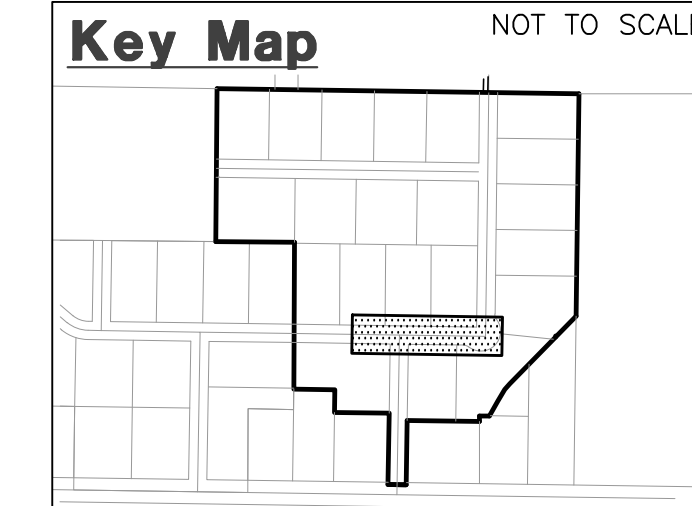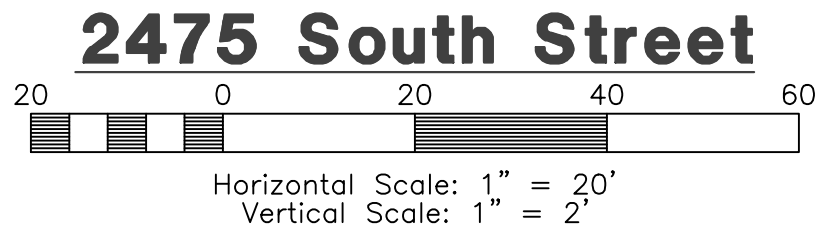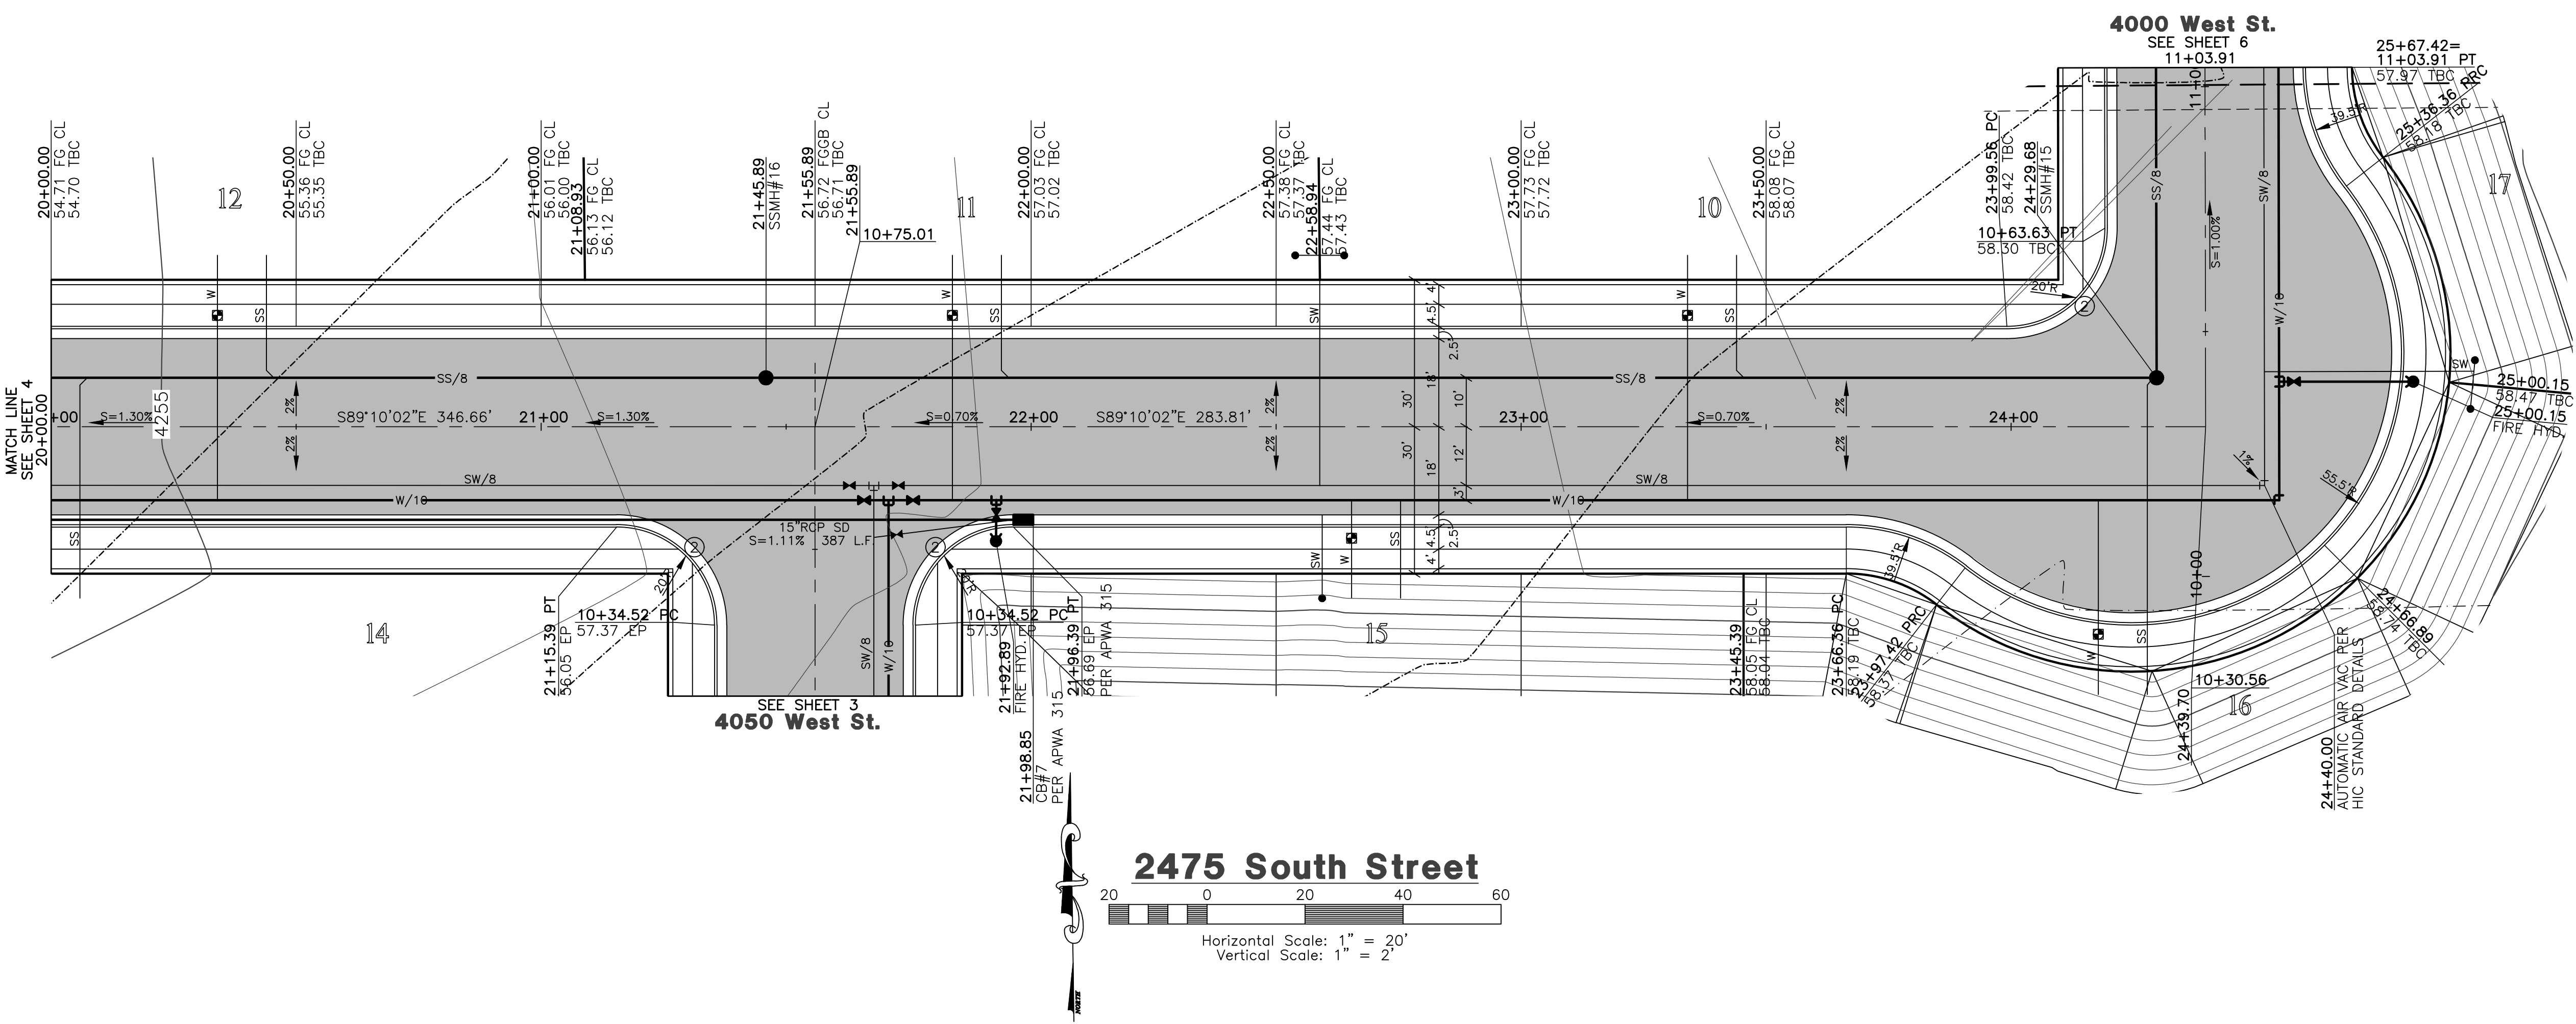


**Construction Notes:**

- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
  - 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.
- CULINARY WATER**  
W/8 - 8" PVC C-900 CLASS 200 WATER
- SANITARY SEWER**  
SS/8 - 8" ASTM D3034 SDR 35 SEWER  
SS/12 - 12" ASTM D3034 SDR 35 SEWER
- STORM DRAIN**  
SD/15 - 15" RCP STORM DRAIN
- SECONDARY WATER**  
SW/8 - 8" PVC C-900 SECONDARY WATER LINE

**Canal Crossing Notes**

- 1) ANY CROSSING OF THE HOOPER IRR. CANALS MUST OBTAIN A LICENSE AGREEMENT.
- 2) THE SEWER LINE MUST BE INSTALLED IN AN 18" STEEL CASING EXTENDING 4'-0" BEYOND HIGH BANK BOTH SIDES OF THE CANAL ACCORDING TO HOOPER IRR. COMPANY STANDARD DETAILS.
- 3) NO DRAINAGE FROM THE DEVELOPMENT IS ALLOWED INTO THE CANAL SYSTEM.
- 4) ALL CONSTRUCTION TO BE DONE IN ACCORDANCE WITH HOOPER IRR. COMPANY STANDARDS.

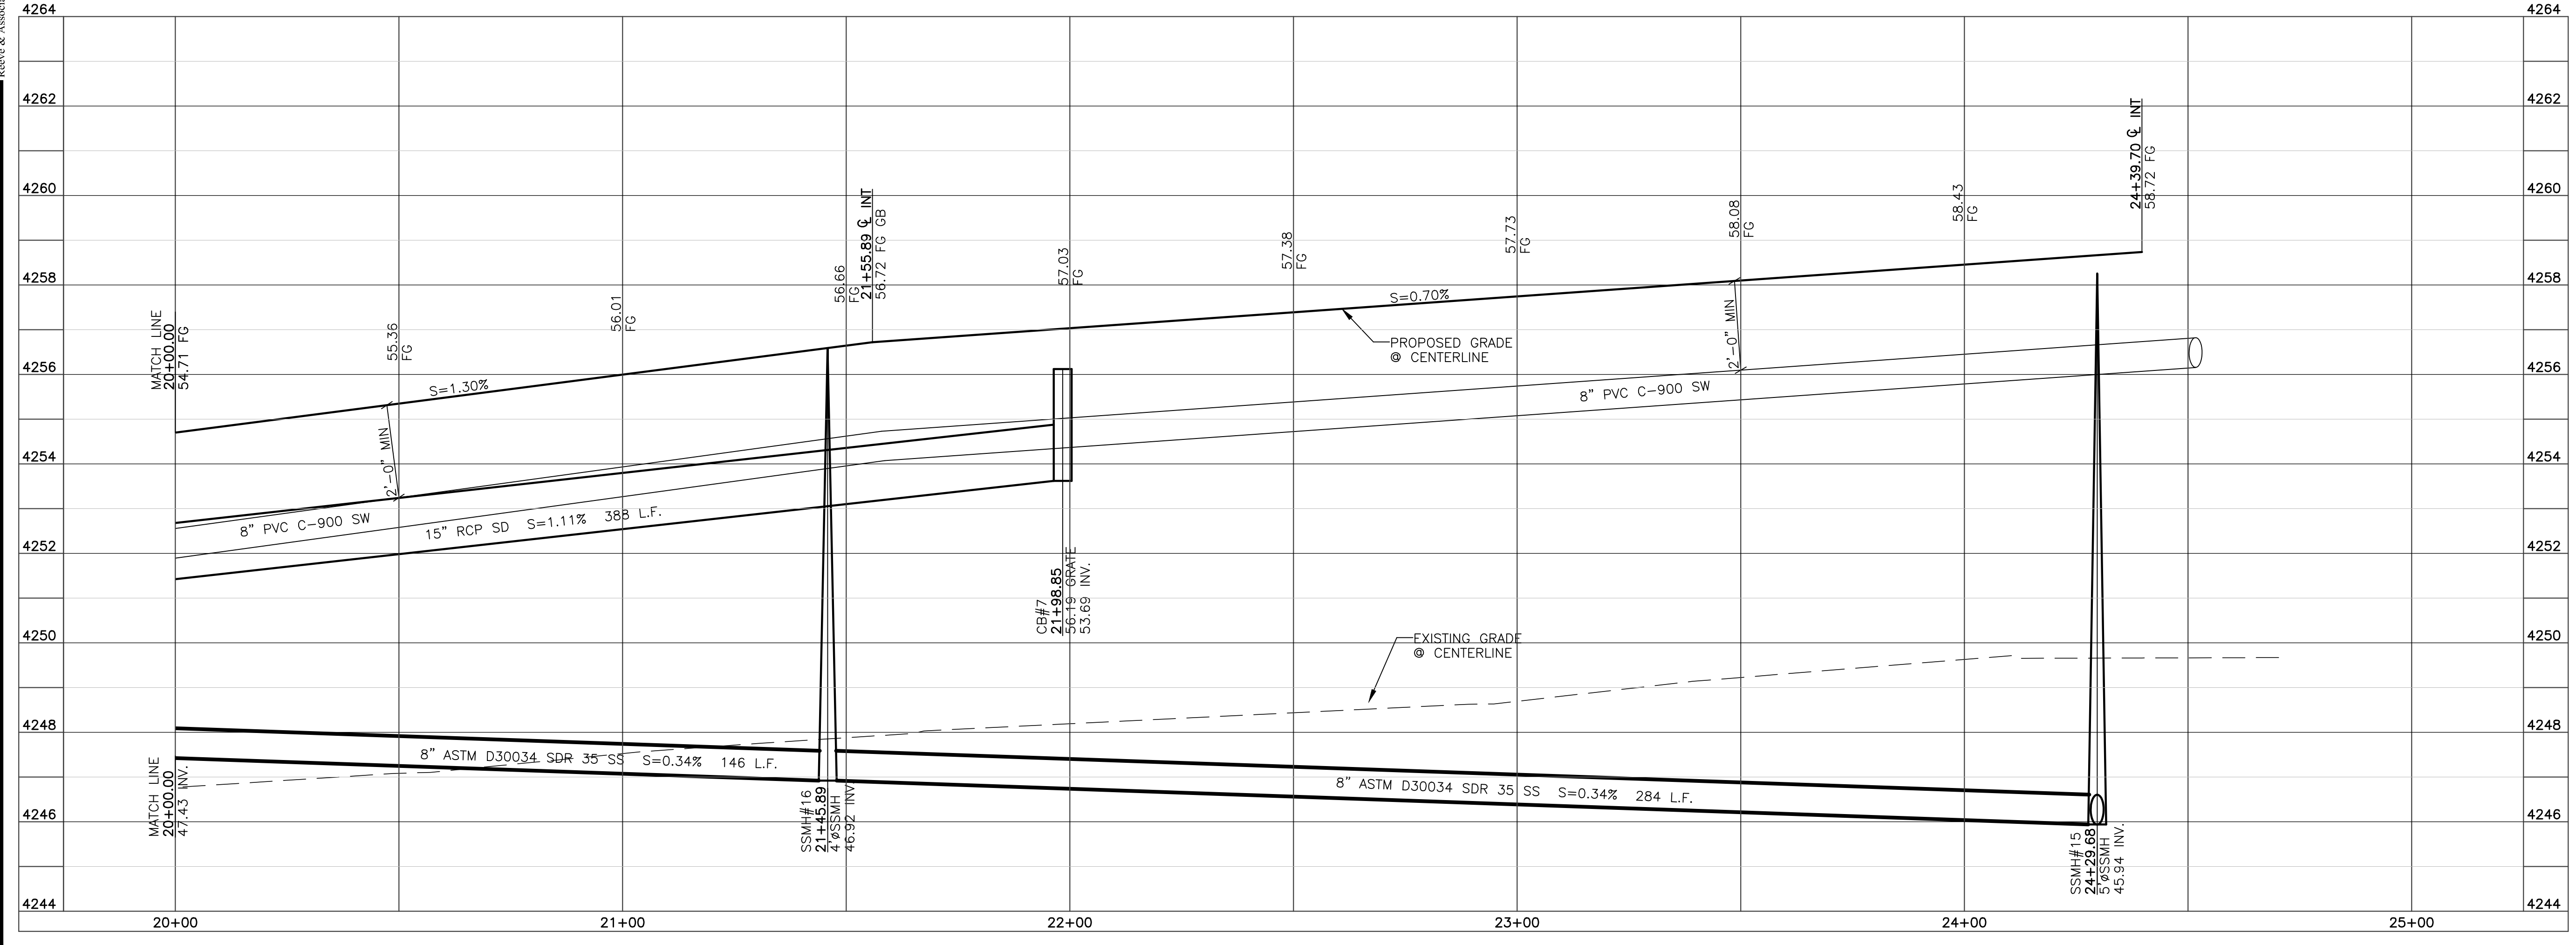

Blue Stakes Location Center  
**Call: Toll Free 1-800-662-4111**  
Two Working Days Before You Dig

**Reeve & Associates, Inc.**  
920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403  
TEL: (801) 621-3100 FAX: (801) 621-2666 www.reeve-assoc.com  
LANDSCAPE ARCHITECTS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

DATE	DESCRIPTION
9-30-14	ST. County Comments
10-9-14	ST. County Comments
11-3-14	RH. Sewer Revisions
11-24-14	ST. HIC Comments
2-18-15	ST. County Comments
5-9-15	ST. County Comments
3-31-16	TP. Detention Update

**Mallard Springs Subdivision**  
WEBER COUNTY, UTAH

**2475 South Street**  
20+00.00 - 25+00.00

**Revised: 5-18-15**




**Project Info.**

Engineer:	J. NATE REEVE, P.E.
Drafter:	R. HANSEN
Begin Date:	NOVEMBER 4, 2013
Name:	MALLARD SPRINGS SUBDIVISION
Number:	3442-A30

Sheet	<b>20</b>
<b>5</b>	Sheets



2475 South St.  
SEE SHEET 5  
23+66.36

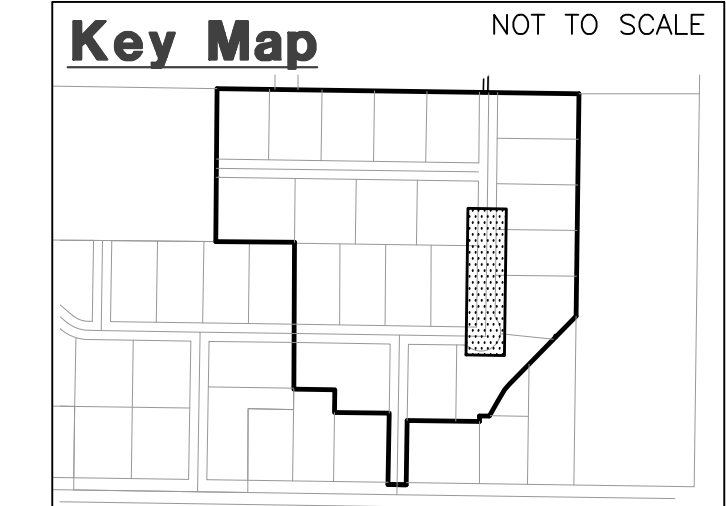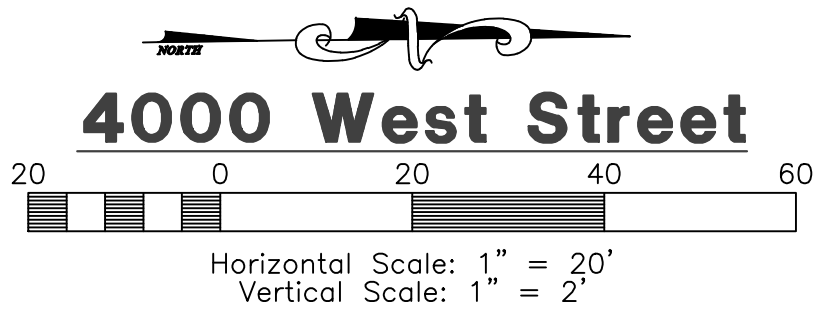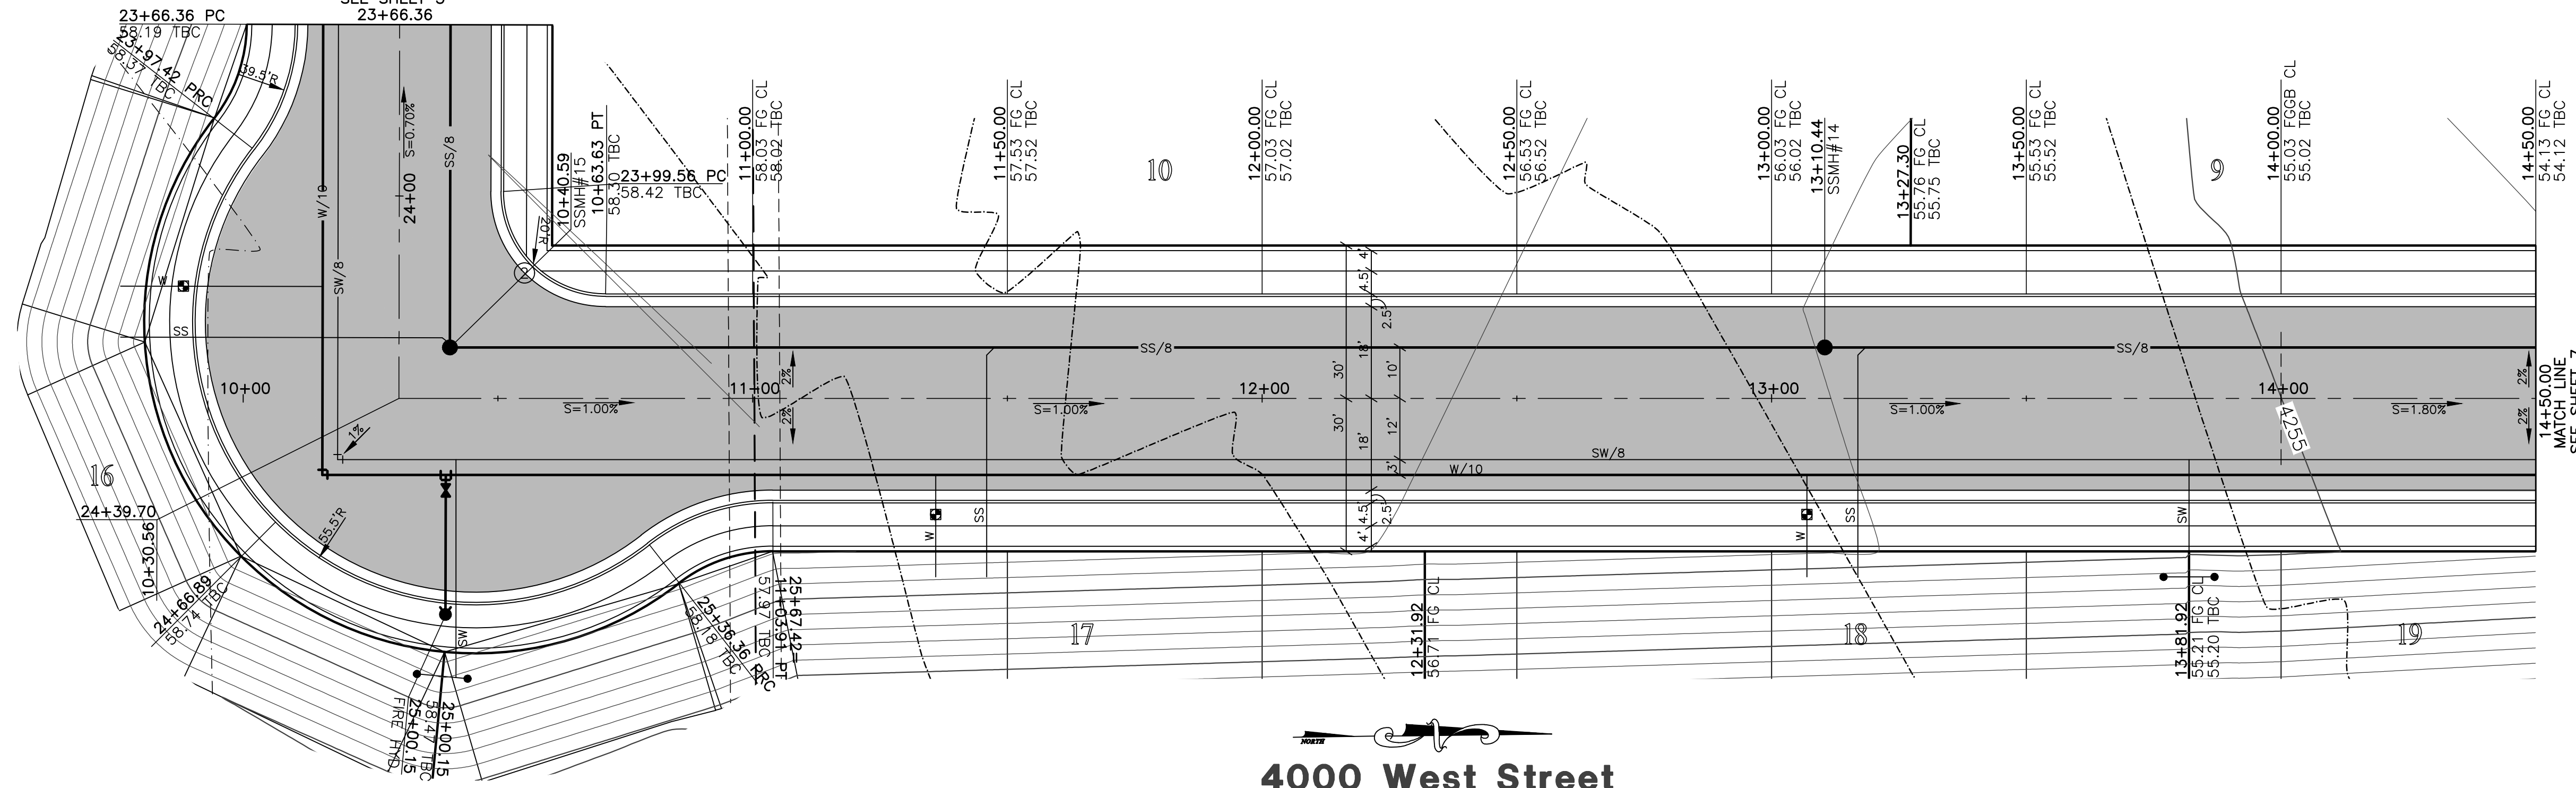

**Construction Notes:**

- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
- 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.

**CULINARY WATER**  
W/8 - 8" PVC C-900 CLASS 200 WATER


**SANITARY SEWER**  
SS/8 - 8" ASTM D3034 SDR 35 SEWER  
SS/12 - 12" ASTM D3034 SDR 35 SEWER

**STORM DRAIN**  
SD/15 - 15" RCP STORM DRAIN

**SECONDARY WATER**  
SW/8 - 8" PVC C-900 SECONDARY WATER LINE

**Canal Crossing Notes**

- 1) ANY CROSSING OF THE HOOPER IRR. CANALS MUST OBTAIN A LICENSE AGREEMENT.
- 2) THE SEWER LINE MUST BE INSTALLED IN AN 18" STEEL CASING EXTENDING 4'-0" BEYOND HIGH BANK BOTH SIDES OF THE CANAL ACCORDING TO HOOPER IRR. COMPANY STANDARD DETAILS.
- 3) NO DRAINAGE FROM THE DEVELOPMENT IS ALLOWED INTO THE CANAL SYSTEM.
- 4) ALL CONSTRUCTION TO BE DONE IN ACCORDANCE WITH HOOPER IRR. COMPANY STANDARDS.

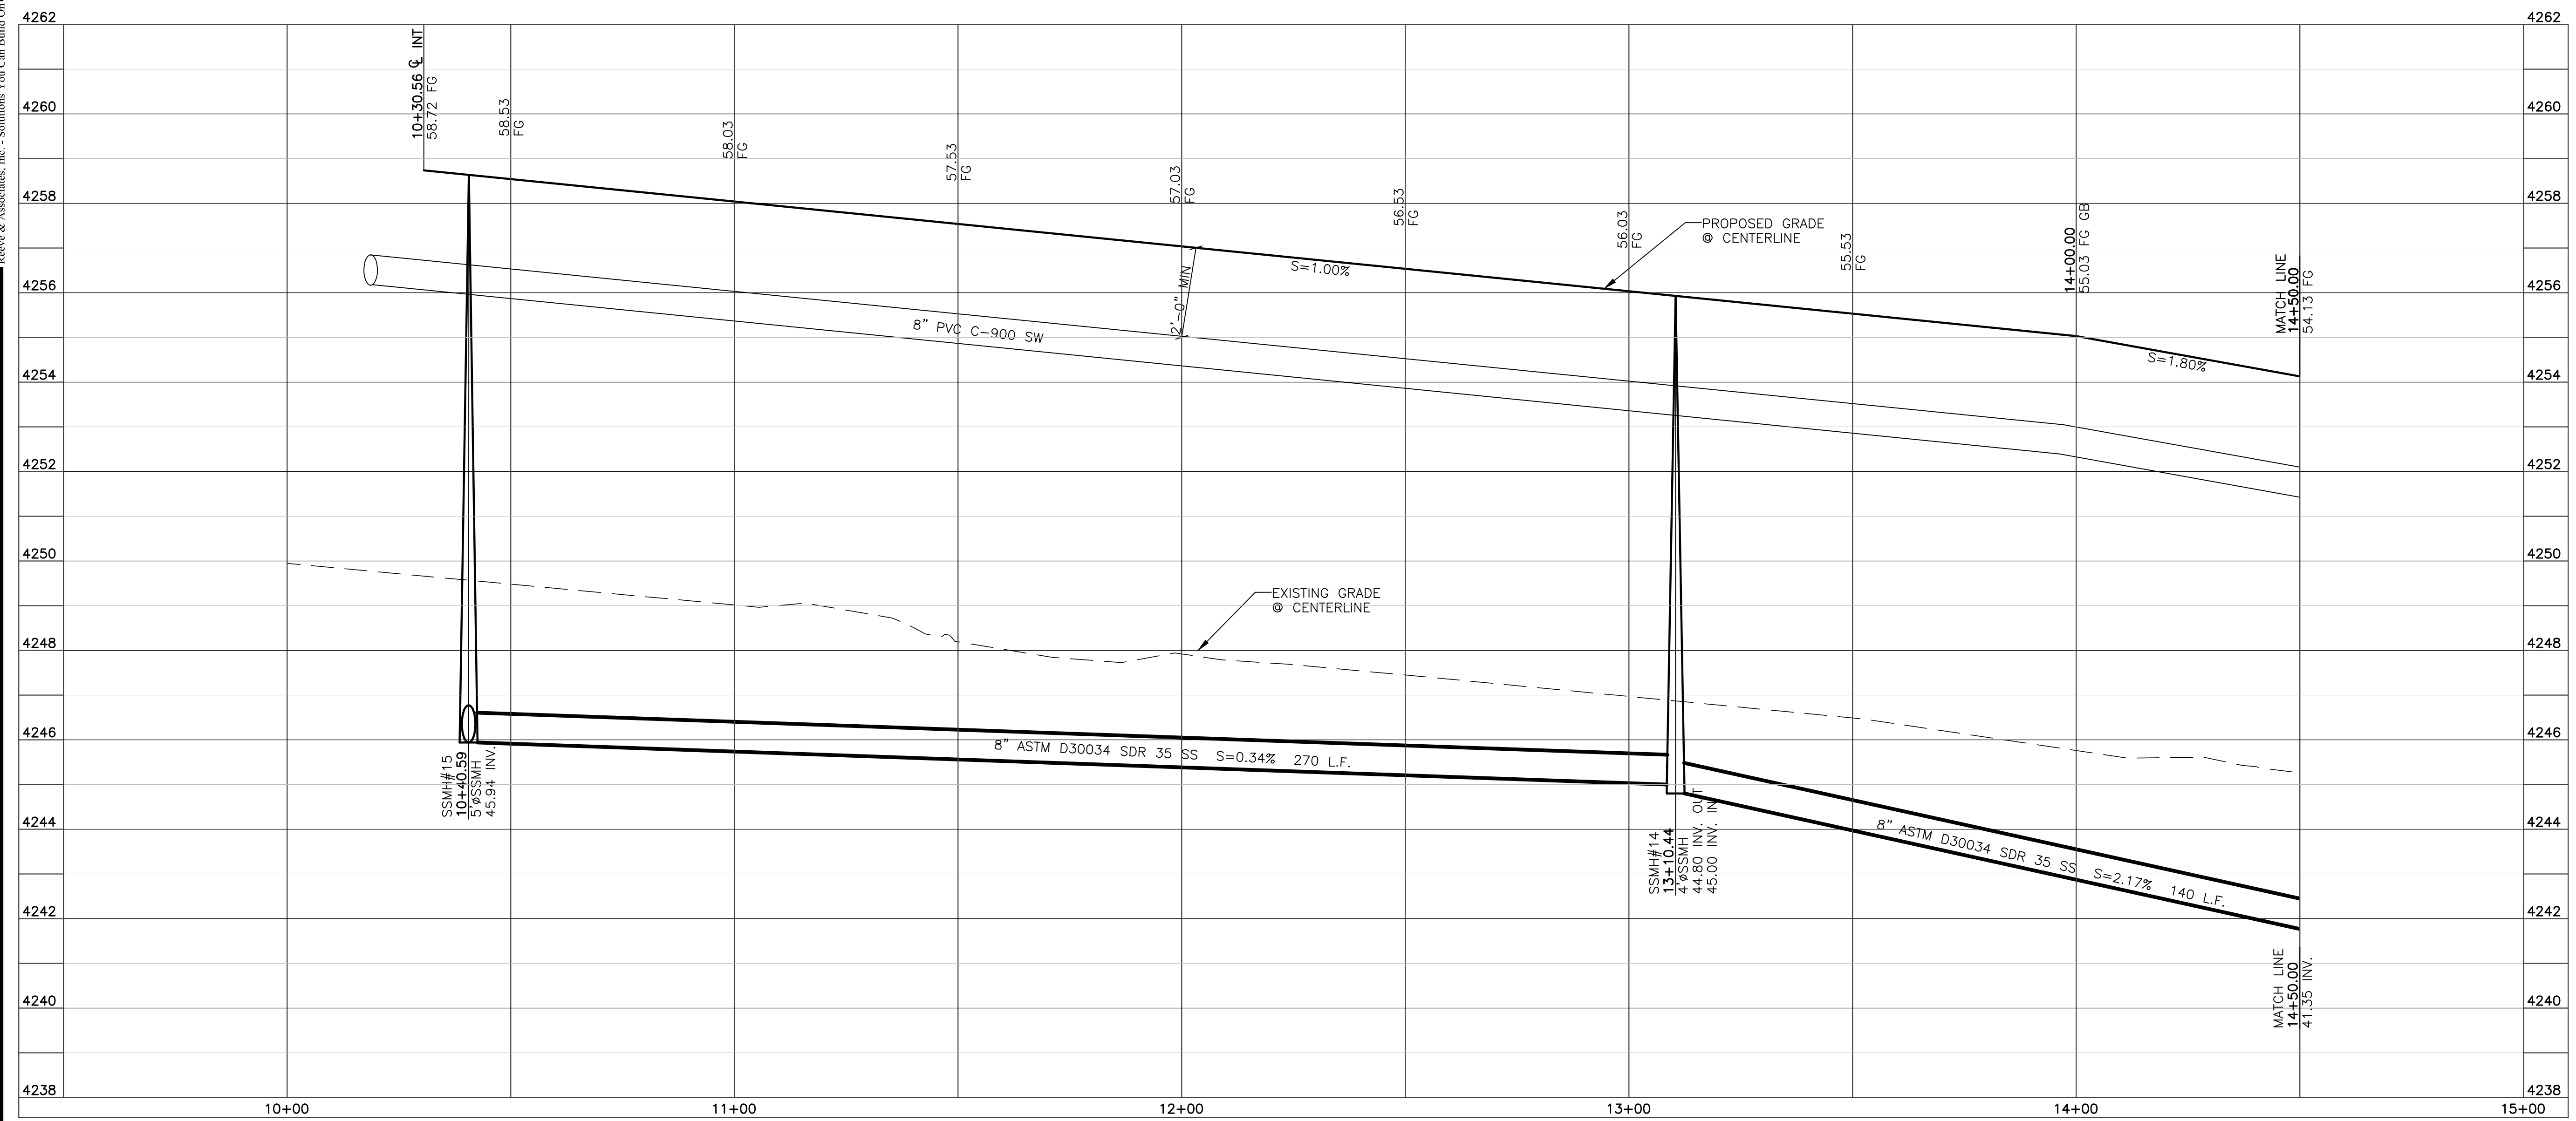

**Reeve & Associates, Inc.**  
920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403  
TEL: (801) 621-5100 FAX: (801) 621-2666 www.reeve-assoc.com  
LANDSCAPE ARCHITECTS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

DATE	DESCRIPTION
9-30-14	ST. County Comments
10-9-14	ST. County Comments
11-3-14	RH. Sewer Revisions
11-24-14	ST. HIC Comments
2-18-15	ST. County Comments
5-9-15	ST. County Comments
3-31-16	TP. Detention Update

**Mallard Springs Subdivision**  
WEBER COUNTY, UTAH

**4000 West Street**  
**10+00.00 - 14+50.00**



**Revised: 5-18-15**

**Project Info.**

Engineer:	J. NATE REEVE, P.E.
Drafter:	R. HANSEN
Begin Date:	NOVEMBER 4, 2013
Name:	MALLARD SPRINGS SUBDIVISION
Number:	3442-A30

Blue Stakes Location Center  
**Call: Toll Free 1-800-662-4111**  
Two Working Days Before You Dig



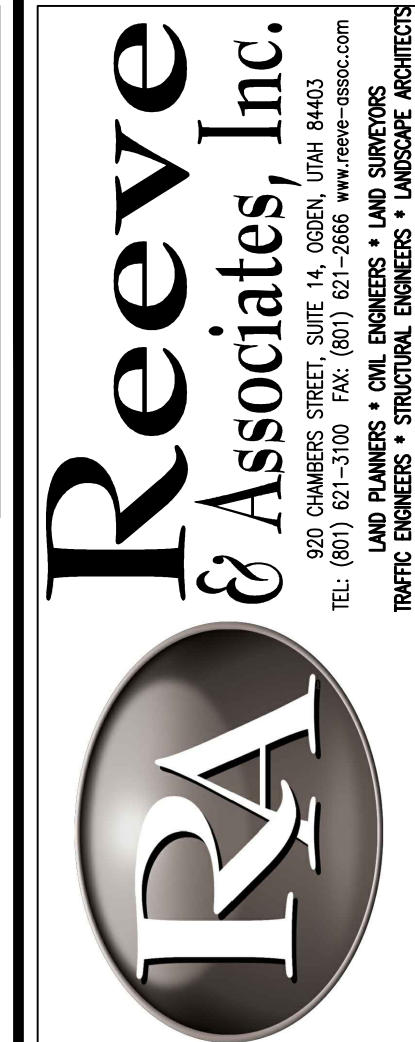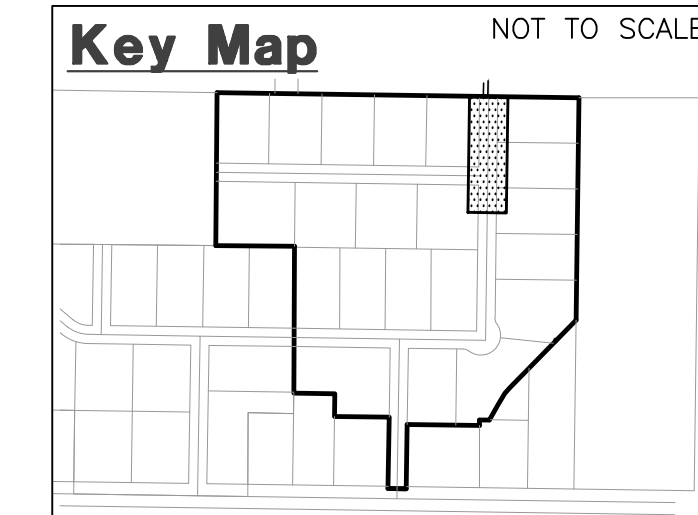

DATE	DESCRIPTION
9-30-14	ST County Comments
10-9-14	ST County Comments
11-3-14	RH Sewer Revisions
11-24-14	ST HIC Comments
2-18-15	ST County Comments
5-9-15	ST County Comments
3-31-16	TP Detention Update

**Construction Notes:**

- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
- 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.

**CULINARY WATER**

W/8 - 8" PVC C-900 CLASS 200 WATER

**SANITARY SEWER**

SS/8 - 8" ASTM D3034 SDR 35 SEWER  
SS/12 - 12" ASTM D3034 SDR 35 SEWER

**STORM DRAIN**


SD/15 - 15" RCP STORM DRAIN

**SECONDARY WATER**

SW/8 - 8" PVC C-900 SECONDARY WATER LINE

**Canal Crossing Notes**

- 1) ANY CROSSING OF THE HOOPER IRR. CANALS MUST OBTAIN A LICENSE AGREEMENT.
- 2) THE SEWER LINE MUST BE INSTALLED IN AN 18" STEEL CASING EXTENDING 4'-0" BEYOND HIGH BANK BOTH SIDES OF THE CANAL ACCORDING TO HOOPER IRR. COMPANY STANDARD DETAILS.
- 3) NO DRAINAGE FROM THE DEVELOPMENT IS ALLOWED INTO THE CANAL SYSTEM.
- 4) ALL CONSTRUCTION TO BE DONE IN ACCORDANCE WITH HOOPER IRR. COMPANY STANDARDS.

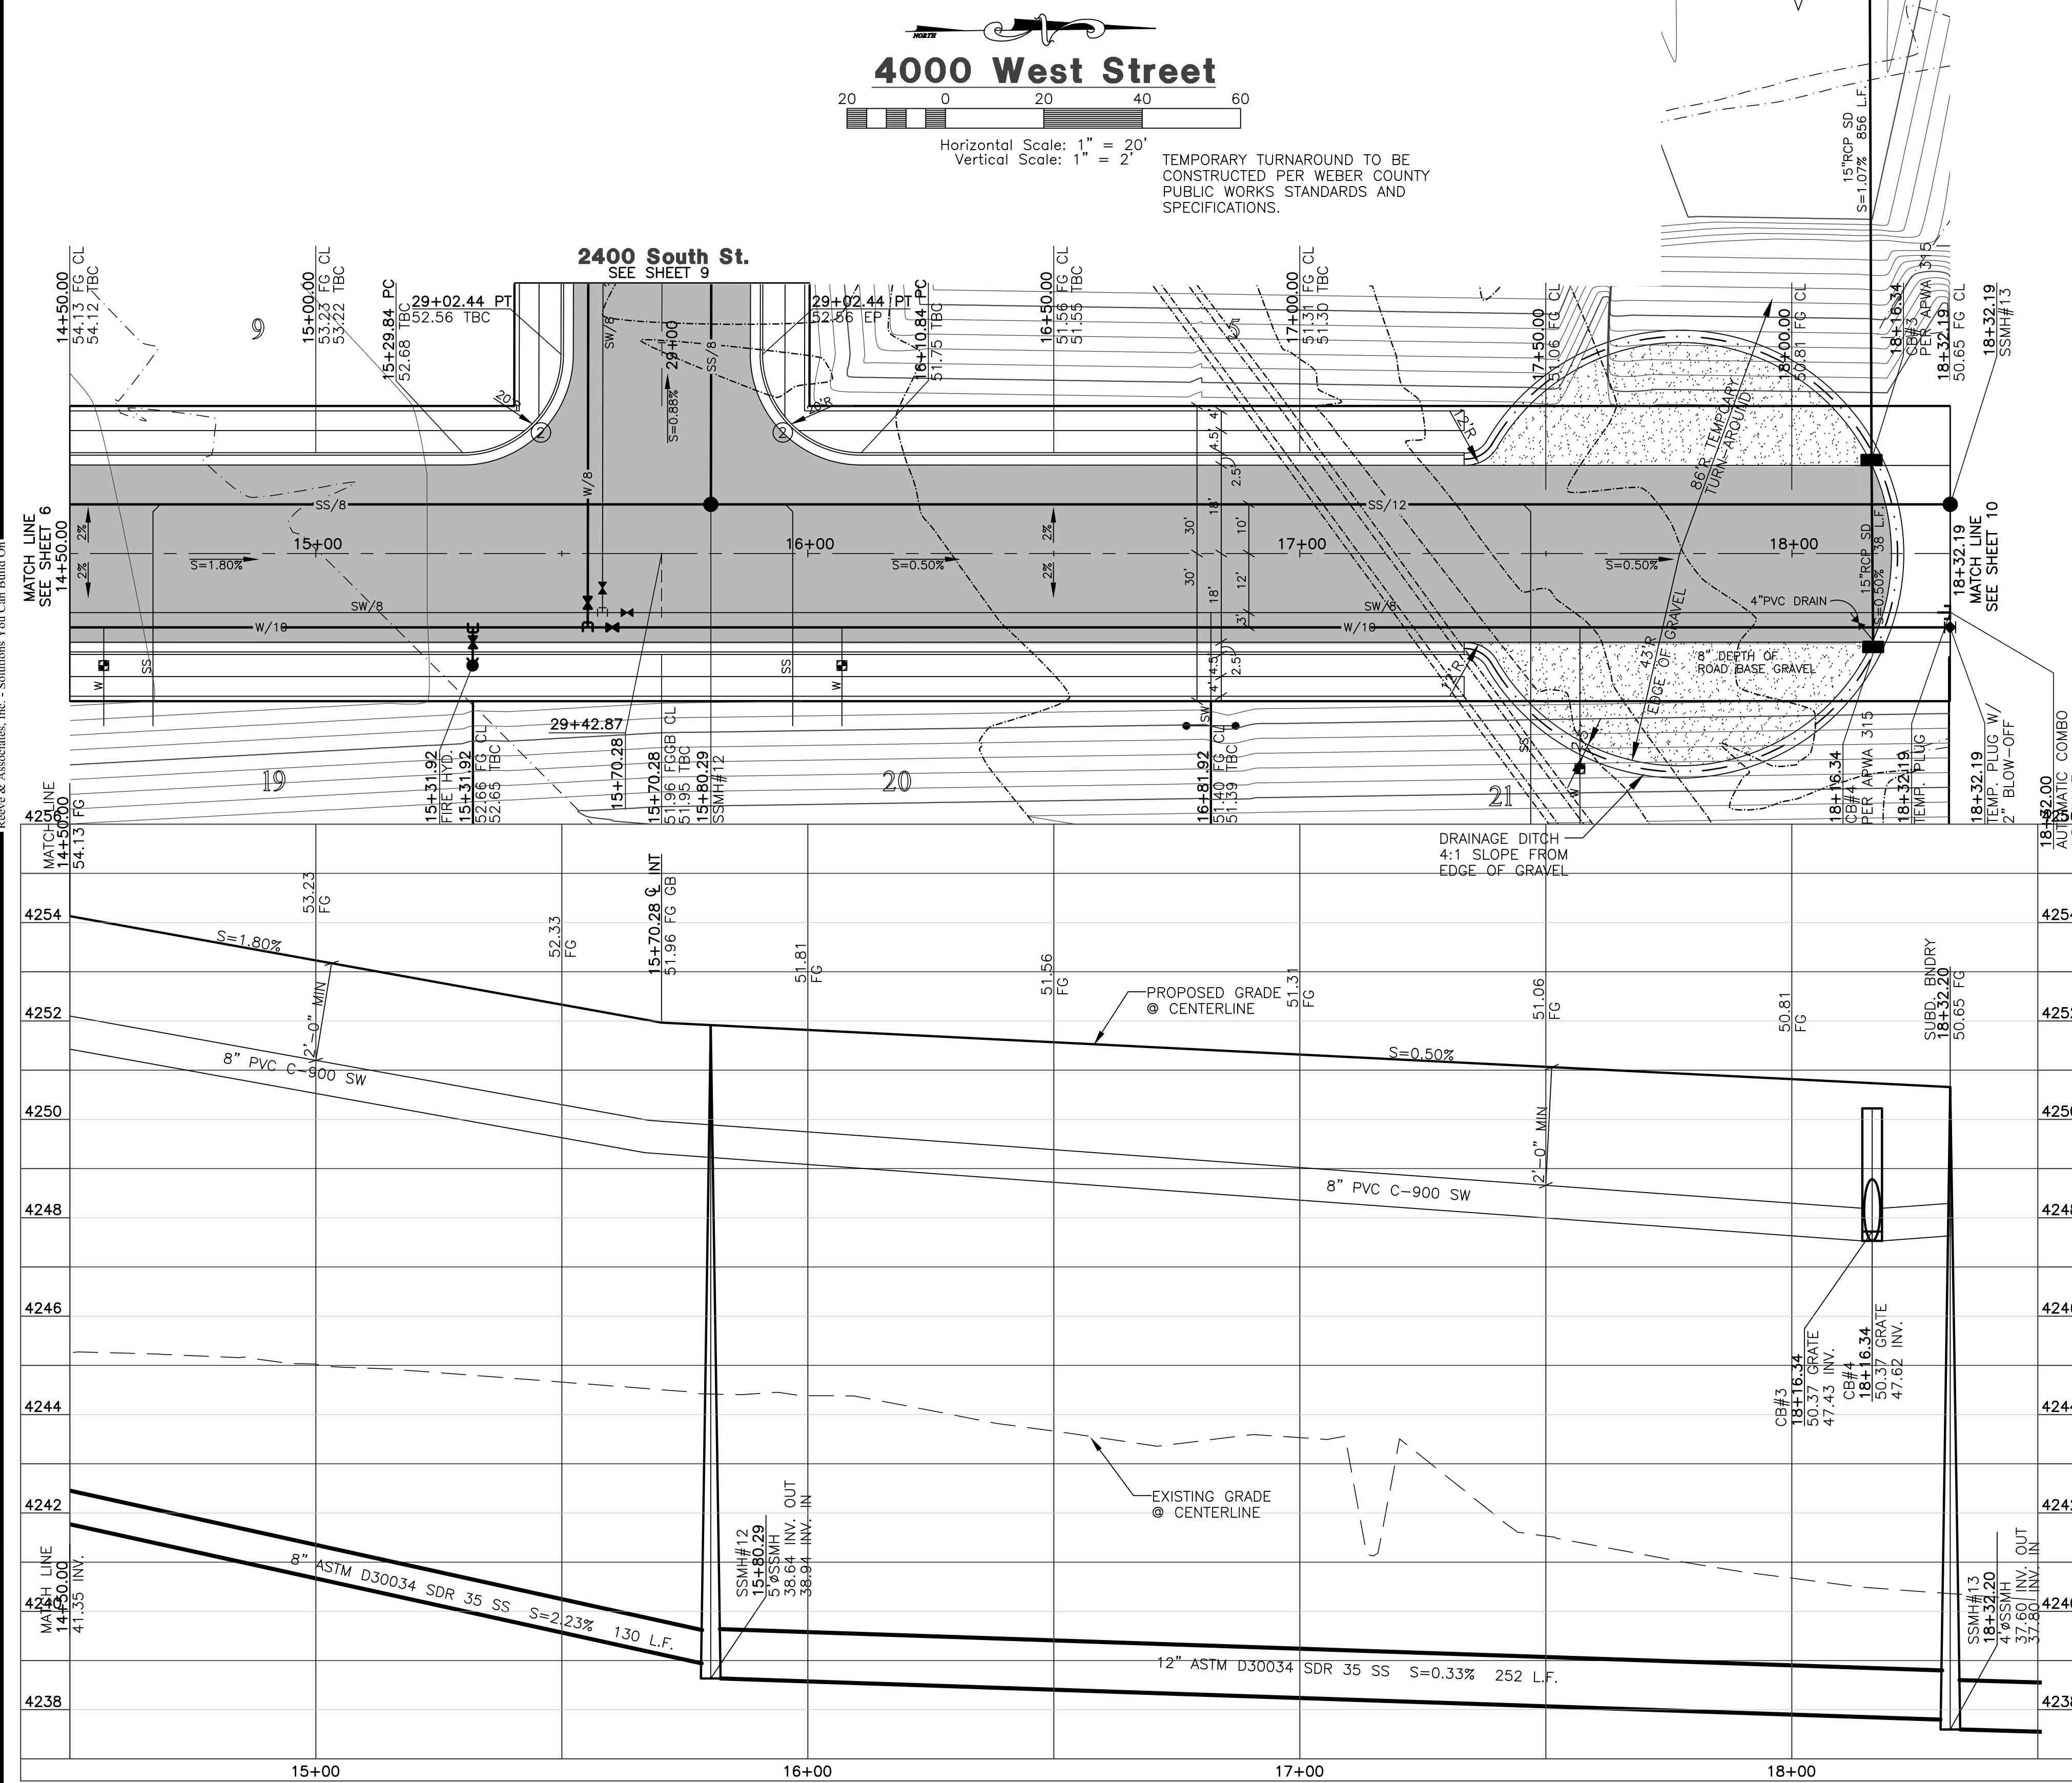

MATCH LINE SEE SHEET 6

MATCH LINE SEE SHEET 6

MATCH LINE SEE SHEET 10

Revised: 5-18-15





**Project Info.**

Engineer: J. NATE REEVE, P.E.  
 Drafter: R. HANSEN  
 Begin Date: NOVEMBER 4, 2013  
 Name: MALLARD SPRINGS SUBDIVISION  
 Number: 3442-A30

Blue Stakes Location Center  
**Call: Toll Free 1-800-662-4111**  
 Two Working Days Before You Dig



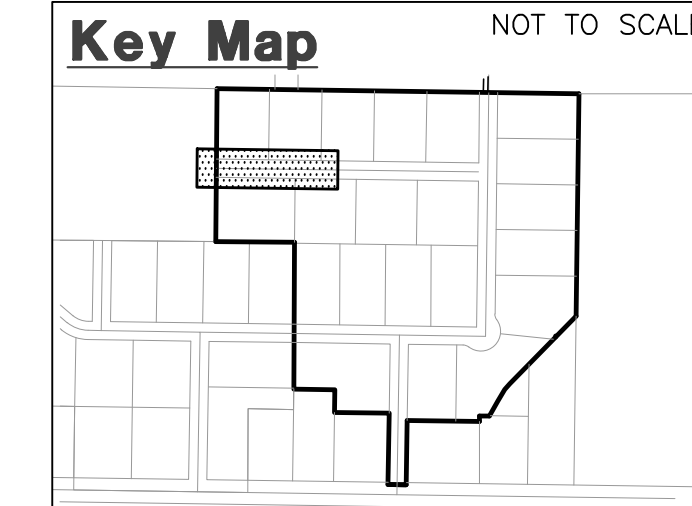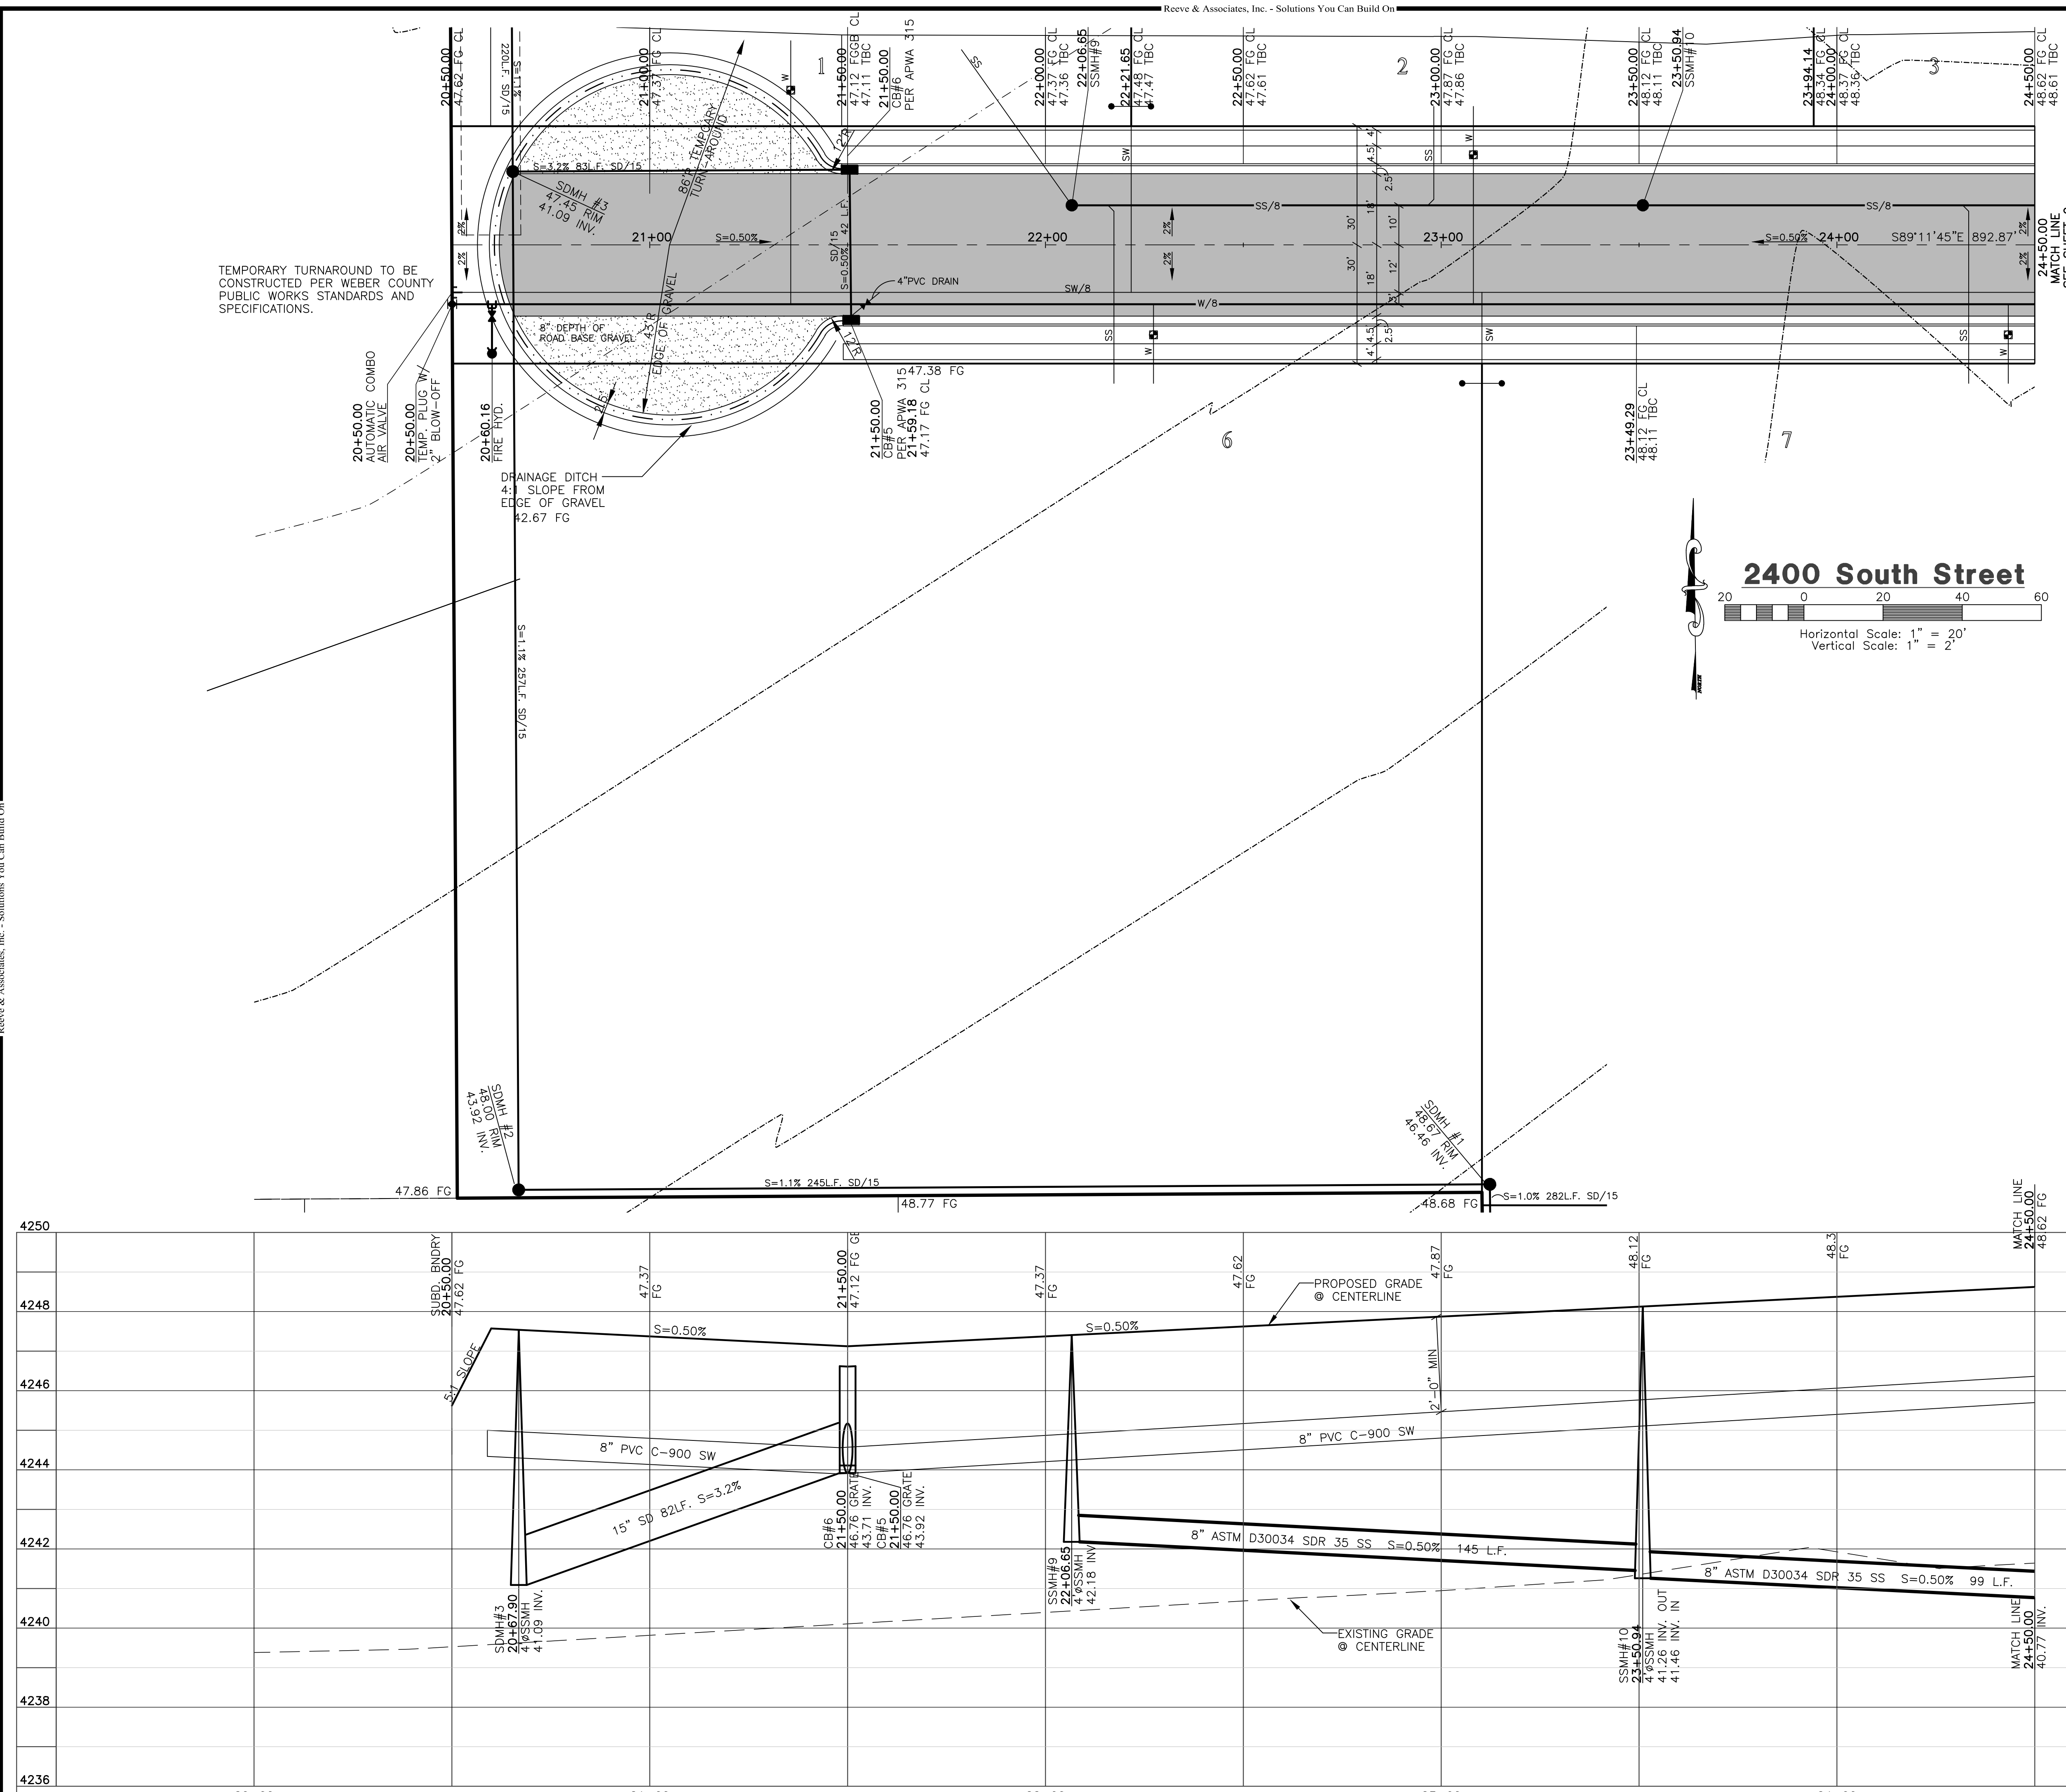

**Construction Notes:**

- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
- 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.

**CULINARY WATER**

W/8 - 8" PVC C-900 CLASS 200 WATER

**SANITARY SEWER**

SS/8 - 8" ASTM D3034 SDR 35 SEWER  
 SS/12 - 12" ASTM D3034 SDR 35 SEWER

**STORM DRAIN**


SD/15 - 15" RCP STORM DRAIN

**SECONDARY WATER**

SW/8 - 8" PVC C-900 SECONDARY WATER LINE

**Canal Crossing Notes**

- 1) ANY CROSSING OF THE HOOPER IRR. CANALS MUST OBTAIN A LICENSE AGREEMENT.
- 2) THE SEWER LINE MUST BE INSTALLED IN AN 18" STEEL CASING EXTENDING 4'-0" BEYOND HIGH BANK BOTH SIDES OF THE CANAL ACCORDING TO HOOPER IRR. COMPANY STANDARD DETAILS.
- 3) NO DRAINAGE FROM THE DEVELOPMENT IS ALLOWED INTO THE CANAL SYSTEM.
- 4) ALL CONSTRUCTION TO BE DONE IN ACCORDANCE WITH HOOPER IRR. COMPANY STANDARDS.

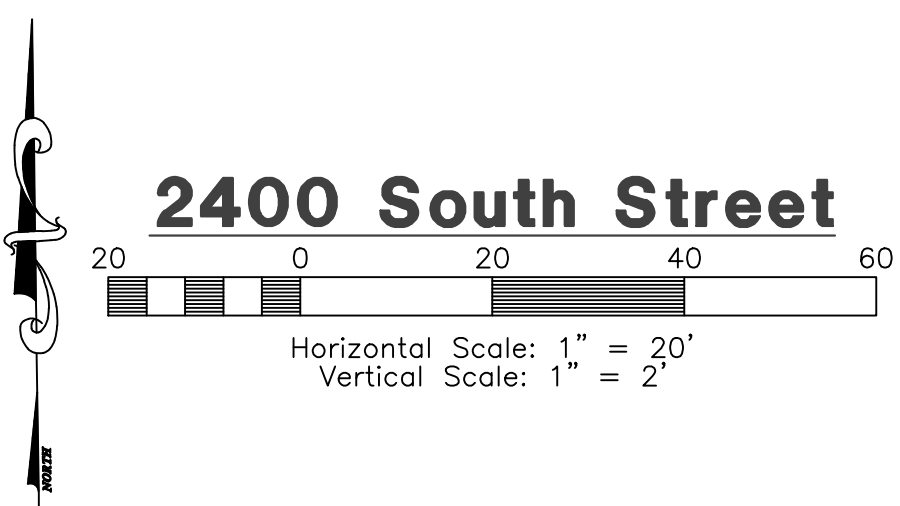

**Reeve & Associates, Inc.**  
 920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403  
 TEL: (801) 621-5100 FAX: (801) 621-2666 www.reeve-assoc.com  
 CIVIL ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

DATE	DESCRIPTION
9-30-14	ST. County Comments
10-9-14	ST. County Comments
11-3-14	RH. Sewer Revisions
11-24-14	ST. HIC Comments
2-18-15	ST. County Comments
5-9-15	ST. County Comments
3-31-16	TP. Detention Update


**Mallard Springs Subdivision**  
 WEBER COUNTY, UTAH

**2400 South Street**  
 20+00.00 - 24+50.00



**Project Info.**  
 Engineer: J. NATE REEVE, P.E.  
 Drafter: R. HANSEN  
 Begin Date: NOVEMBER 4, 2013  
 Name: MALLARD SPRINGS SUBDIVISION  
 Number: 3442-A30

Blue Stakes Location Center  
**Call: Toll Free 1-800-662-4111**  
 Two Working Days Before You Dig



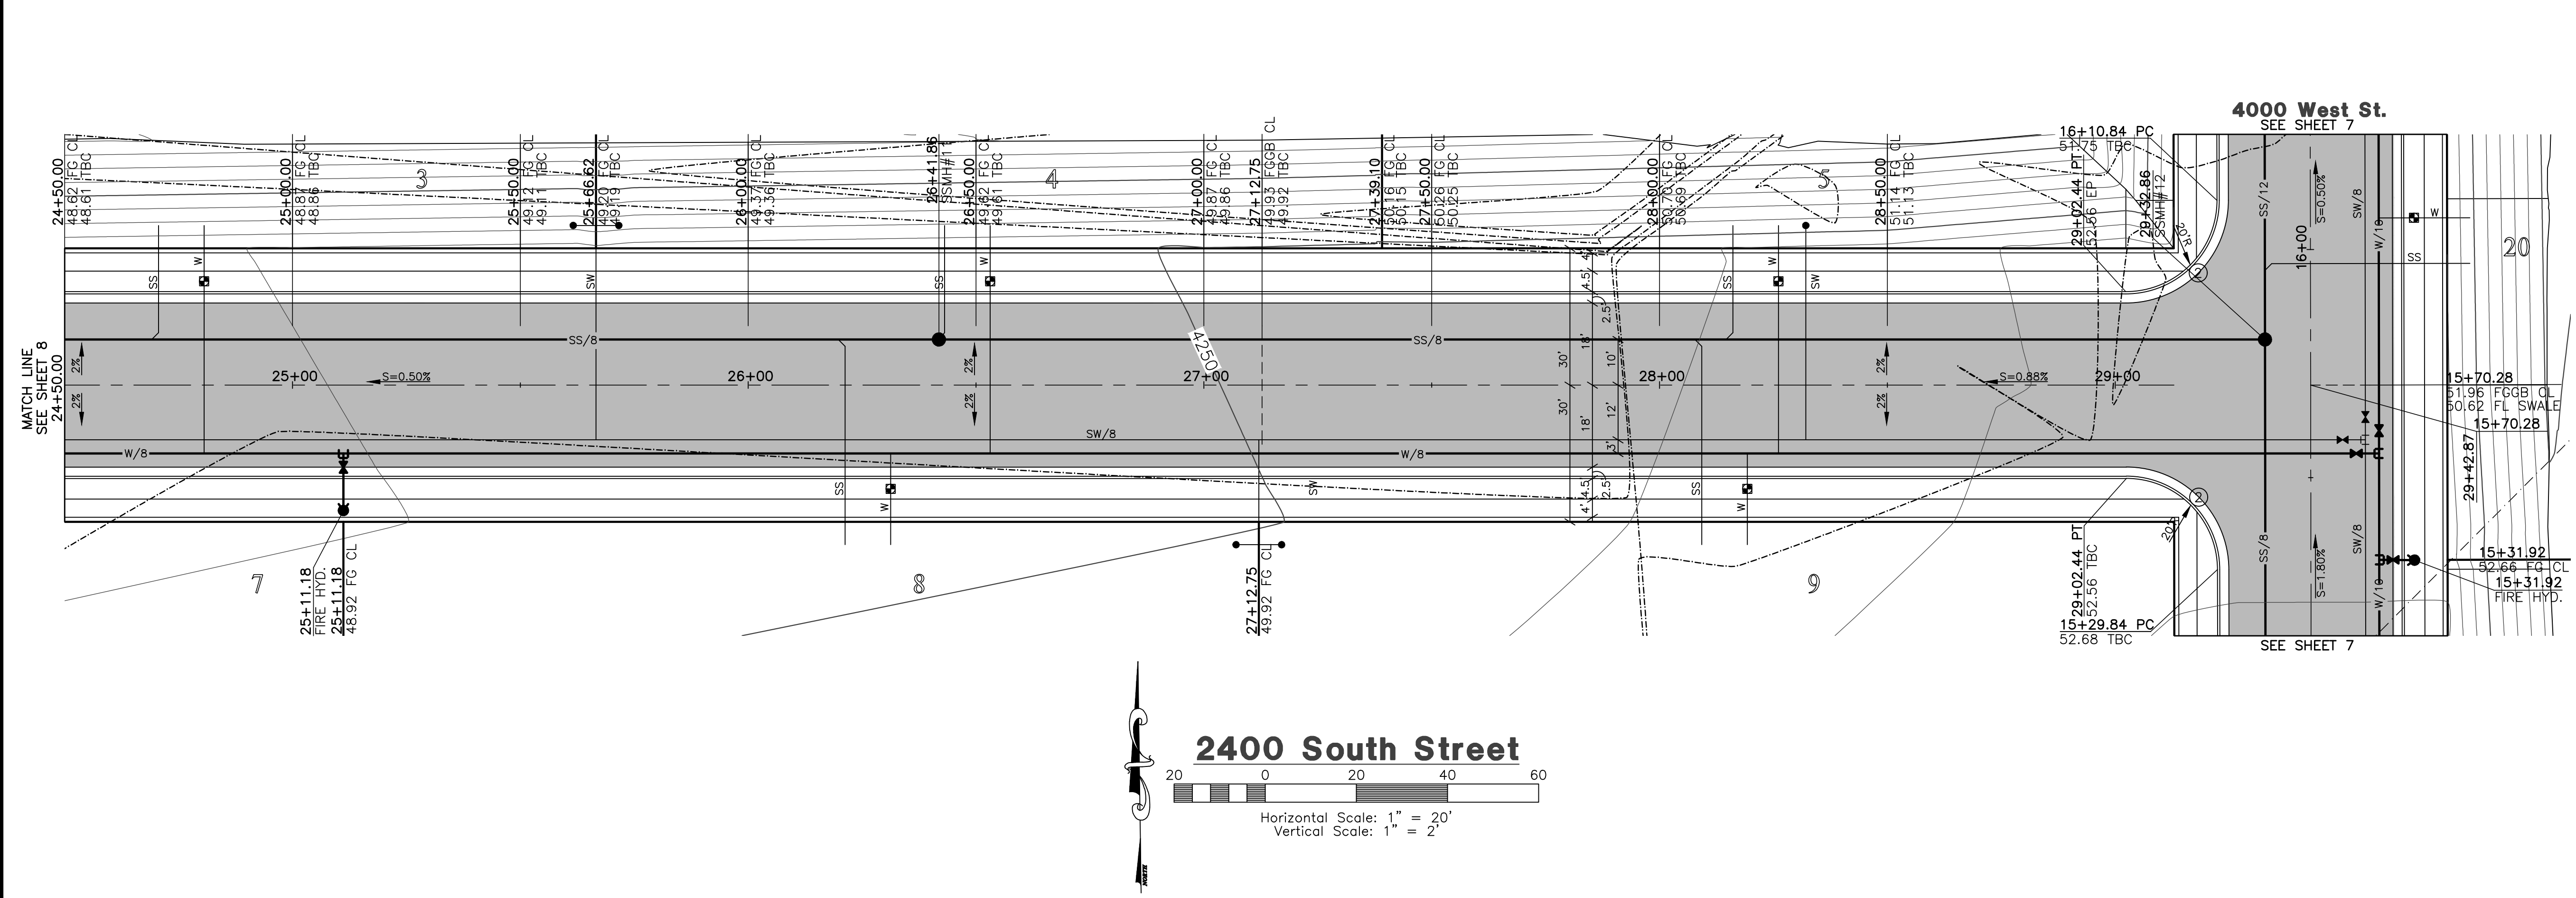

**2400 South Street**

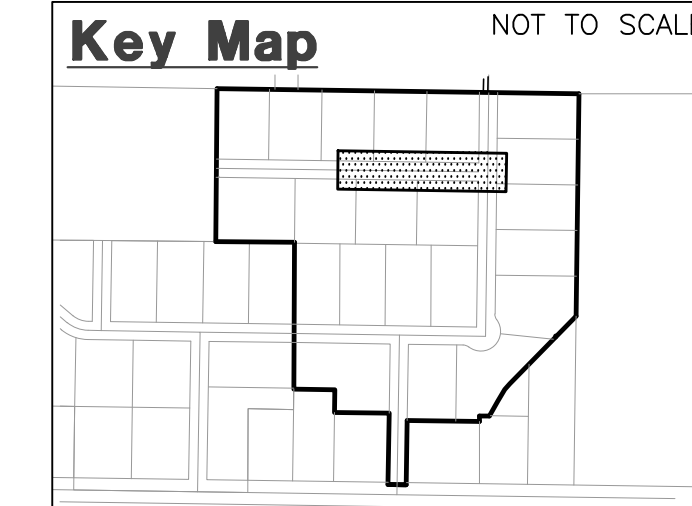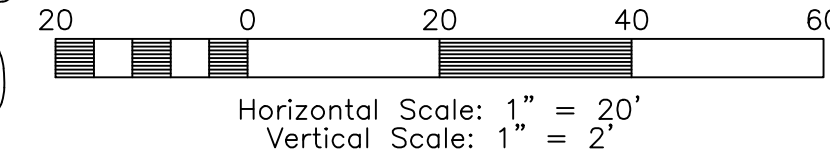

**Construction Notes:**

- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
- 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.

**CULINARY WATER**

W/8 - 8" PVC C-900 CLASS 200 WATER

**SANITARY SEWER**

SS/8 - 8" ASTM D3034 SDR 35 SEWER  
SS/12 - 12" ASTM D3034 SDR 35 SEWER

**STORM DRAIN**


SD/15 - 15" RCP STORM DRAIN

**SECONDARY WATER**

SW/8 - 8" PVC C-900 SECONDARY WATER LINE

**Canal Crossing Notes**

- 1) ANY CROSSING OF THE HOOPER IRR. CANALS MUST OBTAIN A LICENSE AGREEMENT.
- 2) THE SEWER LINE MUST BE INSTALLED IN AN 18" STEEL CASING EXTENDING 4'-0" BEYOND HIGH BANK BOTH SIDES OF THE CANAL ACCORDING TO HOOPER IRR. COMPANY STANDARD DETAILS.
- 3) NO DRAINAGE FROM THE DEVELOPMENT IS ALLOWED INTO THE CANAL SYSTEM.
- 4) ALL CONSTRUCTION TO BE DONE IN ACCORDANCE WITH HOOPER IRR. COMPANY STANDARDS.

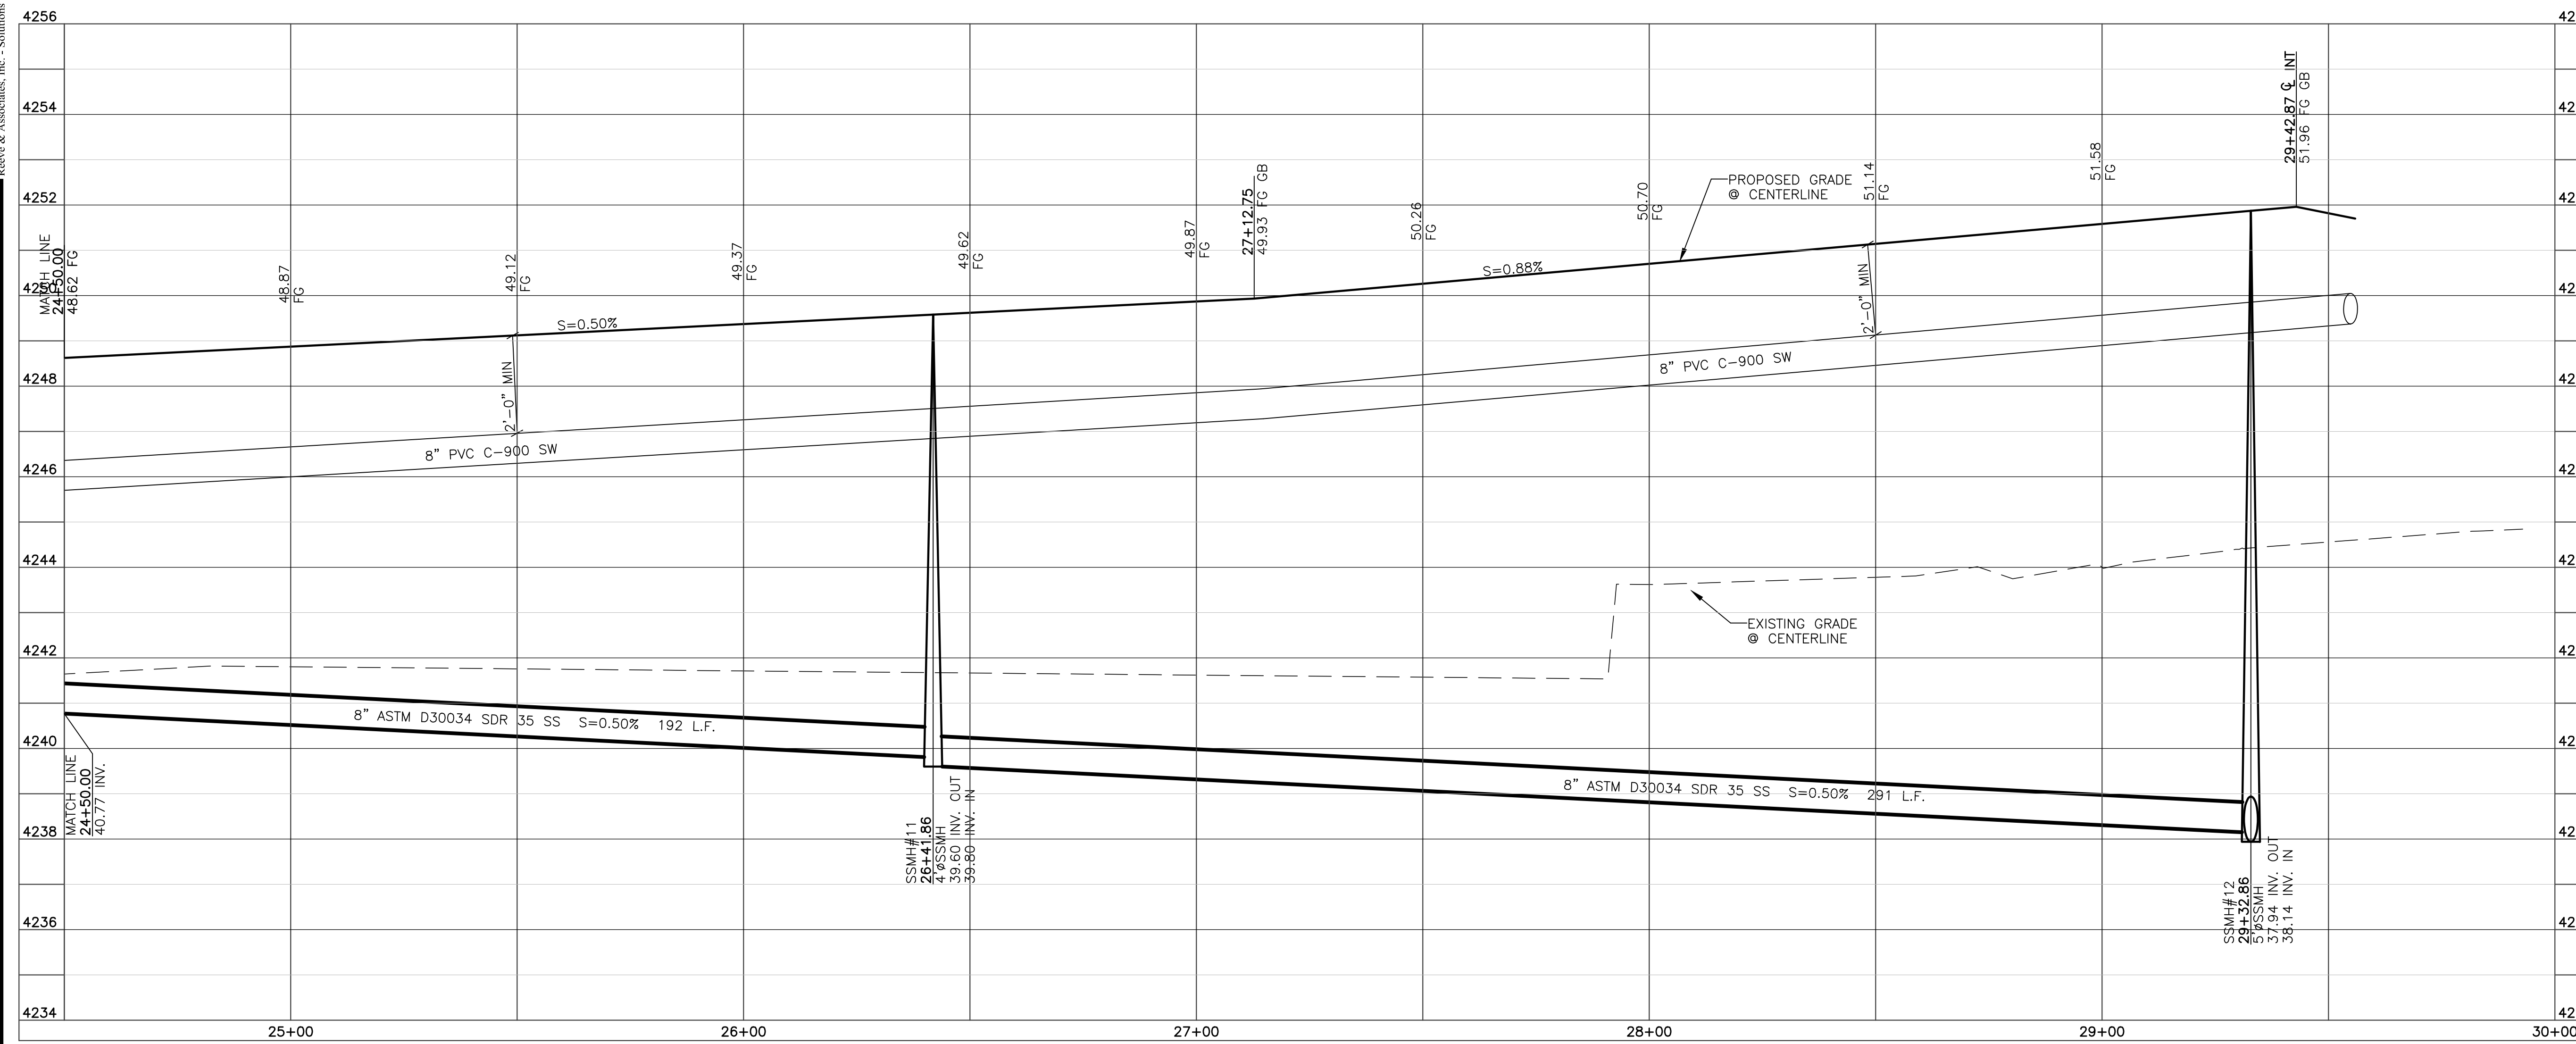


Blue Stakes Location Center  
**Call: Toll Free**  
**1-800-662-4111**  
 Two Working Days Before You Dig

**Reeve & Associates, Inc.**  
 920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403  
 TEL: (801) 921-3100 FAX: (801) 621-2666 www.reeve-assoc.com  
 CIVIL ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

DATE	DESCRIPTION
9-30-14	ST. County Comments
10-9-14	ST. County Comments
11-3-14	RH. Sewer Revisions
11-24-14	ST. HIC Comments
2-18-15	ST. County Comments
5-9-15	ST. County Comments
3-31-16	TP. Detention Update

**Mallard Springs Subdivision**  
 WEBER COUNTY, UTAH  
**2400 South Street**  
**24+50.00 - 30+00.00**





**Revised: 5-18-15**

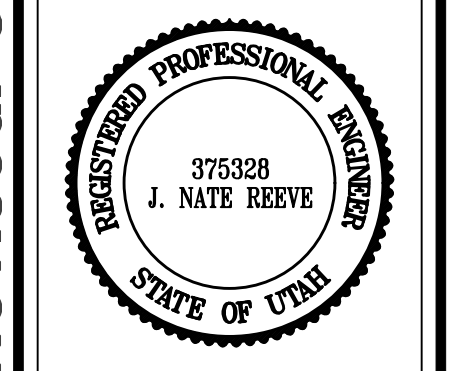

**Project Info.**  
 Engineer: J. NATE REEVE, P.E.  
 Drafter: R. HANSEN  
 Begin Date: NOVEMBER 4, 2013  
 Name: MALLARD SPRINGS SUBDIVISION  
 Number: 3442-A30

Sheet **20**  
 9 Sheets



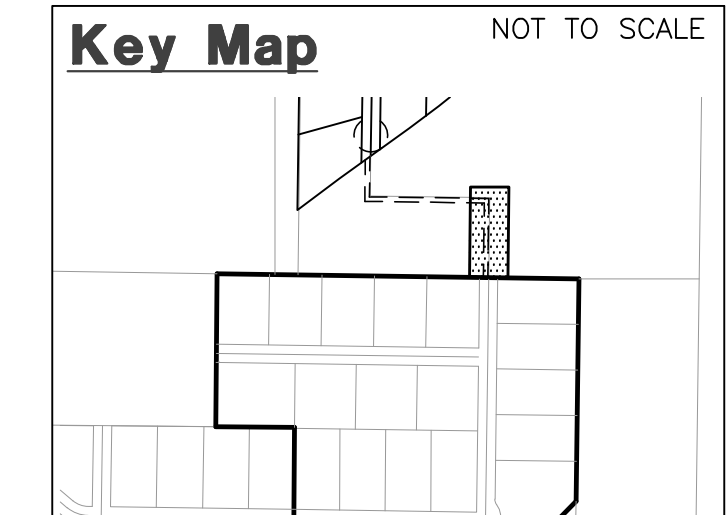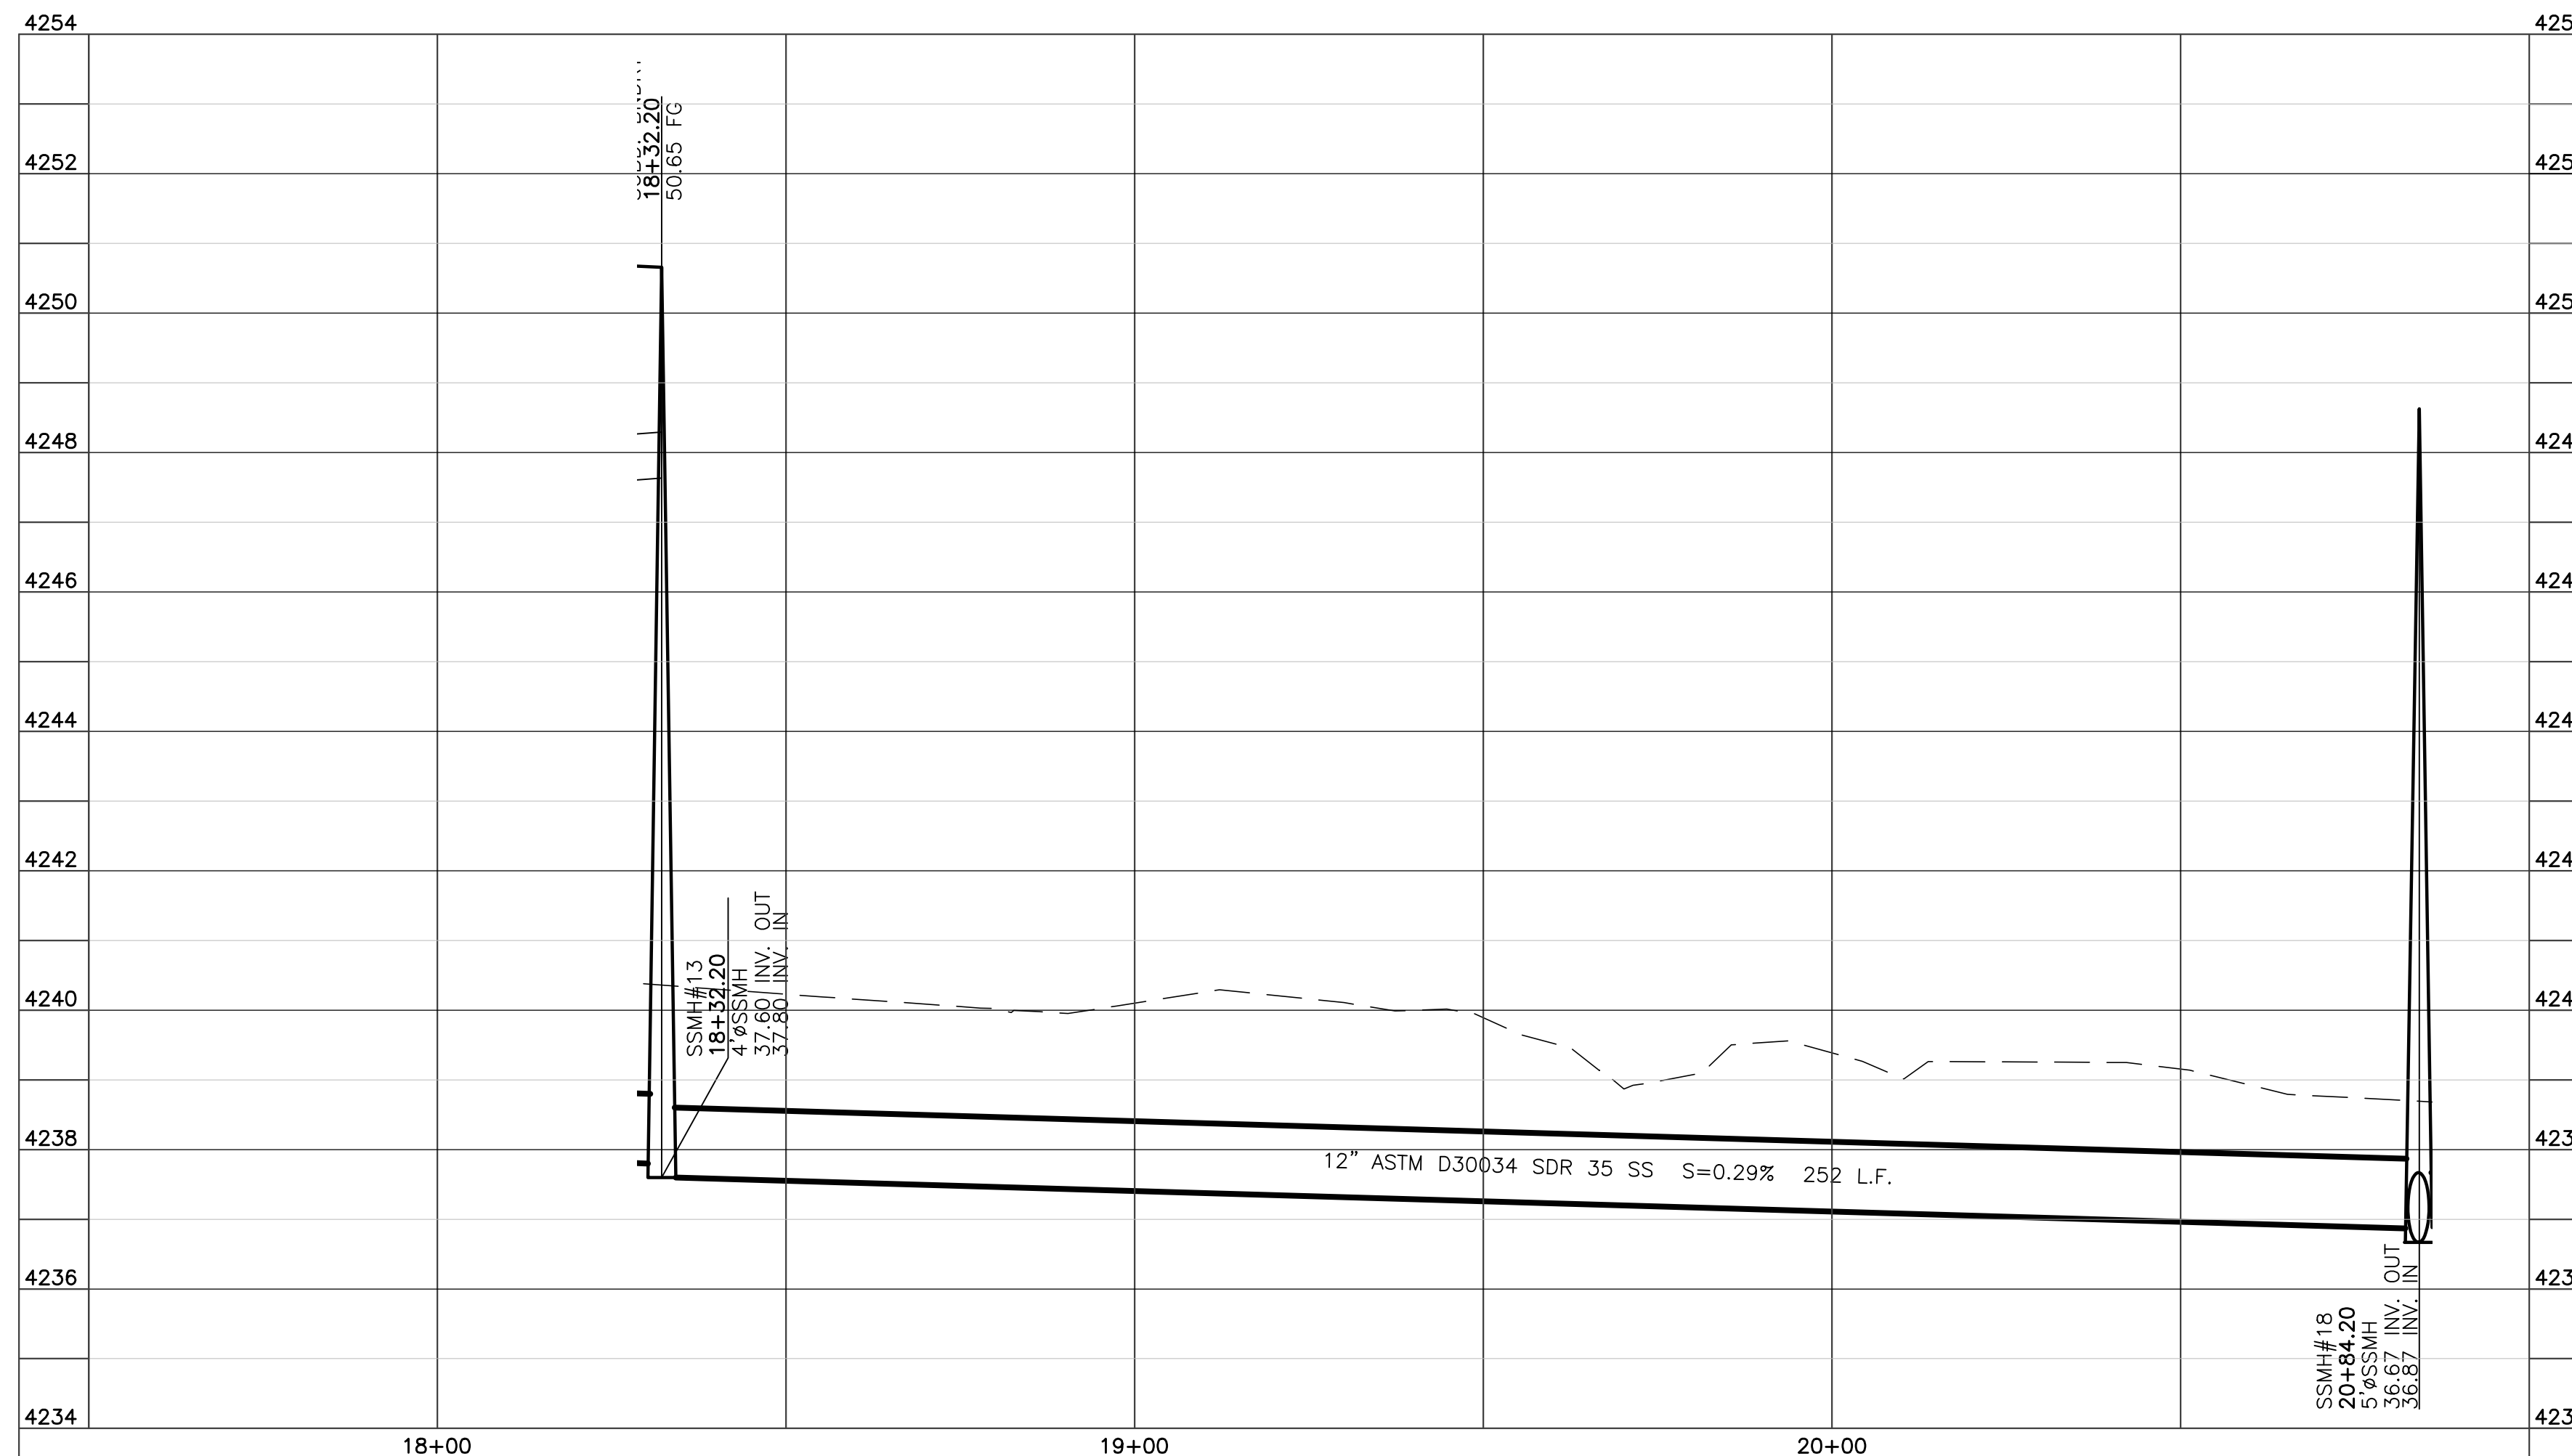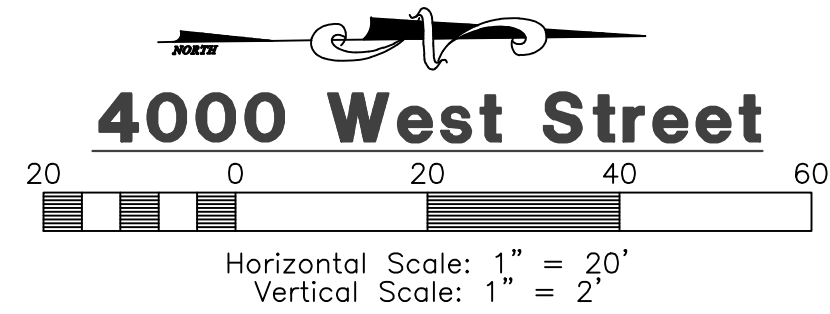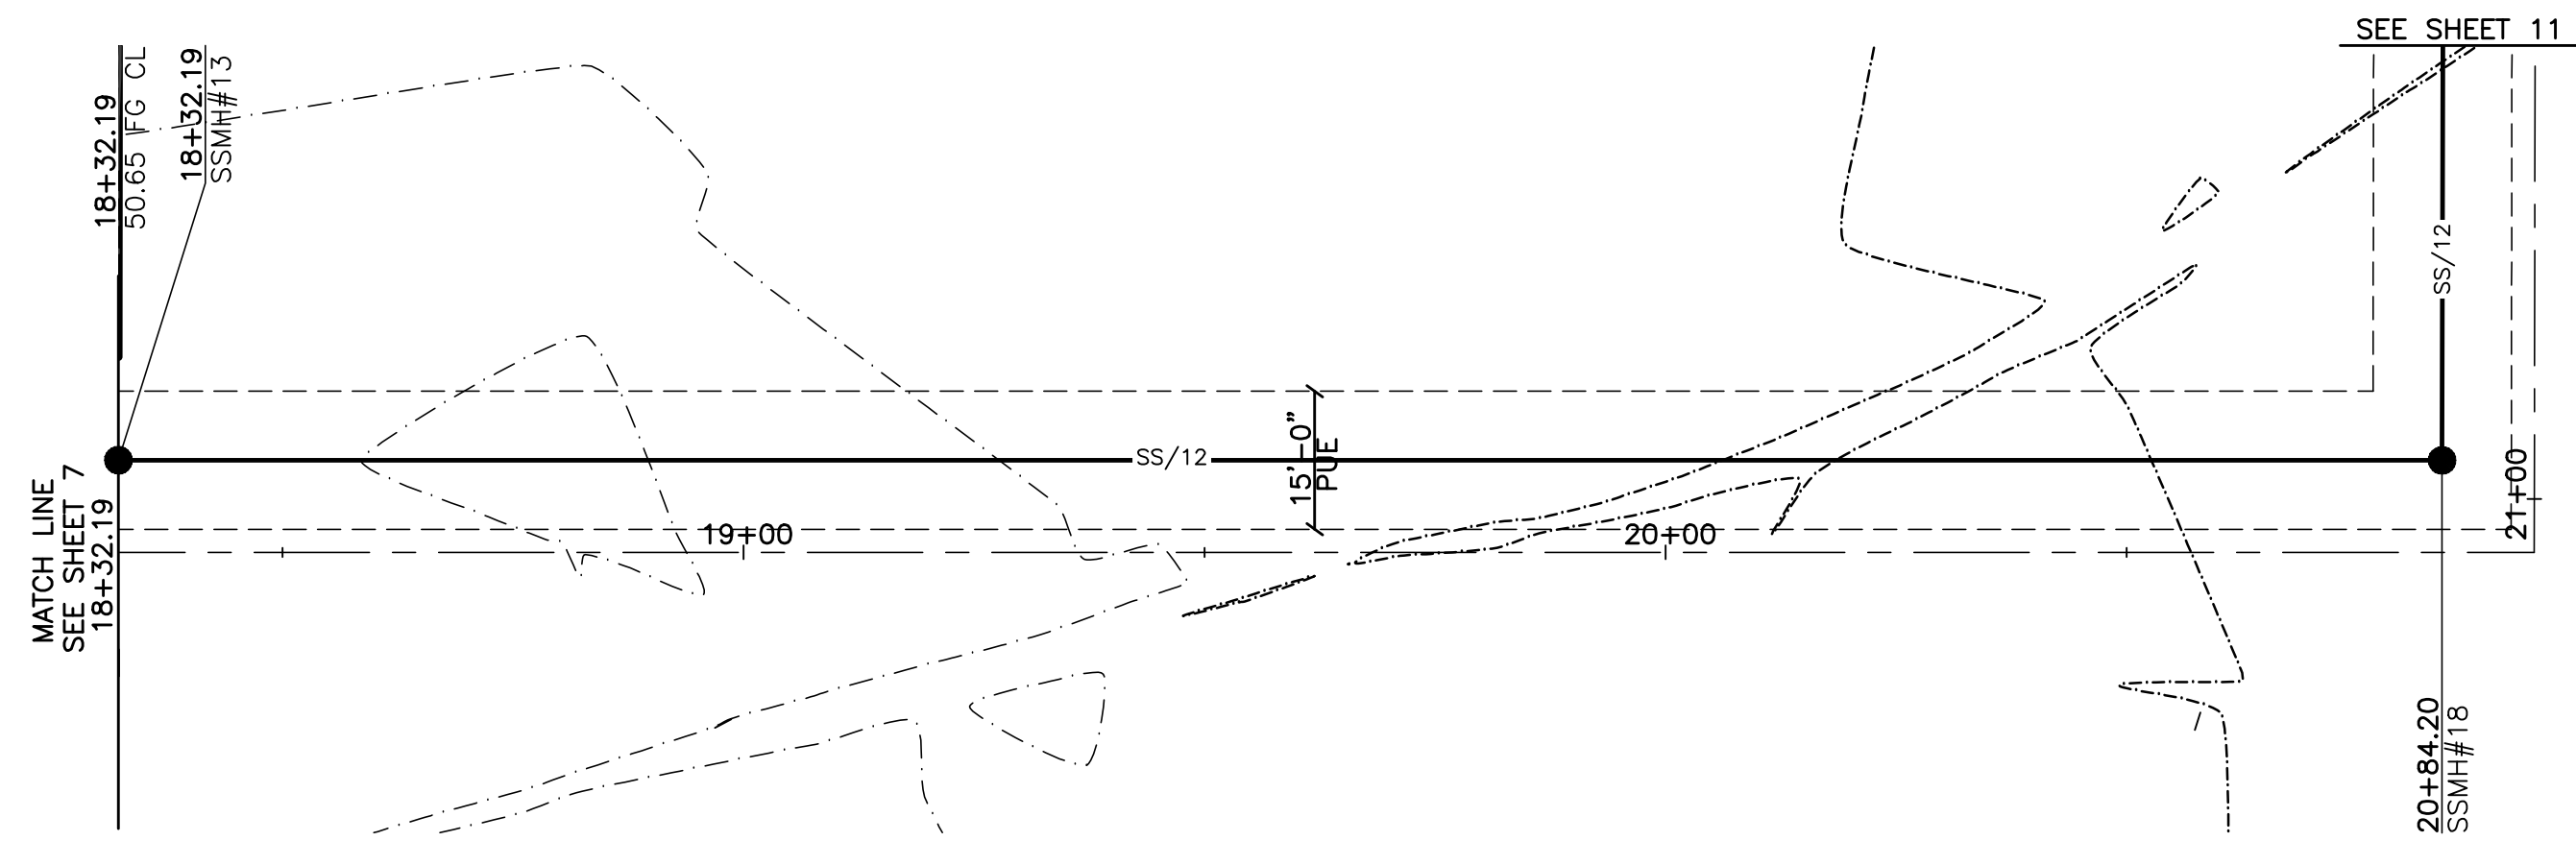

**Construction Notes:**

- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
- 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.

**CULINARY WATER**

W/8 - 8" PVC C-900 CLASS 200 WATER

**SANITARY SEWER**

SS/8 - 8" ASTM D3034 SDR 35 SEWER  
 SS/12 - 12" ASTM D3034 SDR 35 SEWER

**STORM DRAIN**

SD/15 - 15" RCP STORM DRAIN

**SECONDARY WATER**

SW/8 - 8" PVC C-900 SECONDARY WATER LINE


**Canal Crossing Notes**

- 1) ANY CROSSING OF THE HOOPER IRR. CANALS MUST OBTAIN A LICENSE AGREEMENT.
- 2) THE SEWER LINE MUST BE INSTALLED IN AN 18" STEEL CASING EXTENDING 4'-0" BEYOND HIGH BANK BOTH SIDES OF THE CANAL ACCORDING TO HOOPER IRR. COMPANY STANDARD DETAILS.
- 3) NO DRAINAGE FROM THE DEVELOPMENT IS ALLOWED INTO THE CANAL SYSTEM.
- 4) ALL CONSTRUCTION TO BE DONE IN ACCORDANCE WITH HOOPER IRR. COMPANY STANDARDS.

**Reeve & Associates, Inc.**  
 920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403  
 TEL: (801) 621-3100 FAX: (801) 621-2666 www.reeve-assoc.com  
 CIVIL ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

DATE	DESCRIPTION
9-30-14	ST. County Comments
10-9-14	ST. County Comments
11-3-14	RH. Sewer Revisions
11-24-14	ST. HIC Comments
2-18-15	ST. County Comments
5-9-15	ST. County Comments
3-31-16	TP. Detention Update

**Mallard Springs Subdivision**  
 WEBER COUNTY, UTAH  
**4000 West Street**  
**18+32.19 - 21+00.00**

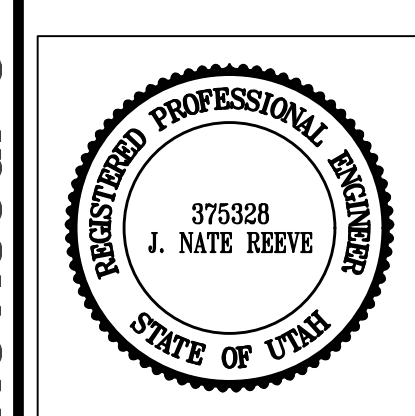


**Project Info.**

Engineer: J. NATE REEVE, P.E.  
 Drafter: R. HANSEN  
 Begin Date: NOVEMBER 4, 2013  
 Name: MALLARD SPRINGS SUBDIVISION  
 Number: 3442-A30

Blue Stakes Location Center  
**Call: Toll Free 1-800-662-4111**  
 Two Working Days Before You Dig

Sheet	<b>20</b>
<b>10</b>	Sheets



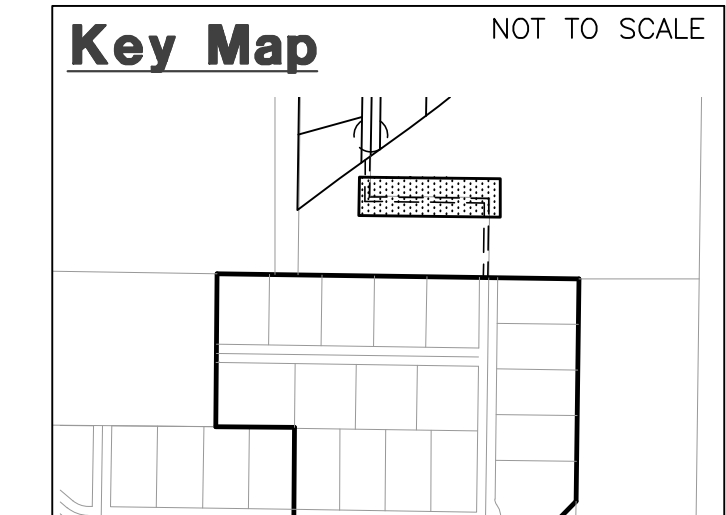



**Reeve & Associates, Inc.**  
 920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403  
 TEL: (801) 621-3100 FAX: (801) 621-2666 www.reeve-assoc.com  
 CIVIL ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

**Construction Notes:**

- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
  - 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.
- CULINARY WATER**  
 W/8 - 8" PVC C-900 CLASS 200 WATER
- SANITARY SEWER**  
 SS/8 - 8" ASTM D3034 SDR 35 SEWER  
 SS/12 - 12" ASTM D3034 SDR 35 SEWER
- STORM DRAIN**  
 SD/15 - 15" RCP STORM DRAIN
- SECONDARY WATER**  
 SW/8 - 8" PVC C-900 SECONDARY WATER LINE

**Canal Crossing Notes**

- 1) ANY CROSSING OF THE HOOPER IRR. CANALS MUST OBTAIN A LICENSE AGREEMENT.
- 2) THE SEWER LINE MUST BE INSTALLED IN AN 18" STEEL CASING EXTENDING 4'-0" BEYOND HIGH BANK BOTH SIDES OF THE CANAL ACCORDING TO HOOPER IRR. COMPANY STANDARD DETAILS.
- 3) NO DRAINAGE FROM THE DEVELOPMENT IS ALLOWED INTO THE CANAL SYSTEM.
- 4) ALL CONSTRUCTION TO BE DONE IN ACCORDANCE WITH HOOPER IRR. COMPANY STANDARDS.

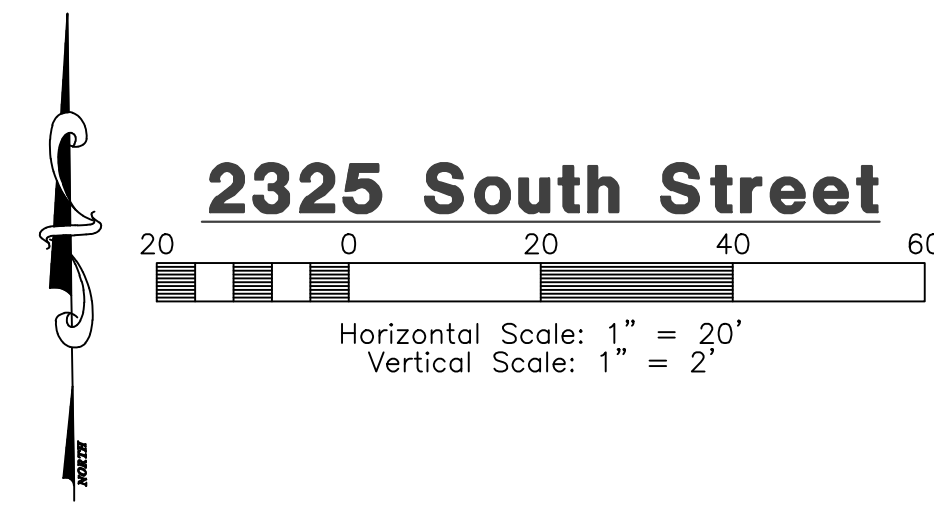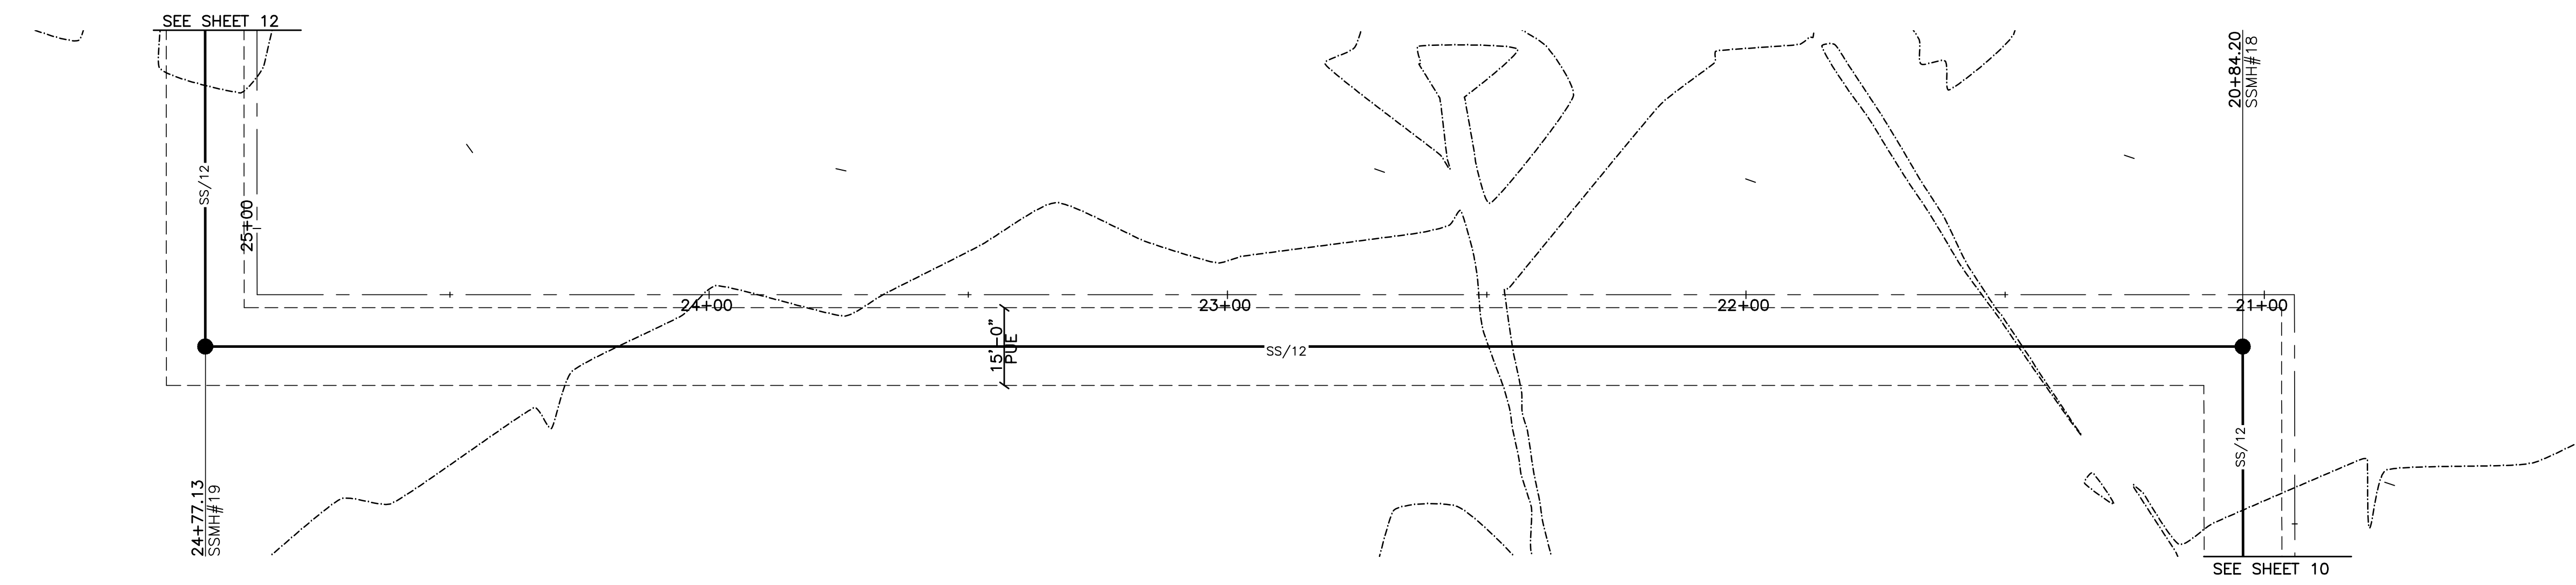

DATE	DESCRIPTION
9-30-14	ST County Comments
10-9-14	ST County Comments
11-3-14	RH Sewer Revisions
11-24-14	ST HIC Comments
2-18-15	ST County Comments
5-9-15	ST County Comments
3-31-16	TP Detention Update


**Mallard Springs Subdivision**  
 WEBER COUNTY, UTAH  
**2325 South Street**  
**21+00.00 - 25+00.00**

**Revised: 5-18-15**



**Project Info.**




Engineer:	J. NATE REEVE, P.E.
Drafter:	R. HANSEN
Begin Date:	NOVEMBER 4, 2013
Name:	MALLARD SPRINGS SUBDIVISION
Number:	3442-A30

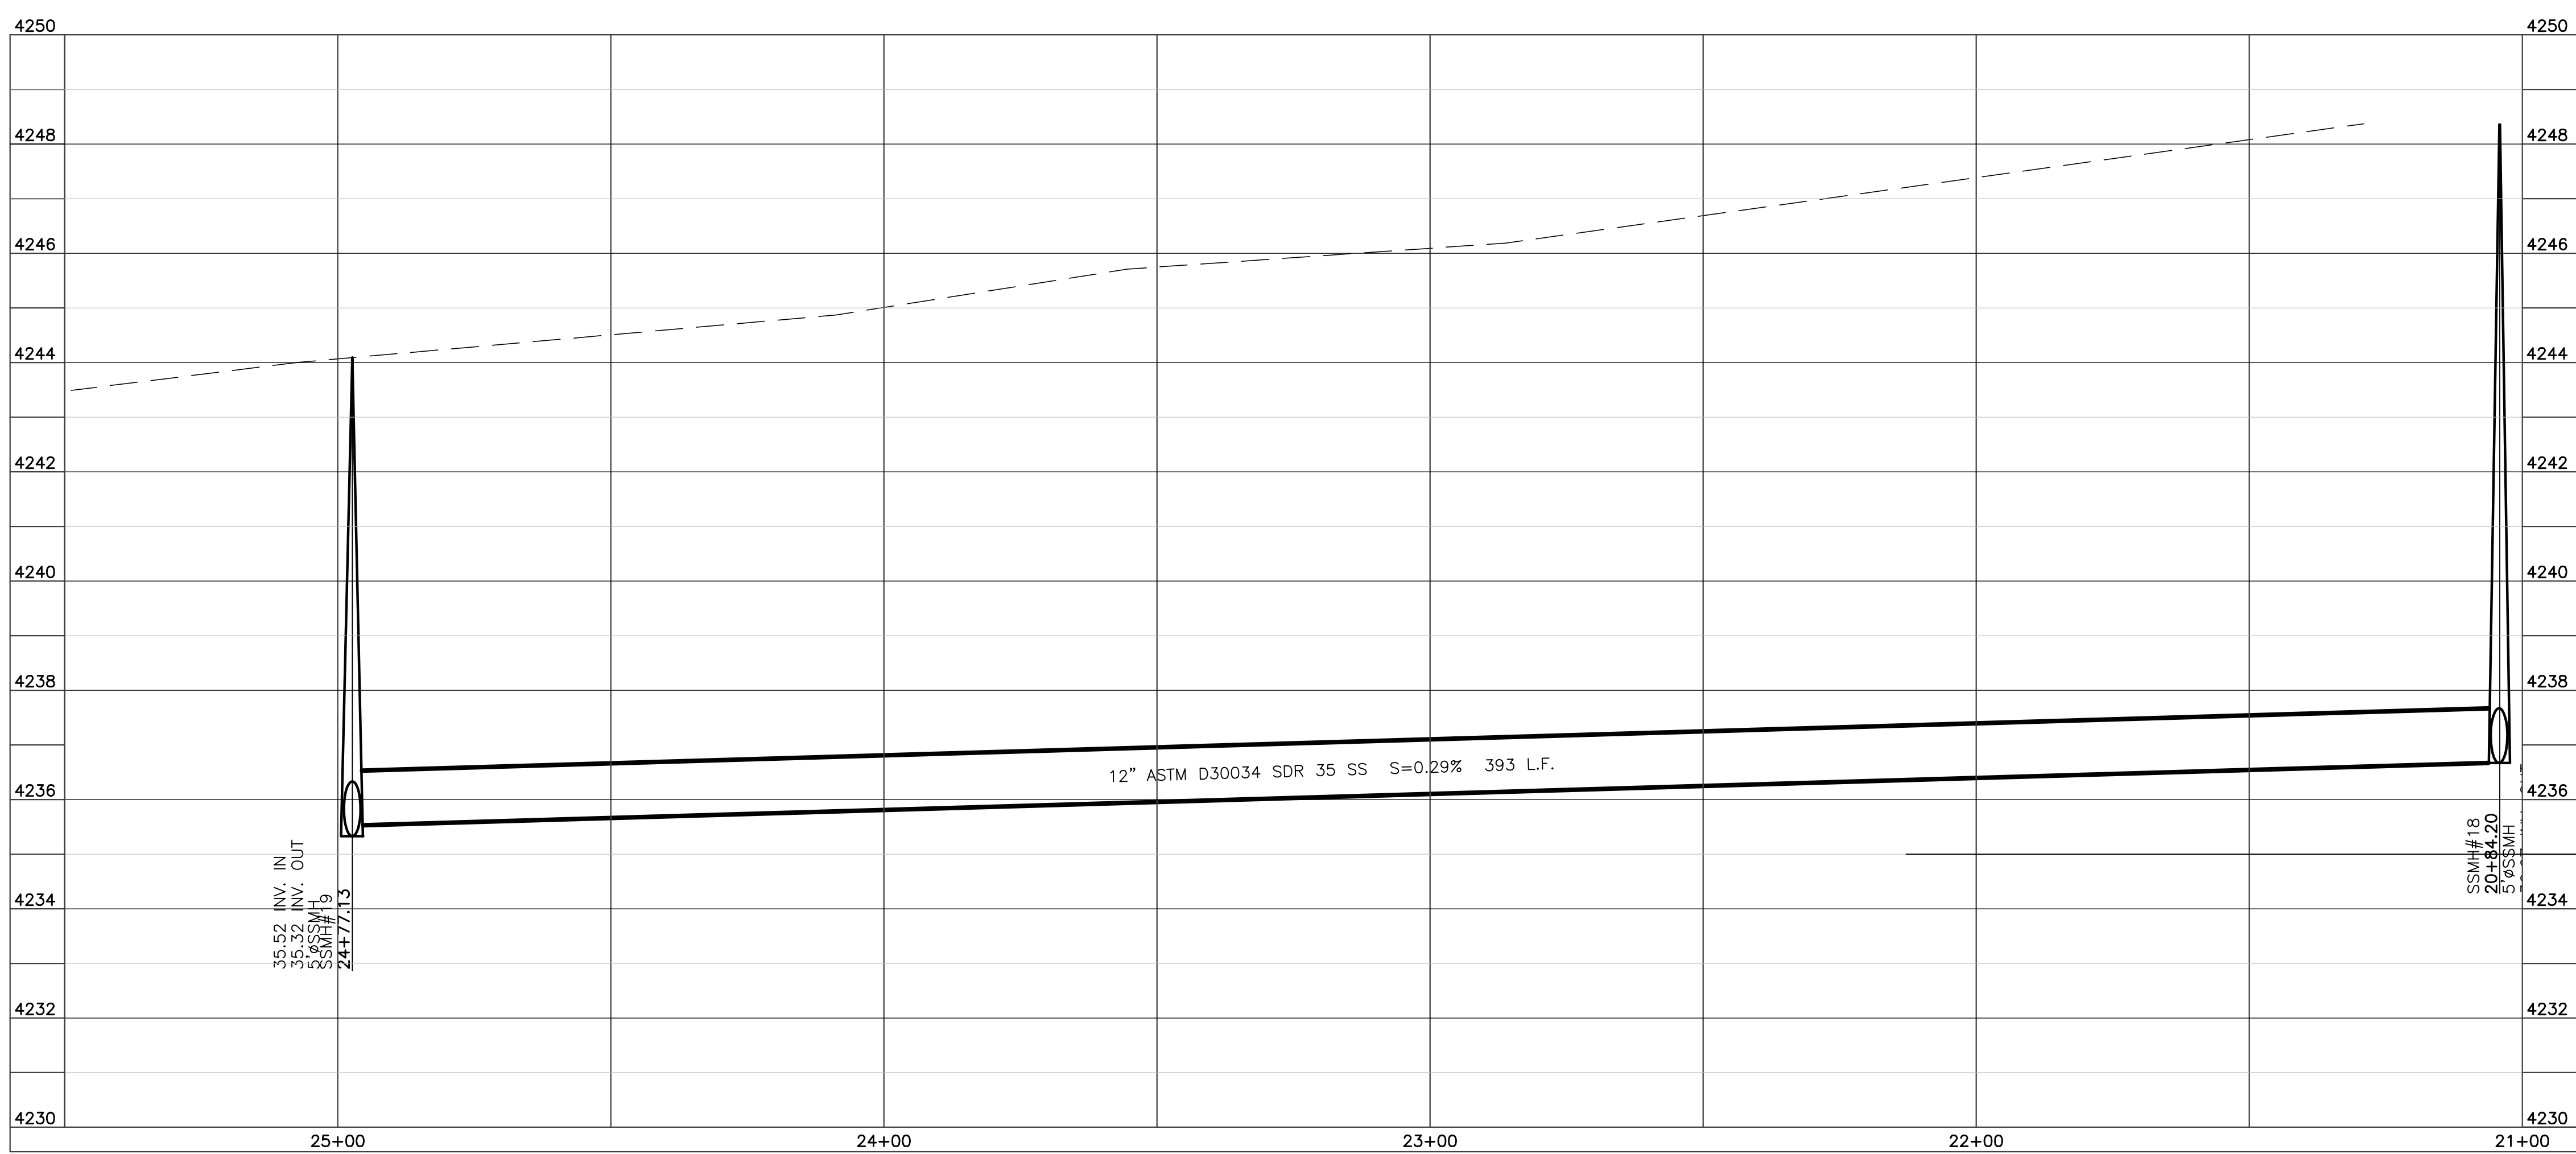

Blue Stakes Location Center  
**Call: Toll Free 1-800-662-4111**  
 Two Working Days Before You Dig

Sheet **11** of **20** Sheets



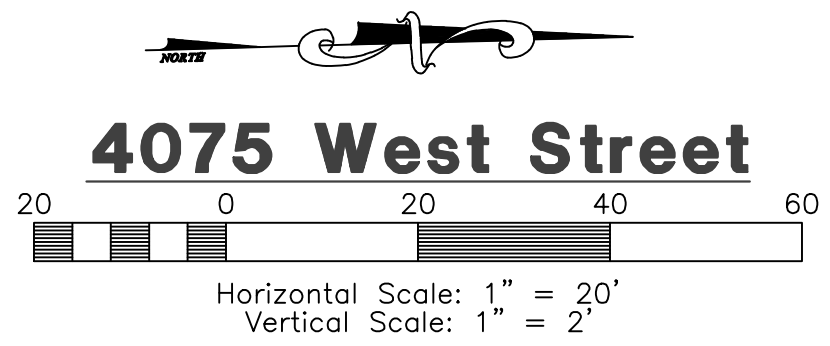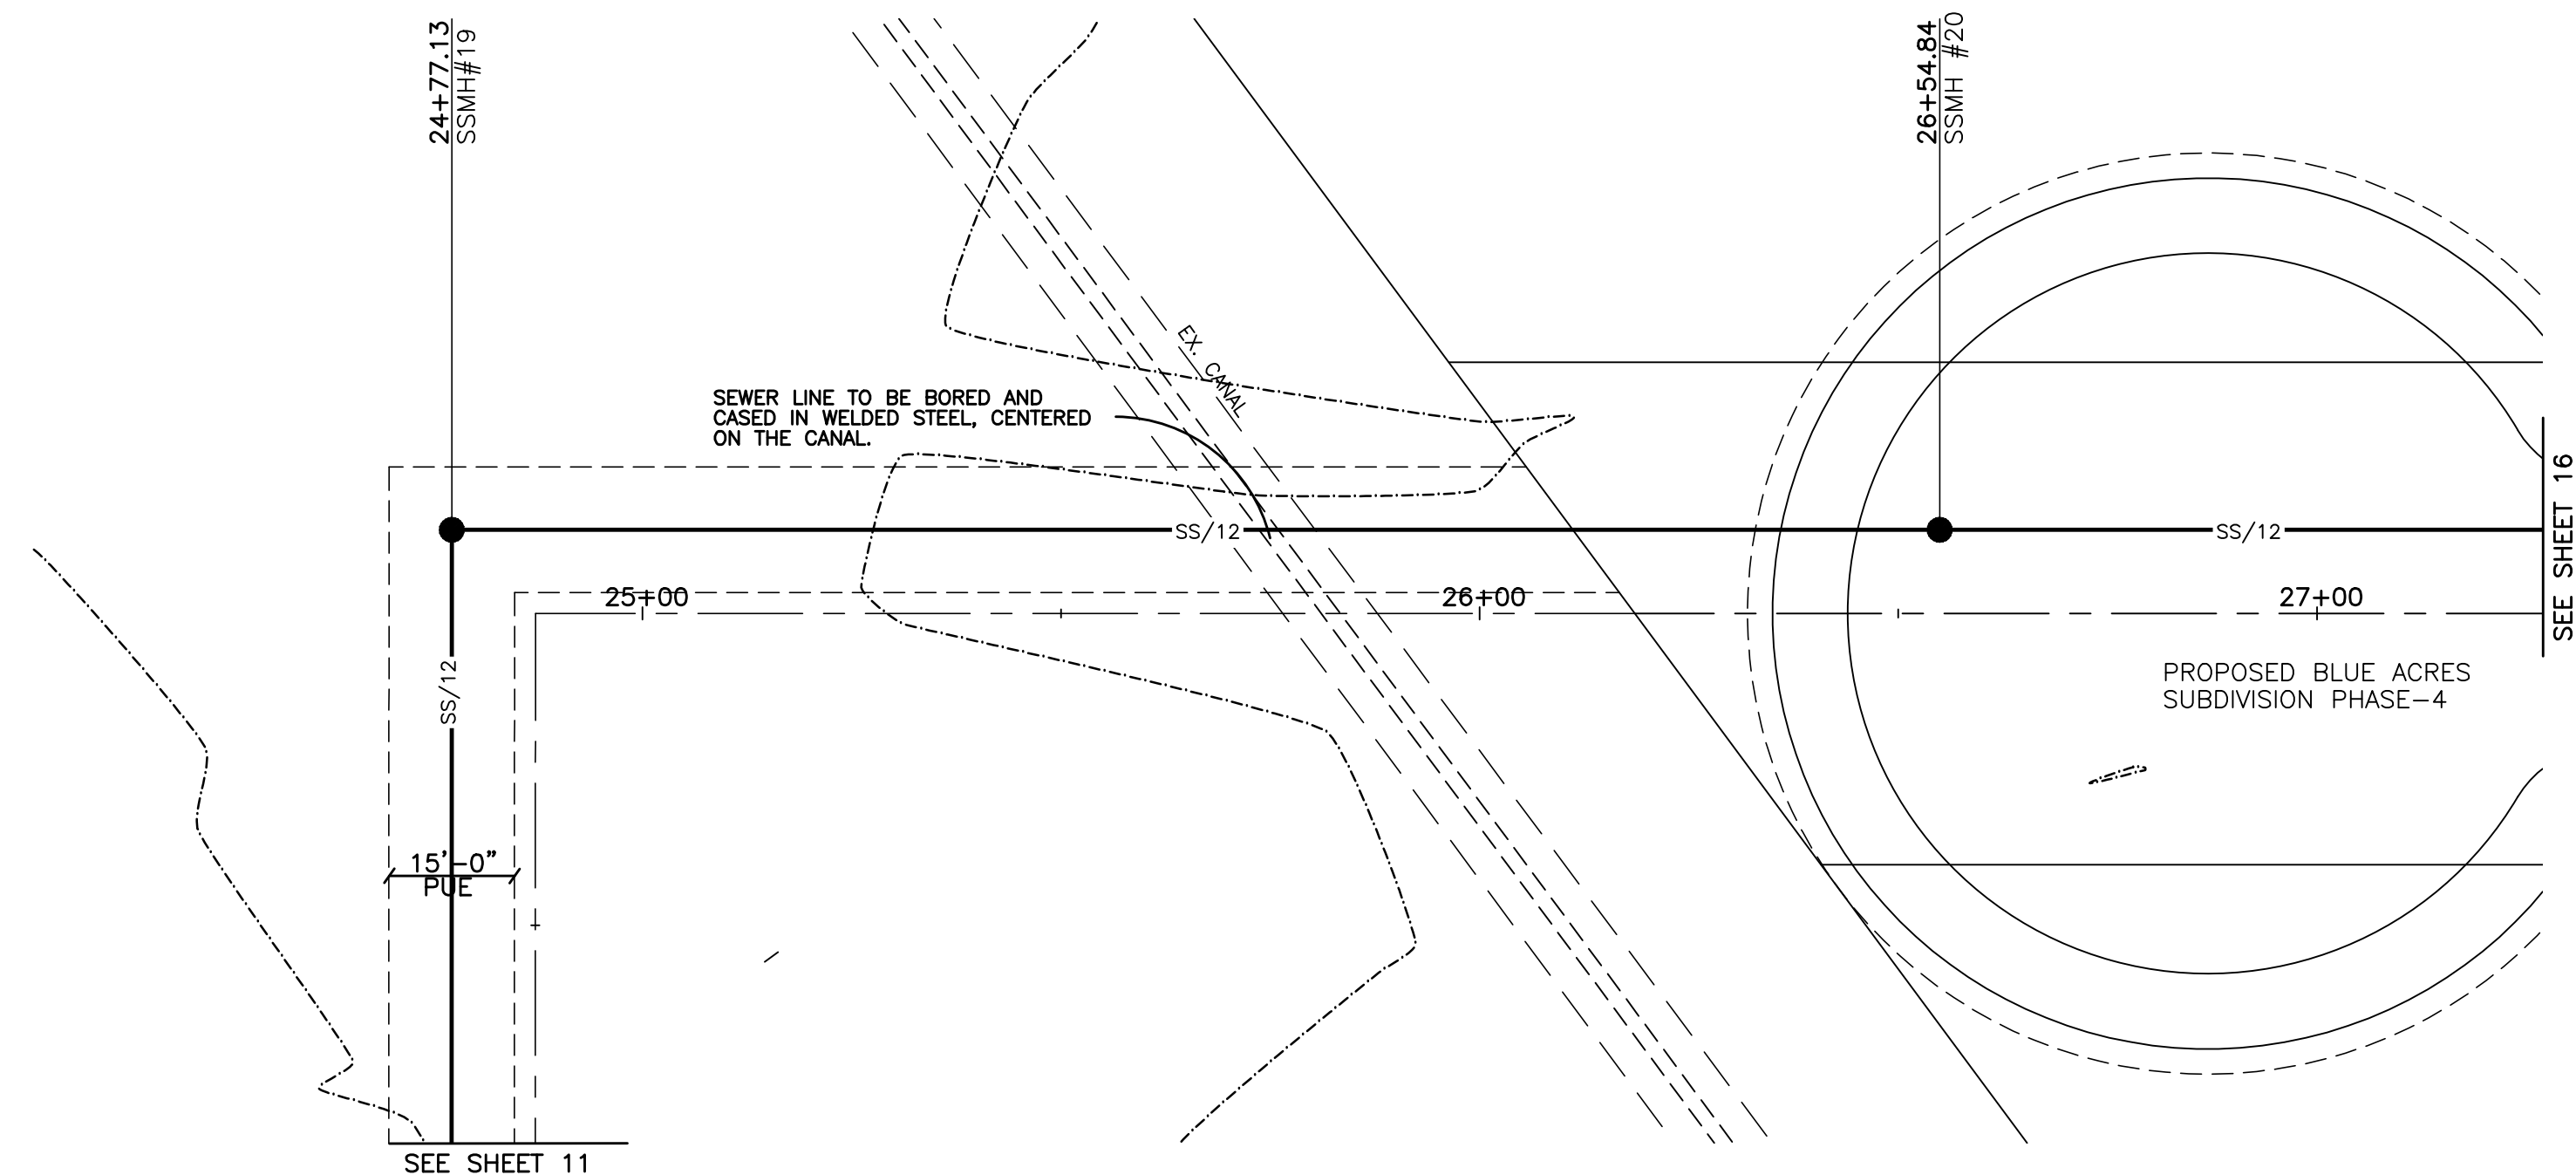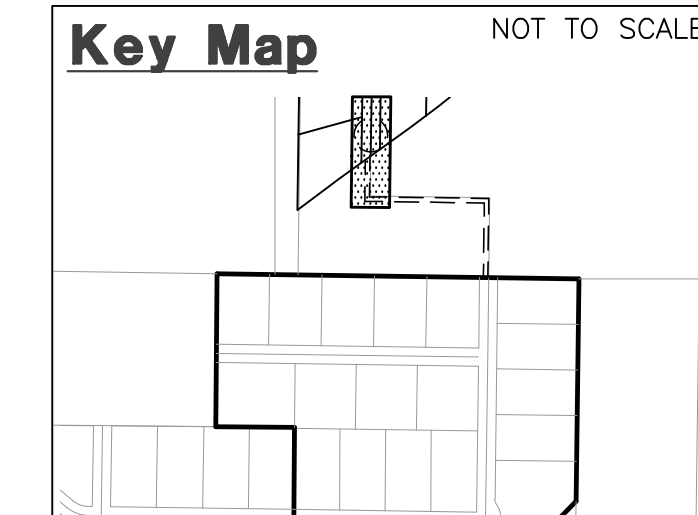

**Construction Notes:**

- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
- 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.

**CULINARY WATER**  
W/8 - 8" PVC C-900 CLASS 200 WATER

**SANITARY SEWER**  
SS/8 - 8" ASTM D3034 SDR 35 SEWER  
SS/12 - 12" ASTM D3034 SDR 35 SEWER

**STORM DRAIN**  
SD/15 - 15" RCP STORM DRAIN

**SECONDARY WATER**  
SW/8 - 8" PVC C-900 SECONDARY WATER LINE


**Canal Crossing Notes**

- 1) ANY CROSSING OF THE HOOPER IRR. CANALS MUST OBTAIN A LICENSE AGREEMENT.
- 2) THE SEWER LINE MUST BE INSTALLED IN AN 18" STEEL CASING EXTENDING 4'-0" BEYOND HIGH BANK BOTH SIDES OF THE CANAL ACCORDING TO HOOPER IRR. COMPANY STANDARD DETAILS.
- 3) NO DRAINAGE FROM THE DEVELOPMENT IS ALLOWED INTO THE CANAL SYSTEM.
- 4) ALL CONSTRUCTION TO BE DONE IN ACCORDANCE WITH HOOPER IRR. COMPANY STANDARDS.

**Reeve & Associates, Inc.**  
920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403  
TEL: (801) 921-3100 FAX: (801) 621-2666 www.reeve-assoc.com  
CIVIL ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

DATE	DESCRIPTION
9-30-14	ST. County Comments
10-9-14	ST. County Comments
11-3-14	RH. Sewer Revisions
11-24-14	ST. HIC Comments
2-18-15	ST. County Comments
5-9-15	ST. County Comments
3-31-16	TP. Detention Update

**Mallard Springs Subdivision**  
WEBER COUNTY, UTAH  
**4075 West Street**  
**24.77.13 - 26+55.00**

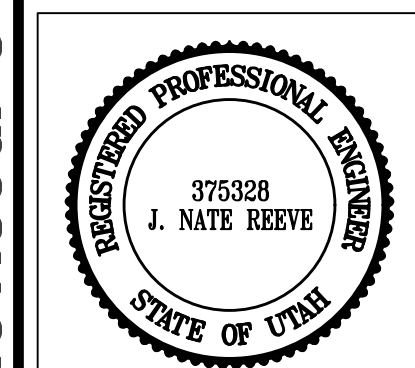

**Project Info.**

Engineer: J. NATE REEVE, P.E.  
 Drafter: R. HANSEN  
 Begin Date: NOVEMBER 4, 2013  
 Name: MALLARD SPRINGS SUBDIVISION  
 Number: 3442-A30


Sheet	20
12	Sheets

Reeve & Associates, Inc. - Solutions You Can Build On


Revised: 5-18-15






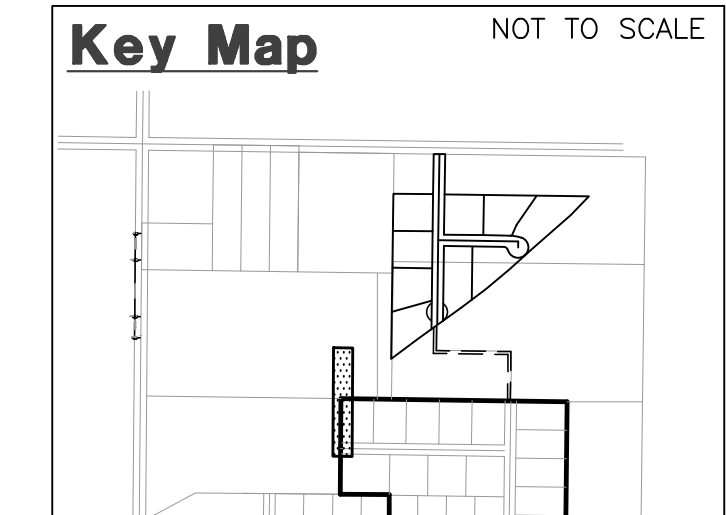

**Reeve & Associates, Inc.**  
 920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403  
 TEL: (801) 621-3100 FAX: (801) 621-2666 www.reeve-assoc.com  
 CIVIL ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

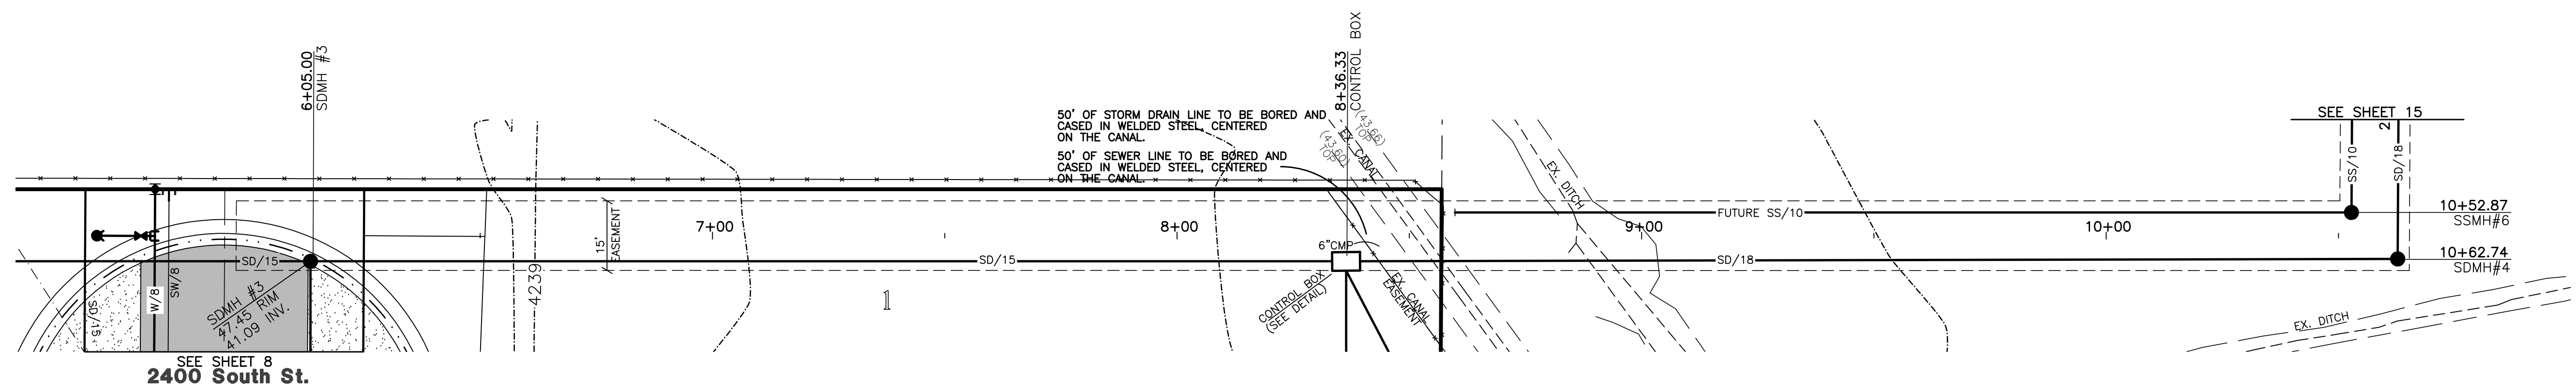

### Sanitary Sewer/Storm Drain Outfall

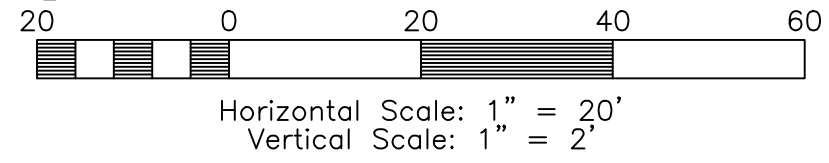

#### Construction Notes:

- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
- 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.

#### CULINARY WATER

W/8 - 8" PVC C-900 CLASS 200 WATER

#### SANITARY SEWER

SS/8 - 8" ASTM D3034 SDR 35 SEWER  
 SS/12 - 12" ASTM D3034 SDR 35 SEWER

#### STORM DRAIN

SD/15 - 15" RCP STORM DRAIN


#### SECONDARY WATER

SW/8 - 8" PVC C-900 SECONDARY WATER LINE

#### Canal Crossing Notes

- 1) ANY CROSSING OF THE HOOPER IRR. CANALS MUST OBTAIN A LICENSE AGREEMENT.
- 2) THE SEWER LINE MUST BE INSTALLED IN AN 18" STEEL CASING EXTENDING 4'-0" BEYOND HIGH BANK BOTH SIDES OF THE CANAL ACCORDING TO HOOPER IRR. COMPANY STANDARD DETAILS.
- 3) NO DRAINAGE FROM THE DEVELOPMENT IS ALLOWED INTO THE CANAL SYSTEM.
- 4) ALL CONSTRUCTION TO BE DONE IN ACCORDANCE WITH HOOPER IRR. COMPANY STANDARDS.


DATE	DESCRIPTION
9-30-14	ST. County Comments
10-9-14	ST. County Comments
11-3-14	RH. Sewer Revisions
11-24-14	ST. HIC Comments
2-18-15	ST. County Comments
5-9-15	ST. County Comments
3-31-16	TP. Detention Update

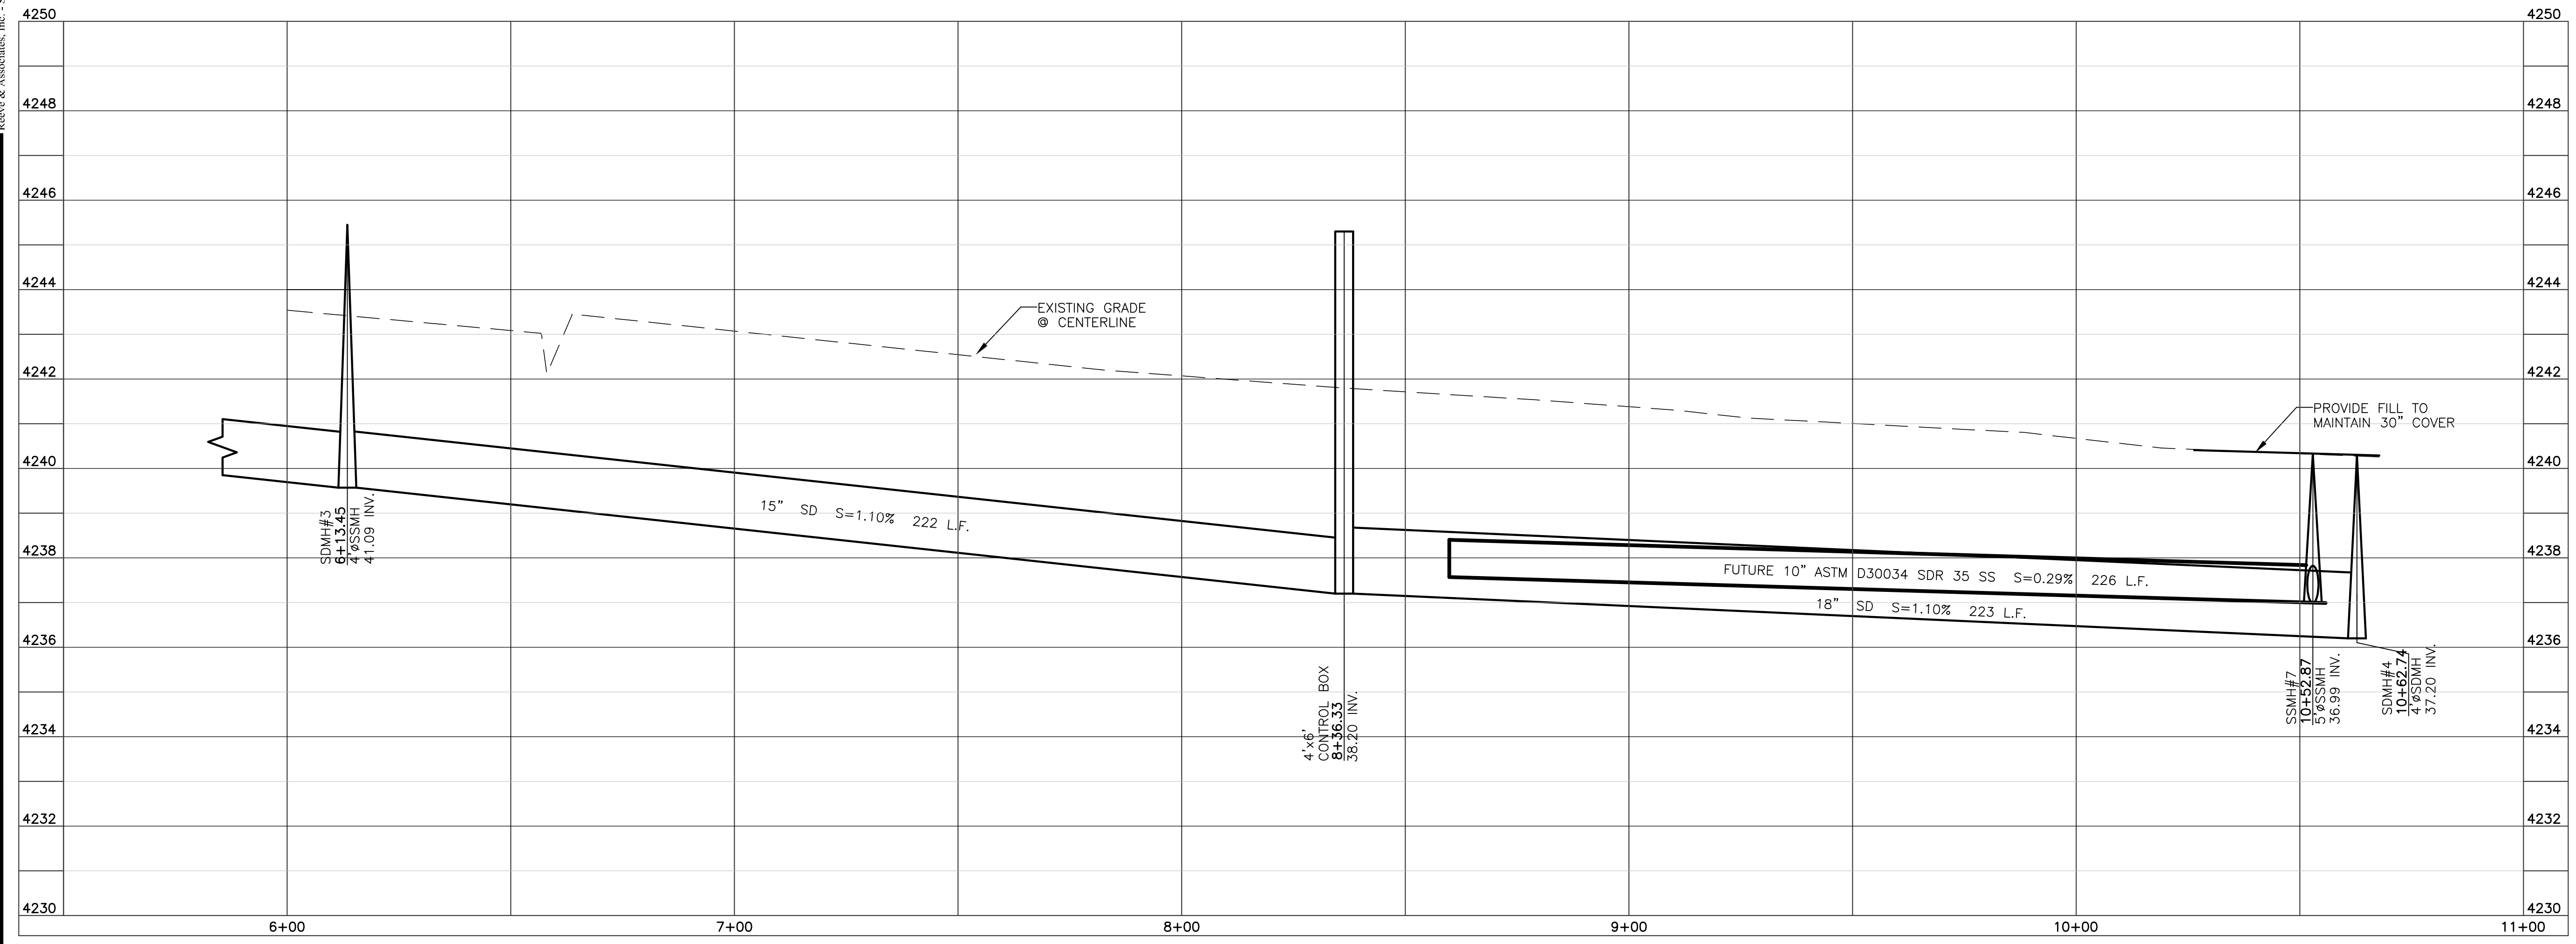

Revised: 5-18-15

**Mallard Springs Subdivision**  
 WEBER COUNTY, UTAH

**Sanitary Sewer/Storm Drain Outfall**  
 6+00.00 - 11+00.00

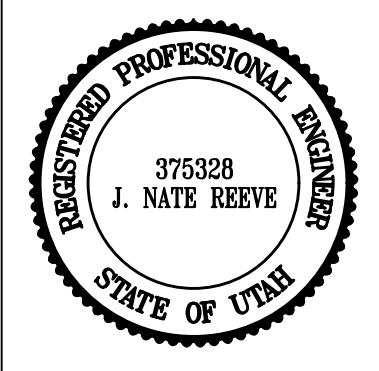


**Project Info.**  
 Engineer: J. NATE REEVE, P.E.  
 Drafter: R. HANSEN  
 Begin Date: NOVEMBER 4, 2013  
 Name: MALLARD SPRINGS SUBDIVISION  
 Number: 3442-A30

Blue Stakes Location Center  
**Call: Toll Free 1-800-662-4111**  
 Two Working Days Before You Dig


Sheet **20**  
 13 Sheets



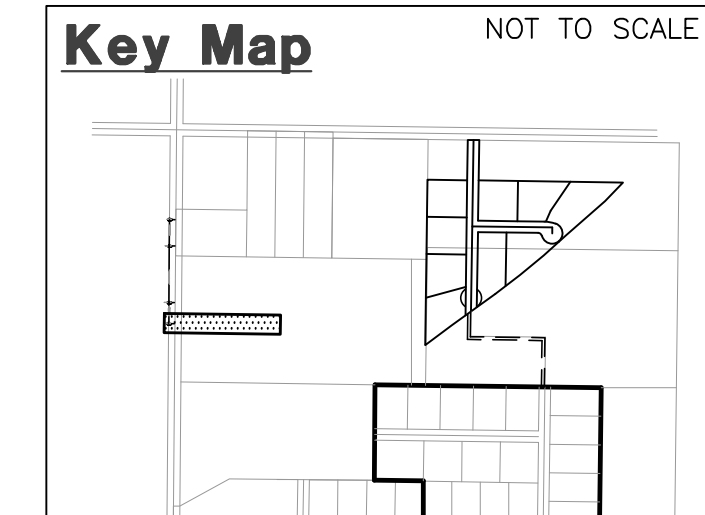


**Construction Notes:**

- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
  - 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.
- CULINARY WATER**  
W/8 - 8" PVC C-900 CLASS 200 WATER
- SANITARY SEWER**  
SS/8 - 8" ASTM D3034 SDR 35 SEWER  
SS/12 - 12" ASTM D3034 SDR 35 SEWER
- STORM DRAIN**  
SD/15 - 15" RCP STORM DRAIN
- SECONDARY WATER**  
SW/8 - 8" PVC C-900 SECONDARY WATER LINE

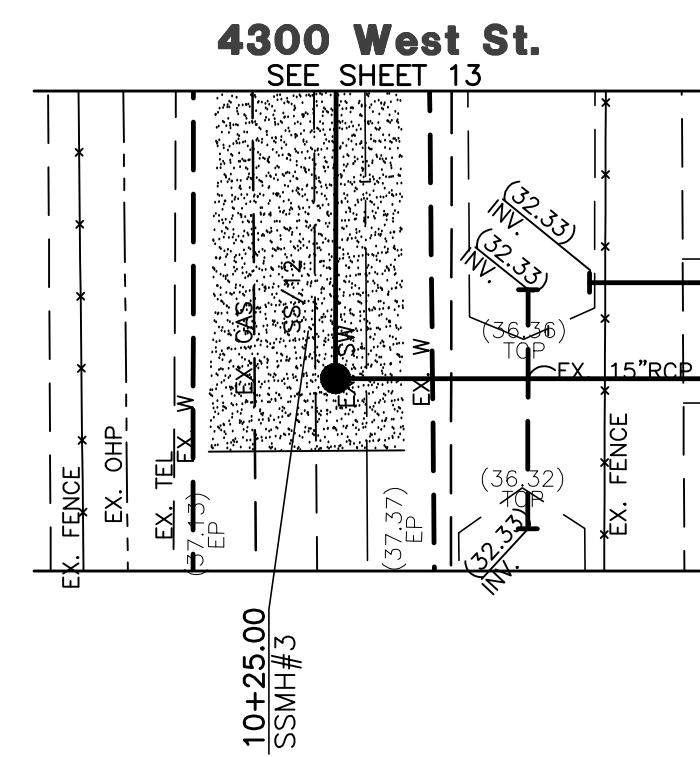


**Sanitary Sewer/Storm Drain Outfall**

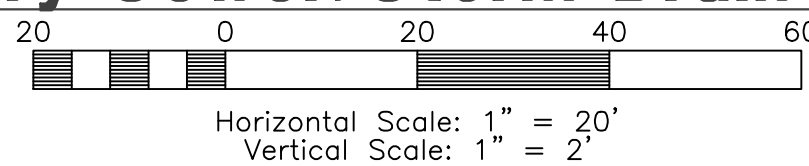

**Canal Crossing Notes**

- 1) ANY CROSSING OF THE HOOPER IRR. CANALS MUST OBTAIN A LICENSE AGREEMENT.
- 2) THE SEWER LINE MUST BE INSTALLED IN AN 18" STEEL CASING EXTENDING 4'-0" BEYOND HIGH BANK BOTH SIDES OF THE CANAL ACCORDING TO HOOPER IRR. COMPANY STANDARD DETAILS.
- 3) NO DRAINAGE FROM THE DEVELOPMENT IS ALLOWED INTO THE CANAL SYSTEM.
- 4) ALL CONSTRUCTION TO BE DONE IN ACCORDANCE WITH HOOPER IRR. COMPANY STANDARDS.

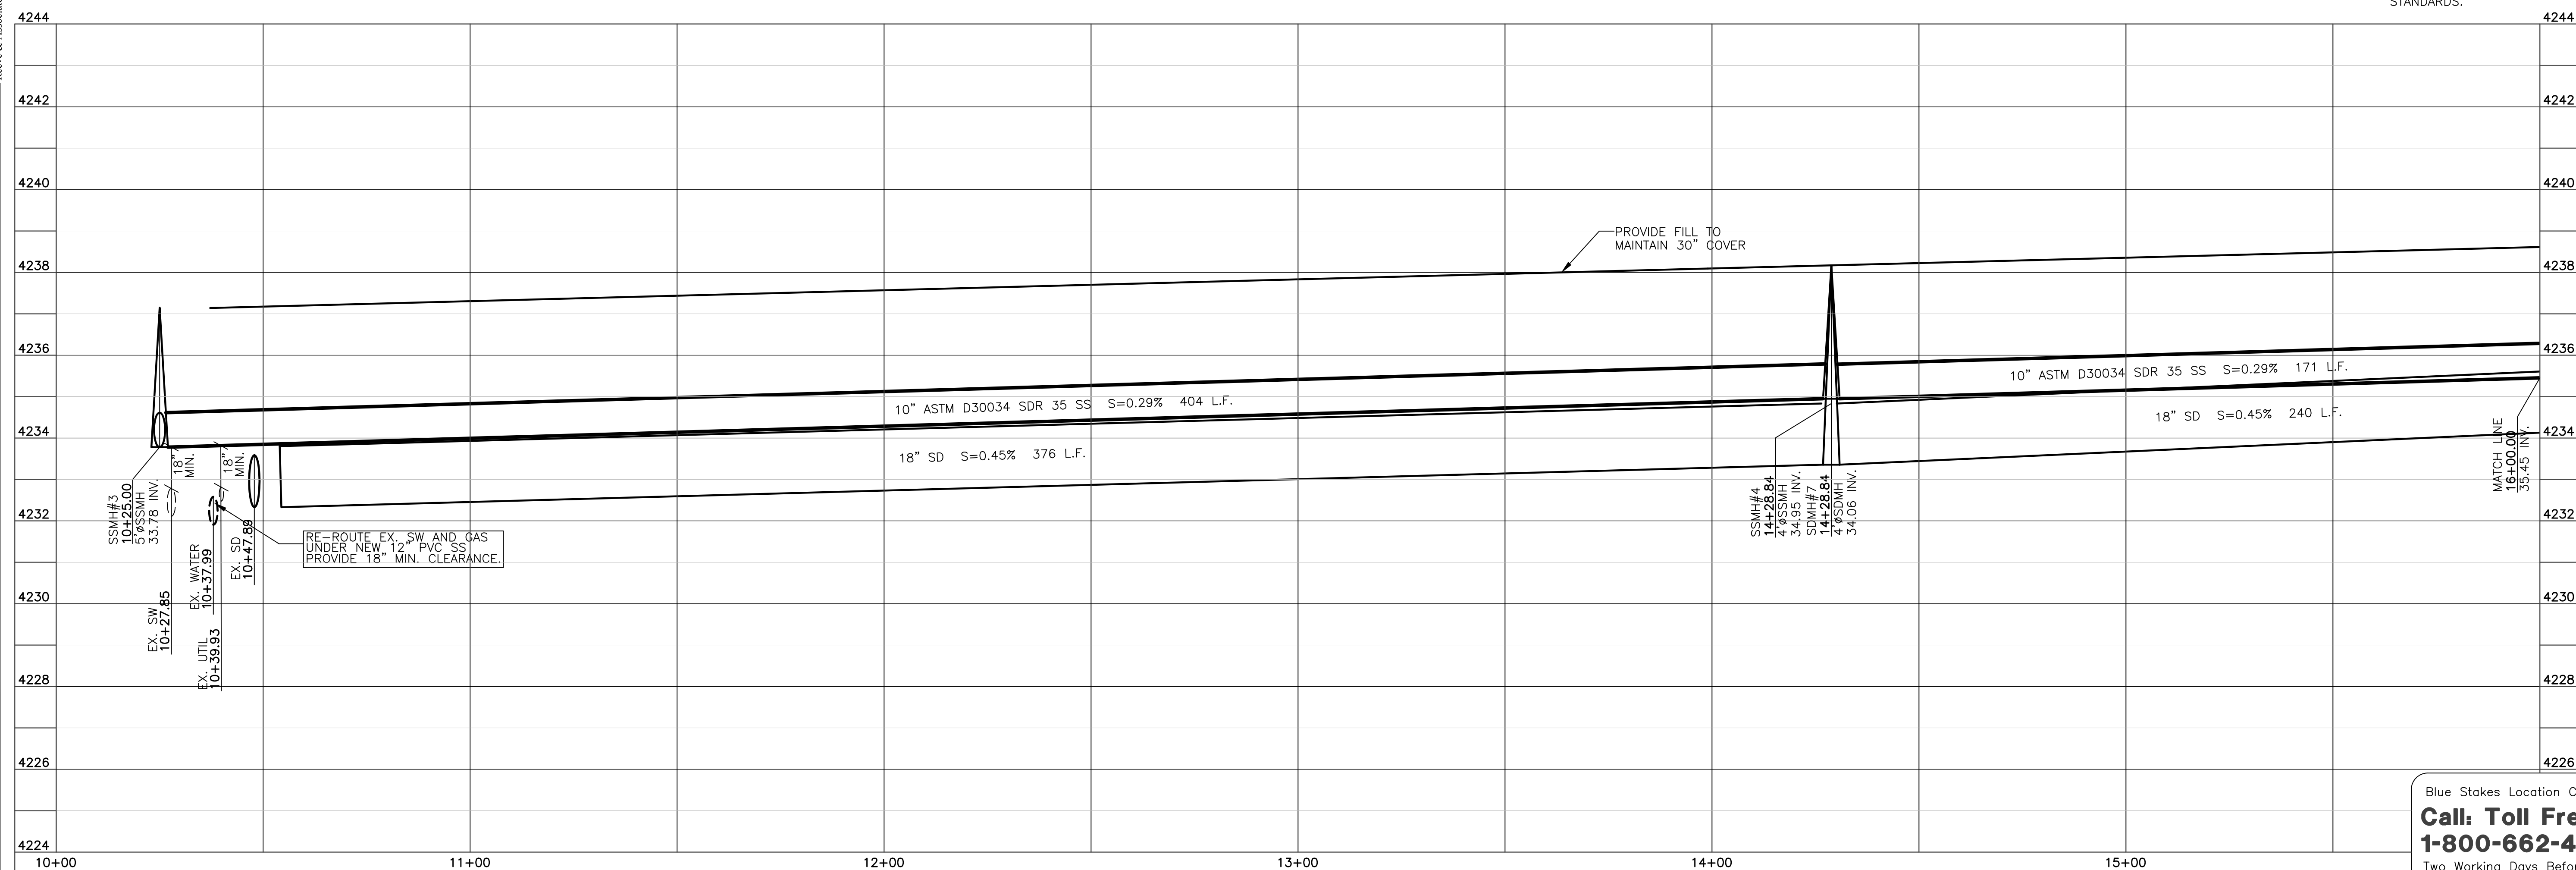


**Reeve & Associates, Inc.**  
920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403  
TEL: (801) 921-3100 FAX: (801) 621-2666 www.reeve-assoc.com  
CIVIL ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

DATE	DESCRIPTION
9-30-14	ST. County Comments
10-9-14	ST. County Comments
11-3-14	RH. Sewer Revisions
11-24-14	ST. HIC Comments
2-18-15	ST. County Comments
5-9-15	ST. County Comments
3-31-16	TP. Detention Update

**Mallard Springs Subdivision**  
WEBER COUNTY, UTAH


**Sanitary Sewer/Storm Drain Outfall**  
10+00.00 - 16+00.00

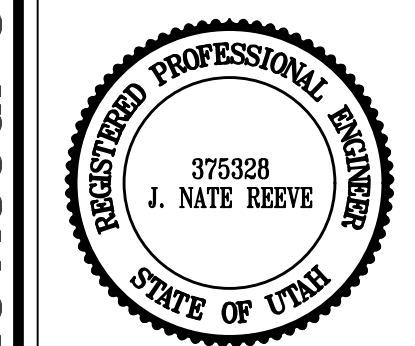

**Project Info.**  
Engineer: J. NATE REEVE, P.E.  
Drafter: R. HANSEN  
Begin Date: NOVEMBER 4, 2013  
Name: MALLARD SPRINGS SUBDIVISION  
Number: 3442-A30

Sheet **14** of **20** Sheets



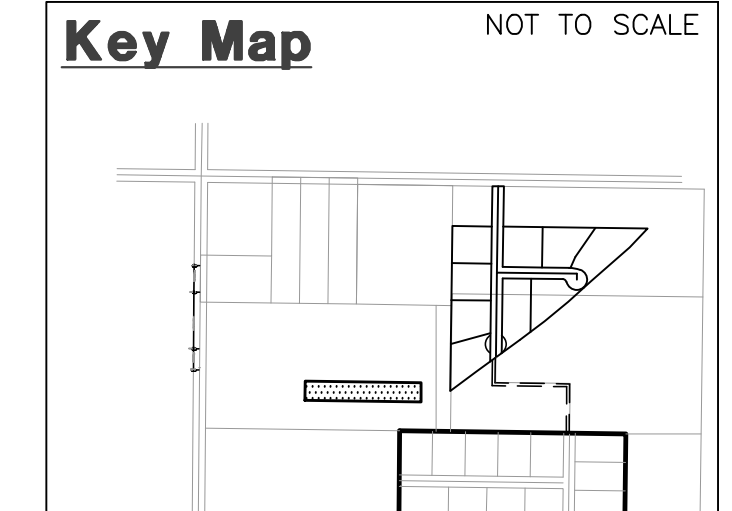


**Construction Notes:**



- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
  - 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.
- CULINARY WATER**  
W/8 - 8" PVC C-900 CLASS 200 WATER
- SANITARY SEWER**  
SS/8 - 8" ASTM D3034 SDR 35 SEWER  
SS/12 - 12" ASTM D3034 SDR 35 SEWER
- STORM DRAIN**  
SD/15 - 15" RCP STORM DRAIN
- SECONDARY WATER**  
SW/8 - 8" PVC C-900 SECONDARY WATER LINE

**Canal Crossing Notes**

- 1) ANY CROSSING OF THE HOOPER IRR. CANALS MUST OBTAIN A LICENSE AGREEMENT.
- 2) THE SEWER LINE MUST BE INSTALLED IN AN 18" STEEL CASING EXTENDING 4'-0" BEYOND HIGH BANK BOTH SIDES OF THE CANAL ACCORDING TO HOOPER IRR. COMPANY STANDARD DETAILS.
- 3) NO DRAINAGE FROM THE DEVELOPMENT IS ALLOWED INTO THE CANAL SYSTEM.
- 4) ALL CONSTRUCTION TO BE DONE IN ACCORDANCE WITH HOOPER IRR. COMPANY STANDARDS.

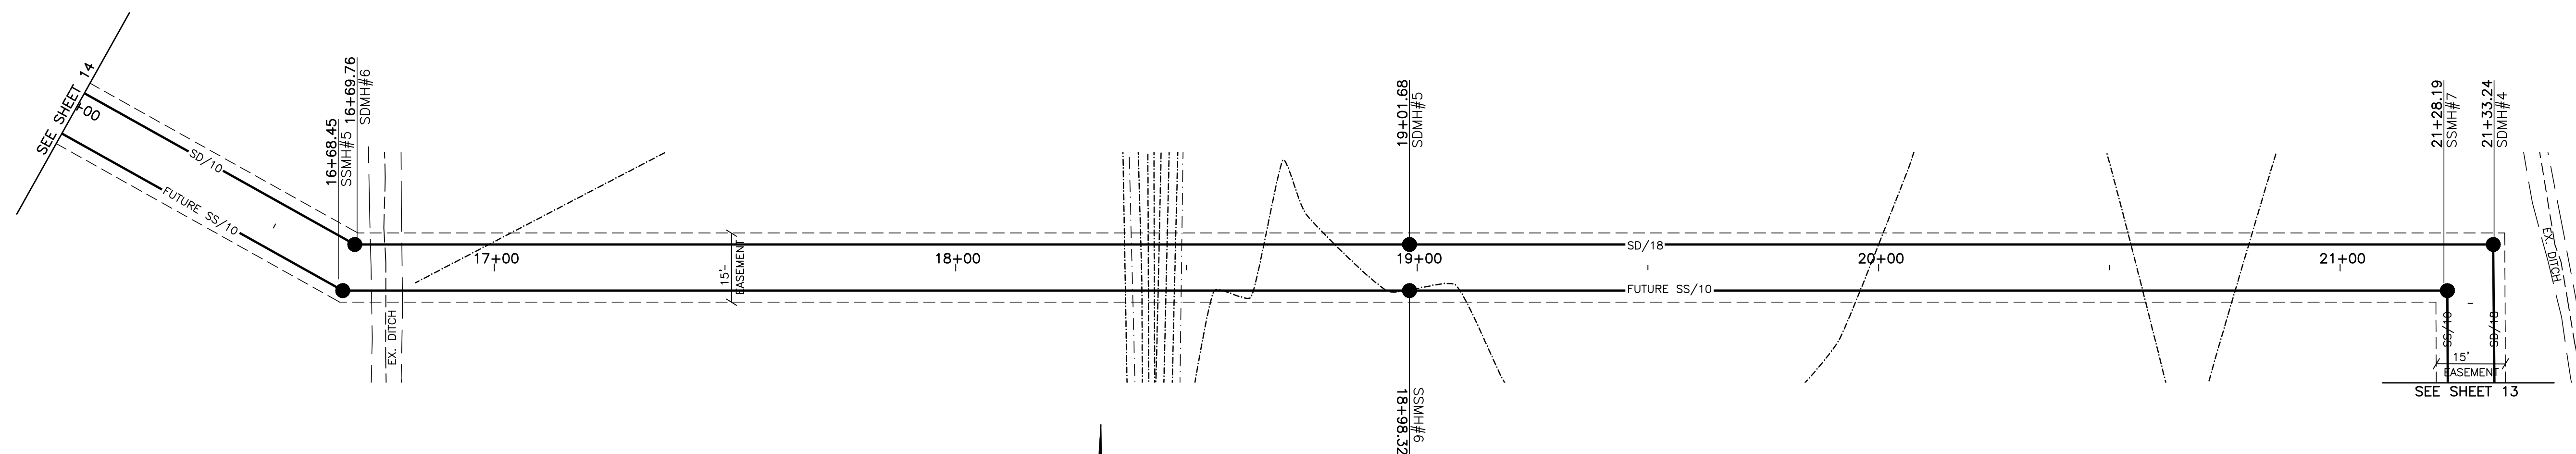

**Sanitary Sewer/Storm Drain Outfall**

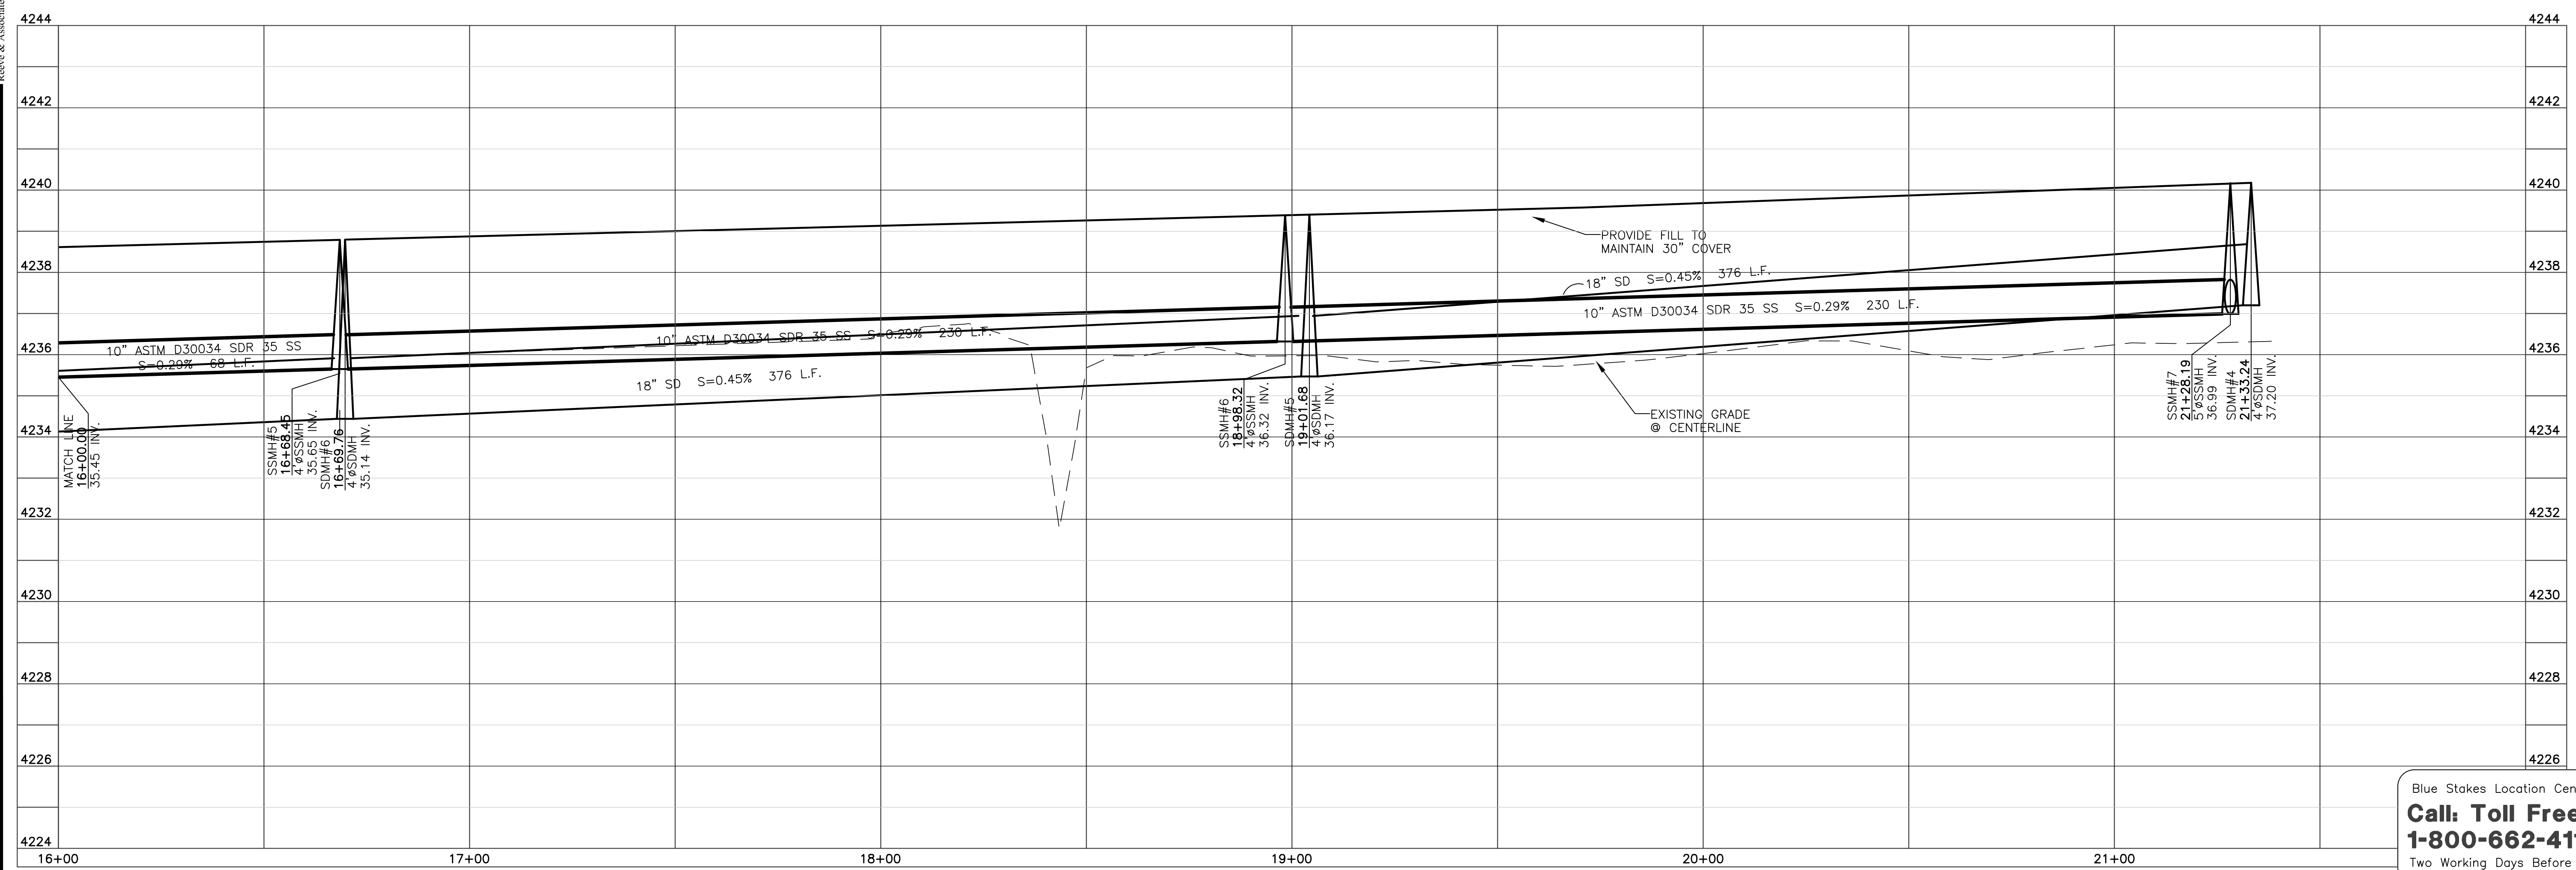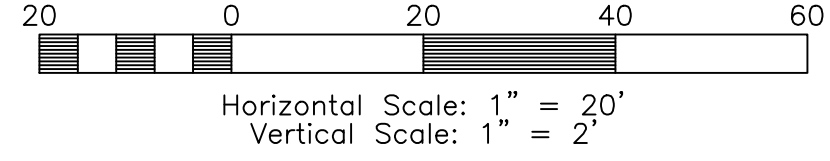


**Reeve & Associates, Inc.**  
920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403  
TEL: (801) 921-3100 FAX: (801) 621-2666 www.reeve-assoc.com  
TRAFFIC ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

DATE	DESCRIPTION
9-30-14	ST. County Comments
10-9-14	ST. County Comments
11-3-14	RH. Sewer Revisions
11-24-14	ST. HIC Comments
2-18-15	ST. County Comments
5-9-15	ST. County Comments
3-31-16	TP. Detention Update

**Mallard Springs Subdivision**  
WEBER COUNTY, UTAH

**Sanitary Sewer/Storm Drain Outfall**  
16+00.00 - 22+00.00

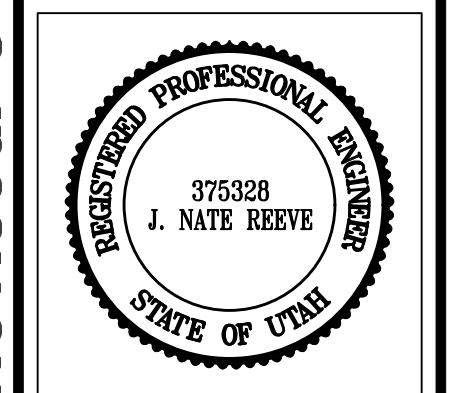


**Project Info.**

Engineer: J. NATE REEVE, P.E.  
 Drafter: R. HANSEN  
 Begin Date: NOVEMBER 4, 2013  
 Name: MALLARD SPRINGS SUBDIVISION  
 Number: 3442-A30

Sheet	20
15	Sheets



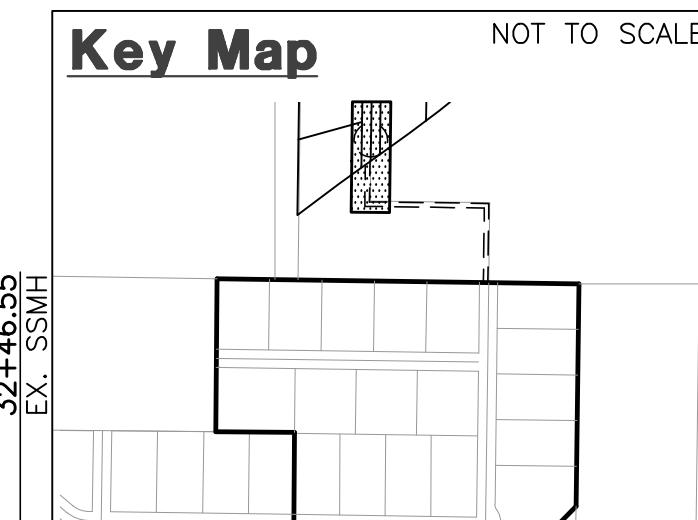

**Construction Notes:**

- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
- 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.

**CULINARY WATER**  
W/8 - 8" PVC C-900 CLASS 200 WATER

**SANITARY SEWER**  
SS/8 - 8" ASTM D3034 SDR 35 SEWER  
SS/12 - 12" ASTM D3034 SDR 35 SEWER




**STORM DRAIN**  
SD/15 - 15" RCP STORM DRAIN

**SECONDARY WATER**  
SW/8 - 8" PVC C-900 SECONDARY WATER LINE

**Canal Crossing Notes**

- 1) ANY CROSSING OF THE HOOPER IRR. CANALS MUST OBTAIN A LICENSE AGREEMENT.
- 2) THE SEWER LINE MUST BE INSTALLED IN AN 18" STEEL CASING EXTENDING 4'-0" BEYOND HIGH BANK BOTH SIDES OF THE CANAL ACCORDING TO HOOPER IRR. COMPANY STANDARD DETAILS.
- 3) NO DRAINAGE FROM THE DEVELOPMENT IS ALLOWED INTO THE CANAL SYSTEM.
- 4) ALL CONSTRUCTION TO BE DONE IN ACCORDANCE WITH HOOPER IRR. COMPANY STANDARDS.


Blue Stakes Location Center  
**Call: Toll Free**  
**1-800-662-4111**  
Two Working Days Before You Dig

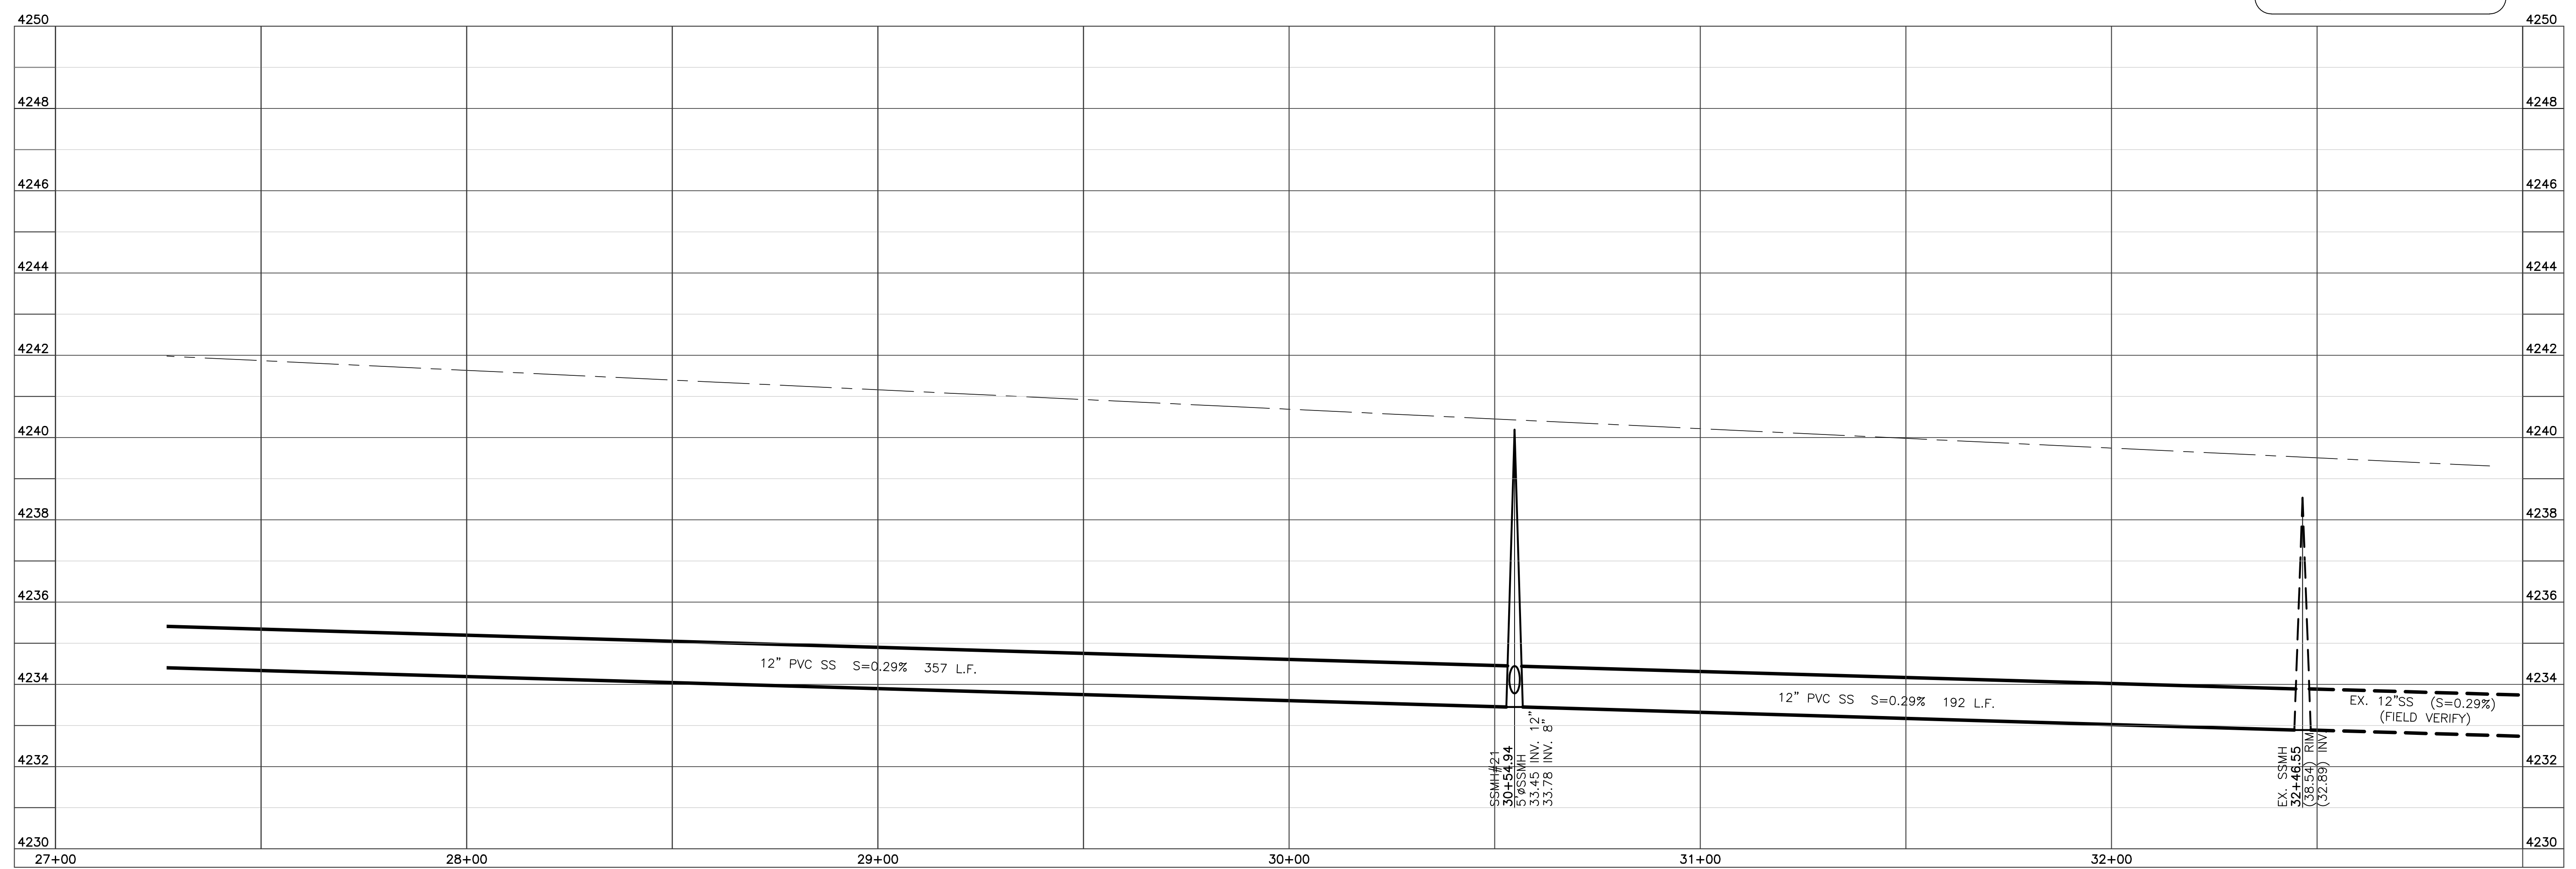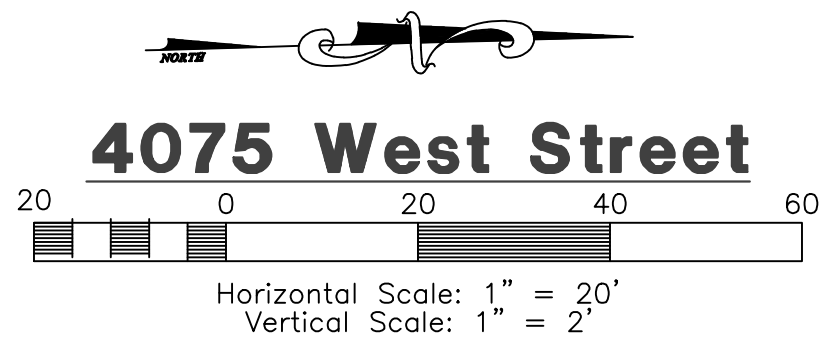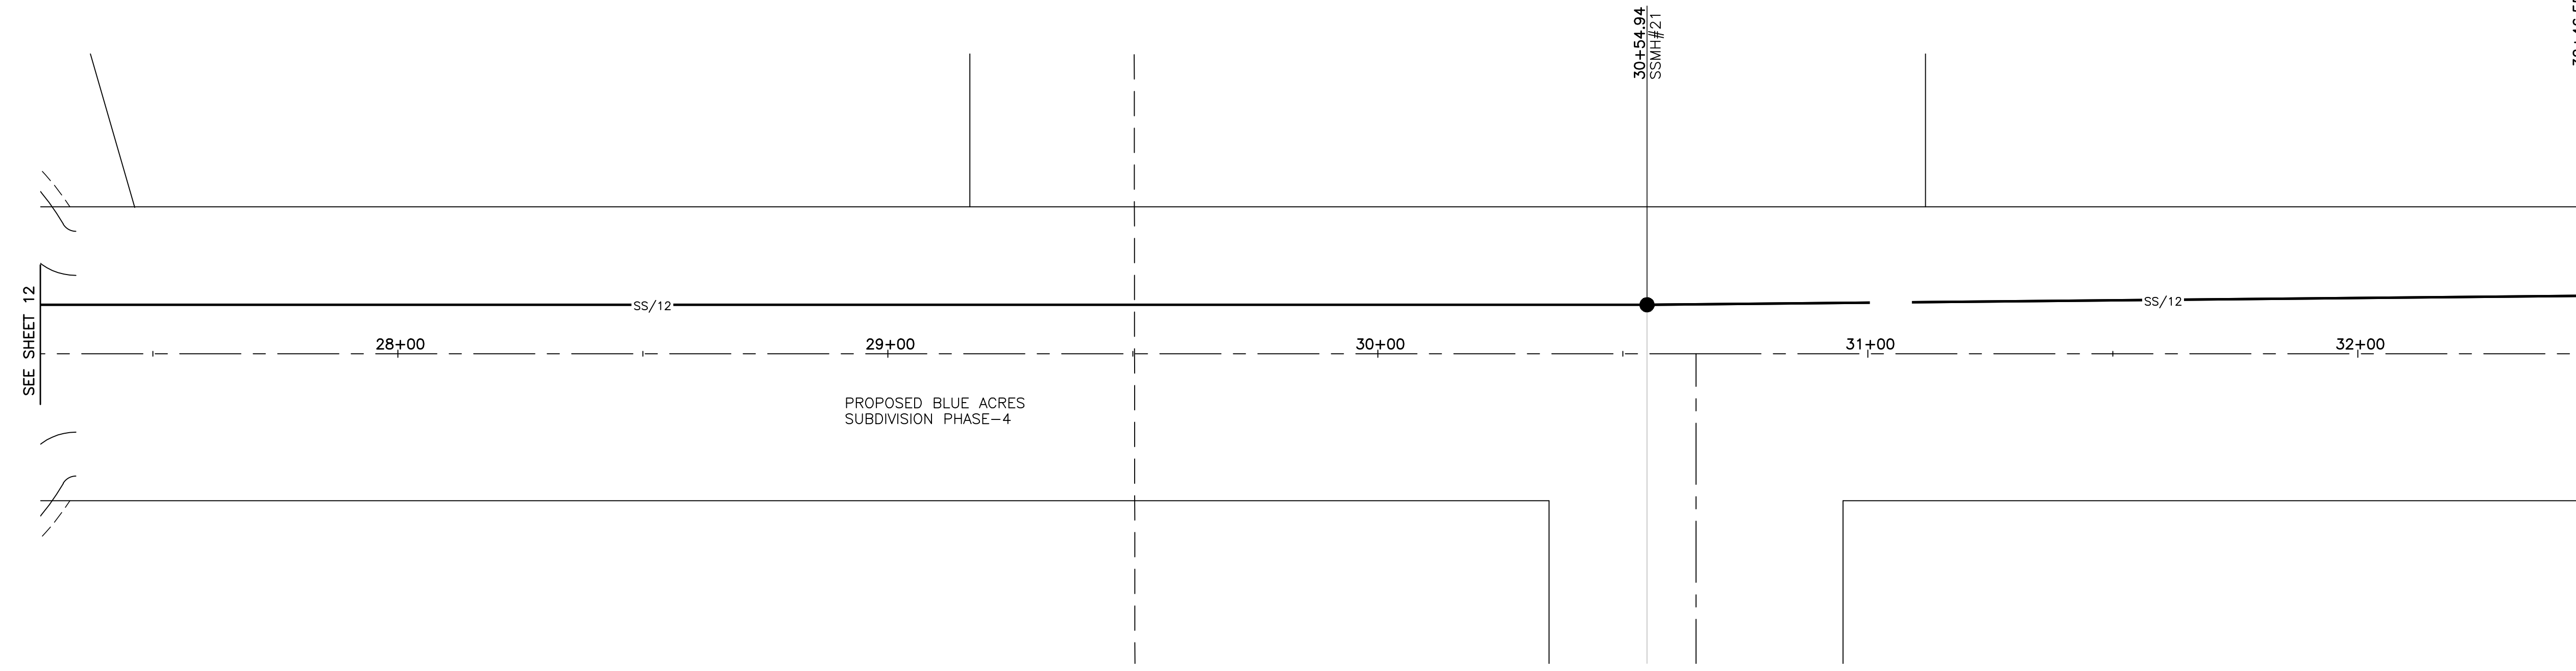

**Reeve & Associates, Inc.**  
920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403  
TEL: (801) 921-3100 FAX: (801) 621-2666 www.reeve-assoc.com  
TRAFFIC ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

DATE	DESCRIPTION
9-30-14	ST. County Comments
10-9-14	ST. County Comments
11-24-14	RH. Sewer Revisions
11-24-14	ST. HIC Comments
2-18-15	ST. County Comments
5-9-15	ST. County Comments
3-31-16	TP. Detention Update

**Mallard Springs Subdivision**  
WEBER COUNTY, UTAH

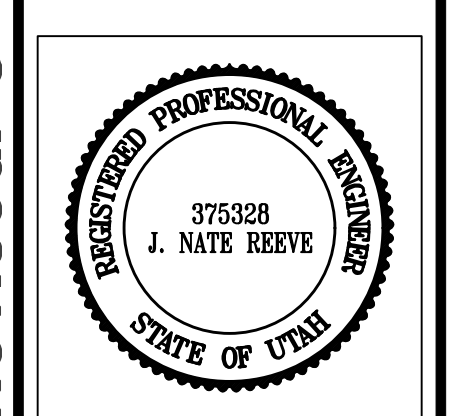

**Project Info.**  
Engineer: J. NATE REEVE, P.E.  
Drafter: R. HANSEN  
Begin Date: NOVEMBER 4, 2013  
Name: MALLARD SPRINGS SUBDIVISION  
Number: 3442-A30


Sheet **20**  
**16** Sheets




# MALLARD SPRINGS SUBDIVISION

## Storm Water Pollution Prevention Plan Exhibit

WEBER COUNTY, UTAH  
NOVEMBER 2013

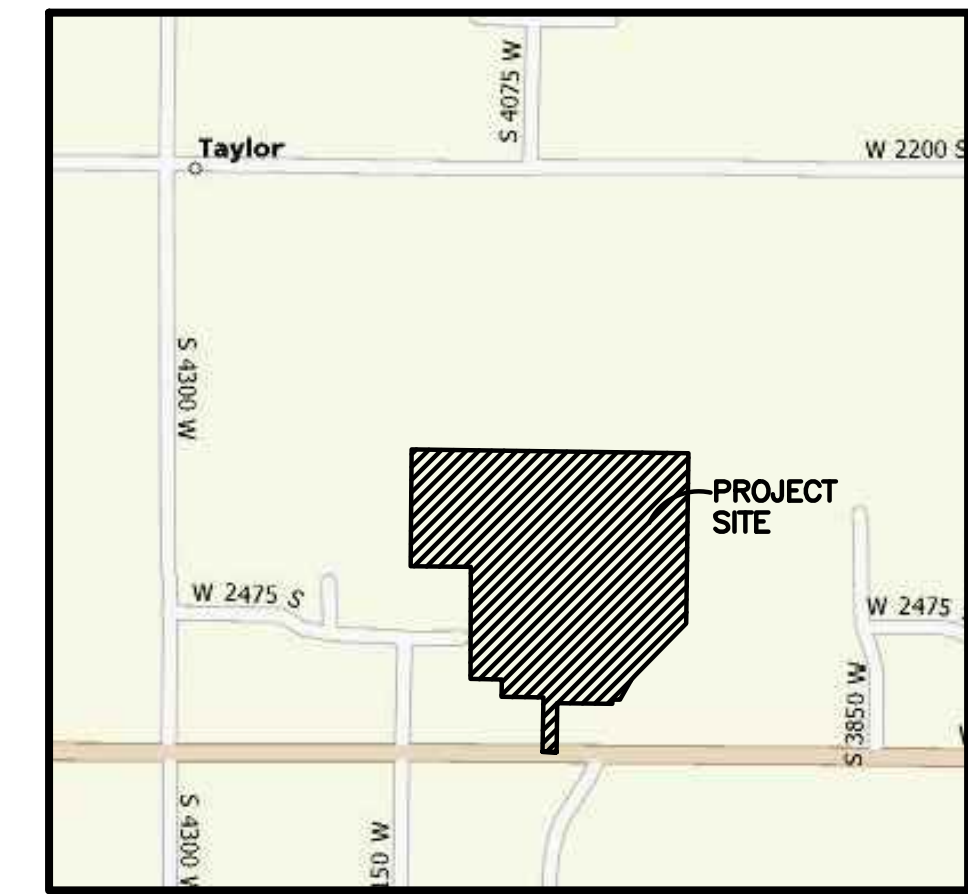


Vicinity Map  
NOT TO SCALE

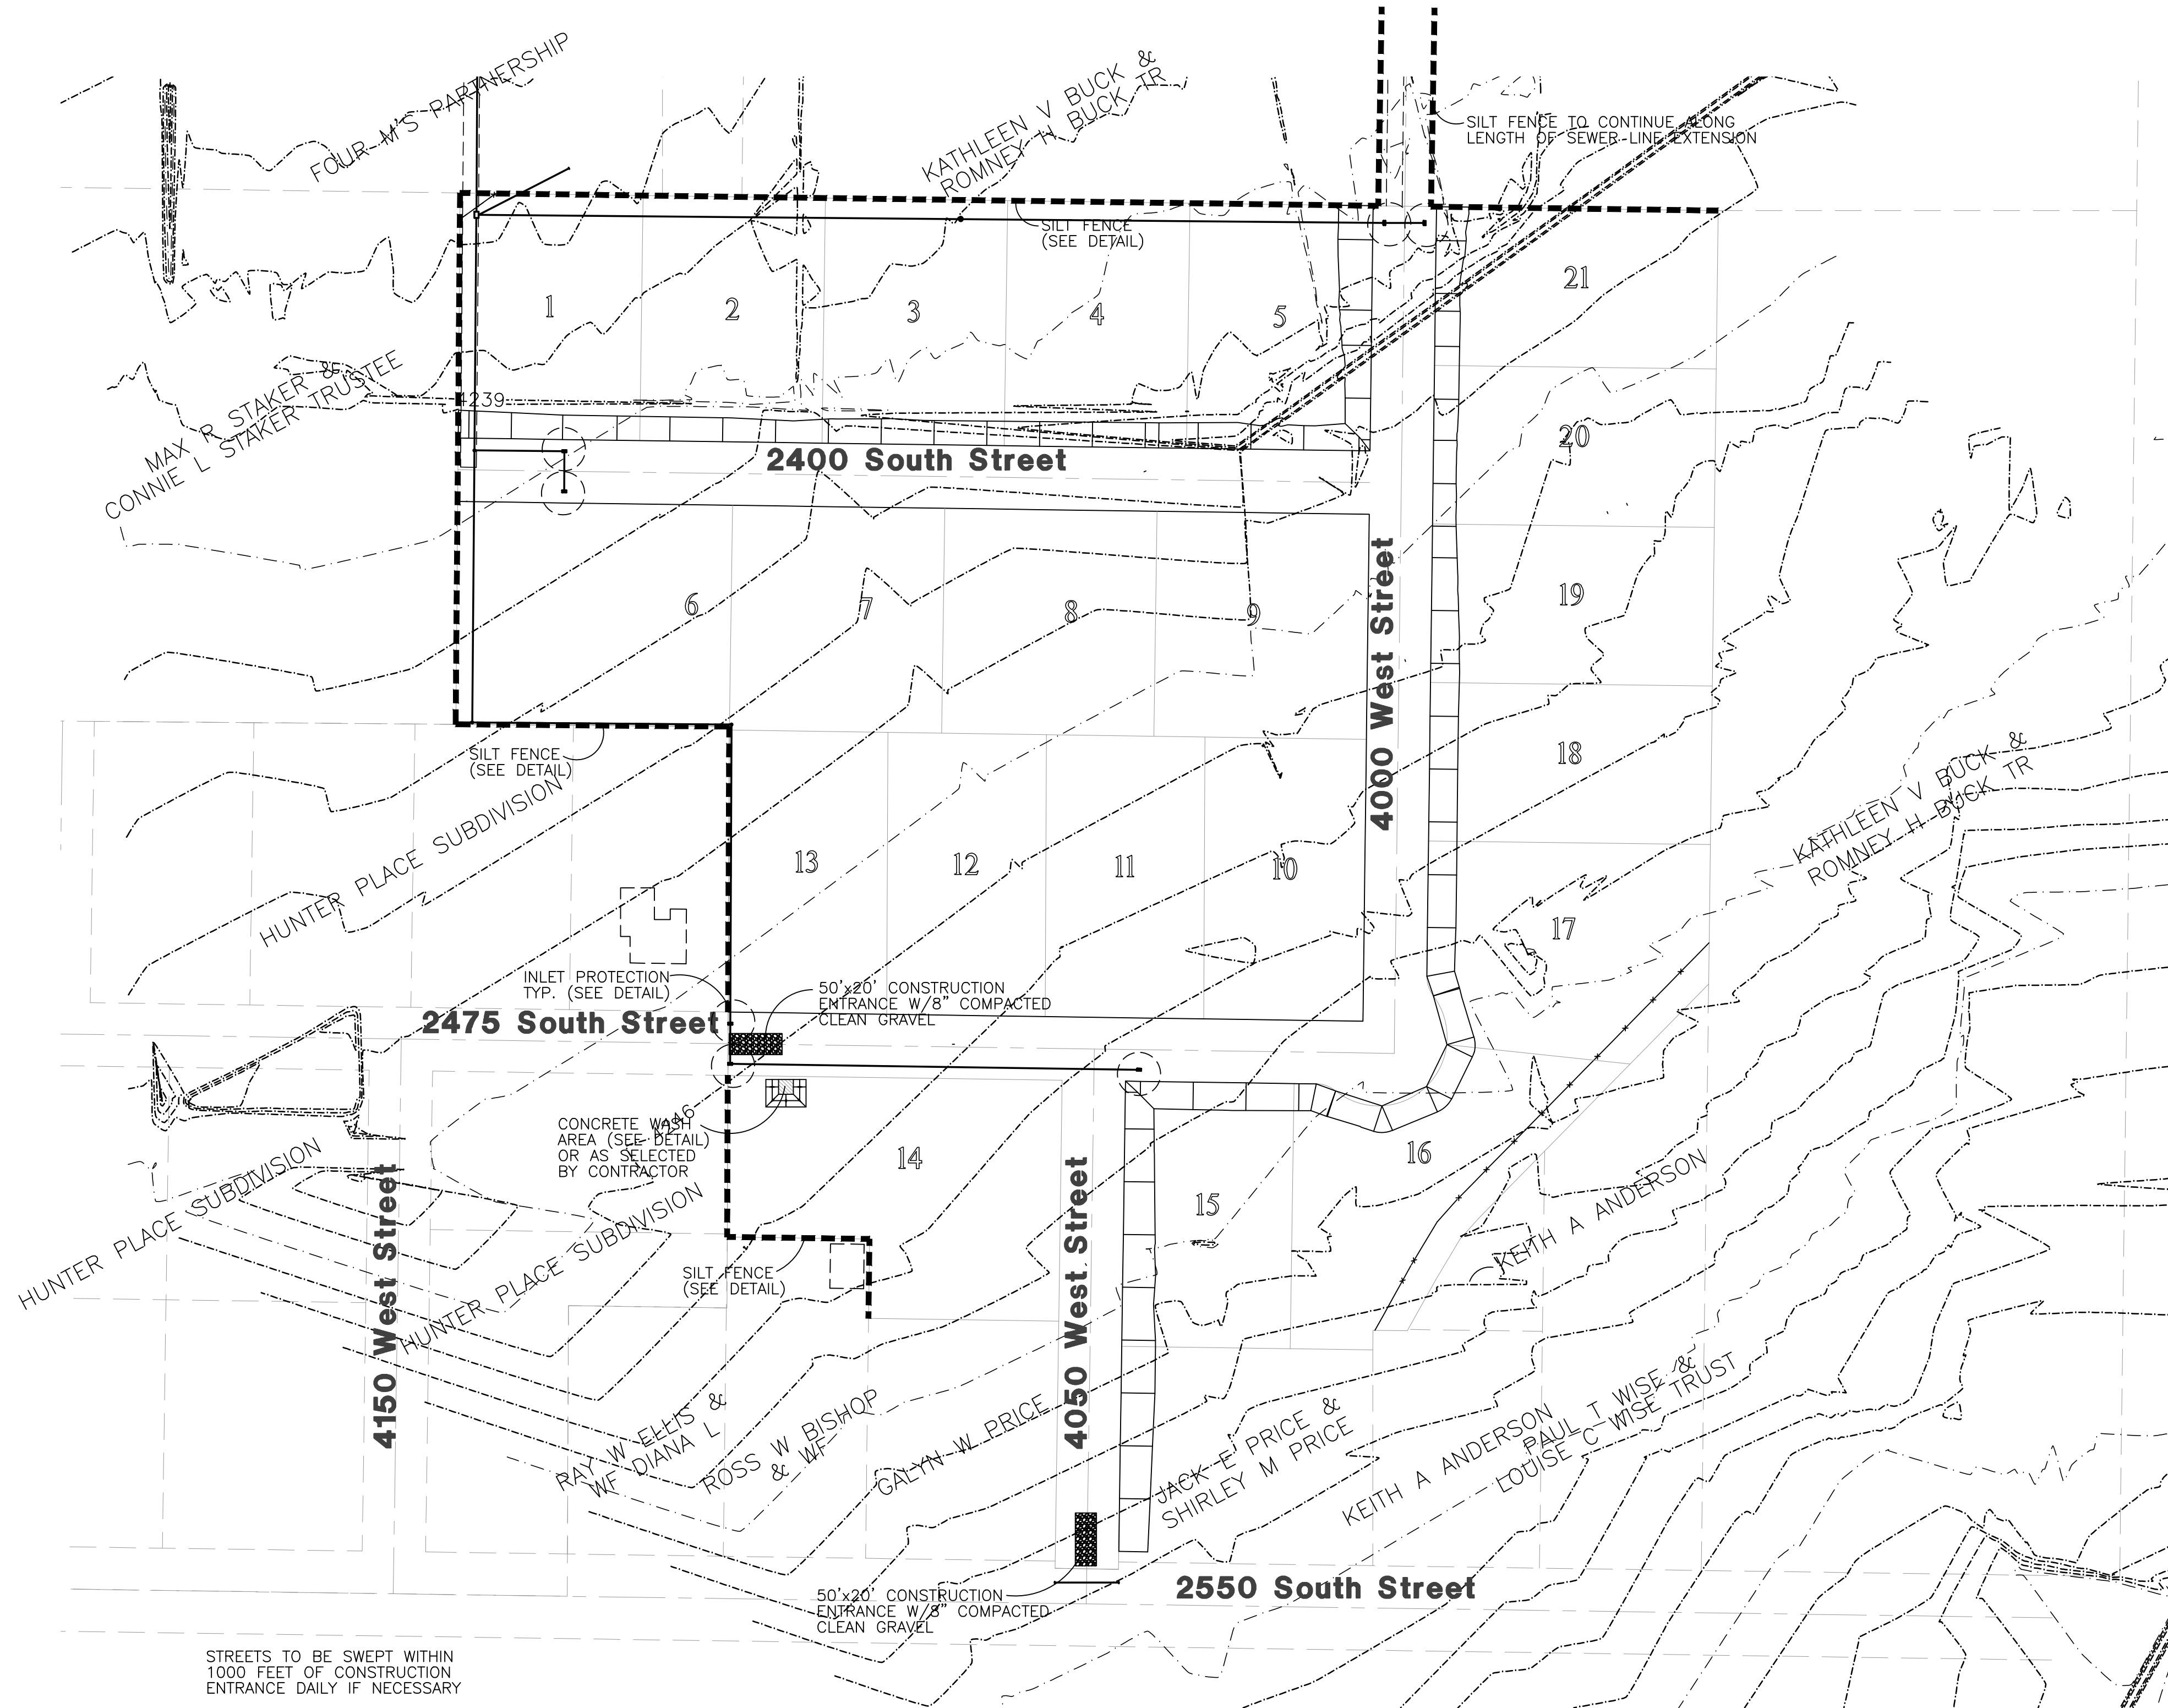

STREETS TO BE SWEEPED WITHIN 1000 FEET OF CONSTRUCTION ENTRANCE DAILY IF NECESSARY

ALL VEHICLES EXITING SITE TO PROCEED THROUGH CONSTRUCTION ENTRANCE TO REDUCE AMOUNTS OF SEDIMENT TRACKED ONTO ROADWAYS.

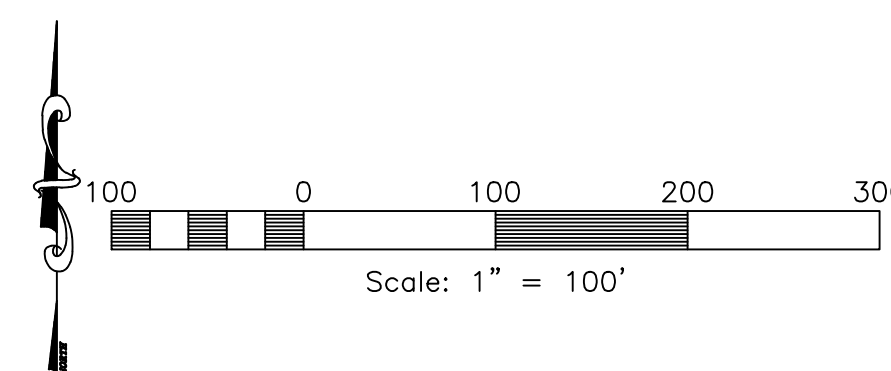

Construction Activity Schedule	
- PROJECT LOCATION.....	WEBER COUNTY, UTAH
- PROJECT BEGINNING DATE.....	NOVEMBER 2013
- BMP'S DEPLOYMENT DATE.....	NOVEMBER 2013
- STORM WATER MANAGEMENT CONTACT / INSPECTOR.....	DOUG HAMBLIN (801) 731-7703
- SPECIFIC CONSTRUCTION SCHEDULE INCLUDING BMP CONSTRUCTION SCHEDULE TO BE INCLUDED WITH SWPPP BY OWNER/DEVELOPER	

**Reeve & Associates, Inc.**  
 920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403  
 TEL: (801) 921-5100 FAX: (801) 621-2666 www.reeve-assoc.com  
 CIVIL ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

DATE	DESCRIPTION
9-30-14	ST. County Comments
10-9-14	ST. County Comments
11-1-14	RH. Sewer Revisions
11-24-14	ST. HIC Comments
2-18-15	ST. County Comments
5-9-15	ST. County Comments
3-31-16	TP. Detention Update

**Mallard Springs Subdivision**  
 WEBER COUNTY, UTAH  
**Storm Water Pollution Prevention Plan Exhibit**


Revised: 5-18-15

**Project Info.**  
 Engineer: J. NATE REEVE, P.E.  
 Drafter: R. HANSEN  
 Begin Date: NOVEMBER 4, 2013  
 Name: MALLARD SPRINGS SUBDIVISION  
 Number: 3442-A30




**Notes:**

- Describe all BMP's to protect storm water inlets:  
All storm water inlets to be protected by straw wattle barriers, or gravel bags (see detail).
- Describe BMP's to eliminate/reduce contamination of storm water from:
  - Equipment / building / concrete wash areas:  
To be performed in designated areas only and surrounded with silt fence barriers.
  - Soil contaminated by soil amendments:  
If any contaminants are found or generated, contact environmental engineer and contacts listed.
  - Areas of contaminated soil:  
If any contaminants are found or generated, contact environmental engineer and contacts listed.
  - Fueling area:  
To be performed in designated areas only and surrounded with silt fence.
  - Vehicle maintenance areas:  
To be performed in designated areas only and surrounded with silt fence.
  - Vehicle parking areas:  
To be performed in designated areas only and surrounded with silt fence.
  - Equipment storage areas:  
To be performed in designated areas only and surrounded with silt fence.
  - Materials storage areas:  
To be performed in designated areas only and surrounded with silt fence.
  - Waste containment areas:  
To be performed in designated areas only and surrounded with silt fence.
  - Service areas:  
To be performed in designated areas only and surrounded with silt fence.
- BMP's for wind erosion:  
Stockpiles and site as needed to be watered regularly to eliminate / control wind erosion
- Construction Vehicles and Equipment:
  - Maintenance
    - Maintain all construction equipment to prevent oil or other fluid leaks.
    - Keep vehicles and equipment clean, prevent excessive build-up of oil and grease.
    - Regularly inspect on-site vehicles and equipment for leaks, and repair immediately.
    - Check incoming vehicles and equipment (including delivery trucks, and employee and subcontractor vehicles) for leaking oil and fluids. Do not allow leaking vehicles or equipment on-site.
    - Segregate and recycle wastes, such as greases, used oil or oil filters, antifreeze, cleaning solutions, automotive batteries, hydraulic, and transmission fluids.
  - Fueling
    - If fueling must occur on-site, use designated areas away from drainage.
    - Locate on-site fuel storage tanks within a bermed area designed to hold the tank volume.
    - Cover retention area with an impervious material and install in a manner to ensure that any spills will be contained in the retention area. To catch spills or leaks when removing or changing fluids.
    - Use drip pans for any oil or fluid changes.
  - Washing
    - Use as little water as possible to avoid installing erosion and sediment controls for the wash area.
    - If washing must occur on-site, use designated, bermed wash areas to prevent waste water discharge into storm water, creeks, rivers, and other water bodies.
    - Use phosphate-free, biodegradable soaps.
    - Do not permit steam cleaning on-site.
- Spill Prevention and Control
  - Minor Spills:  
Minor spills are those which are likely to be controlled by on-site personnel. After contacting local emergency response agencies, the following actions should occur upon discovery of a minor spill:
    - Contain the spread of the spill.
    - If the spill occurs on paved or impermeable surfaces, clean up using "dry" methods (i.e. absorbent materials, cat litter, and / or rags).
    - If the spill occurs in dirt areas, immediately contain the spill by constructing an earth dike. Dig up property dispose of contaminated soil.
    - If the spill occurs during rain, cover the impacted area to avoid runoff.
    - Record all steps taken to report and contain spill.
  - Major Spills:  
On-site personnel should not attempt to control major spills until the appropriate and qualified emergency response staff have arrived at the site. For spills of federal reportable quantities, also notify the National Response Center at (800) 424-8802. A written report should be sent to all notified authorities. Failure to report major spills can result in significant fines and penalties.
- Post Roadway / Utility Construction
  - Maintain good housekeeping practices.
  - Enclose or cover building material storage areas.
  - Properly store materials such as paints and solvents.
  - Store dry and wet materials under cover, away from drainage areas.
  - Avoid mixing excess amounts of fresh concrete or cement on-site.
  - Perform washout of concrete trucks offsite or in designated areas only.
  - Do not wash out concrete trucks into storm drains, open ditches, streets or streams.
  - Do not place material or debris into streams, gutters or catch basins that stop or reduce the flow of runoff water.
  - All public streets and storm drain facilities shall be maintained free of building materials, mud and debris caused by grading or construction operations. Roads will be swept within 1000' of construction entrance daily, if necessary.
  - Install straw wattle around all inlets contained within the development and all others that receive runoff from the development.
- Erosion Control Plan Notes
  - The contractor will designate an emergency contact that can be reached 24 hours a day 7 days a week.
  - A stand-by crew for emergency work shall be available at all times during potential rain or snow runoff events. Necessary materials shall be available on site and stockpiled at convenient locations to facilitate rapid construction of emergency devices when rain or runoff is eminent.
  - Erosion control devices shown on the plans and approved for the project may not be removed without approval of the engineer of record. If devices are removed, no work may continue that have the potential of erosion without consulting the engineer of record. If deemed necessary erosion control should be reestablished before this work begins.
  - Graded areas adjacent to fill slopes located at the site perimeter must drain away from the top of the slope at the conclusion of each working day. This should be confirmed by survey or other means acceptable to the engineer of record.
  - All silt and debris shall be removed from all devices within 24 hours after each rain or runoff event.
  - Except as otherwise approved by the inspector, all removable protective devices shown shall be in place at the end of each working day and through weekends until removal of the system is approved.
  - All loose soil and debris, which may create a potential hazard to offsite property, shall be removed from the site as directed by the Engineer of record of the governing agency.
  - The placement of additional devices to reduce erosion damage within the site is left to the discretion of the Engineer of record.
  - Desilting basins may not be removed or made inoperable without the approval of the engineer of record and the governing agency.
  - Erosion control devices will be modified as need as the project progresses, and plans of these changes submitted for approval by the engineer of record and the governing agency.
- Conduct a minimum of one inspection of the erosion and sediment controls every two weeks. Maintain documentation on site.
  - Part III.D.4 of general permit UTR300000 identifies the minimum inspection requirements.
  - Part II.D.4.C identifies the minimum inspection report requirements.
  - Failure to complete and/or document storm water inspections is a violation of part III.D.4 of Utah General Permit UTR 300000.

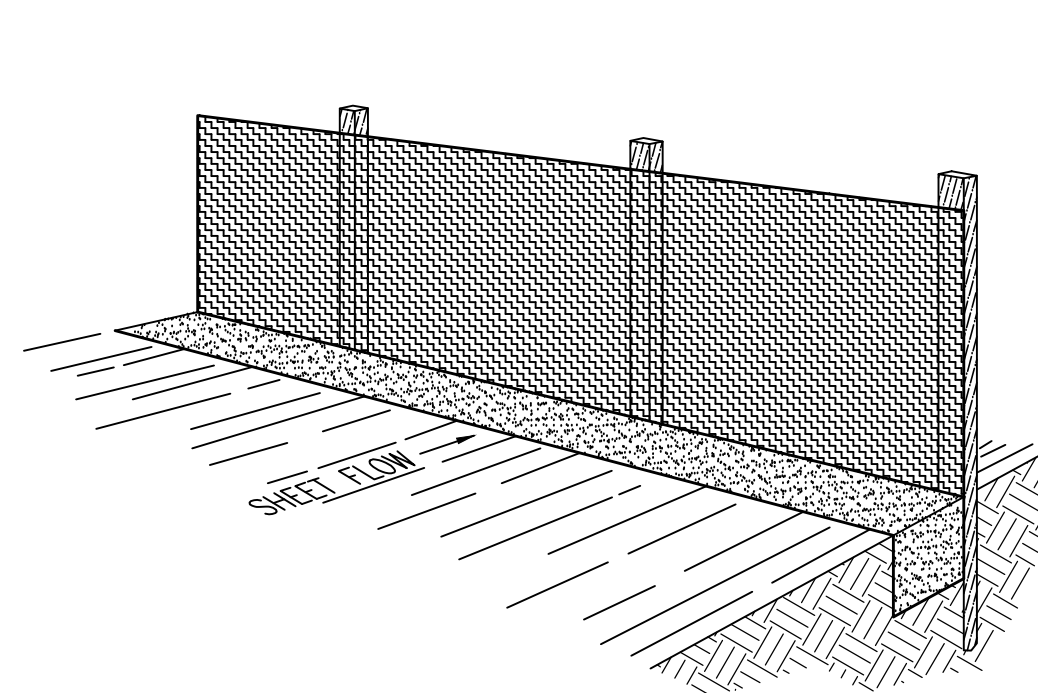

**Perspective View**

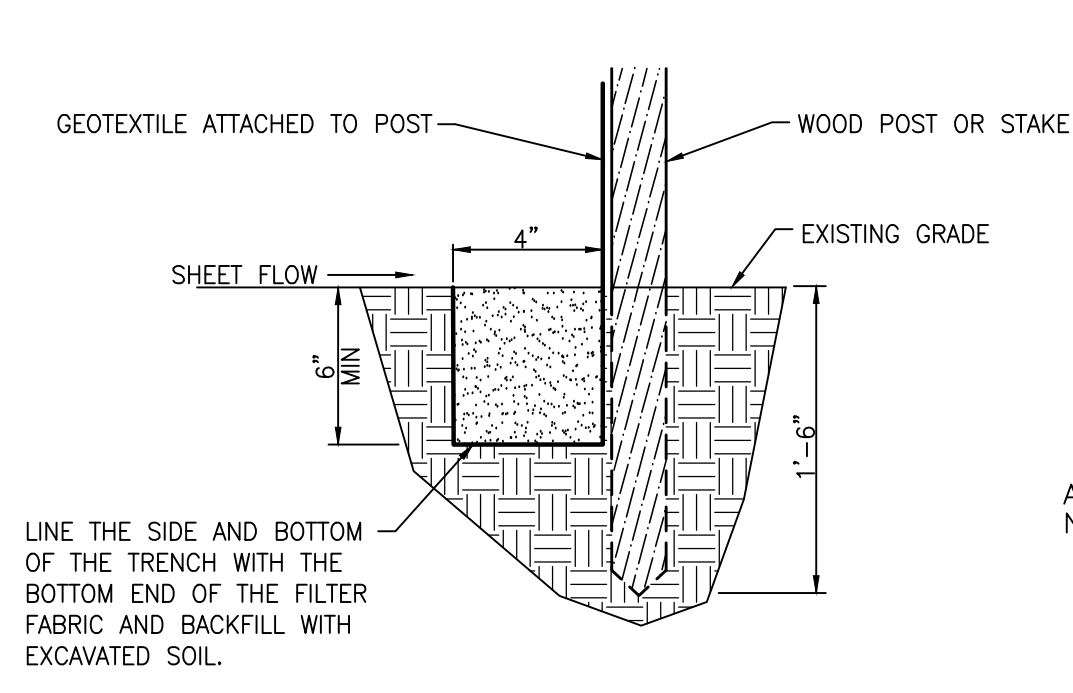

**Section**

**INSTALLATION**

The silt fence should be installed prior to major soil disturbances in the drainage area. The fence should be placed across the slope along a line of uniform elevation wherever flow of sediment is anticipated. Table 1 shows generally-recommended maximum slope lengths (slope spacing between fences) at various site grades for most silt fence applications.

TABLE 1: Recommended Maximum Slope Lengths for Silt Fence (Richardson & Middlebrooks, 1991)	
Slope Steepness (%)	Max. Slope Length m (ft)
<2%	30.5m (100ft)
2-5%	22.9m (75ft)
5-10%	15.2m (50ft)
10-20%	7.6m (25ft)
>20%	4.5m (15ft)

**PREFABRICATED SILT FENCE ROLLS**

- Excavate a minimum 15.2cm x 15.2cm (6"x6") trench at the desired location.
- Unroll the silt fence, positioning the post against the downstream wall of the trench.
- Adjacent rolls of silt fence should be joined by nesting the end post of one fence into the other. Before nesting the end posts, rotate each post until the geotextile is wrapped completely around the post, then abut the end posts to create a tight seal as shown in Figure 1.
- Drive posts into the ground until the required fence height and/or anchorage depth is obtained.
- Bury the loose geotextile at the bottom of the fence in the upstream trench and backfill with natural soil, tamping the backfill to provide good compaction and anchorage. Figure 2 illustrates a typical silt fence installation and anchor trench placement.

should generally be less than three (3) times the height of the fence.  
If a steel or plastic mesh is required to reinforce the geotextile, it shall have a minimum mesh opening of 15.2cm (6").  
Fasten the mesh to the upslope side of the posts using heavy duty wire staples, tie wires or hog strings. Extend the mesh into the bottom of the trench.  
The geotextile shall then be stapled or wired to the posts. An extra 20-50cm (8-20") of geotextile shall extend into the trench.

**INSPECTION**

- Inspect the silt fence daily during periods of rainfall, immediately after significant rainfall event and weekly during periods of no rainfall. Make any repairs immediately.
- When sediment deposits behind the silt fence are one-third of the fence height, remove and properly dispose of the silt accumulations. Avoid damage to the fabric during cleanup.

**REMOVAL**

- Silt fence should not be removed until construction ceases and the upslope area has been properly stabilized and/or revegetated.


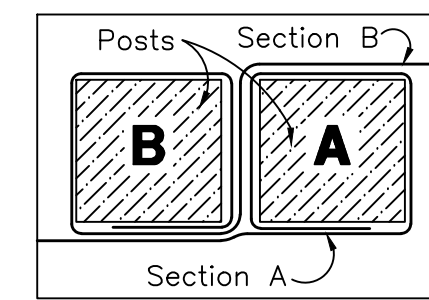


Figure 1: Top View of Roll-to-Roll Connection


**Silt Fence Detail**

SCALE: NONE

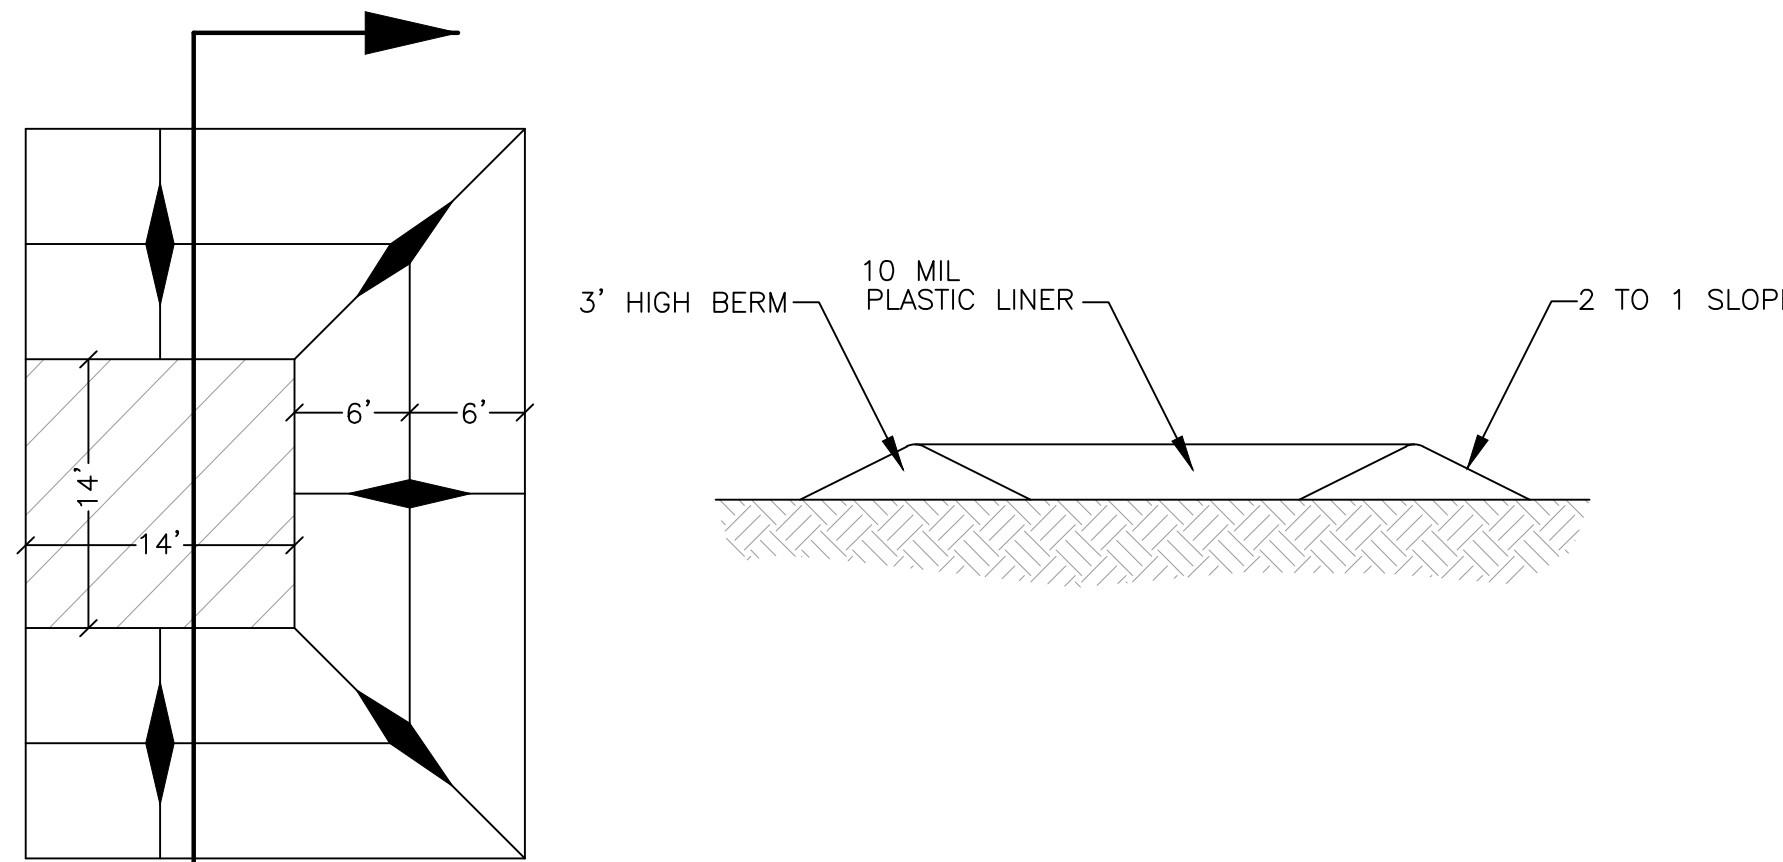


**Concrete Washout Area w/ 10 mil Plastic Liner**


SCALE: NONE

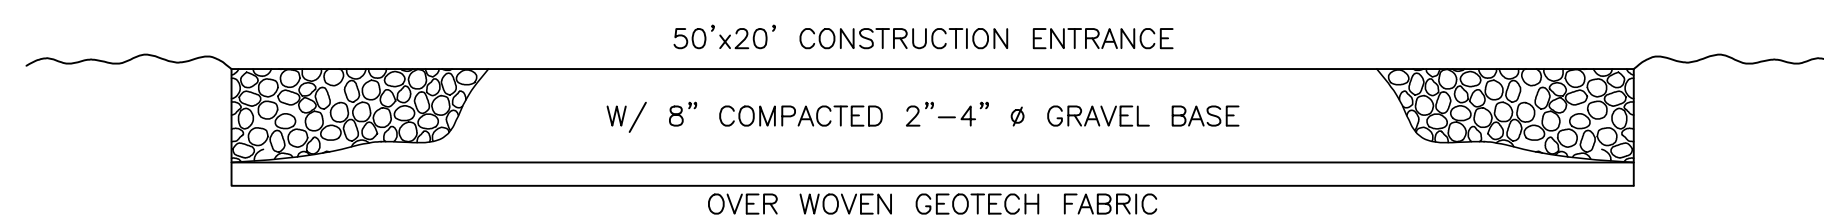


**Cross Section 50' x 20' Construction Entrance**

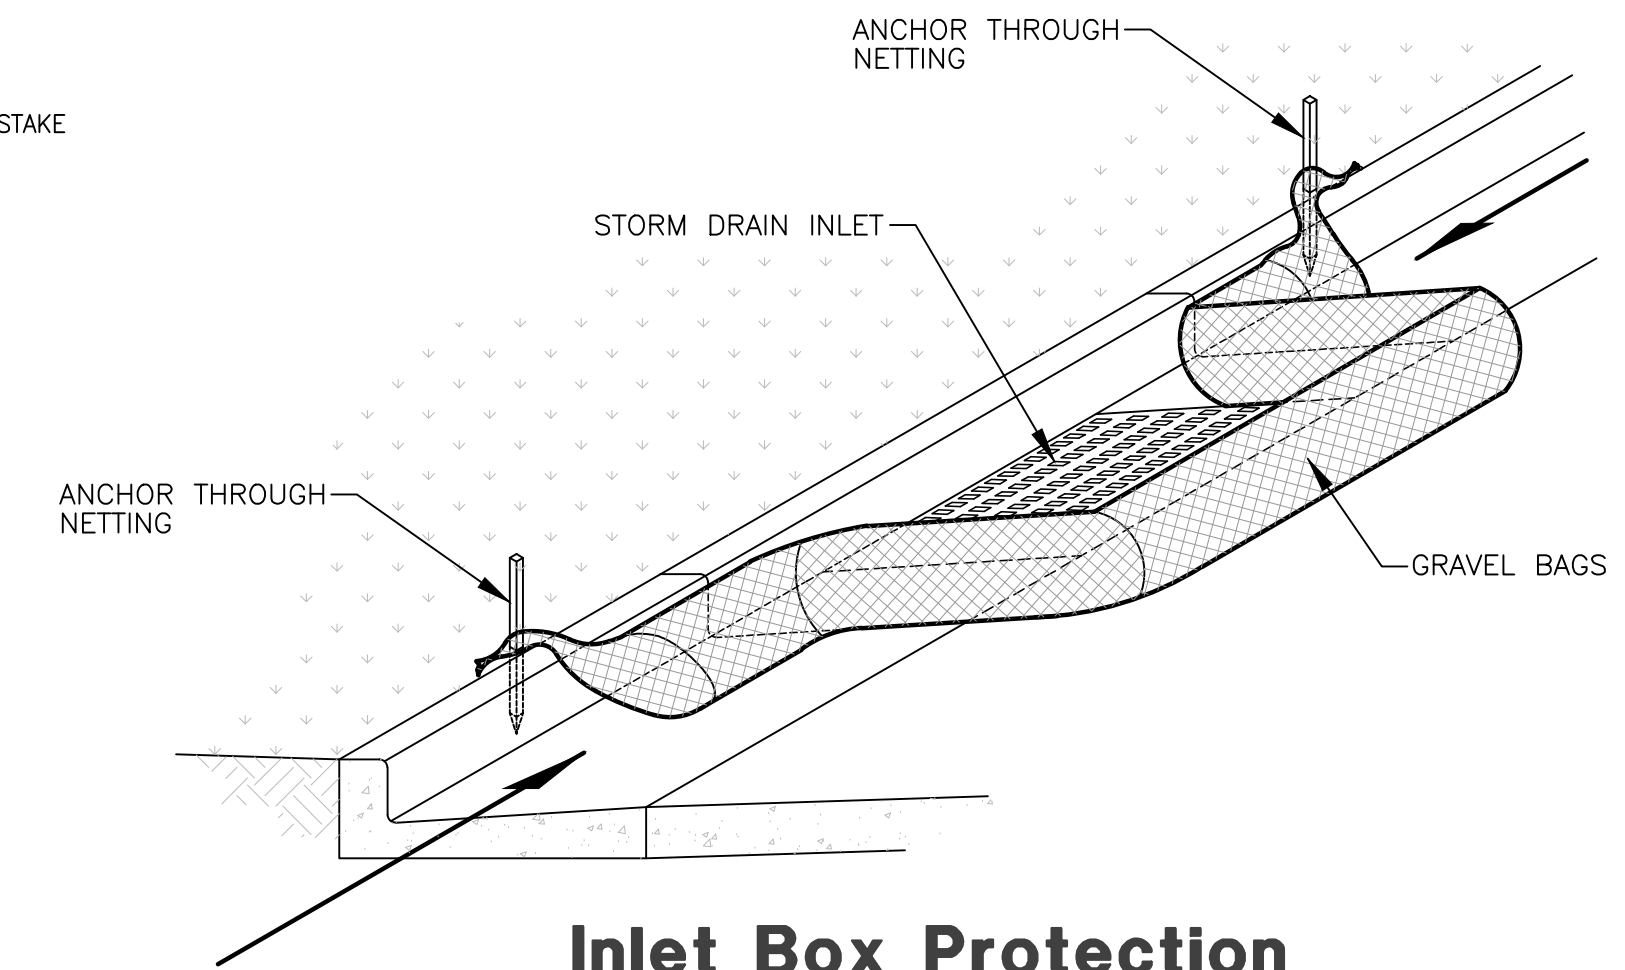


**Inlet Box Protection**

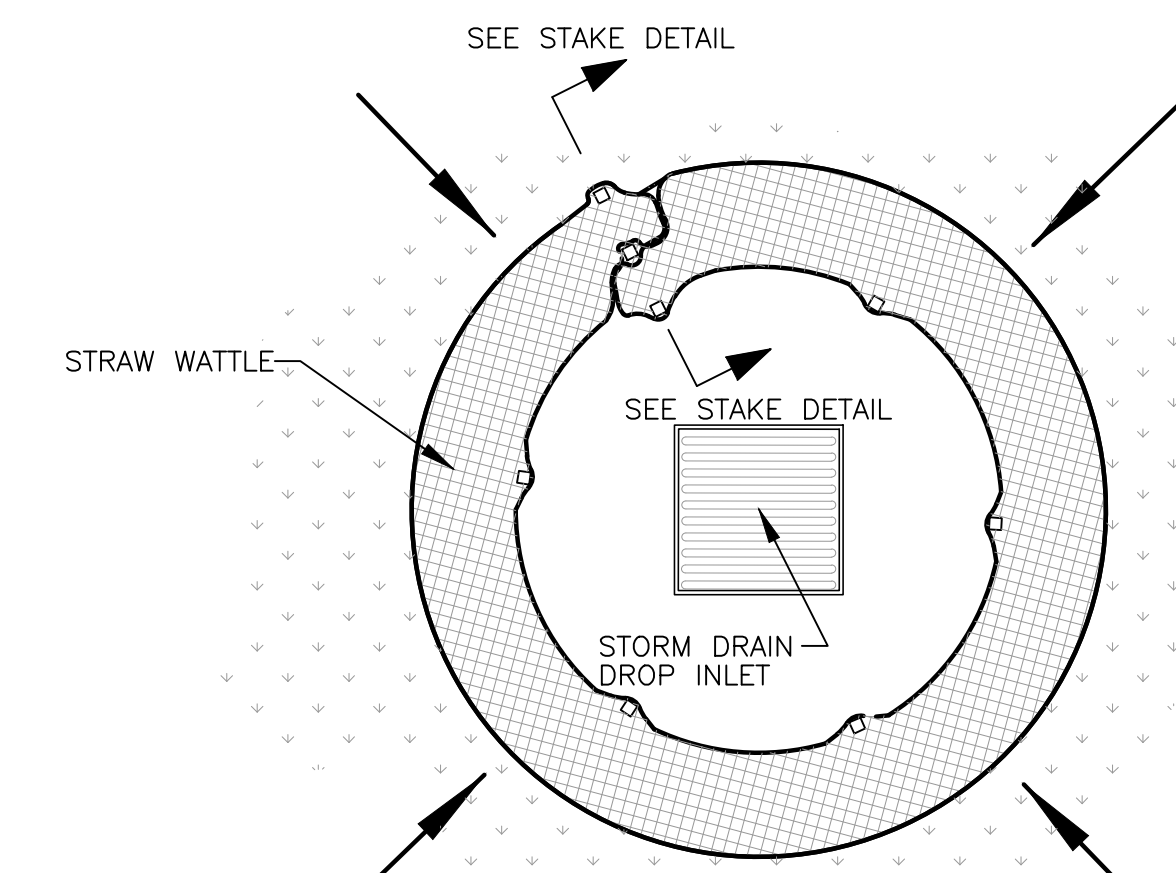

**Plan View**

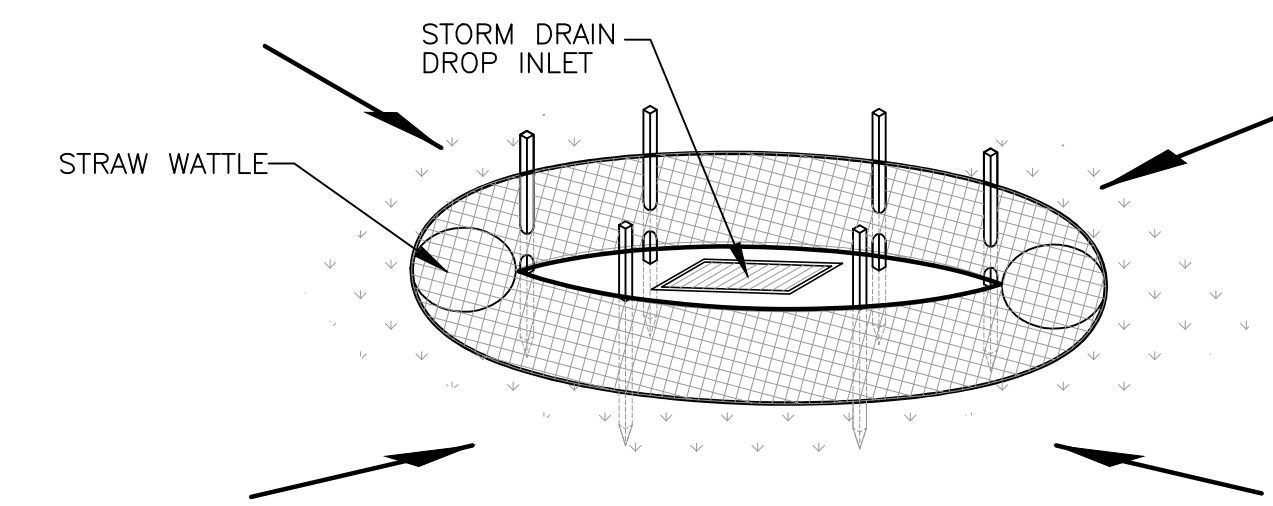

**Drop Inlet Protection**

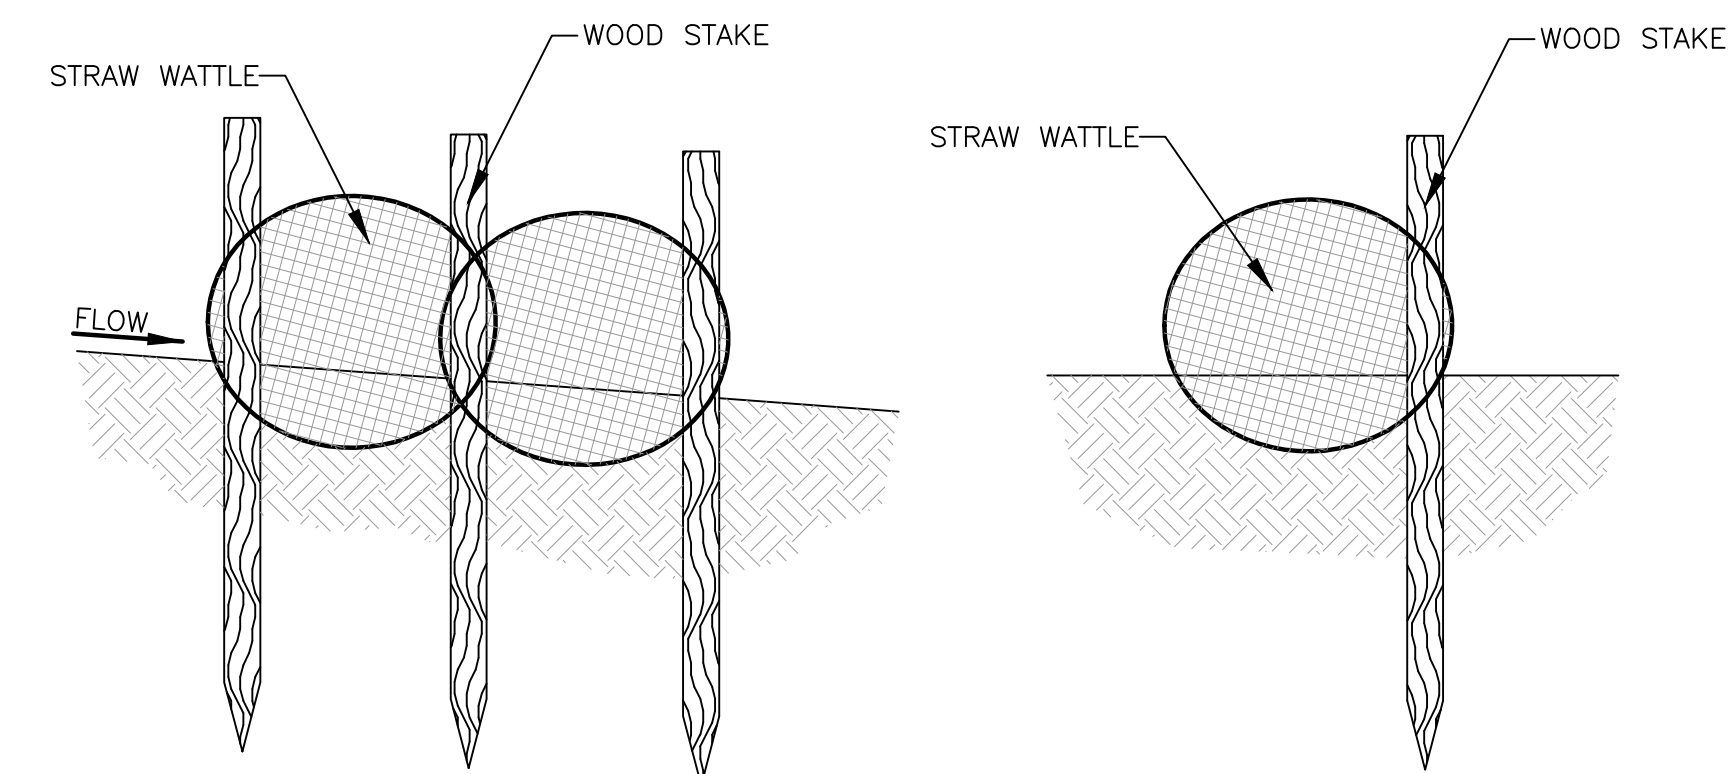

**Stake Detail**

**Reeve & Associates, Inc.**  
 920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403  
 TEL: (801) 921-5100 FAX: (801) 621-2666 www.reeve-assoc.com  
 CIVIL ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

DATE	DESCRIPTION
9-30-14	ST. County Comments
10-9-14	ST. County Comments
11-3-14	RH. Sewer Revisions
11-24-14	ST. HIC Comments
2-18-15	ST. County Comments
5-9-15	ST. County Comments
3-31-16	TP. Detention Update


**Mallard Springs Subdivision**  
 WEBER COUNTY, UTAH  
**Storm Water Pollution Prevention Plan Details**

**REGISTERED PROFESSIONAL ENGINEER**  
 375328  
**J. NATE REEVE**  
 STATE OF UTAH

**Project Info.**  
 Engineer: J. NATE REEVE, P.E.  
 Drafter: R. HANSEN  
 Begin Date: NOVEMBER 4, 2013  
 Name: MALLARD SPRINGS SUBDIVISION  
 Number: 3442-A30

Sheet **20**  
 18 Sheets




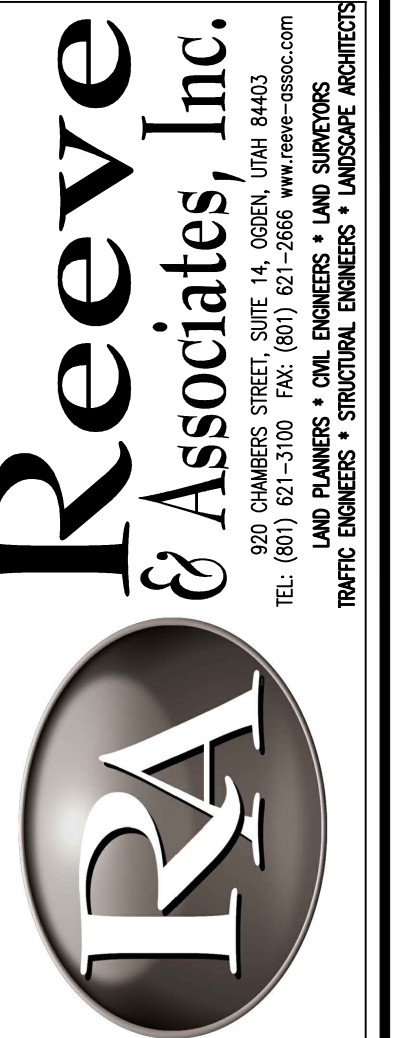

DATE	DESCRIPTION
9-30-14	ST. County Comments
10-9-14	ST. County Comments
11-3-14	RH. Sewer Revisions
11-24-14	ST. HIC Comments
2-18-15	ST. County Comments
5-9-15	ST. County Comments
3-31-16	TP. Detention Update


**Mallard Springs Subdivision**  
WEBER COUNTY, UTAH  
**Overall Grading Plan**

Revised: 5-18-15

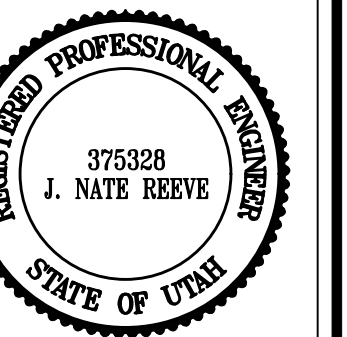


**Project Info.**


Engineer: J. NATE REEVE, P.E.  
 Drafter: R. HANSEN  
 Begin Date: NOVEMBER 4, 2013  
 Name: MALLARD SPRINGS SUBDIVISION  
 Number: 3442-A30

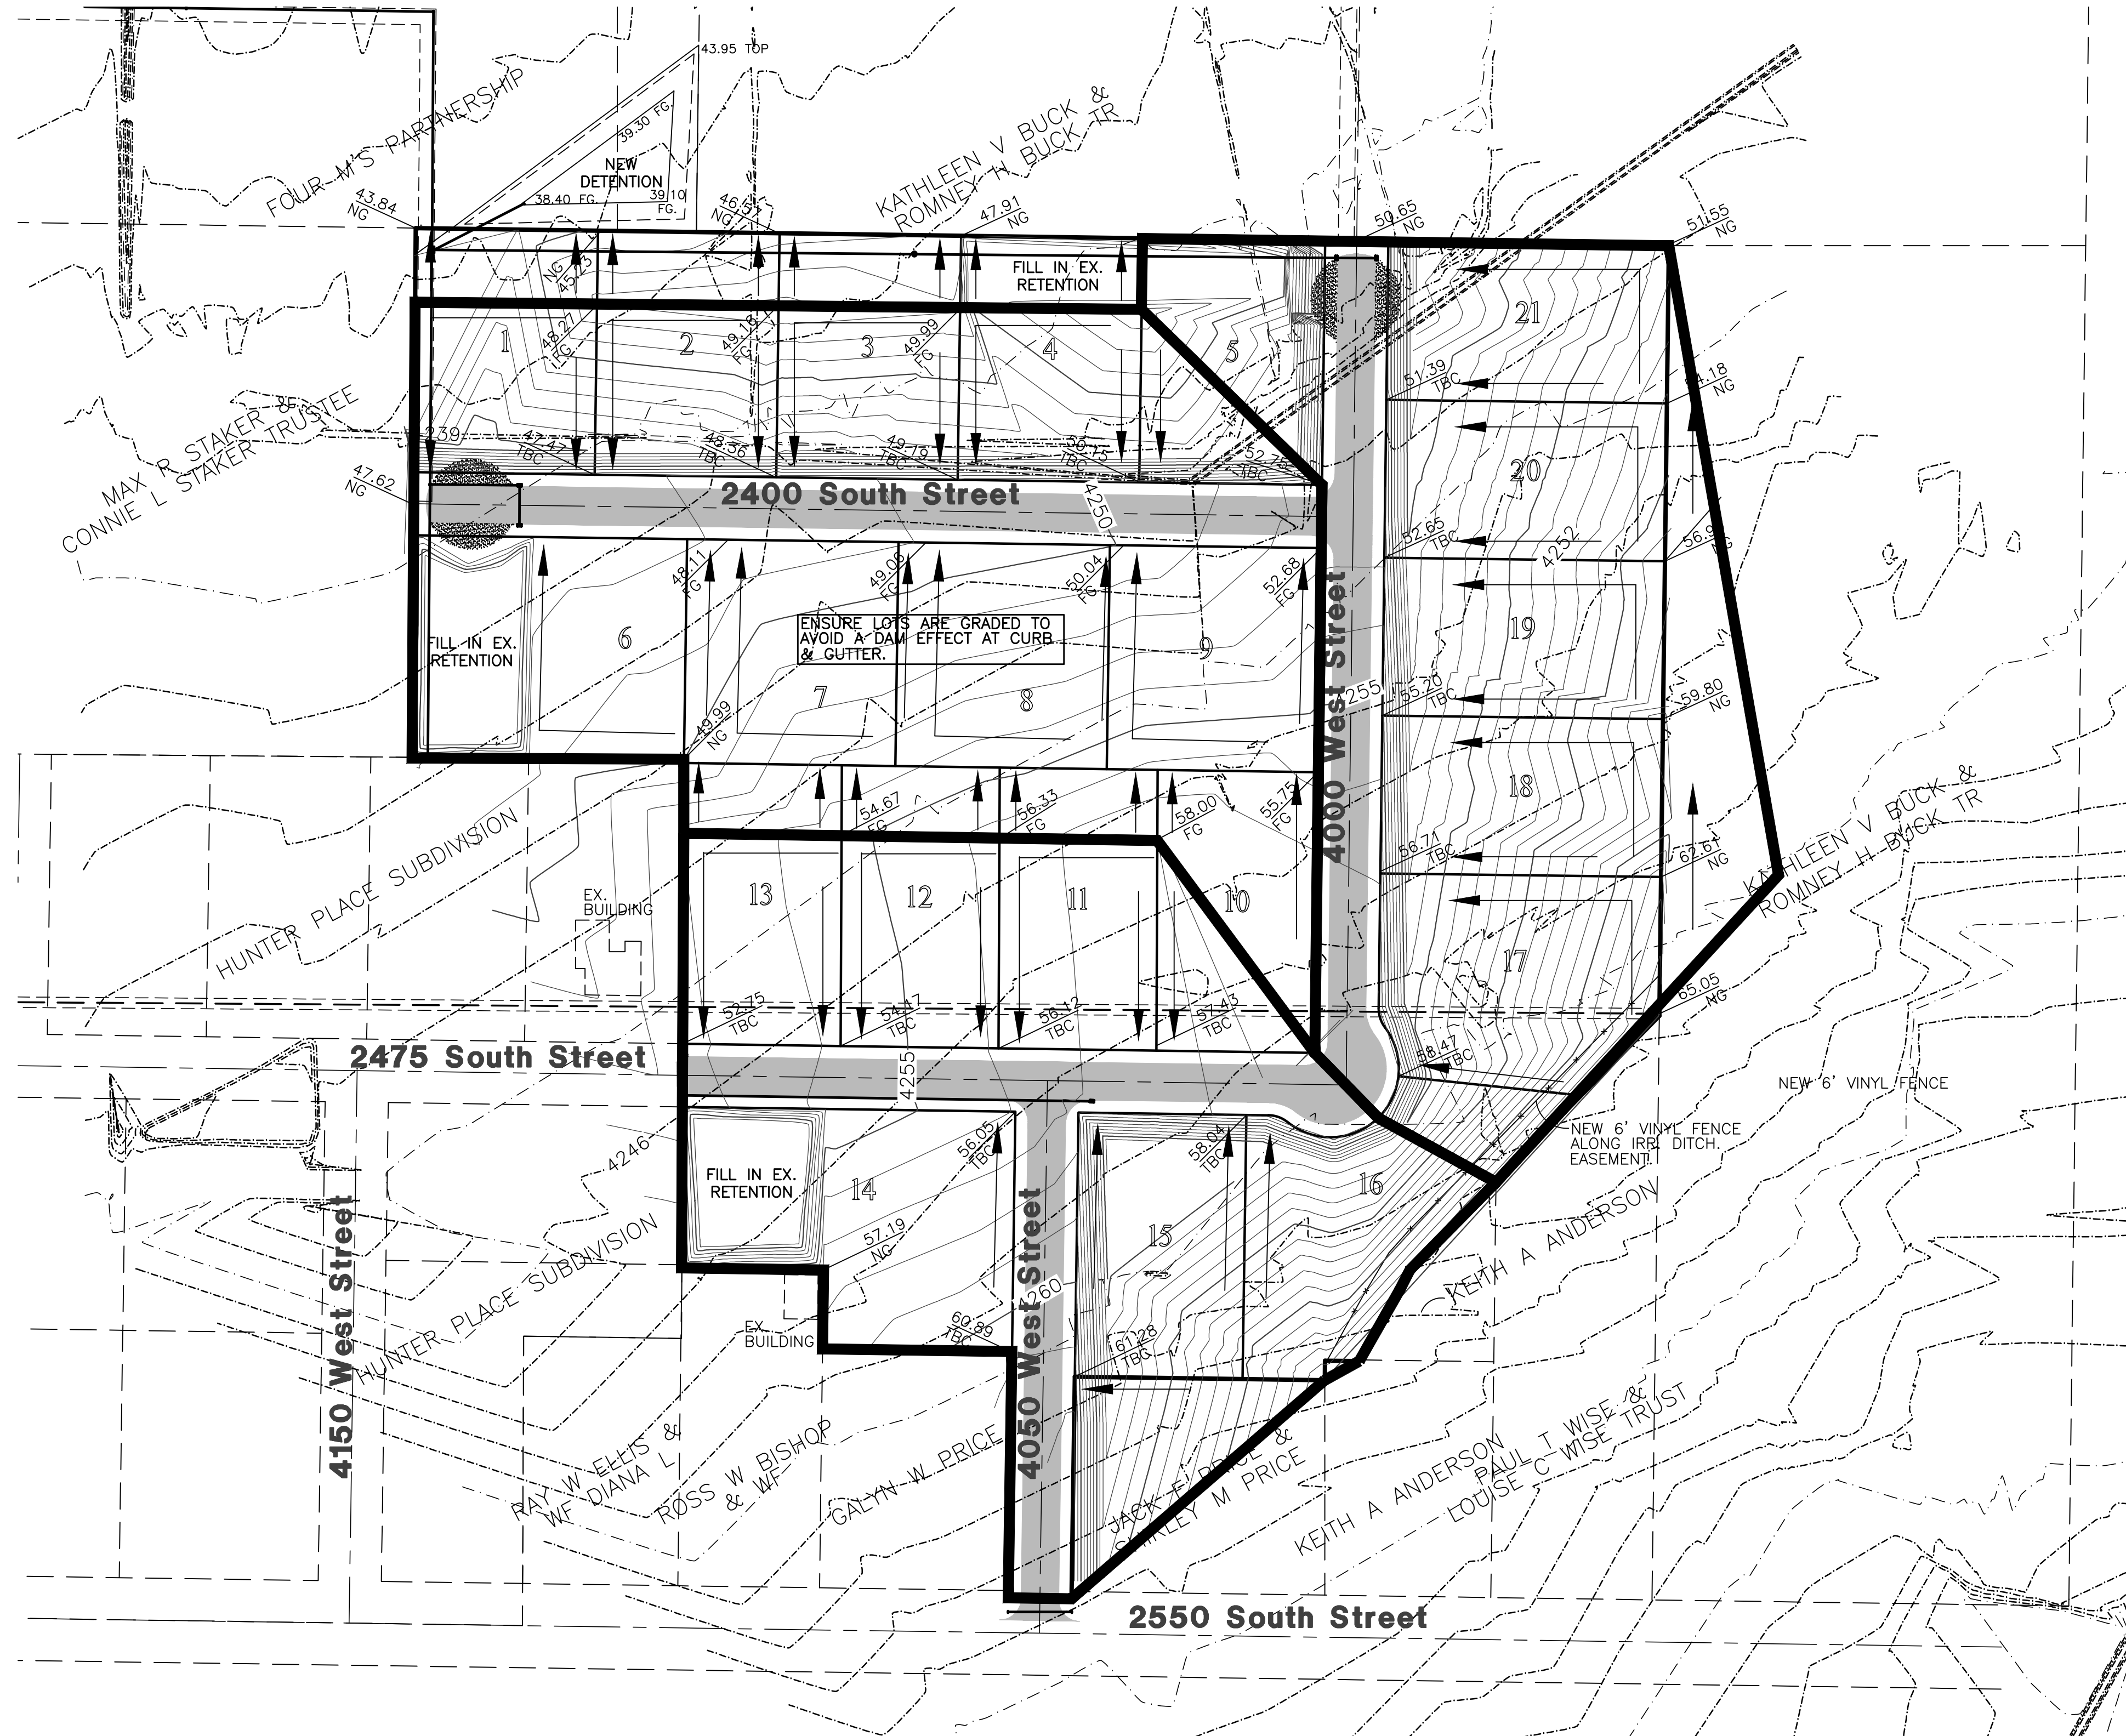

**LEGEND**  
 - - - - - PROPOSED 1' CONTOURS  
 \_\_\_\_\_ EXISTING 1' CONTOURS

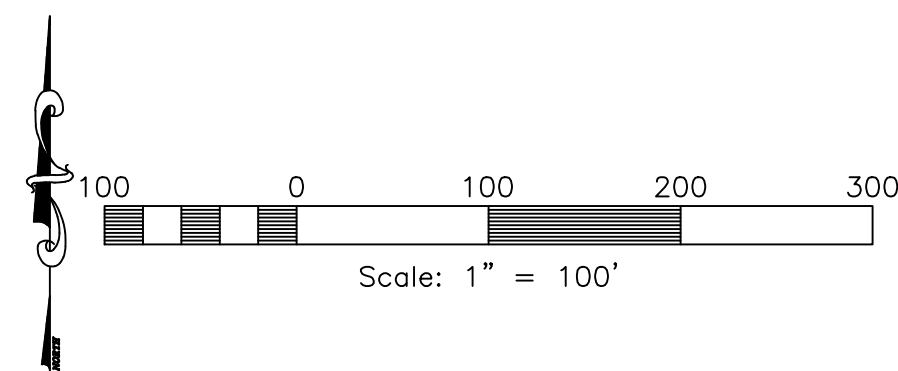



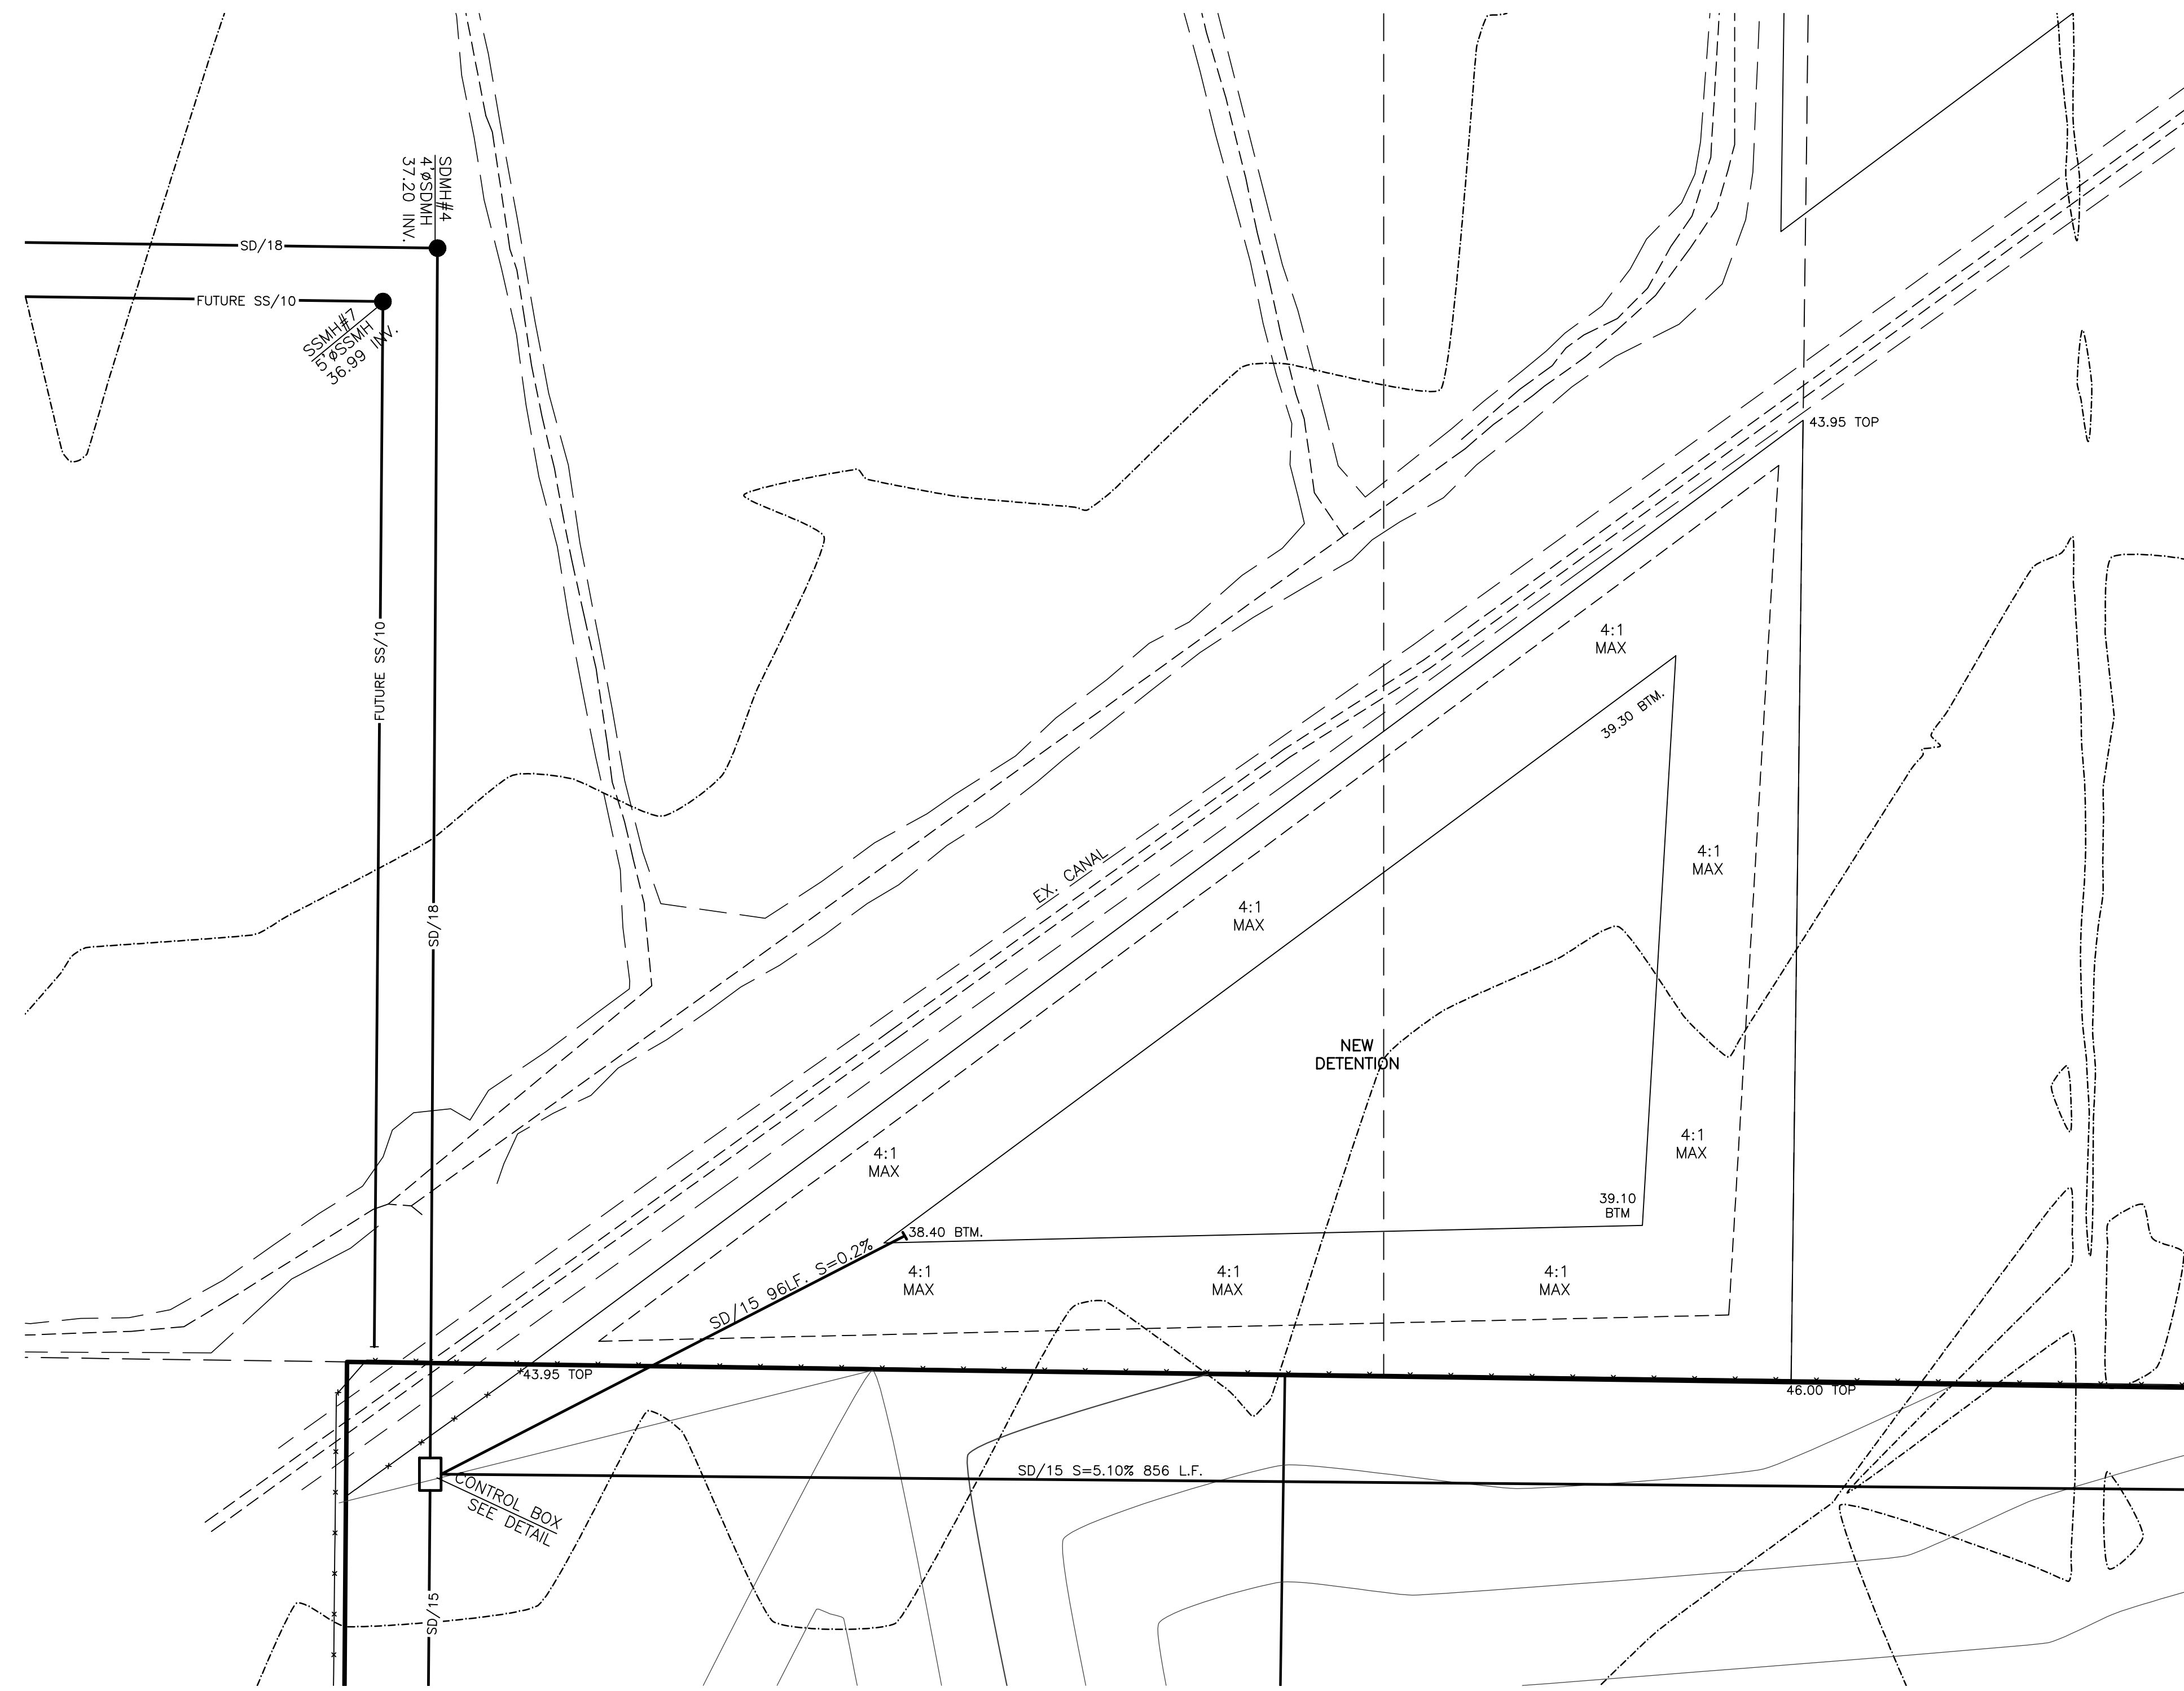

**EURV CALCULATIONS**  
 BOTTOM AREA (4238.85) = 7,353 AVG  
 TOP AREA (4242.95) = 16,342 AVG  
 $[7,353 + (16,342)/2] = 11,848$  S.F. AVG.  
 11,848 S.F. x 4.10' DEEP = 48,577 C.F.  
 48,577 C.F. > 43,083 C.F. (REQ'D.) = **OK**

**Storm Runoff Calculations**  
**Mallard Springs Subdivision**

3/14/2016 rjh

The following runoff calculations are based on the Rainfall - Intensity - Duration Frequency Curve for the West Haven, UT area taken from data compiled by NOAA Atlas 14, using a 100-year storm event.

Runoff storm water has been calculated for two different sets of conditions, one being the existing undeveloped land and the other with land fully improved. The difference between the two quantities will be retained in a holding pond and discharged at its historical rate of 0.2 cfs/acre.

In case of a storm even greater than the 100-year storm, an emergency spillway has been designed for the storm water to overtop the baffle wall in the control box and follow its historical path.

The calculations are as follows:


- Project Site Drainage Area:**  
 Runoff Coefficients  
 Paved Area 182,553 C = 0.95  
 Landscaped Area 796,132 C = 0.20  
 Roof 95,136 C = 0.95  
 Weighted Runoff Coefficient C = 0.39
  - Time of Concentration:**  
 Tc from Project Site = 62 minutes
  - Rainfall Intensities:**  
 Rainfall Intensities were obtained from the Rainfall - Intensity - Duration Frequency Curve for the West Haven, UT are taken and compiled by NOAA Atlas 14 for the 100-year storm event.  
 Rainfall Intensity for a 62 minute Time of Concentration 1.72 in/hr
  - Peak Run-off:**  
 Runoff Coefficient C = 0.39  
 Rainfall Intensity i = 1.72 IN./HR.  
 Acreage A = 24.65 ACRES  
 Runoff Quantity Q = CIA
- Q (total) Q = 16.70 cfs**
- Allowable Discharge:**  
 Allowable Discharge of Storm Water Volume (pre-development) is 0.2 cfs per acre.  
 Allowable Discharge Q = (0.2 x acres)  
**Allowable Discharge = Q = 4.93 cfs**
  - Volume of Run-off for 100-year Storm Event**

time (min)	time (sec)	i (in./hr.)	Q (cfs)	Vol. in (cf)	Vol. out (cf)	Difference (cf)
0	0	0.00	0.00	0.00	0.00	0.00
5	300	6.64	64.48	19345.22	1479.09	17866.12
10	600	5.05	49.04	29425.71	2958.18	26467.52
15	900	4.17	40.50	36447.09	4437.28	32009.81
30	1800	2.81	27.29	49120.54	8874.55	40245.98
60	3600	1.74	16.90	60632.55	17749.11	43083.44
180	10800	0.65	6.31	68174.41	53247.32	14927.09
360	21600	0.36	3.50	75516.27	106494.64	-30978.38
720	43200	0.22	2.14	92297.66	212989.29	-120691.63
1440	86400	0.13	1.26	109079.05	425978.58	-316899.52


**Required Detention Volume 43083.44 c.f.**

- Orifice Sizing**  
 Given: Q = 4.93 cfs (0.2 cfs/acre)  
 2g = 64.4 ft/s<sup>2</sup>  
 H = 3.50 ft  
 Cd = 0.7 for circular openings  
 $R = \sqrt{Q(0.7)(64.4H)^{0.5}}$   
 R = 0.68 feet  
 R = 8.22 inches  
 D = 16.44 inches



**SUMMARY:**  
 The required volume of the detention basin is **43,083 cubic feet**  
 Orifice Diameter at Outlet is **16.44 inches**

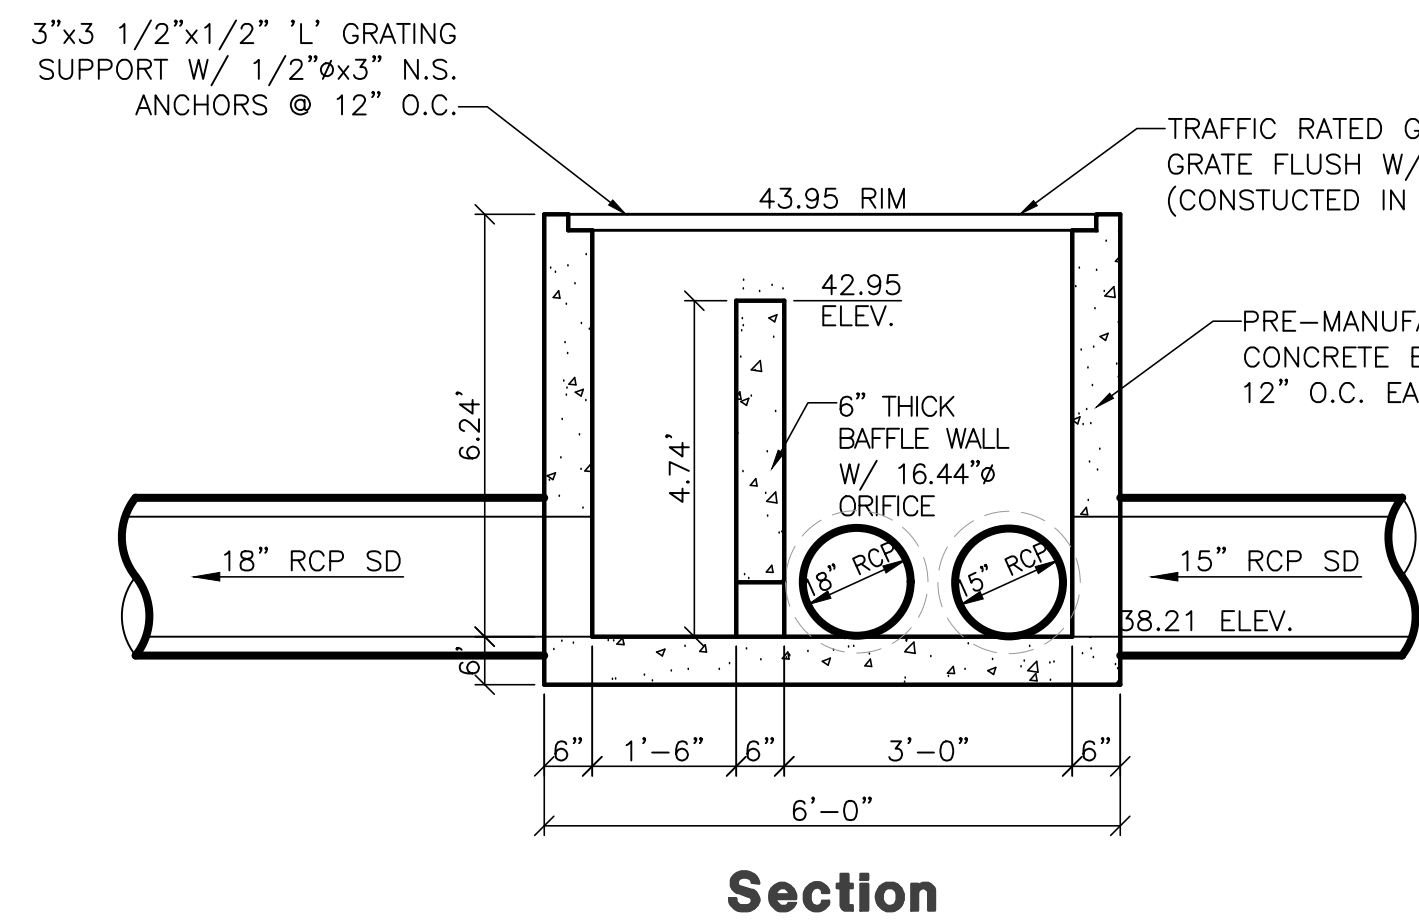

**Detention Basin Control Box**  
 SCALE: 1" = 2'

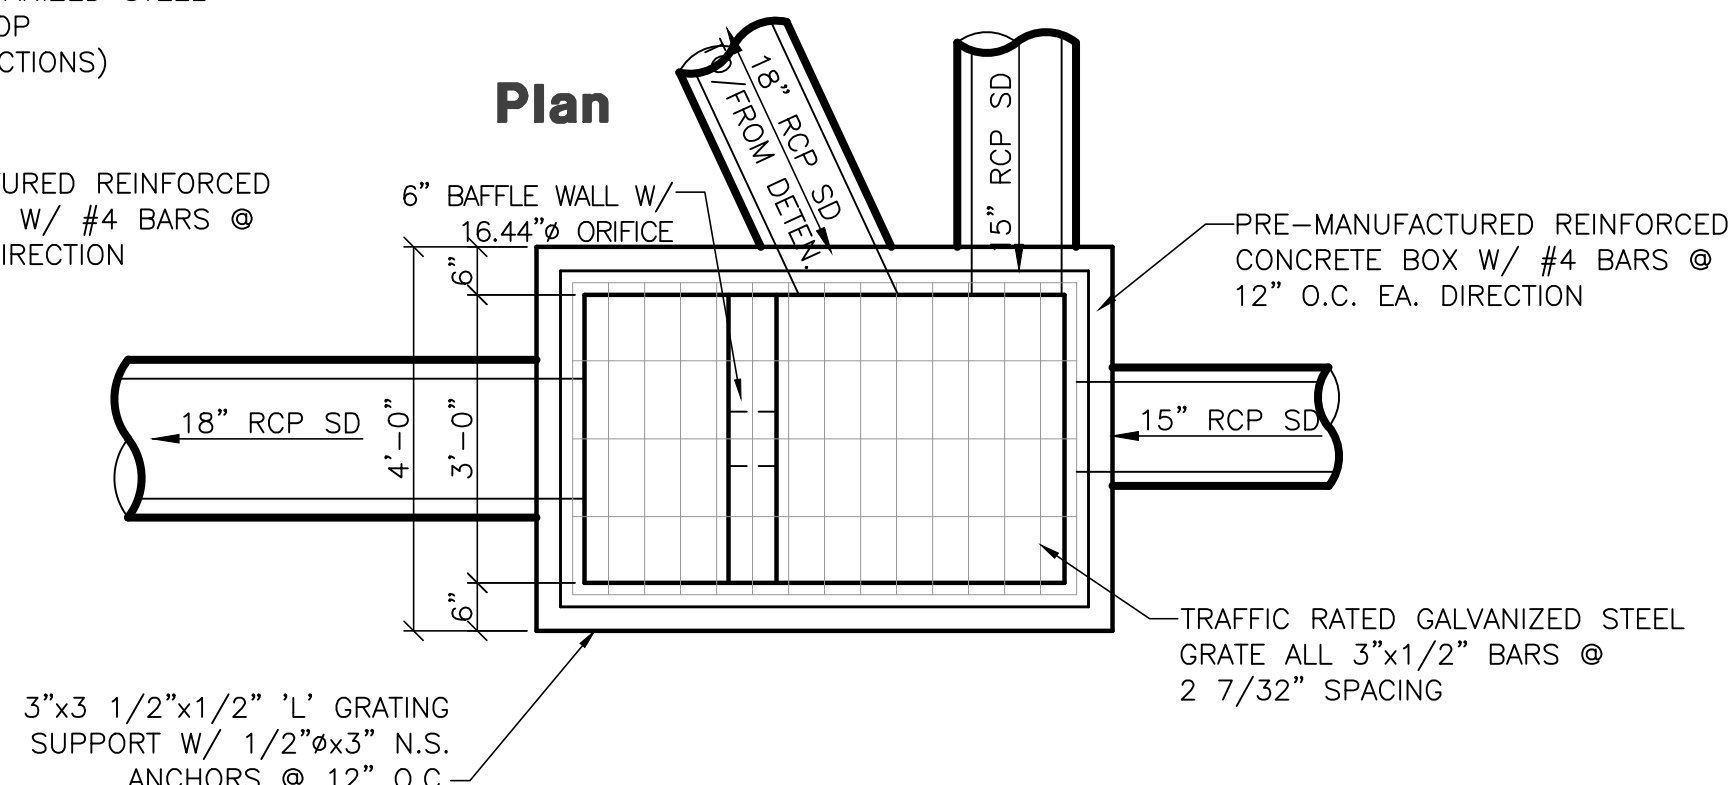

HOT DIP GALVANIZE GRATE & GRATING SUPPORTS AFTER FABRICATION

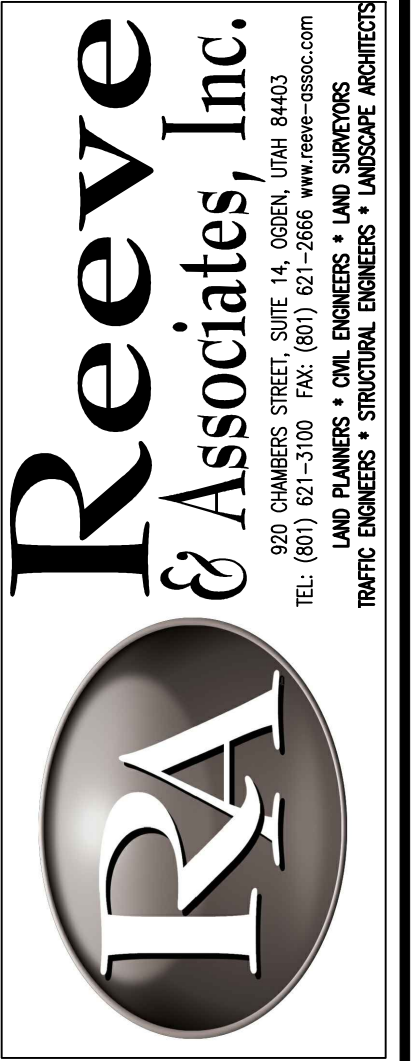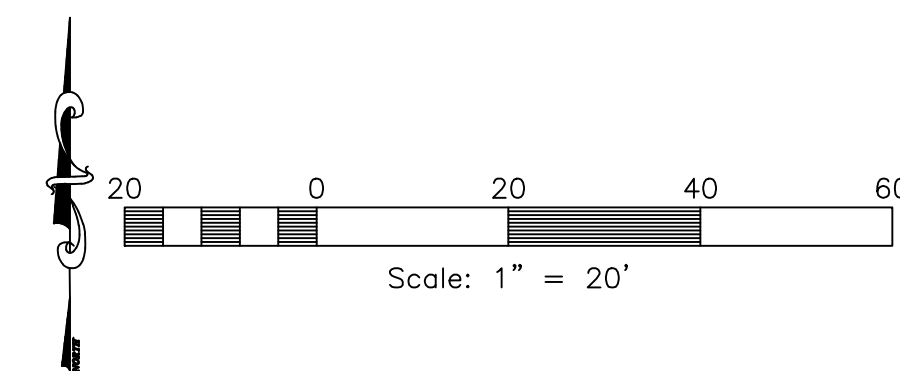


**REVISIONS**

DATE	DESCRIPTION
9-30-14	ST. County Comments
10-9-14	ST. County Comments
11-3-14	RH. Sewer Revisions
11-24-14	ST. HIC Comments
2-18-15	ST. County Comments
5-9-15	ST. County Comments
3-31-16	TP. Detention Update

**Mallard Springs Subdivision**  
 WEBER COUNTY, UTAH  
**Overall Grading Plan**

Revised: 5-18-15

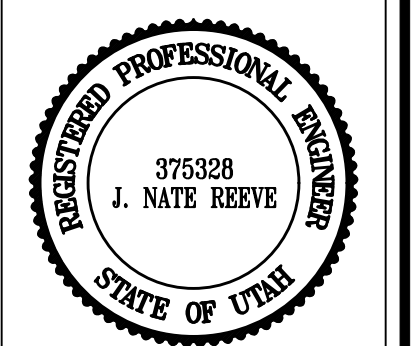

**Project Info.**  
 Engineer: J. NATE REEVE, P.E.  
 Drafter: R. HANSEN  
 Begin Date: NOVEMBER 4, 2013  
 Name: MALLARD SPRINGS SUBDIVISION  
 Number: 3442-A30

Sheet **20** of 20 Sheets