


Project Narrative/Notes/Revisions


- 1) 11/8/13 RH - COMPLETED DESIGN FOR CLIENT & CITY REVIEW.
- 2) 1/14/14 ST - PROVIDED RETENTION PONDS/CURBS & GUTTER.
- 3) 3/10/14 ST - UPDATED PER COUNTY COMMENTS
- 4) 5/2/14 ST - UPDATED PER COUNTY COMMENTS
- 5) 9/4/14 ST - UPDATED PER COUNTY COMMENTS
- 6) 10/9/14 ST - UPDATED PER COUNTY COMMENTS

MALLARD SPRINGS SUBDIVISION Improvement Plans

WEBER COUNTY, UTAH
SEPTEMBER 2014

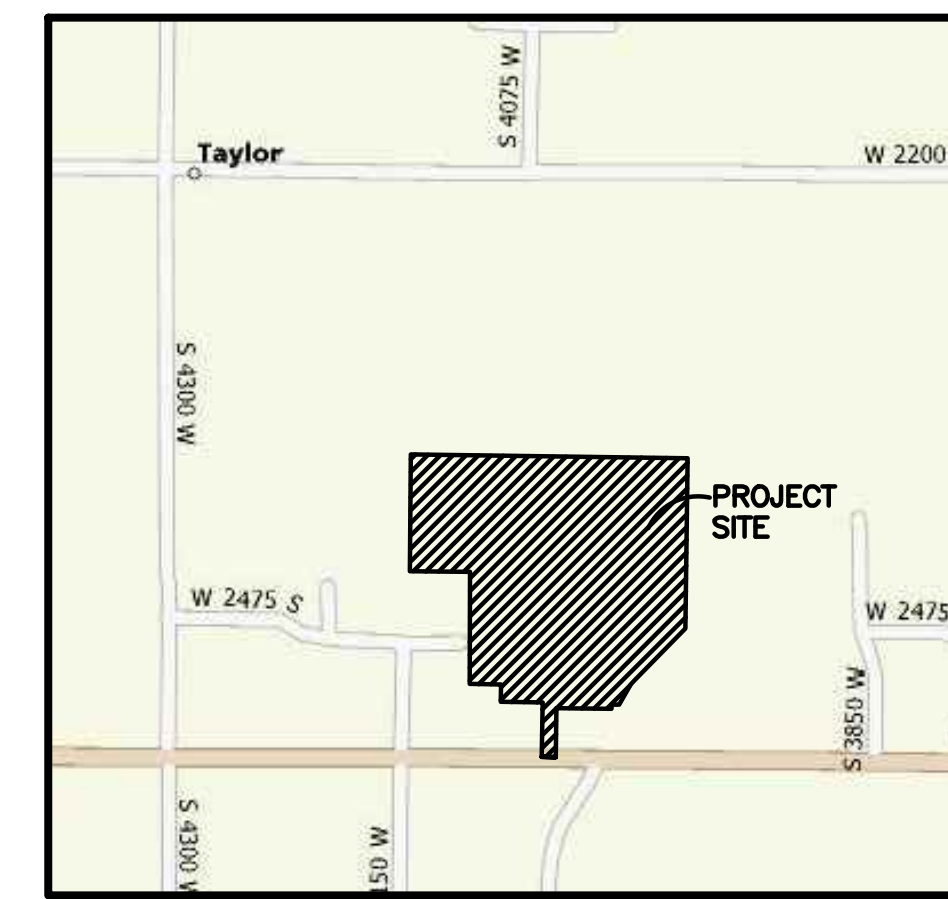



Vicinity Map
NOT TO SCALE

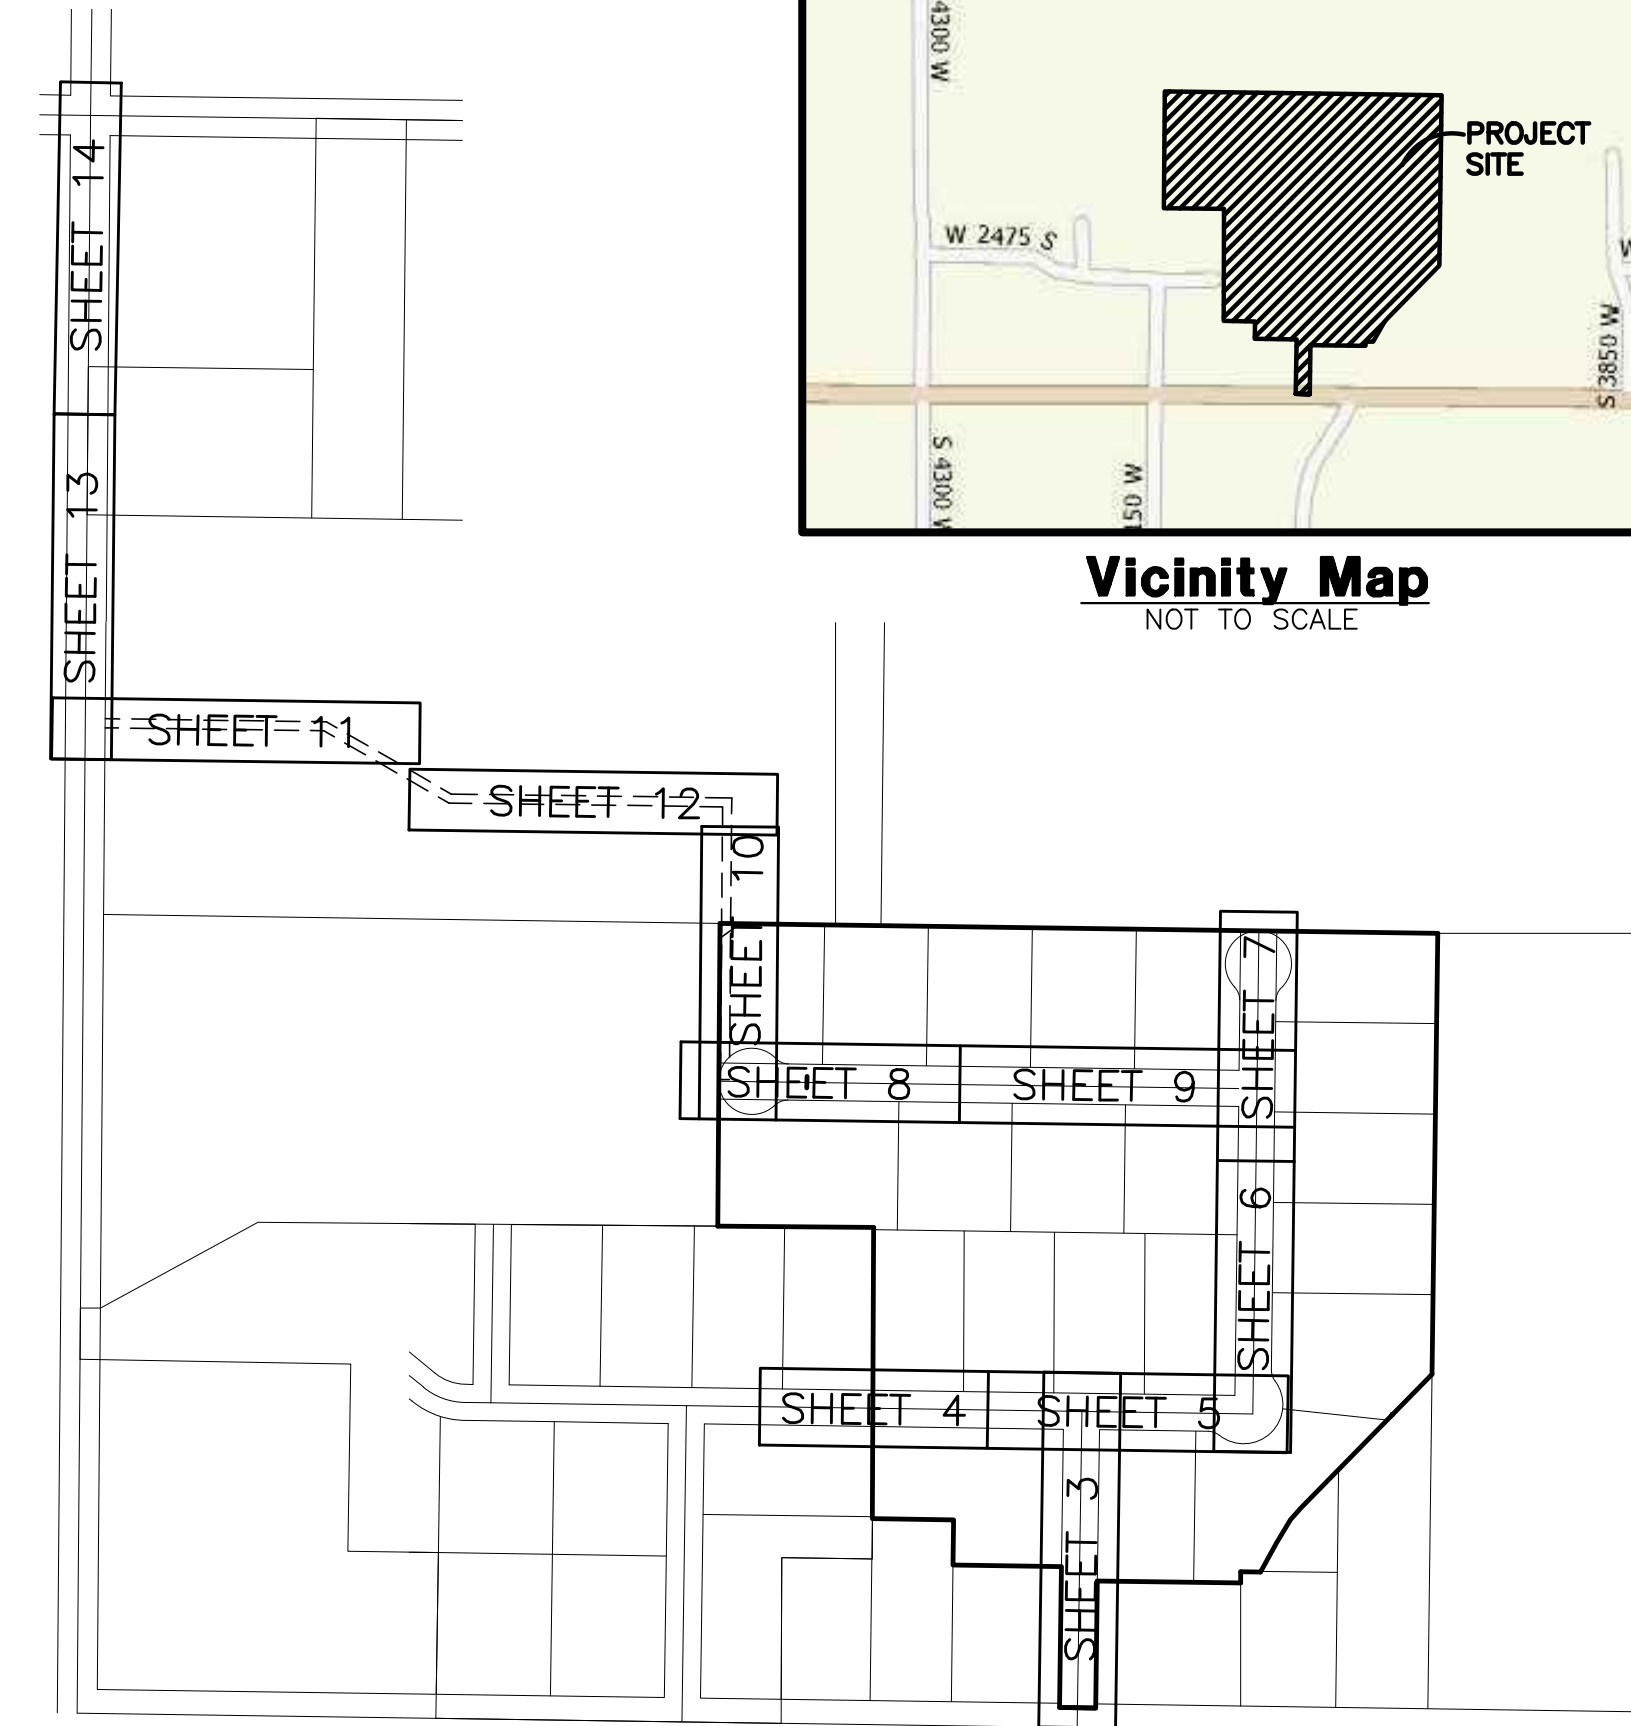

Sheet Index Key Map
NOT TO SCALE

Sheet Index


- Sheet 1 - Cover/Index Sheet
- Sheet 2 - Notes/Legend/Street Cross-Section
- Sheet 3 - 4050 West Street 5+50.00 - 11+00.00
- Sheet 4 - 2475 South Street 16+00.00 - 20+00.00
- Sheet 5 - 2475 South Street 20+00.00 - 25+00.00
- Sheet 6 - 4000 West Street 10+00.00 - 14+50.00
- Sheet 7 - 4000 West Street 14+50.00 - 18+50.00
- Sheet 8 - 2400 South Street 20+00.00 - 24+50.00
- Sheet 9 - 2400 South Street 24+50.00 - 30+00.00
- Sheet 10 - Sewer Outfall 5+50.00 - 11+00.00
- Sheet 11 - Sewer Outfall 10+00.00 - 16+00.00
- Sheet 12 - Sewer Outfall 16+00.00 - 22+00.00
- Sheet 13 - Sewer Outfall/4300 W 29+00.00 - 34+50.00
- Sheet 14 - Sewer Outfall/4300 W 34+50.00 - 40+00.00
- Sheet 15 - Storm Water Pollution Prevention Plan Exhibit
- Sheet 16 - Storm Water Pollution Prevention Plan Details
- Sheet 17 - Overall Grading Plan

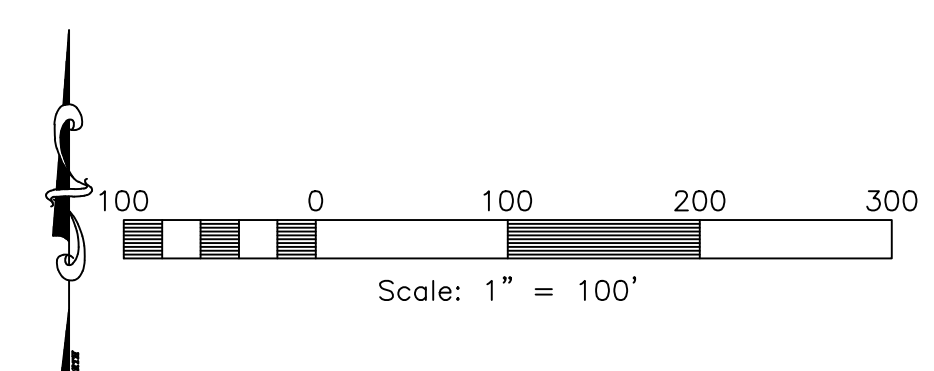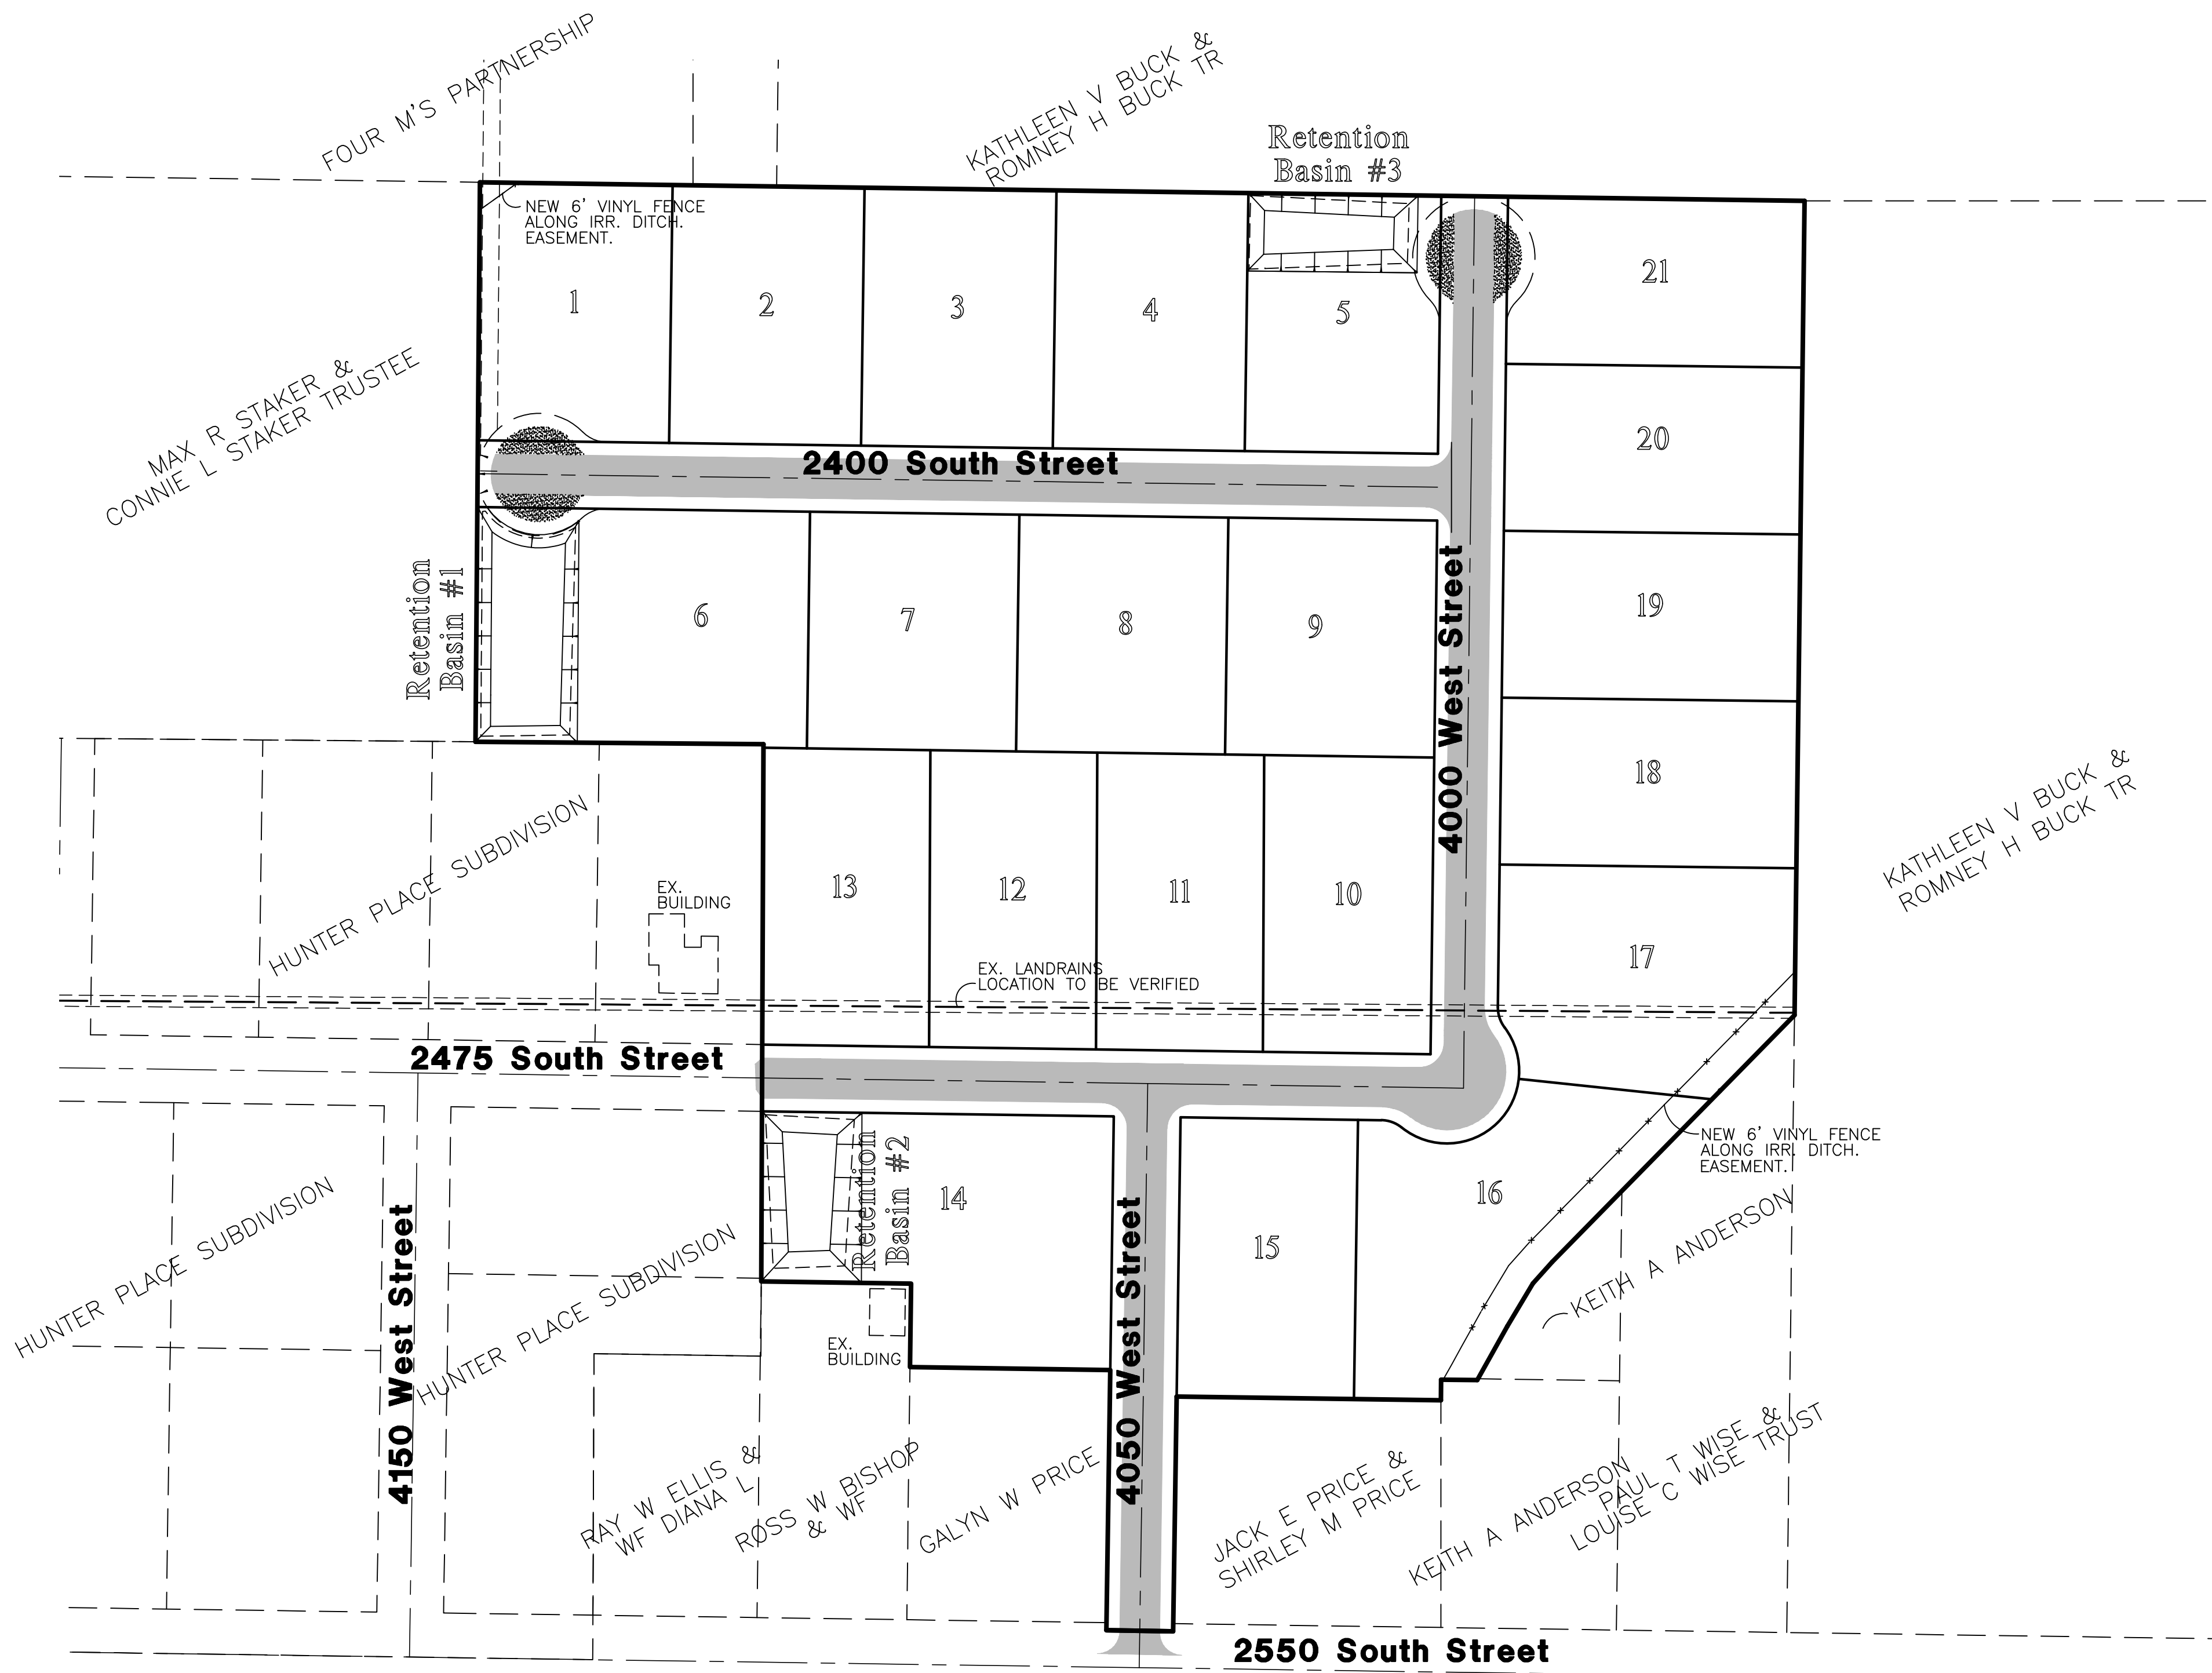

Reeve & Associates, Inc.
IRA
 920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403
 TEL: (801) 621-2100 FAX: (801) 621-2666 WWW.REEVE-ASSOCIATES.COM
 LAND PLANNERS • CIVIL ENGINEERS • LAND SURVEYORS
 TRAFFIC ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

DATE	DESCRIPTION
5-2-14	Rh County Comments
9-4-14	ST County Comments
9-30-14	ST County Comments
10-9-14	ST County Comments

Mallard Springs Subdivision
 WEBER COUNTY, UTAH
Cover/Index Sheet

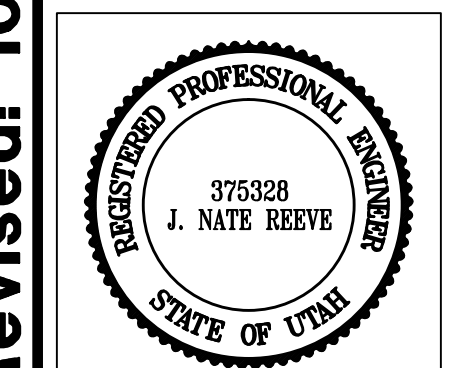

Project Info.

Engineer:	J. NATE REEVE, P.E.
Drafter:	R. HANSEN
Begin Date:	NOVEMBER 4, 2013
Name:	MALLARD SPRINGS SUBDIVISION
Number:	3442-A30

Sheet	17
1	Sheets

Engineer's Notice To Contractors
 THE EXISTENCE AND LOCATION OF ANY UNDERGROUND UTILITY PIPES OR STRUCTURES SHOWN ON THESE PLANS WERE OBTAINED FROM AVAILABLE INFORMATION PROVIDED BY OTHERS. THE LOCATIONS SHOWN ARE APPROXIMATE AND SHALL BE CONFIRMED IN THE FIELD BY THE CONTRACTOR, SO THAT ANY NECESSARY ADJUSTMENT CAN BE MADE IN ALIGNMENT AND/OR GRADE OF THE PROPOSED IMPROVEMENT. THE CONTRACTOR IS REQUIRED TO CONTACT THE UTILITY COMPANIES AND TAKE DUE PRECAUTIONARY MEASURE TO PROTECT ANY UTILITY LINES SHOWN, AND ANY OTHER LINES OBTAINED BY THE CONTRACTOR'S RESEARCH, AND OTHERS NOT OF RECORD OR NOT SHOWN ON THESE PLANS.

Developer Contact:
 Doug Hamblin
 Hamblin Investments
 1613 North 2000 West
 Clinton, Utah, 84015
 PH: (801) 731-7703

Blue Stakes Location Center
Call: Toll Free
1-800-662-4111
 Two Working Days Before You Dig

General Notes

- 1. ALL CONSTRUCTION MUST STRICTLY FOLLOW THE STANDARDS AND SPECIFICATIONS SET FORTH BY THE DESIGN ENGINEER...

Utility Notes

- 1. CONTRACTOR SHALL COORDINATE LOCATION OF NEW "DRY UTILITIES" WITH THE APPROPRIATE UTILITY COMPANY...

Master Legend

Table mapping symbols to utility types: -W- = PROPOSED CULINARY WATER LINE, -EX-W- = EXISTING CULINARY WATER LINE, etc.

General Notes

- 1. ALL CONSTRUCTION ON THIS PROJECT SHALL CONFORM TO THE DEVELOPMENT STANDARDS OF WEBER COUNTY...

Erosion Control General Notes

THE CONTRACTOR TO USE BEST MANAGEMENT PRACTICES FOR PROVIDING EROSION CONTROL FOR CONSTRUCTION OF THIS PROJECT...

WHEN GRADING OPERATIONS ARE COMPLETED AND THE DISTURBED GROUND IS LEFT "OPEN" FOR 14 DAYS OR MORE...

THE CONTRACTOR SHALL KEEP THE SITE WATERED TO CONTROL DUST. CONTRACTOR TO LOCATE A NEARBY HYDRANT FOR USE AND TO INSTALL TEMPORARY METER...

ALL ACCESS TO PROPERTY WILL BE FROM PUBLIC RIGHT-OF-WAYS. THE CONTRACTOR IS REQUIRED BY STATE AND FEDERAL REGULATIONS TO PREPARE A STORM WATER POLLUTION PREVENTION PLAN...

Maintenance

ALL BEST MANAGEMENT PRACTICES (BMP'S) SHOWN ON THIS PLAN MUST BE MAINTAINED AT ALL TIMES UNTIL PROJECT CLOSE-OUT.


THE CONTRACTOR'S RESPONSIBILITY SHALL INCLUDE MAKING BI-WEEKLY CHECKS ON ALL EROSION CONTROL MEASURES TO DETERMINE IF REPAIR OR SEDIMENT REMOVAL IS NECESSARY...

SEDIMENT DEPOSITS SHOULD BE REMOVED AFTER EACH RAINFALL. THEY MUST BE REMOVED WHEN THE LEVEL OF DEPOSITION REACHES APPROXIMATELY ONE-HALF THE HEIGHT OF BARRIER.


SEDIMENT TRACKED ONTO PAVED ROADS MUST BE CLEANED UP AS SOON AS PRACTICAL, BUT IN NO CASE LATER THAN THE END OF THE NORMAL WORK DAY.

EXPOSED SLOPES:


- ANY EXPOSED SLOPE THAT WILL REMAIN UNTOUCHED FOR LONGER THAN 14 DAYS MUST BE STABILIZED BY ONE OR MORE OF THE FOLLOWING METHODS: A) Spraying DISTURBED AREAS WITH A TACKIFIER VIA HYDROSEED...

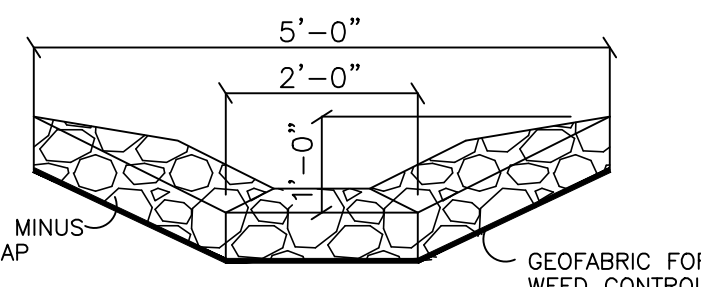

Emergency Spillway SCALE: NONE

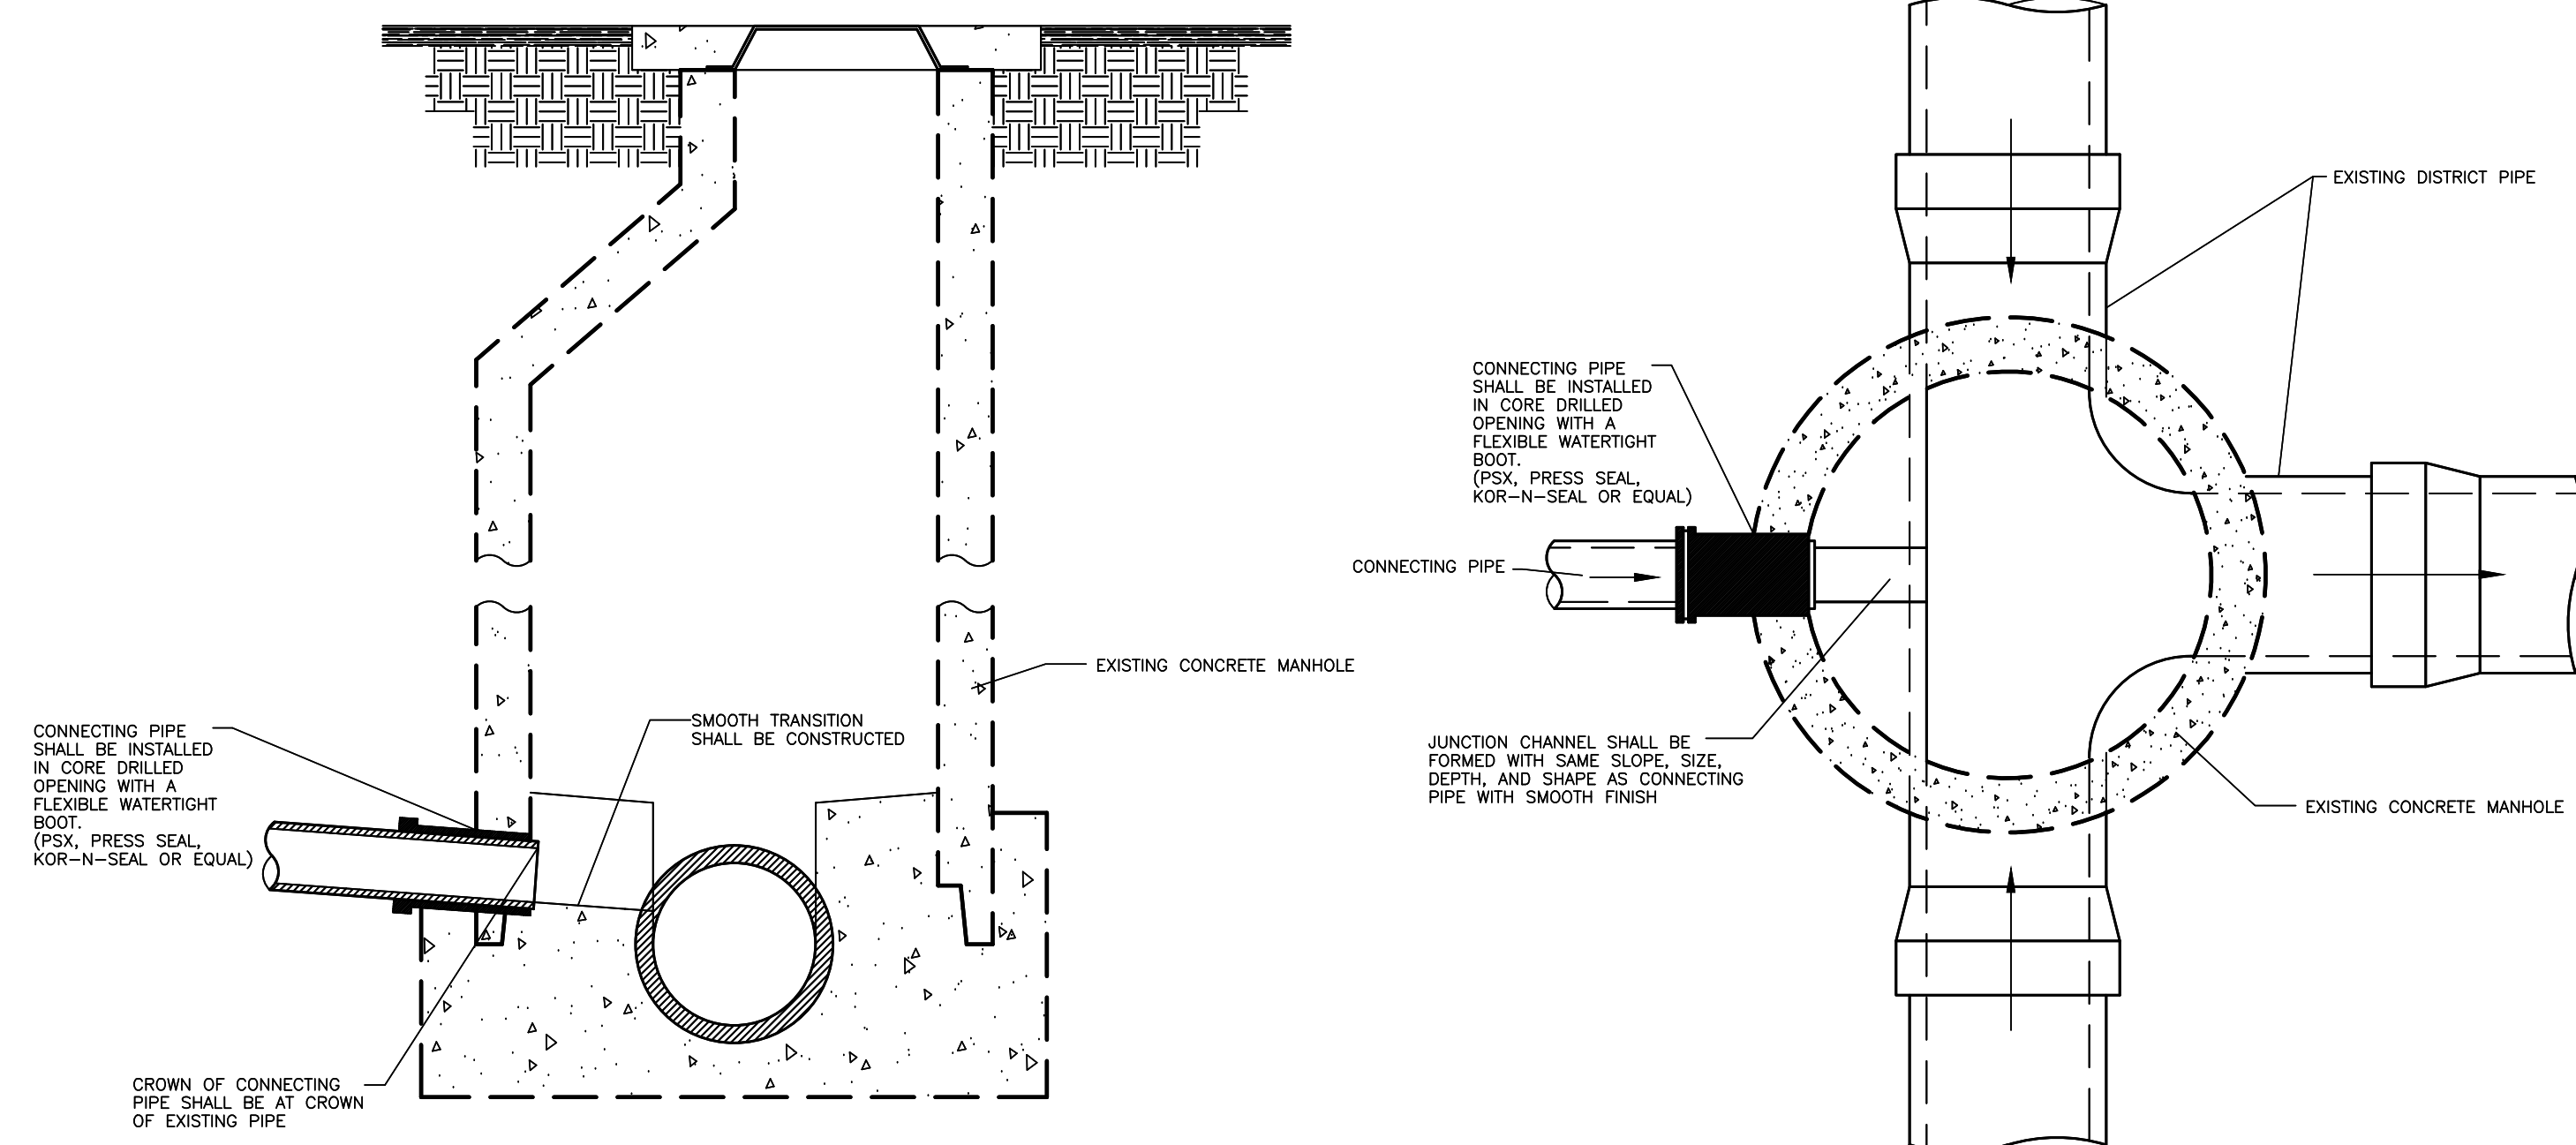

Connection to Central Weber Sewer Improvement District - Existing Manhole SCALE: NONE

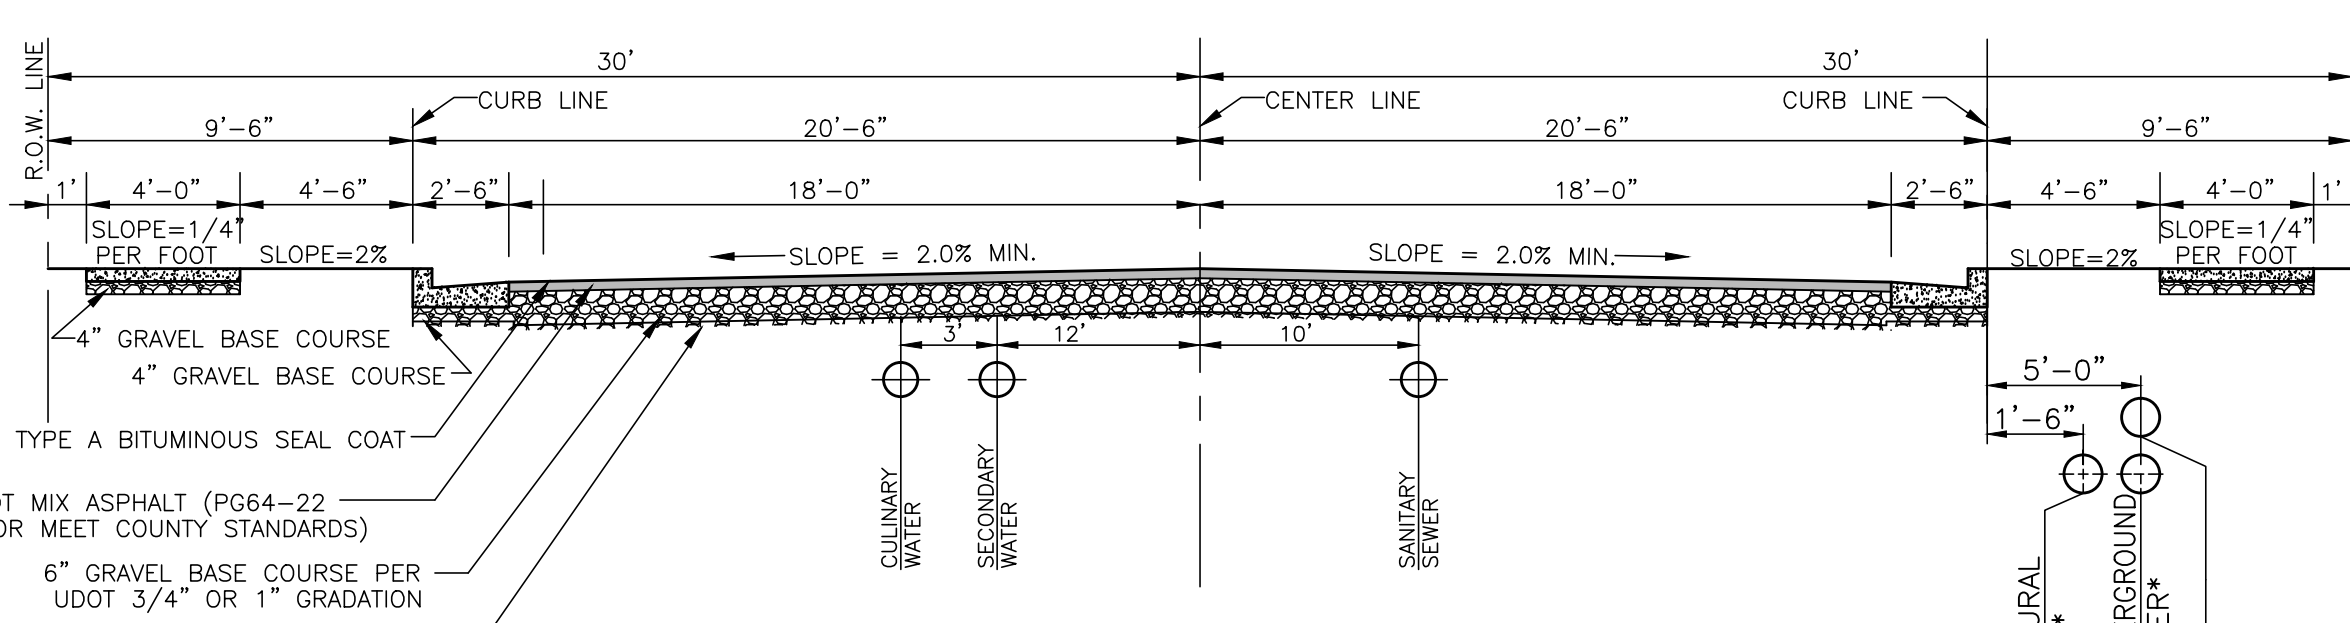

Street Section (60' R.O.W.) SCALE: NONE

*VERIFY LOCATION WITH PHONE, GAS AND POWER COMPANIES.


Reeve & Associates, Inc. logo and contact information: 920 CHAMBERS STREET SUITE 14, OGDEN, UTAH 84403. TEL: (801) 621-1100. FAX: (801) 621-2656. WWW: REEVE-ASSOCIATES.COM

Revisions table with columns for DATE, DESCRIPTION, and COUNTY COMMENTS. Includes entries for 5-2-14, 9-4-14, 9-30-14, and 10-9-14.

Mallard Springs Subdivision Notes/Legend/Street Cross-Section. Project info: REEVE & ASSOCIATES, INC. - SOLUTIONS YOU CAN BUILD ON. REGISTERED PROFESSIONAL ENGINEER 375328 J. NATE REEVE, STATE OF UTAH.




Project Info. Engineer: J. NATE REEVE, P.E. Drafter: R. HANSEN. Begin Date: NOVEMBER 4, 2013. Name: MALLARD SPRINGS SUBDIVISION. Number: 3442-A30

Sheet 2 of 17. SHEETS 17. Includes revision history for sheet 17.

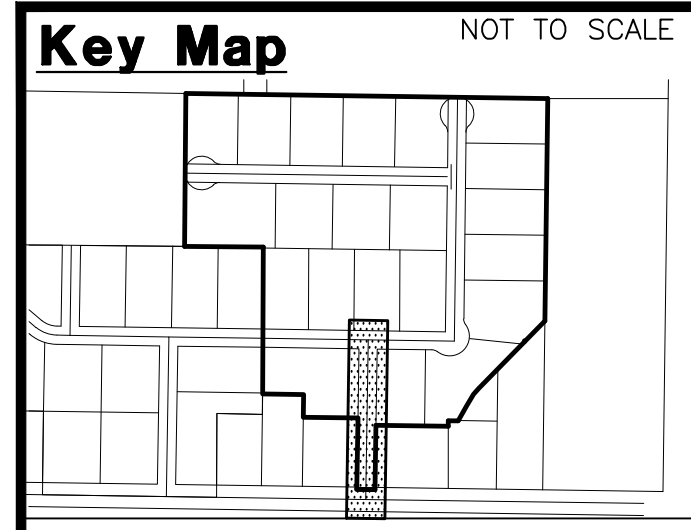

Construction Notes:

- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
 - 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.
- CULINARY WATER**
W/8 - 8" PVC C-900 CLASS 200 WATER
- SANITARY SEWER**
SS/8 - 8" ASTM D3034 SDR 35 SEWER
SS/10 - 10" ASTM D3034 SDR 35 SEWER
- DUE TO THE SHALLOWNESS OF THE SEWER LINE THROUGH ADJACENT FIELD, CLASS I OR CLASS II PIPE EMBEDMENT (PER ASTM D2487) INSTALLED PER ASTM D 2321 WITH 95% MODIFIED PROCTOR.
- STORM DRAIN**
SD/15 - 15" RCP STORM DRAIN
- SECONDARY WATER**
SW/8 - 8" PVC C-900 SECONDARY WATER LINE

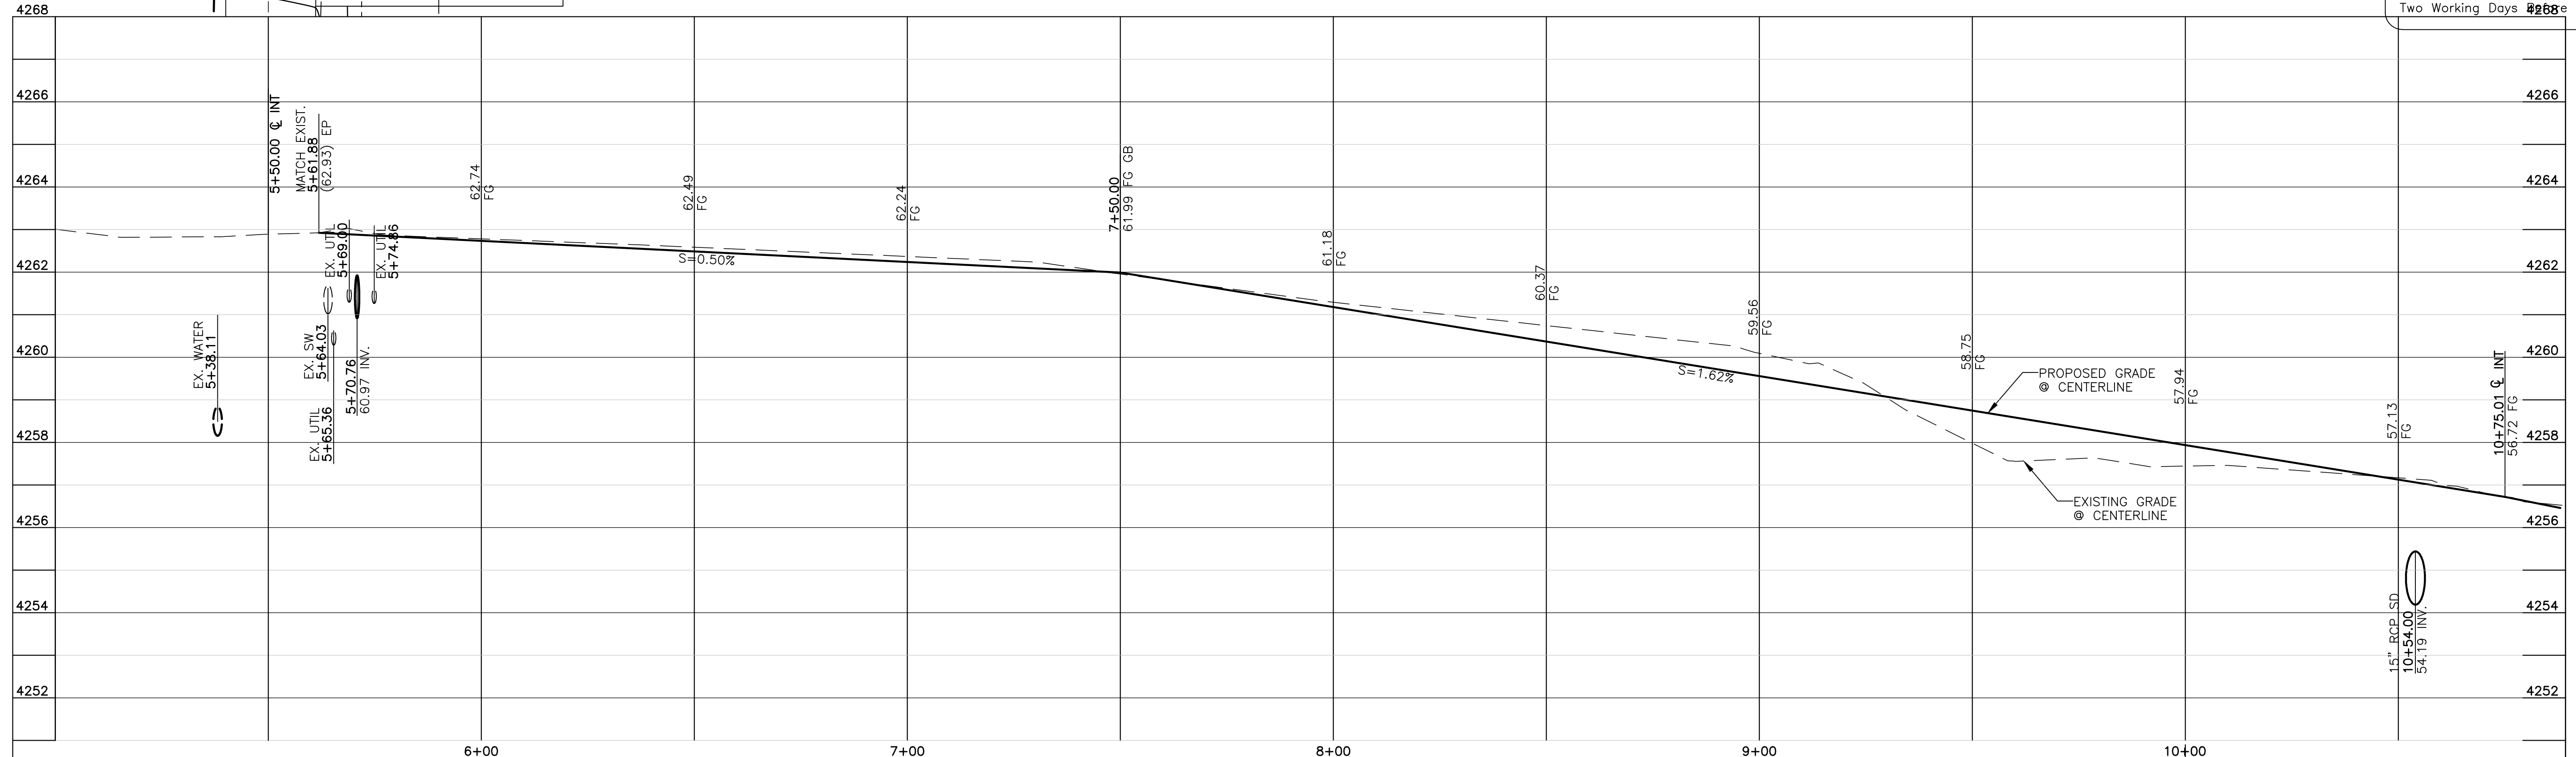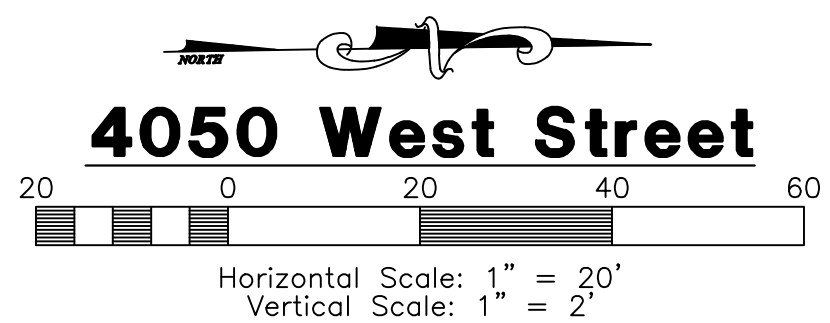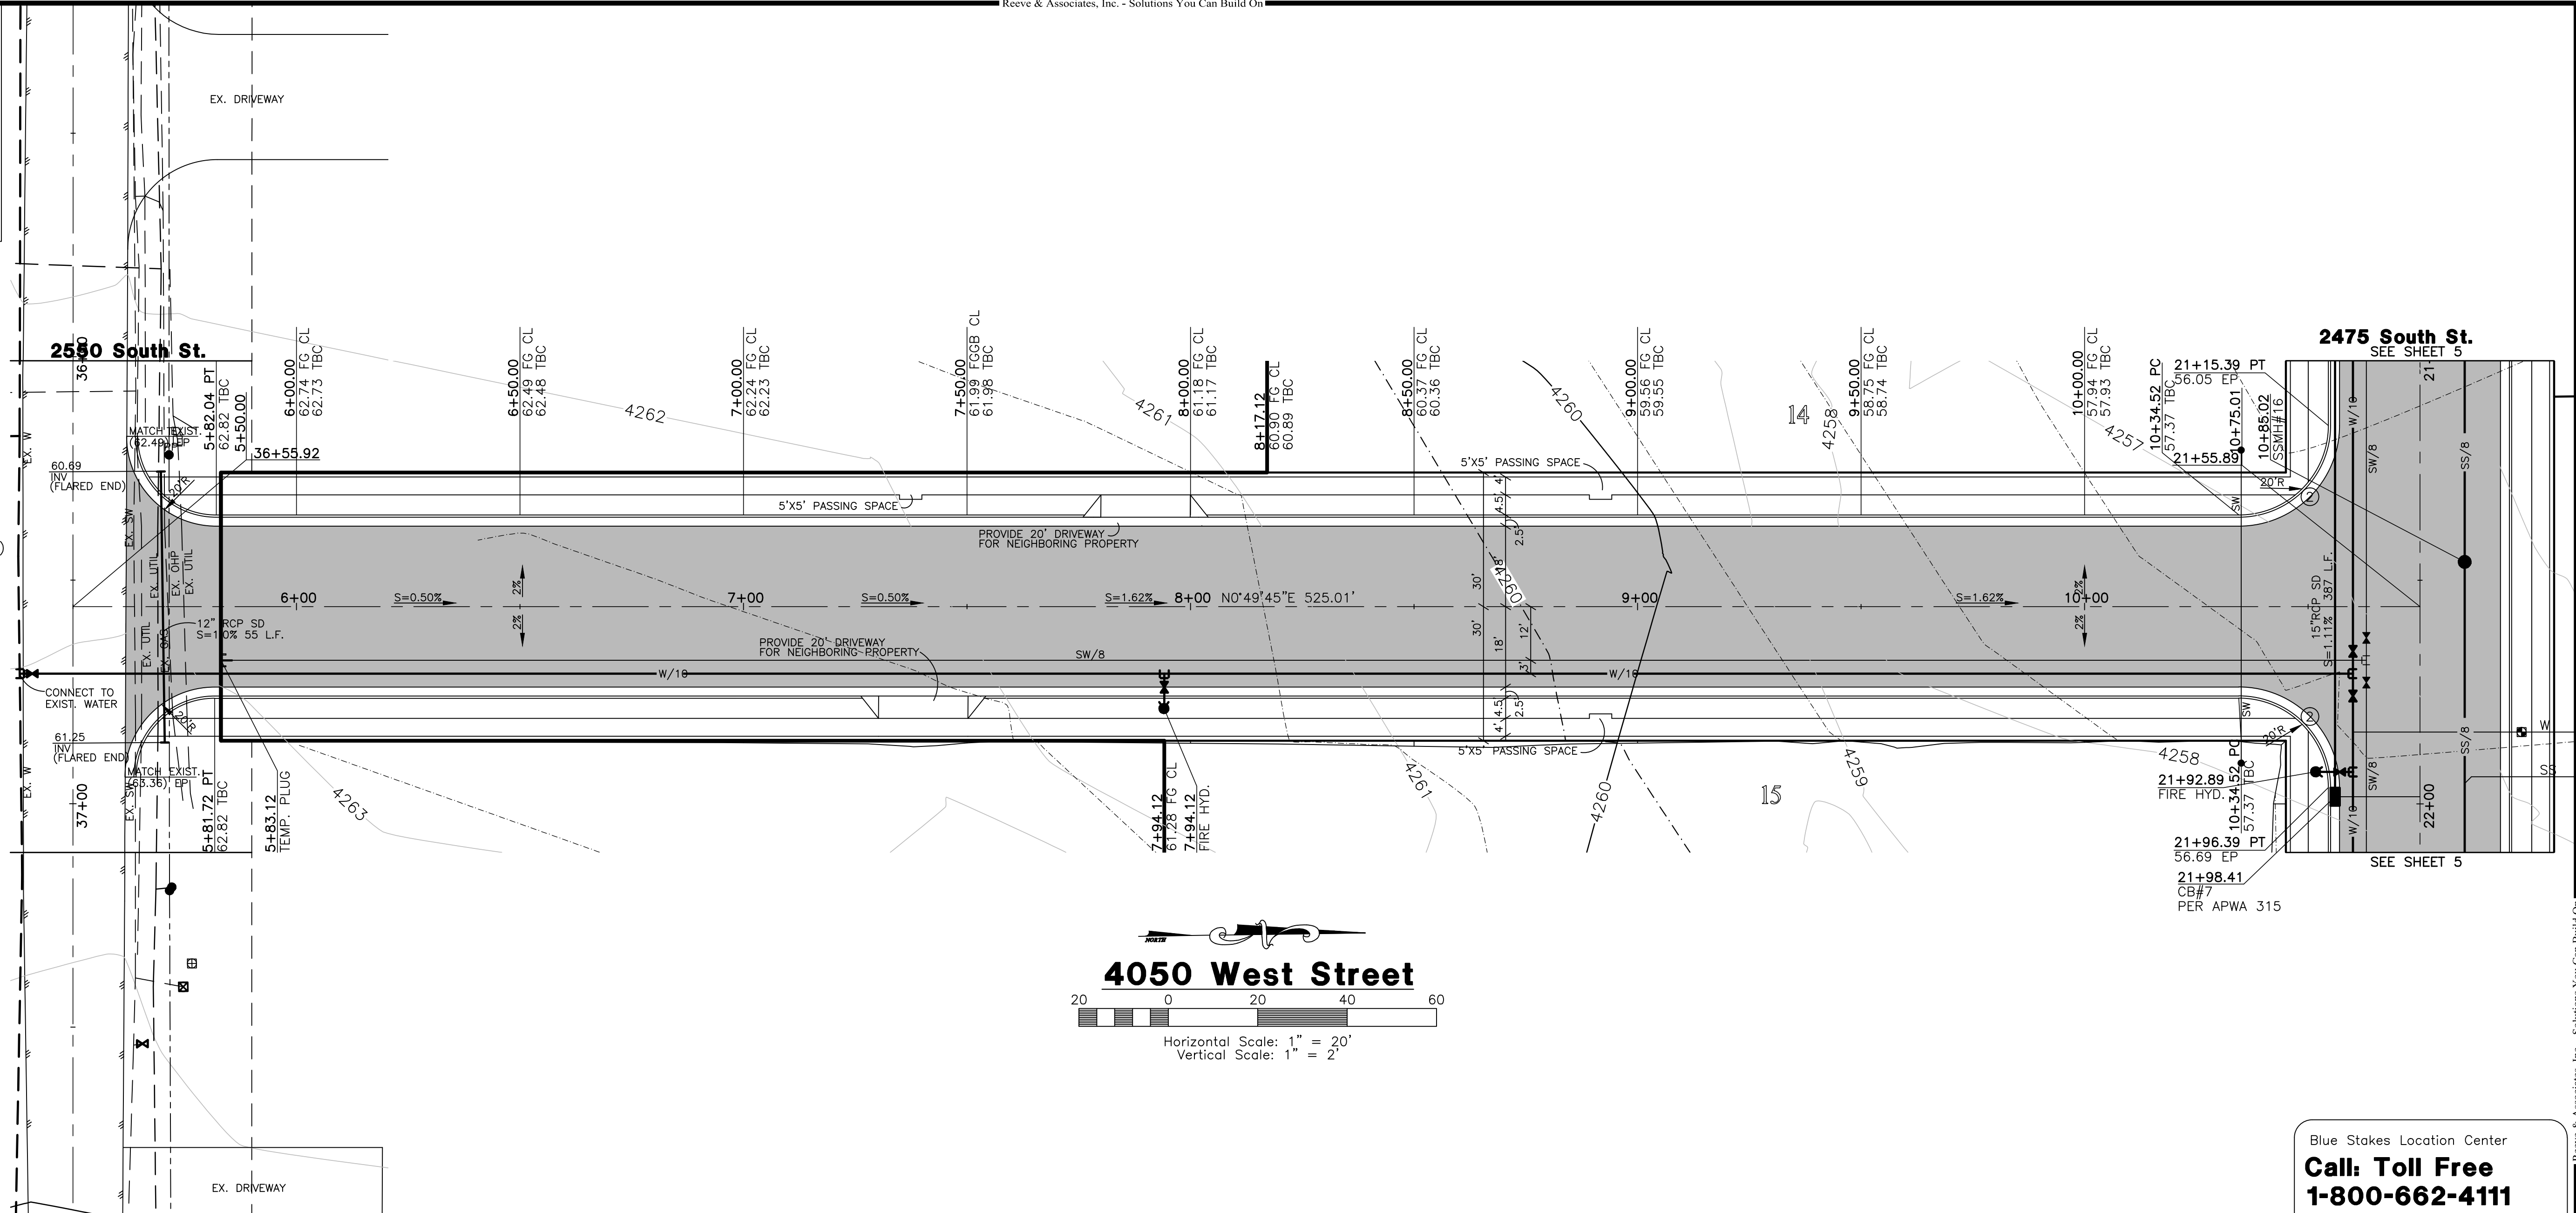


Blue Stakes Location Center
Call: Toll Free 1-800-662-4111
Two Working Days ~~2288~~ You Dig

Reeve & Associates, Inc.
920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403
TEL: (801) 621-2100 FAX: (801) 621-2666 WWW.REEVE-ASSOC.COM
LAND PLANNERS • CIVIL ENGINEERS • LAND SURVEYORS
TRAFFIC ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS


REVISIONS	DATE	DESCRIPTION
5-2-14	RH	County Comments
9-4-14	ST	County Comments
9-30-14	ST	County Comments
10-9-14	ST	County Comments

Mallard Springs Subdivision
WEBER COUNTY, UTAH



4050 West Street
5+50.00 - 11+00.00

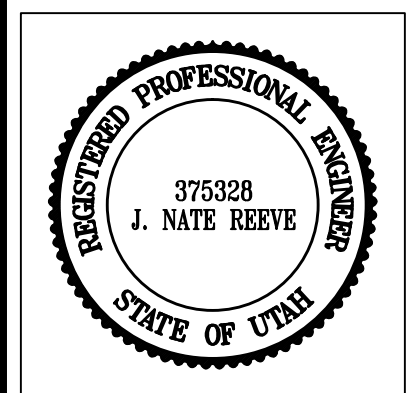

Project Info.
Engineer: J. NATE REEVE, P.E.
Drafted: R. HANSEN
Begin Date: NOVEMBER 4, 2013
Name: MALLARD SPRINGS SUBDIVISION
Number: 3442-A30

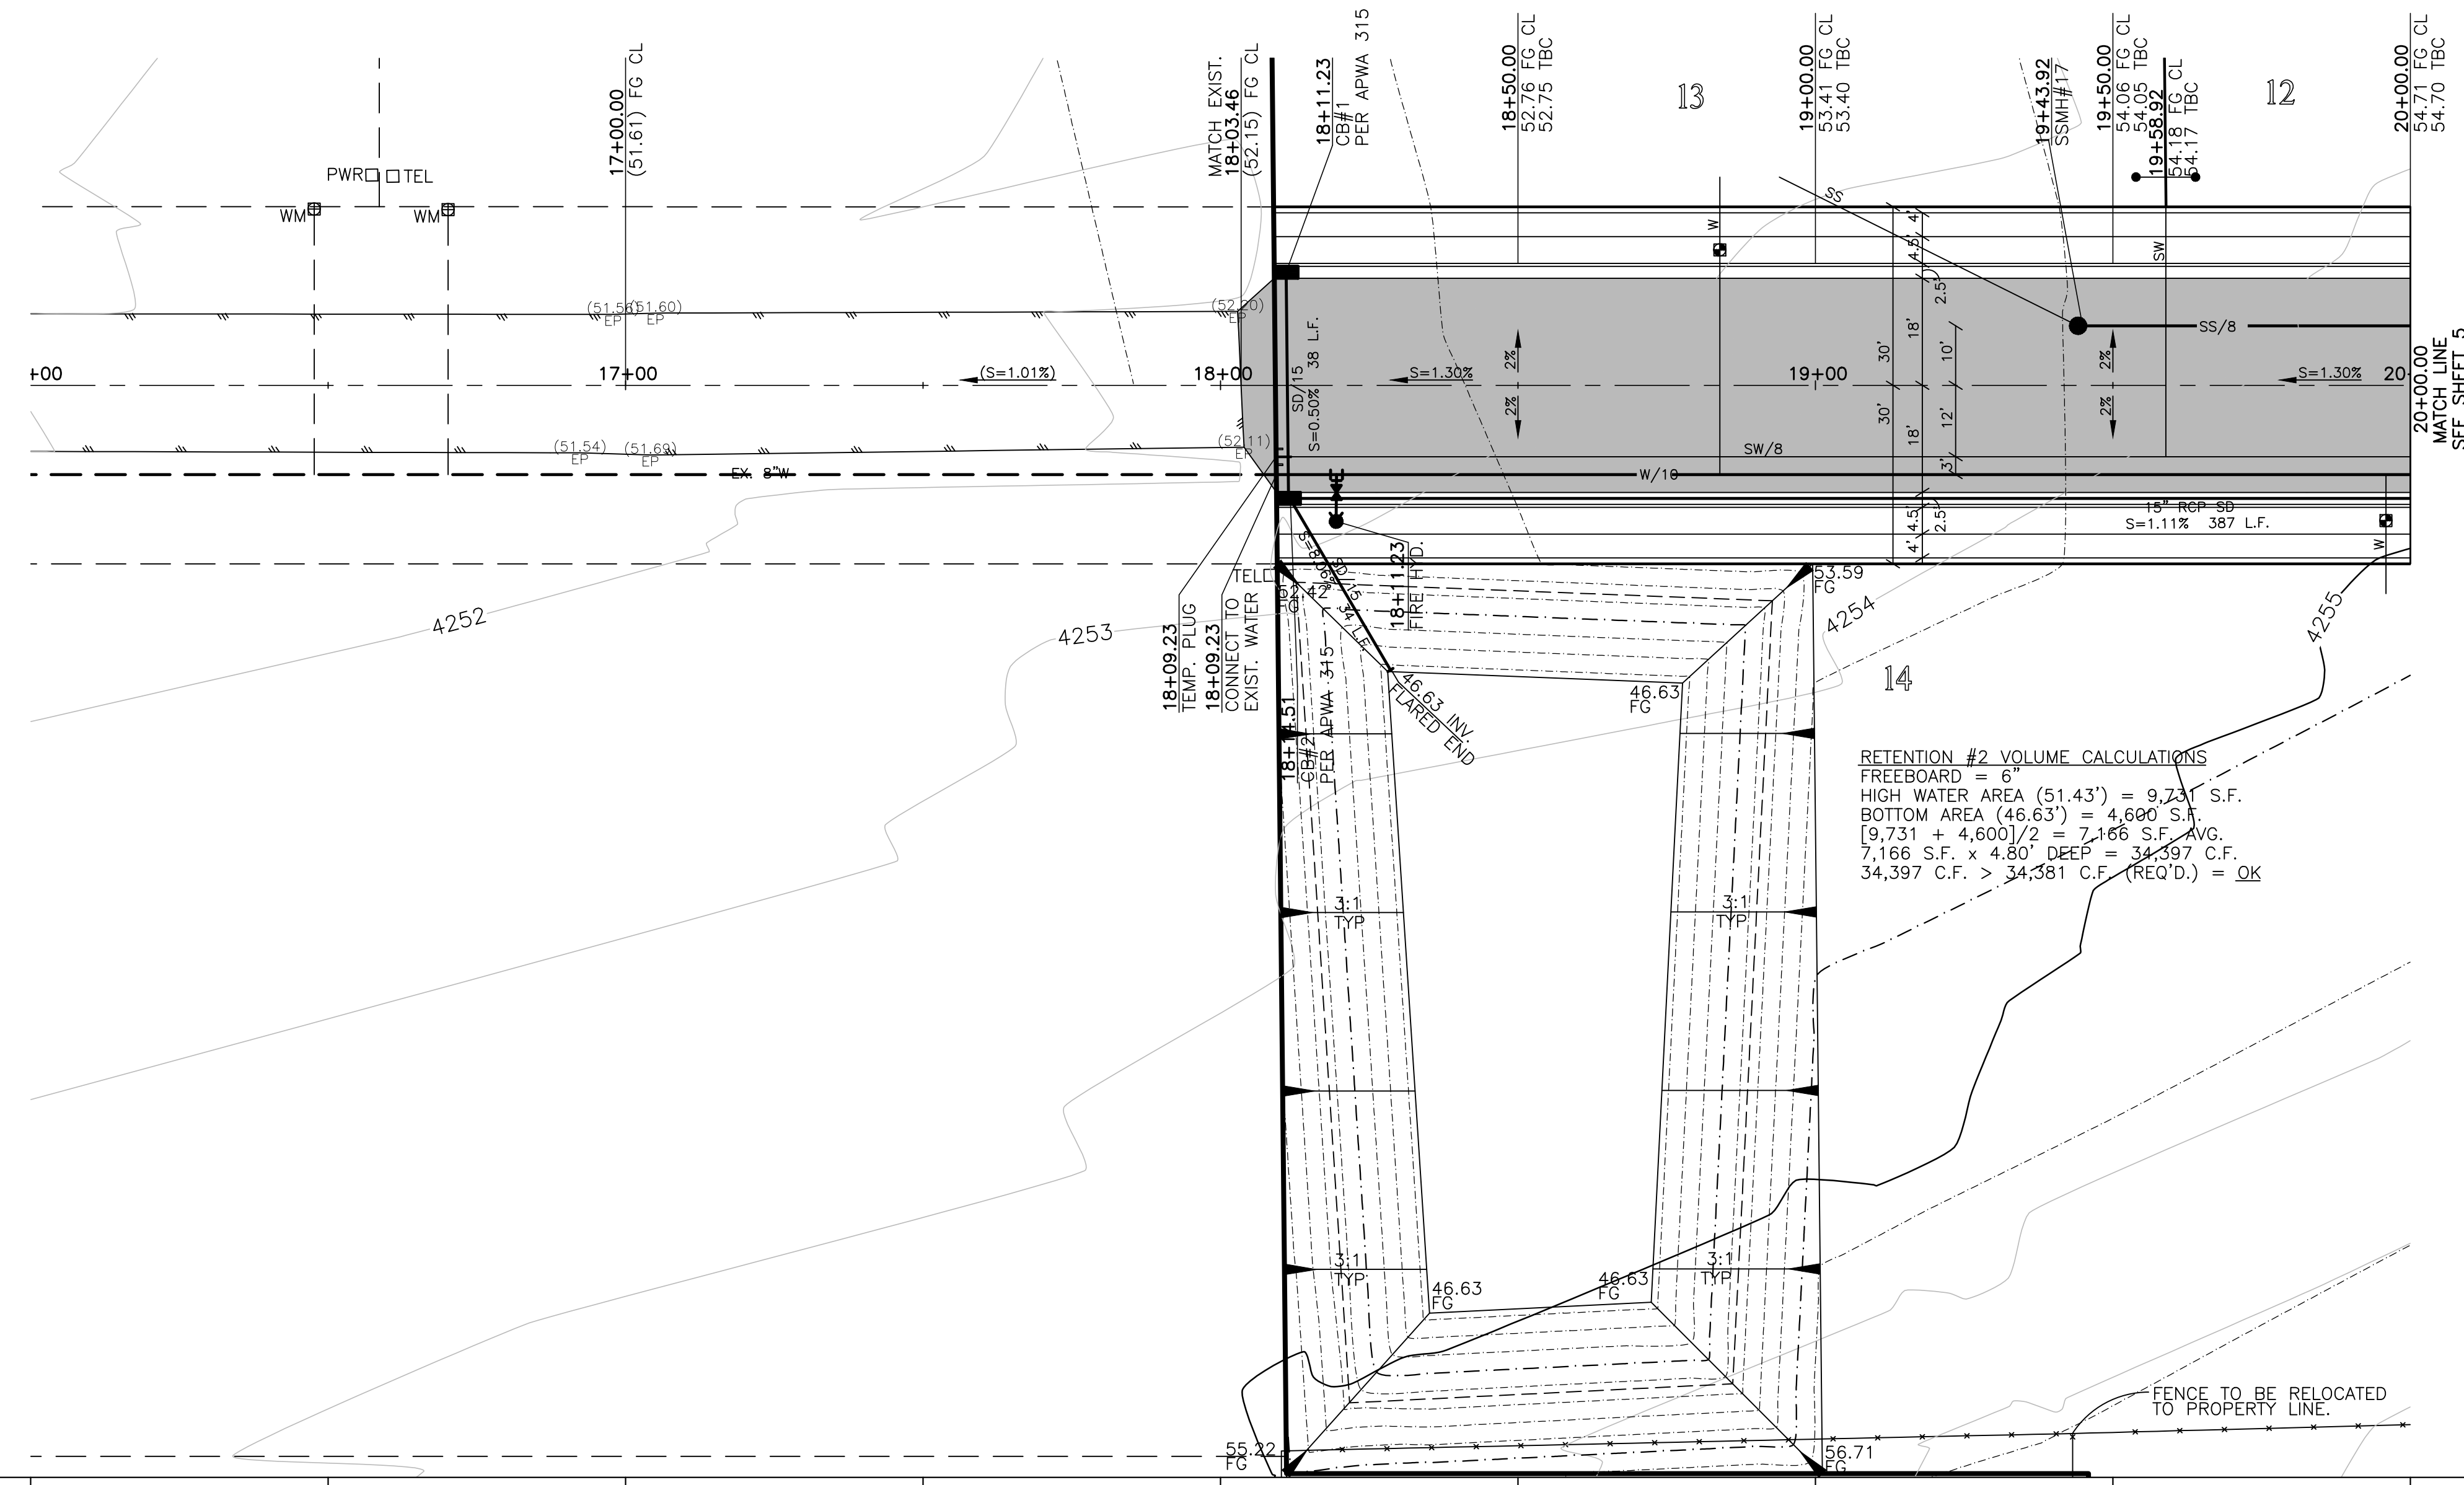

RETENTION #2 VOLUME CALCULATIONS
 FREEBOARD = 6"
 HIGH WATER AREA (51.43') = 9,731 S.F.
 BOTTOM AREA (46.63') = 4,600 S.F.
 $(9,731 + 4,600) / 2 = 7,166$ S.F. AVG.
 $7,166 \text{ S.F.} \times 4.80' \text{ DEEP} = 34,397 \text{ C.F.}$
 $34,397 \text{ C.F.} > 34,381 \text{ C.F. (REQ'D)} = \text{OK}$

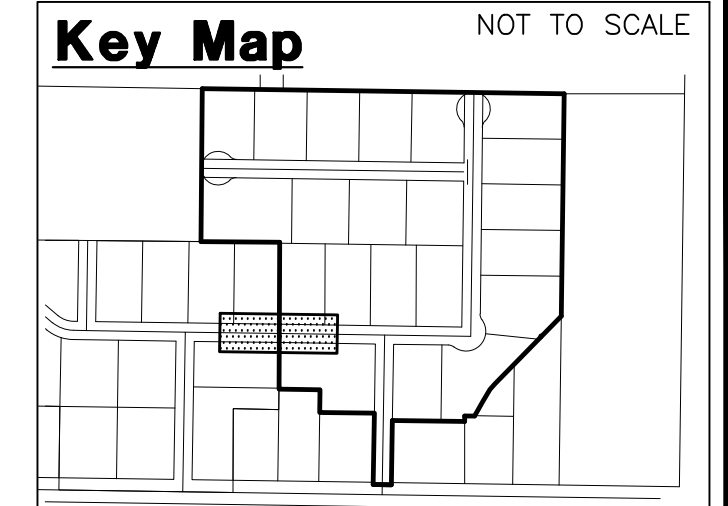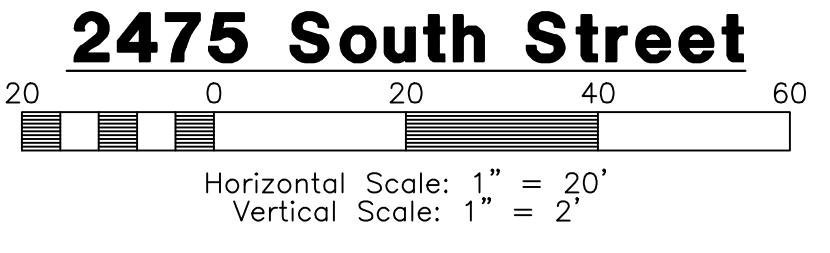

Construction Notes:

- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
 - 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.
- CULINARY WATER**
 W/8 - 8" PVC C-900 CLASS 200 WATER
- SANITARY SEWER**
 SS/8 - 8" ASTM D3034 SDR 35 SEWER
 SS/10 - 10" ASTM D3034 SDR 35 SEWER
- DUE TO THE SHALLOWSNESS OF THE SEWER LINE THROUGH ADJACENT FIELD, CLASS I OR CLASS II PIPE EMBEDMENT (PER ASTM D2487) INSTALLED PER ASTM D 2321 WITH 95% MODIFIED PROCTOR.
- STORM DRAIN**
 SD/15 - 15" RCP STORM DRAIN
- SECONDARY WATER**
 SW/8 - 8" PVC C-900 SECONDARY WATER LINE

Storm Runoff Calculations
 Mallard Springs Subdivision-Basin 2
 9/22/2014

The following runoff calculations are based on the Rainfall - Intensity - Duration Frequency Curve for the West Haven, UT area taken from data compiled by NOAA Atlas 14, using a 100 year storm.

Runoff storm water has been calculated for two different sets of conditions, one being the existing undeveloped land and the other with land fully improved. The difference between the two quantities will be retained in a holding pond.

The calculations are as follows:

1. Runoff from the undeveloped existing land.

Runoff Quantity	Q =	0 cfs
Acreage	A =	7.93 ACRES
Perc Rate		27.00 mpi

$Q(\text{out}) = 0.00 \text{ CFS}$
2. Runoff from developed land

Runoff Coefficients		
Paved Area	72,351	C = 0.9
Landscaped Area	241,771	C = 0.2
Roof	31,500	C = 0.8

Weighted Runoff Coefficient C = 0.40

Rainfall Intensity	i = varies with time
Runoff Quantity	Q = CIA
3. Detention Basin

Volume in	Q * t
Volume out	0.00 * t

The capacity of the retention basin is calculated as the maximum difference between the volume flowing in and the volume flowing out.

The outflow from the retention basin is limited to outflow if undeveloped. Use 0.00 cfs for Q outflow

The required volume of the retention basin is 34,381 cubic feet

RETENTION BASIN
 Cumulative Volume For Detention Pond
 Mallard Springs Subdivision-Basin 2

C =	0.40
A =	7.93
Q(out) =	0.00

time (min)	time (sec)	i (in./hr.)	Q (cfs)	Vol. in (cf)	Vol. out (cf)	Difference (cf)
0	0	0.00	0.00	0.00	0.00	0.00
5	300	6.64	21.14	6341.39	0.00	6341.39
10	600	5.05	16.08	9845.79	0.00	9845.79
15	900	4.17	13.27	11947.40	0.00	11947.40
30	1800	2.81	8.95	16101.78	0.00	16101.78
60	3600	1.74	5.54	19940.99	0.00	19940.99
180	10800	0.65	2.07	22382.04	0.00	22382.04
360	21600	0.36	1.16	24960.62	0.00	24960.62
720	43200	0.22	0.70	30255.29	0.00	30255.29
1440	86400	0.13	0.40	34381.02	0.00	34381.02

West Haven UT
NOAA Atlas 14

Station	Proposed Grade (Centerline)	Existing Grade (Centerline)	Notes
4258			
4256			
4254			
4252			
4250			
4248			
4246			
4244			
4242			
4240			
4238			

Blue Stakes Location Center
Call: Toll Free 1-800-662-4111
 Two Working Days Before You Dig


Reeve & Associates, Inc.
 920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403
 TEL: (801) 621-2100 FAX: (801) 621-2666 WWW: REEVE-ASSOC.COM
 LAND PLANNERS • CIVIL ENGINEERS • LAND SURVEYORS
 TRAFFIC ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS






DATE	DESCRIPTION
5-2-14	Rh County Comments
9-4-14	ST County Comments
9-30-14	ST County Comments
10-9-14	ST County Comments

Mallard Springs Subdivision
 WEBER COUNTY, UTAH

2475 South Street
16+00.00 - 20+00.00

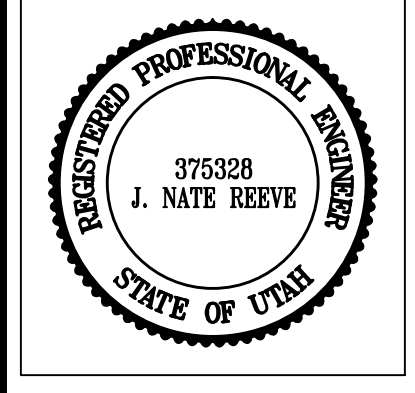


Project Info.
 Engineer: J. NATE REEVE, P.E.
 Drafter: R. HANSEN
 Begin Date: NOVEMBER 4, 2013
 Name: MALLARD SPRINGS SUBDIVISION
 Number: 3442-A30

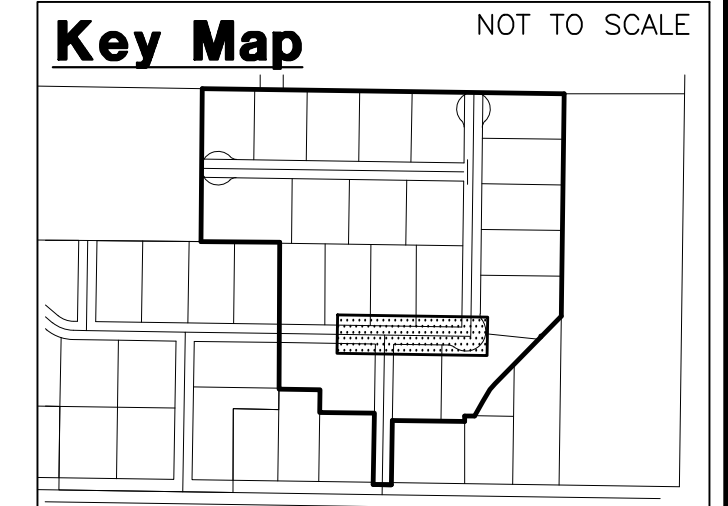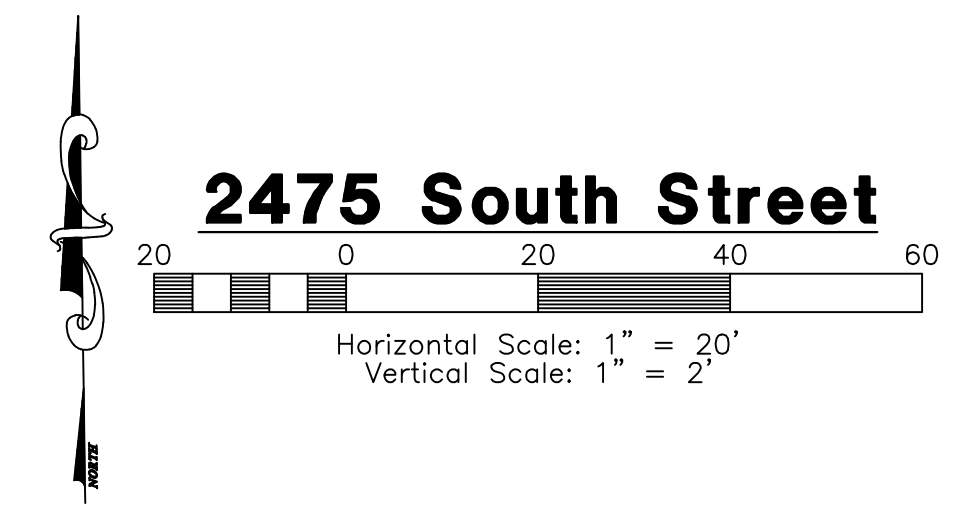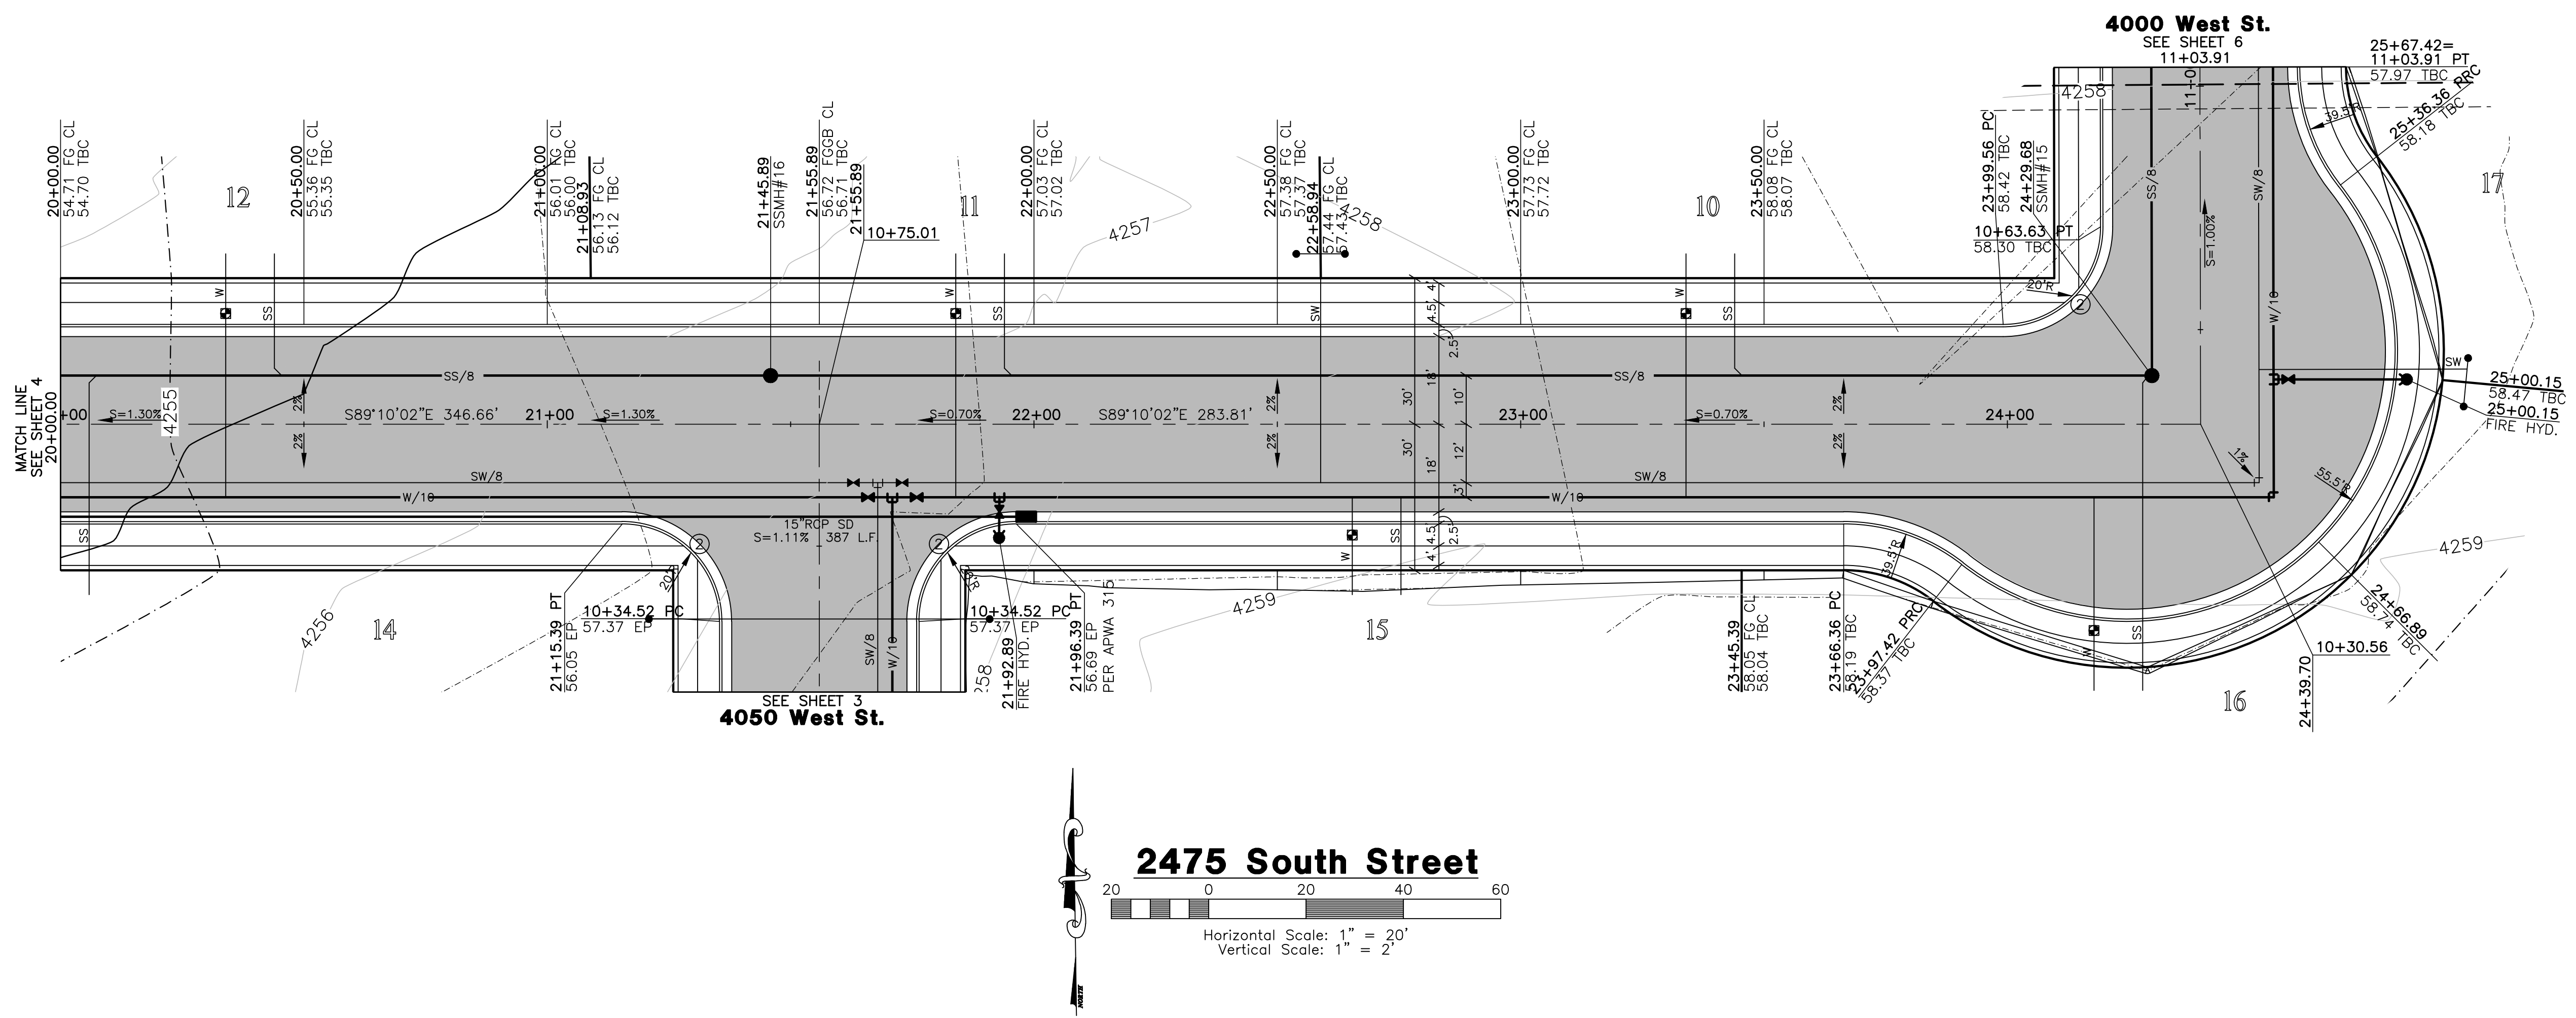

- Construction Notes:**
- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
 - 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.
- CULINARY WATER**
W/8 - 8" PVC C-900 CLASS 200 WATER
- SANITARY SEWER**
SS/8 - 8" ASTM D3034 SDR 35 SEWER
SS/10 - 10" ASTM D3034 SDR 35 SEWER
- DUE TO THE SHALLOWNESS OF THE SEWER LINE THROUGH ADJACENT FIELD, CLASS I OR CLASS II PIPE EMBEDMENT (PER ASTM D2487) INSTALLED PER ASTM D 2321 WITH 95% MODIFIED PROCTOR.
- STORM DRAIN**
SD/15 - 15" RCP STORM DRAIN
- SECONDARY WATER**
SW/8 - 8" PVC C-900 SECONDARY WATER LINE


Reeve & Associates, Inc.
IRA
920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403
LAND PLANNERS • CIVIL ENGINEERS • LAND SURVEYORS
TEL: (801) 621-3100 FAX: (801) 621-2668 www.reeve-assoc.com
PRACTICE ENGINEERS • LANDSCAPE ARCHITECTS

DATE	DESCRIPTION
5-2-14	Rh County Comments
9-4-14	ST County Comments
9-30-14	ST County Comments
10-9-14	ST County Comments

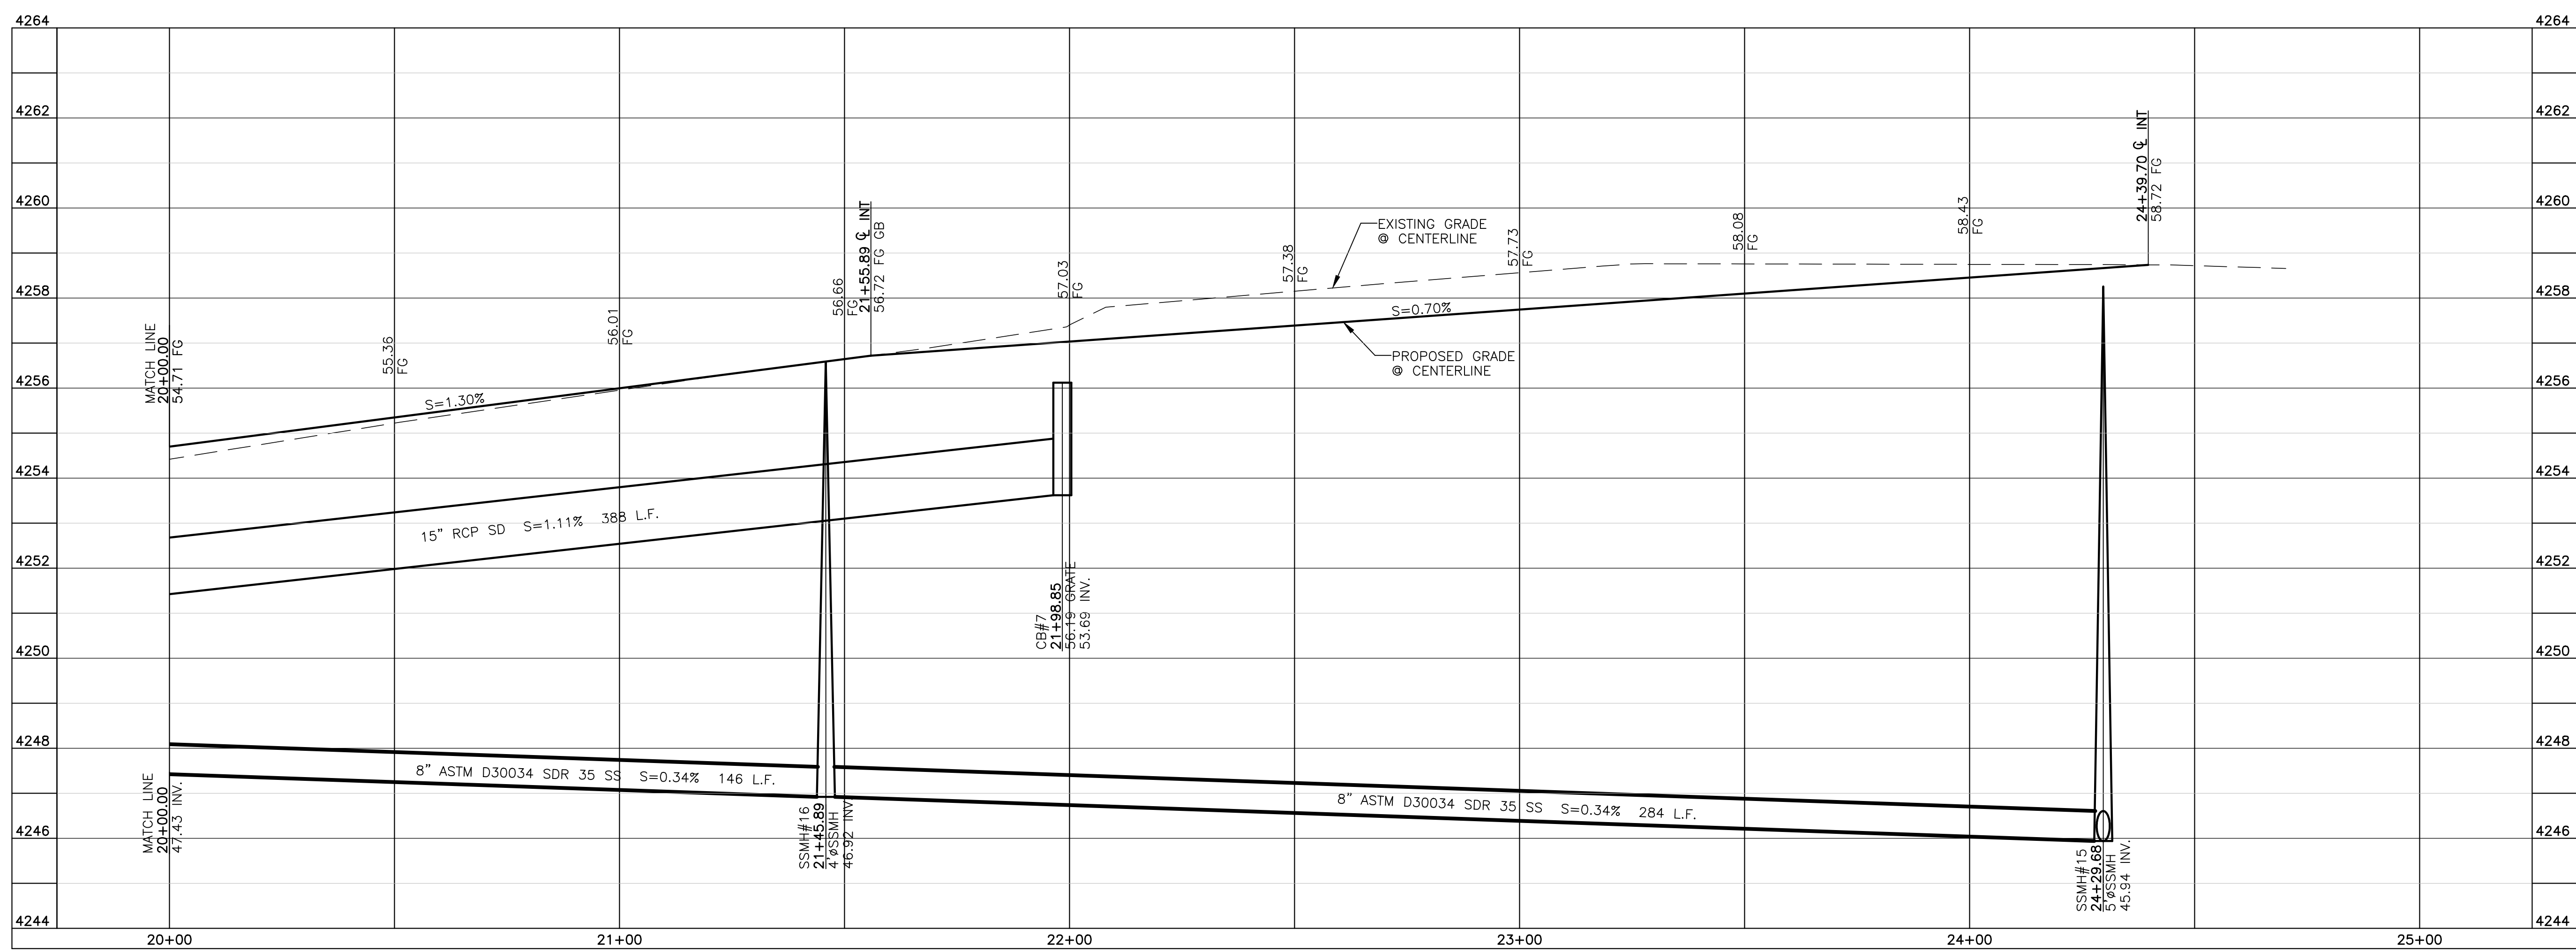





Revised: 10-9-14

Mallard Springs Subdivision
WEBER COUNTY, UTAH
2475 South Street
20+00.00 - 25+00.00

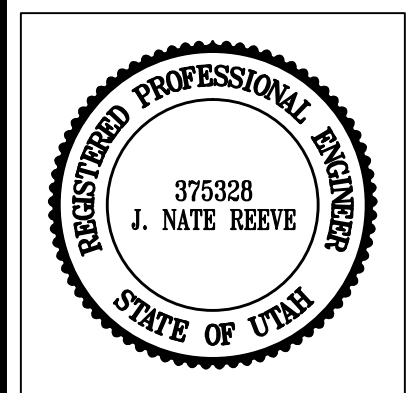

Project Info.
Engineer: J. NATE REEVE, P.E.
Draftsman: R. HANSEN
Begin Date: NOVEMBER 4, 2013
Name: MALLARD SPRINGS SUBDIVISION
Number: 3442-A30

Blue Stakes Location Center
Call: Toll Free 1-800-662-4111
Two Working Days Before You Dig

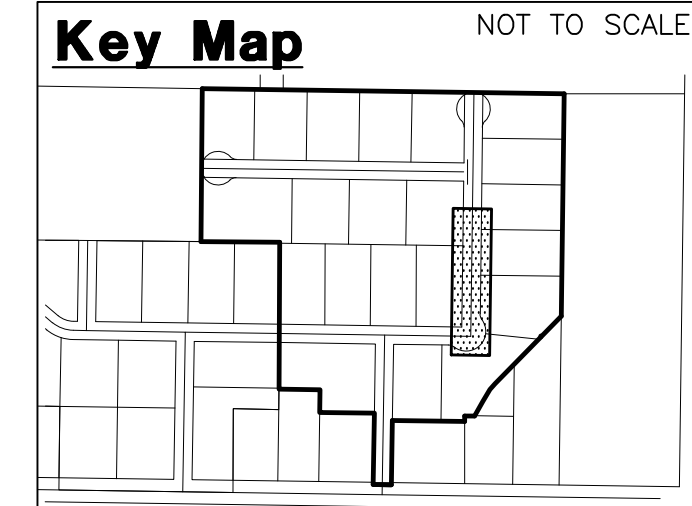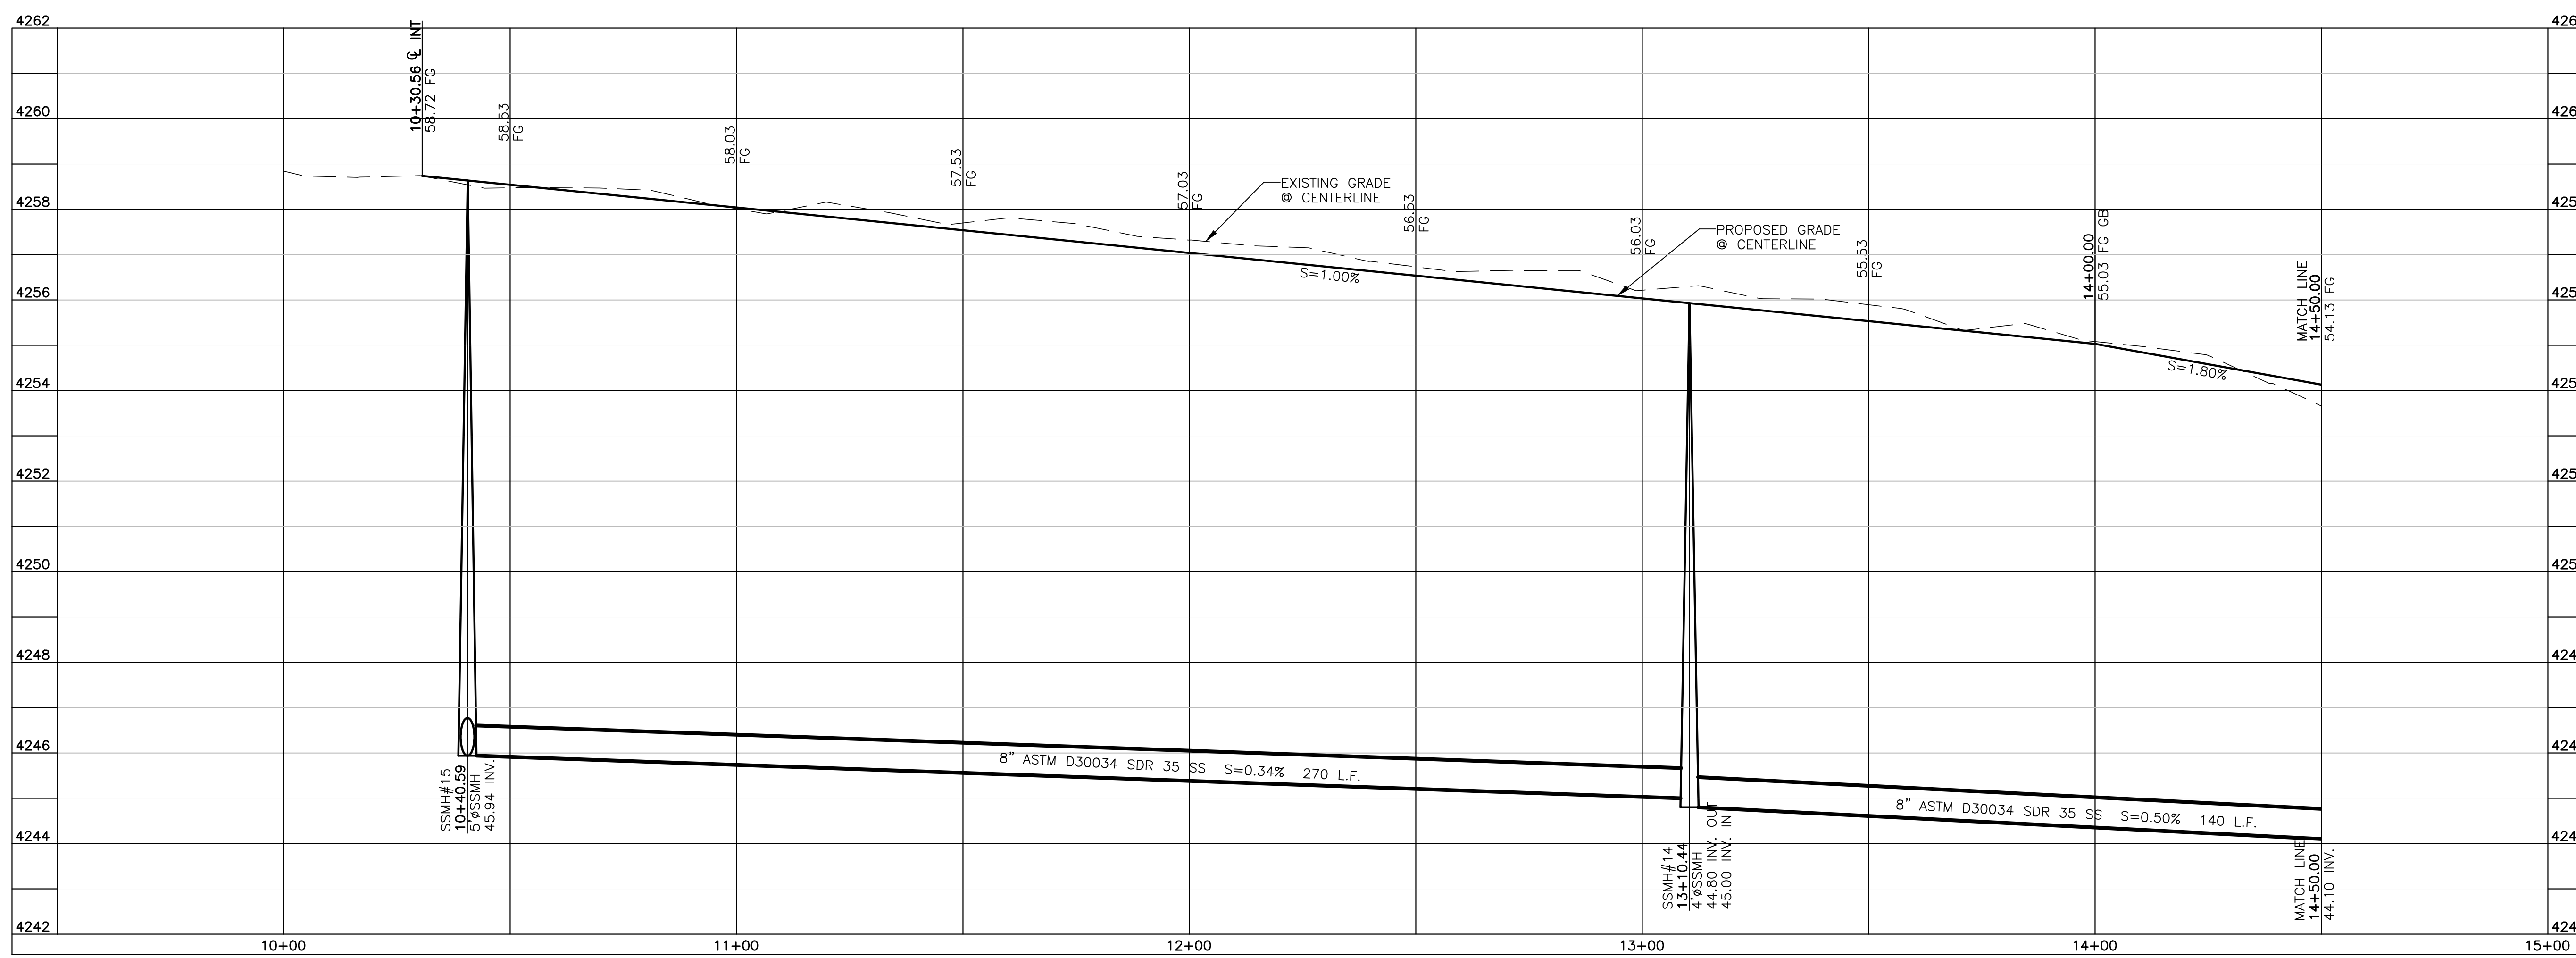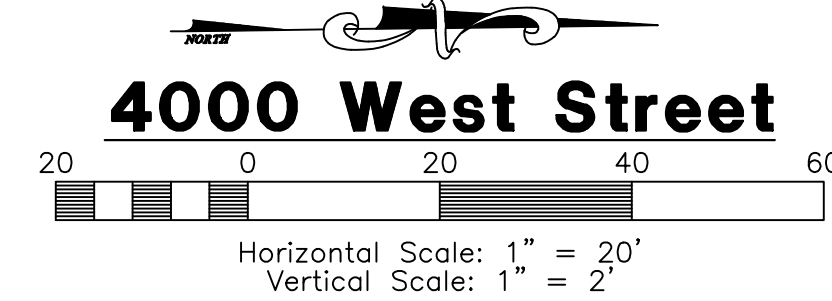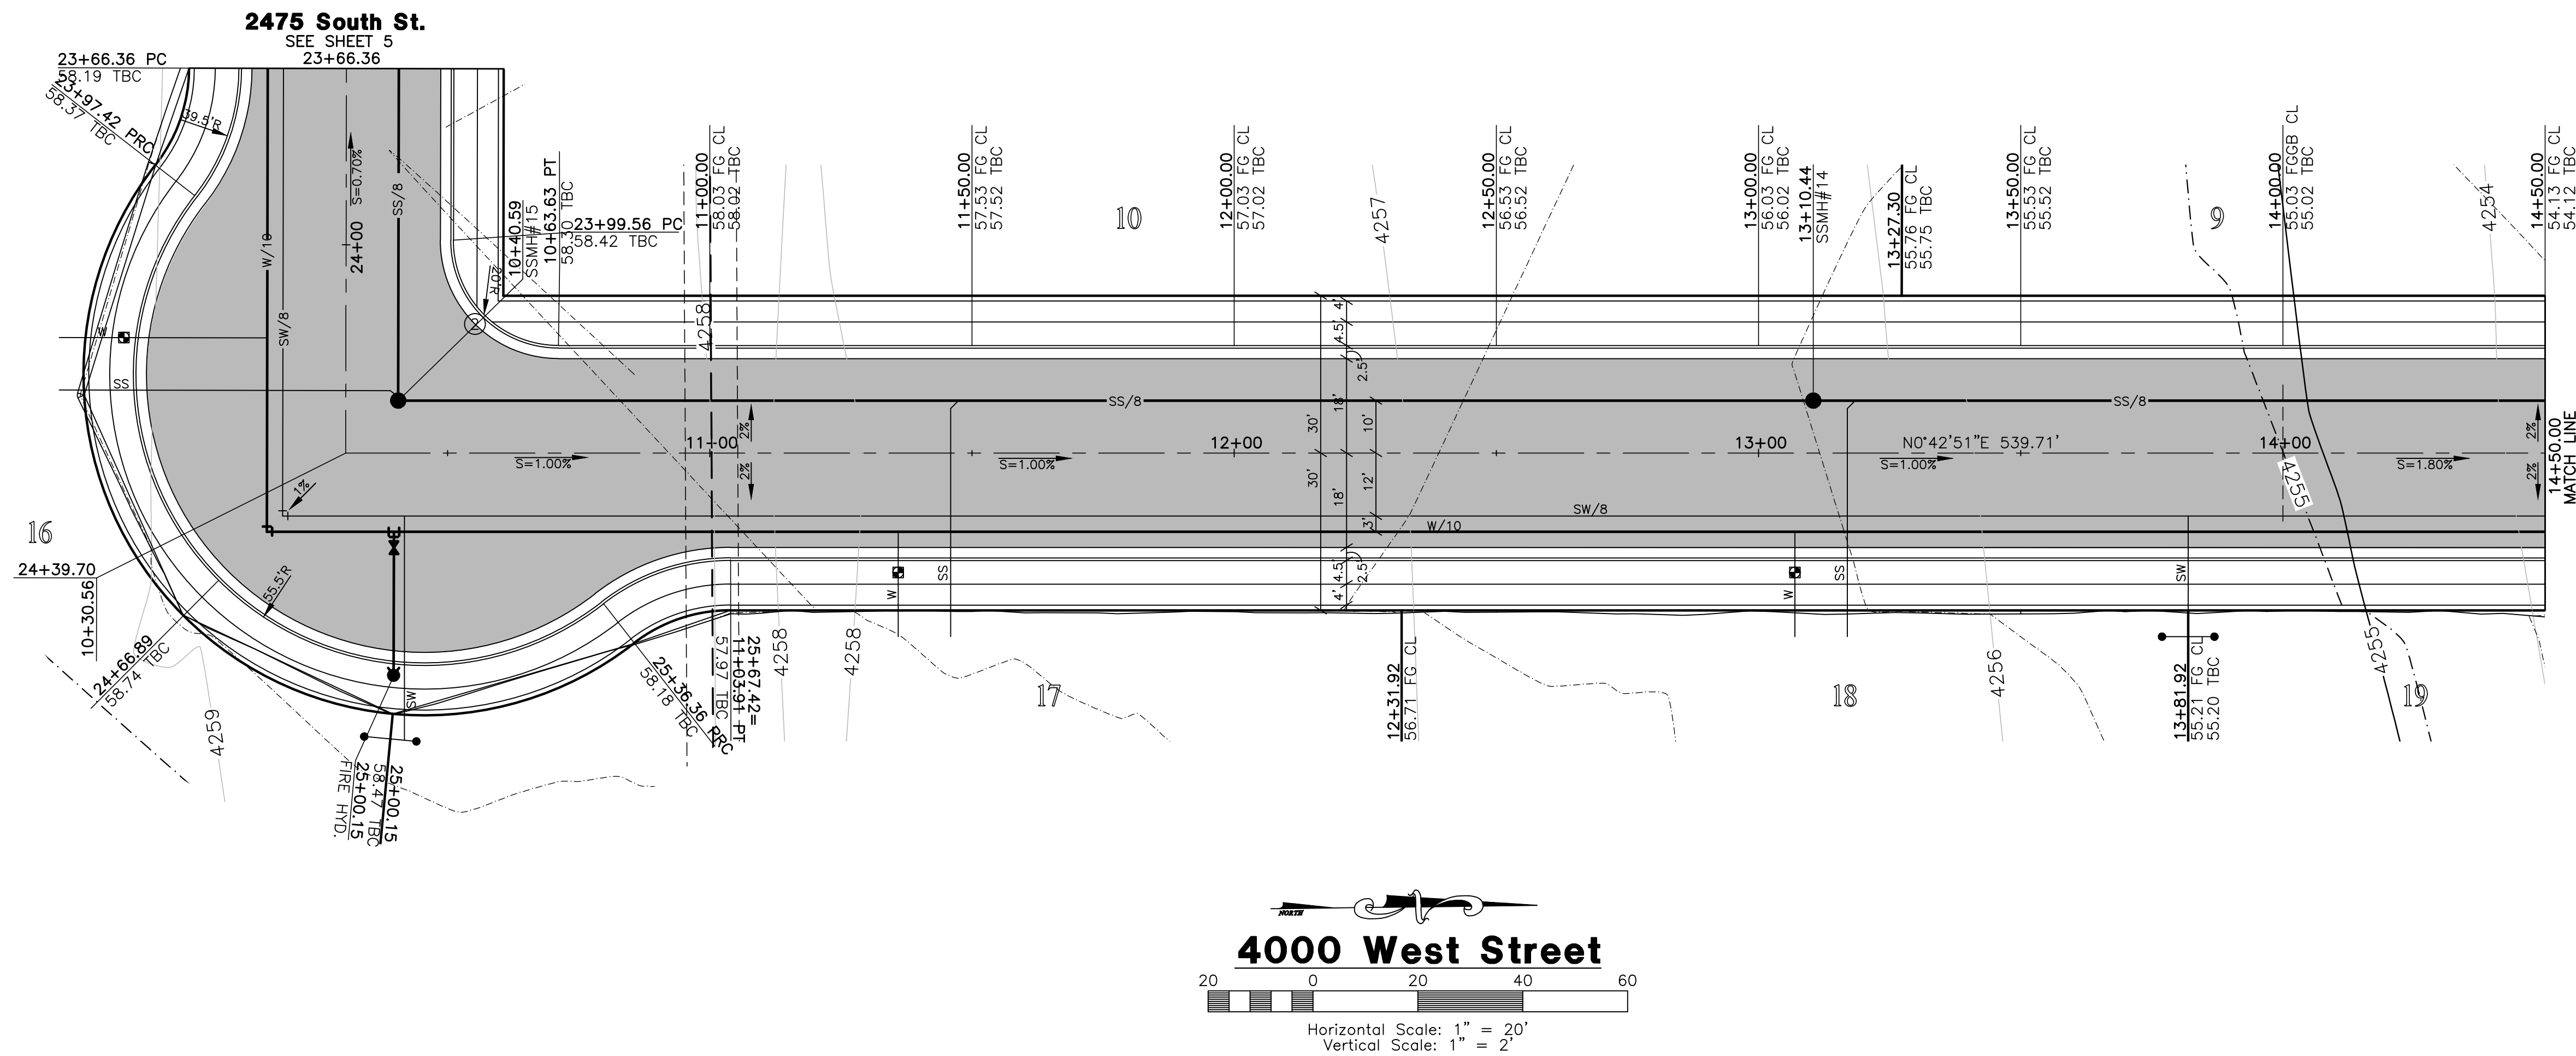

Construction Notes:

- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
- 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.

CULINARY WATER
W/8 - 8" PVC C-900 CLASS 200 WATER


SANITARY SEWER
SS/8 - 8" ASTM D3034 SDR 35 SEWER
SS/10 - 10" ASTM D3034 SDR 35 SEWER

DUE TO THE SHALLOWSNESS OF THE SEWER LINE THROUGH ADJACENT FIELD, CLASS I OR CLASS II PIPE EMBEDMENT (PER ASTM D2487) INSTALLED PER ASTM D 2321 WITH 95% MODIFIED PROCTOR.

STORM DRAIN
SD/15 - 15" RCP STORM DRAIN


SECONDARY WATER
SW/8 - 8" PVC C-900 SECONDARY WATER LINE

Reeve & Associates, Inc.
920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403
TEL: (801) 621-2100 FAX: (801) 621-2666 WWW.REEVE-ASSOC.COM
LAND PLANNERS • CIVIL ENGINEERS • LAND SURVEYORS
TRAFFIC ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

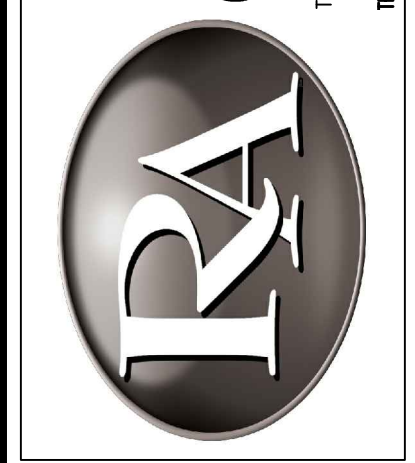


DATE	DESCRIPTION
5-2-14	Rh County Comments
9-4-14	ST County Comments
9-30-14	ST County Comments
10-9-14	ST County Comments

Mallard Springs Subdivision
WEBER COUNTY, UTAH
4000 West Street
10+00.00 - 14+50.00

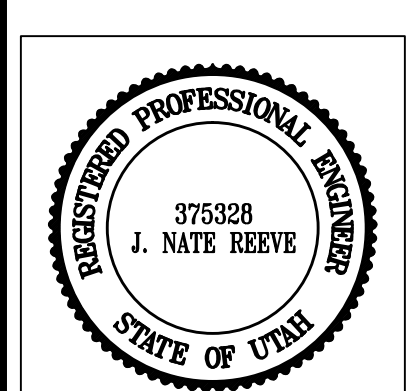


Project Info.
Engineer: J. NATE REEVE, P.E.
Drafted: R. HANSEN
Begin Date: NOVEMBER 4, 2013
Name: MALLARD SPRINGS SUBDIVISION
Number: 3442-A30

Sheet **17**
6 Sheets

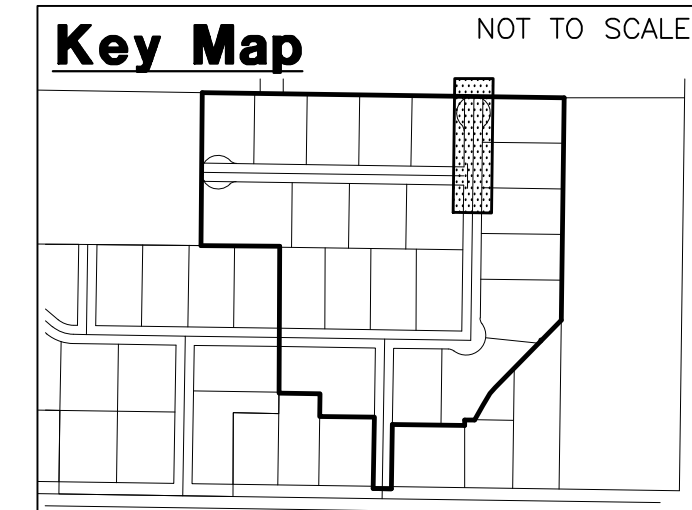


Reeve & Associates, Inc.
 920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403
 TEL: (801) 621-2100 FAX: (801) 621-2666 www.reeve-assoc.com
 LAND PLANNERS • CIVIL ENGINEERS • LAND SURVEYORS
 TRAFFIC ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

REVISIONS	DATE	DESCRIPTION
5-2-14	Rh	County Comments
9-4-14	ST	County Comments
9-30-14	ST	County Comments
10-9-14	ST	County Comments

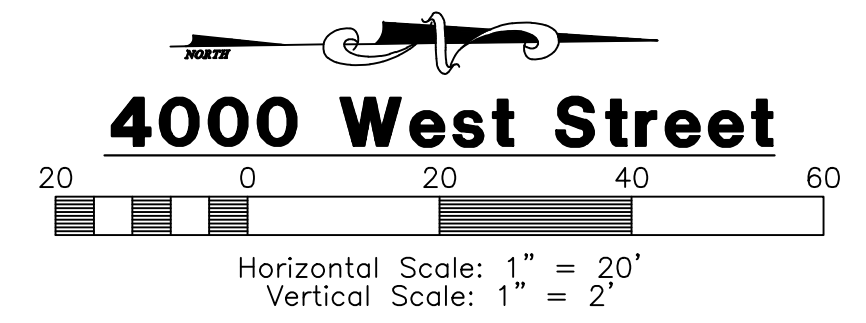

RETENTION #3 VOLUME CALCULATIONS
 FREEBOARD = 6"
 HIGH WATER AREA (48.25') = 8,531 S.F.
 BOTTOM AREA (43.64') = 3,976 S.F.
 $[8,531 + 3,976] / 2 = 6,254$ S.F. AVG.
 6,254 S.F. x 4.61' DEEP = 28,831 C.F.
 28,831 C.F. > 28,773 C.F. (REQ'D.) = OK

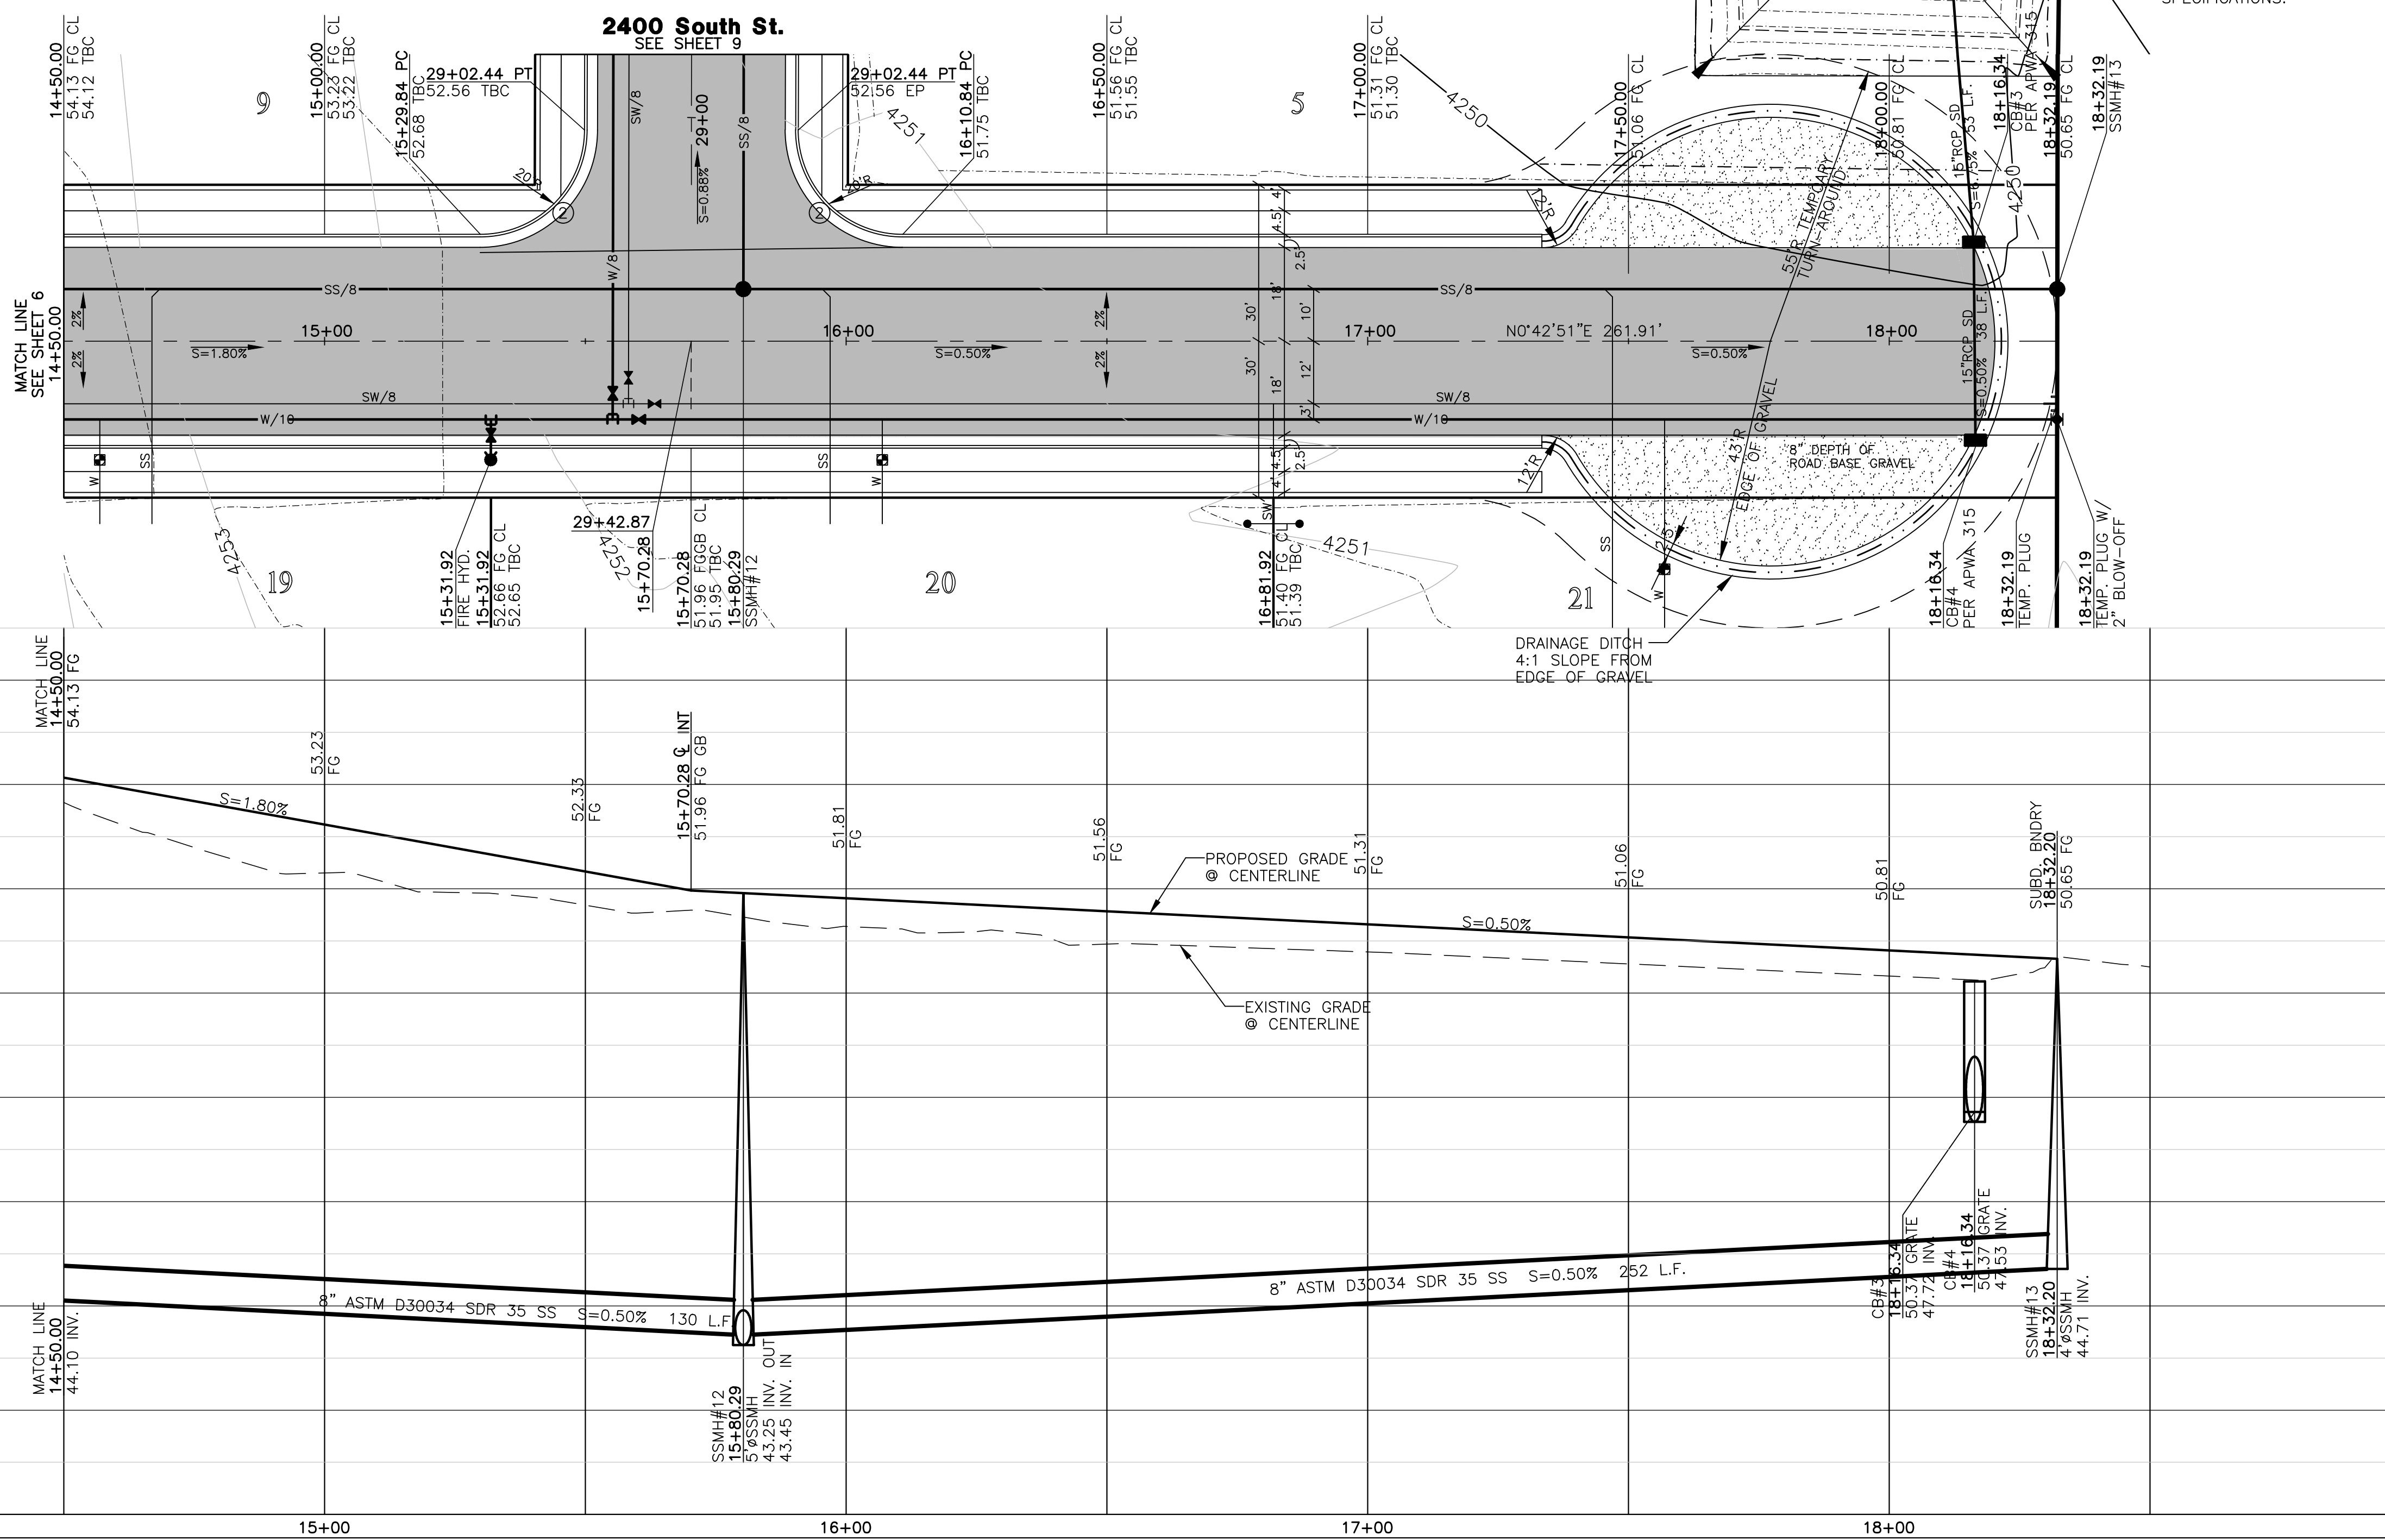

Storm Runoff Calculations
 Mallard Springs Subdivision-Basin 3
 6/2/2014 SET

The following runoff calculations are based on the Rainfall - Intensity - Duration Frequency Curve for the West Haven, UT area taken from data compiled by NOAA Atlas 14, using a 100 year storm.
 Runoff storm water has been calculated for two different sets of conditions, one being the existing undeveloped land and the other with land fully improved. The difference between the two quantities will be retained in a holding pond.

The calculations are as follows:

- Runoff from the undeveloped existing land.

Runoff Quantity	Q = 0 cfs
Acreage	A = 7.71 ACRES
Perc Rate	40.00 mpi
Q(out) =	0.00 CFS
- Runoff from developed land

Runoff Coefficients		
Paved Area	50,588	C = 0.9
Landscaped Area	282,812	C = 0.2
Roof	22,500	C = 0.8
Weighted Runoff Coefficient		C = 0.35
- Detention Basin

Rainfall Intensity	i = varies with time
Runoff Quantity	Q = CIA
Volume in	Q * t
Volume out	0.00 * t

The capacity of the retention basin is calculated as the maximum difference between the volume flowing in and the volume flowing out.
 The outflow from the retention basin is limited to outflow if undeveloped.
 Use 0.00 cfs for Q outflow

The required volume of the retention basin is 28,773 cubic feet

RETENTION BASIN
 Cumulative Volume For Detention Pond
 Mallard Springs Subdivision-Basin 3

C =	0.35
A =	7.71
Q(out) =	0.00

time (min)	time (sec)	i (in./hr.)	Q (cfs)	Vol. in (cf)	Vol. out (cf)	Difference (cf)
0	0	0.00	0.00	0.00	0.00	0.00
5	300	6.64	17.69	5307.04	0.00	5307.04
10	600	5.05	13.45	8072.46	0.00	8072.46
15	900	4.17	11.11	9998.66	0.00	9998.66
30	1800	2.81	7.49	13475.41	0.00	13475.41
60	3600	1.74	4.64	16888.41	0.00	16888.41
180	10800	0.85	1.73	18731.30	0.00	18731.30
360	21600	0.36	0.97	20889.29	0.00	20889.29
720	43200	0.22	0.59	25320.35	0.00	25320.35
1440	86400	0.13	0.33	28773.12	0.00	28773.12

West Haven UT
 NOAA Atlas 14



Blue Stakes Location Center
Call: Toll Free
1-800-662-4111
 Two Working Days Before You Dig

Revised: 10-9-14




Project Info.
 Engineer: J. NATE REEVE, P.E.
 Drafter: R. HANSEN
 Begin Date: NOVEMBER 4, 2013
 Name: MALLARD SPRINGS SUBDIVISION
 Number: 3442-A30

Reeve & Associates, Inc. - Solutions You Can Build On

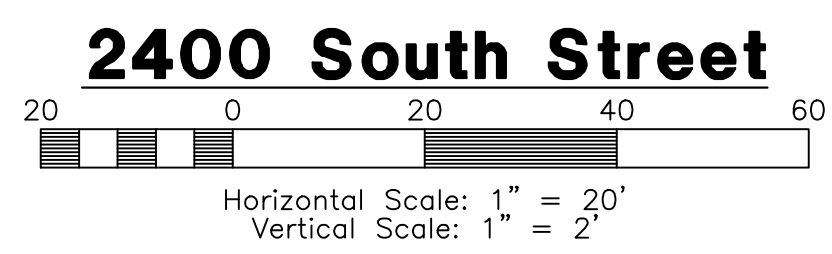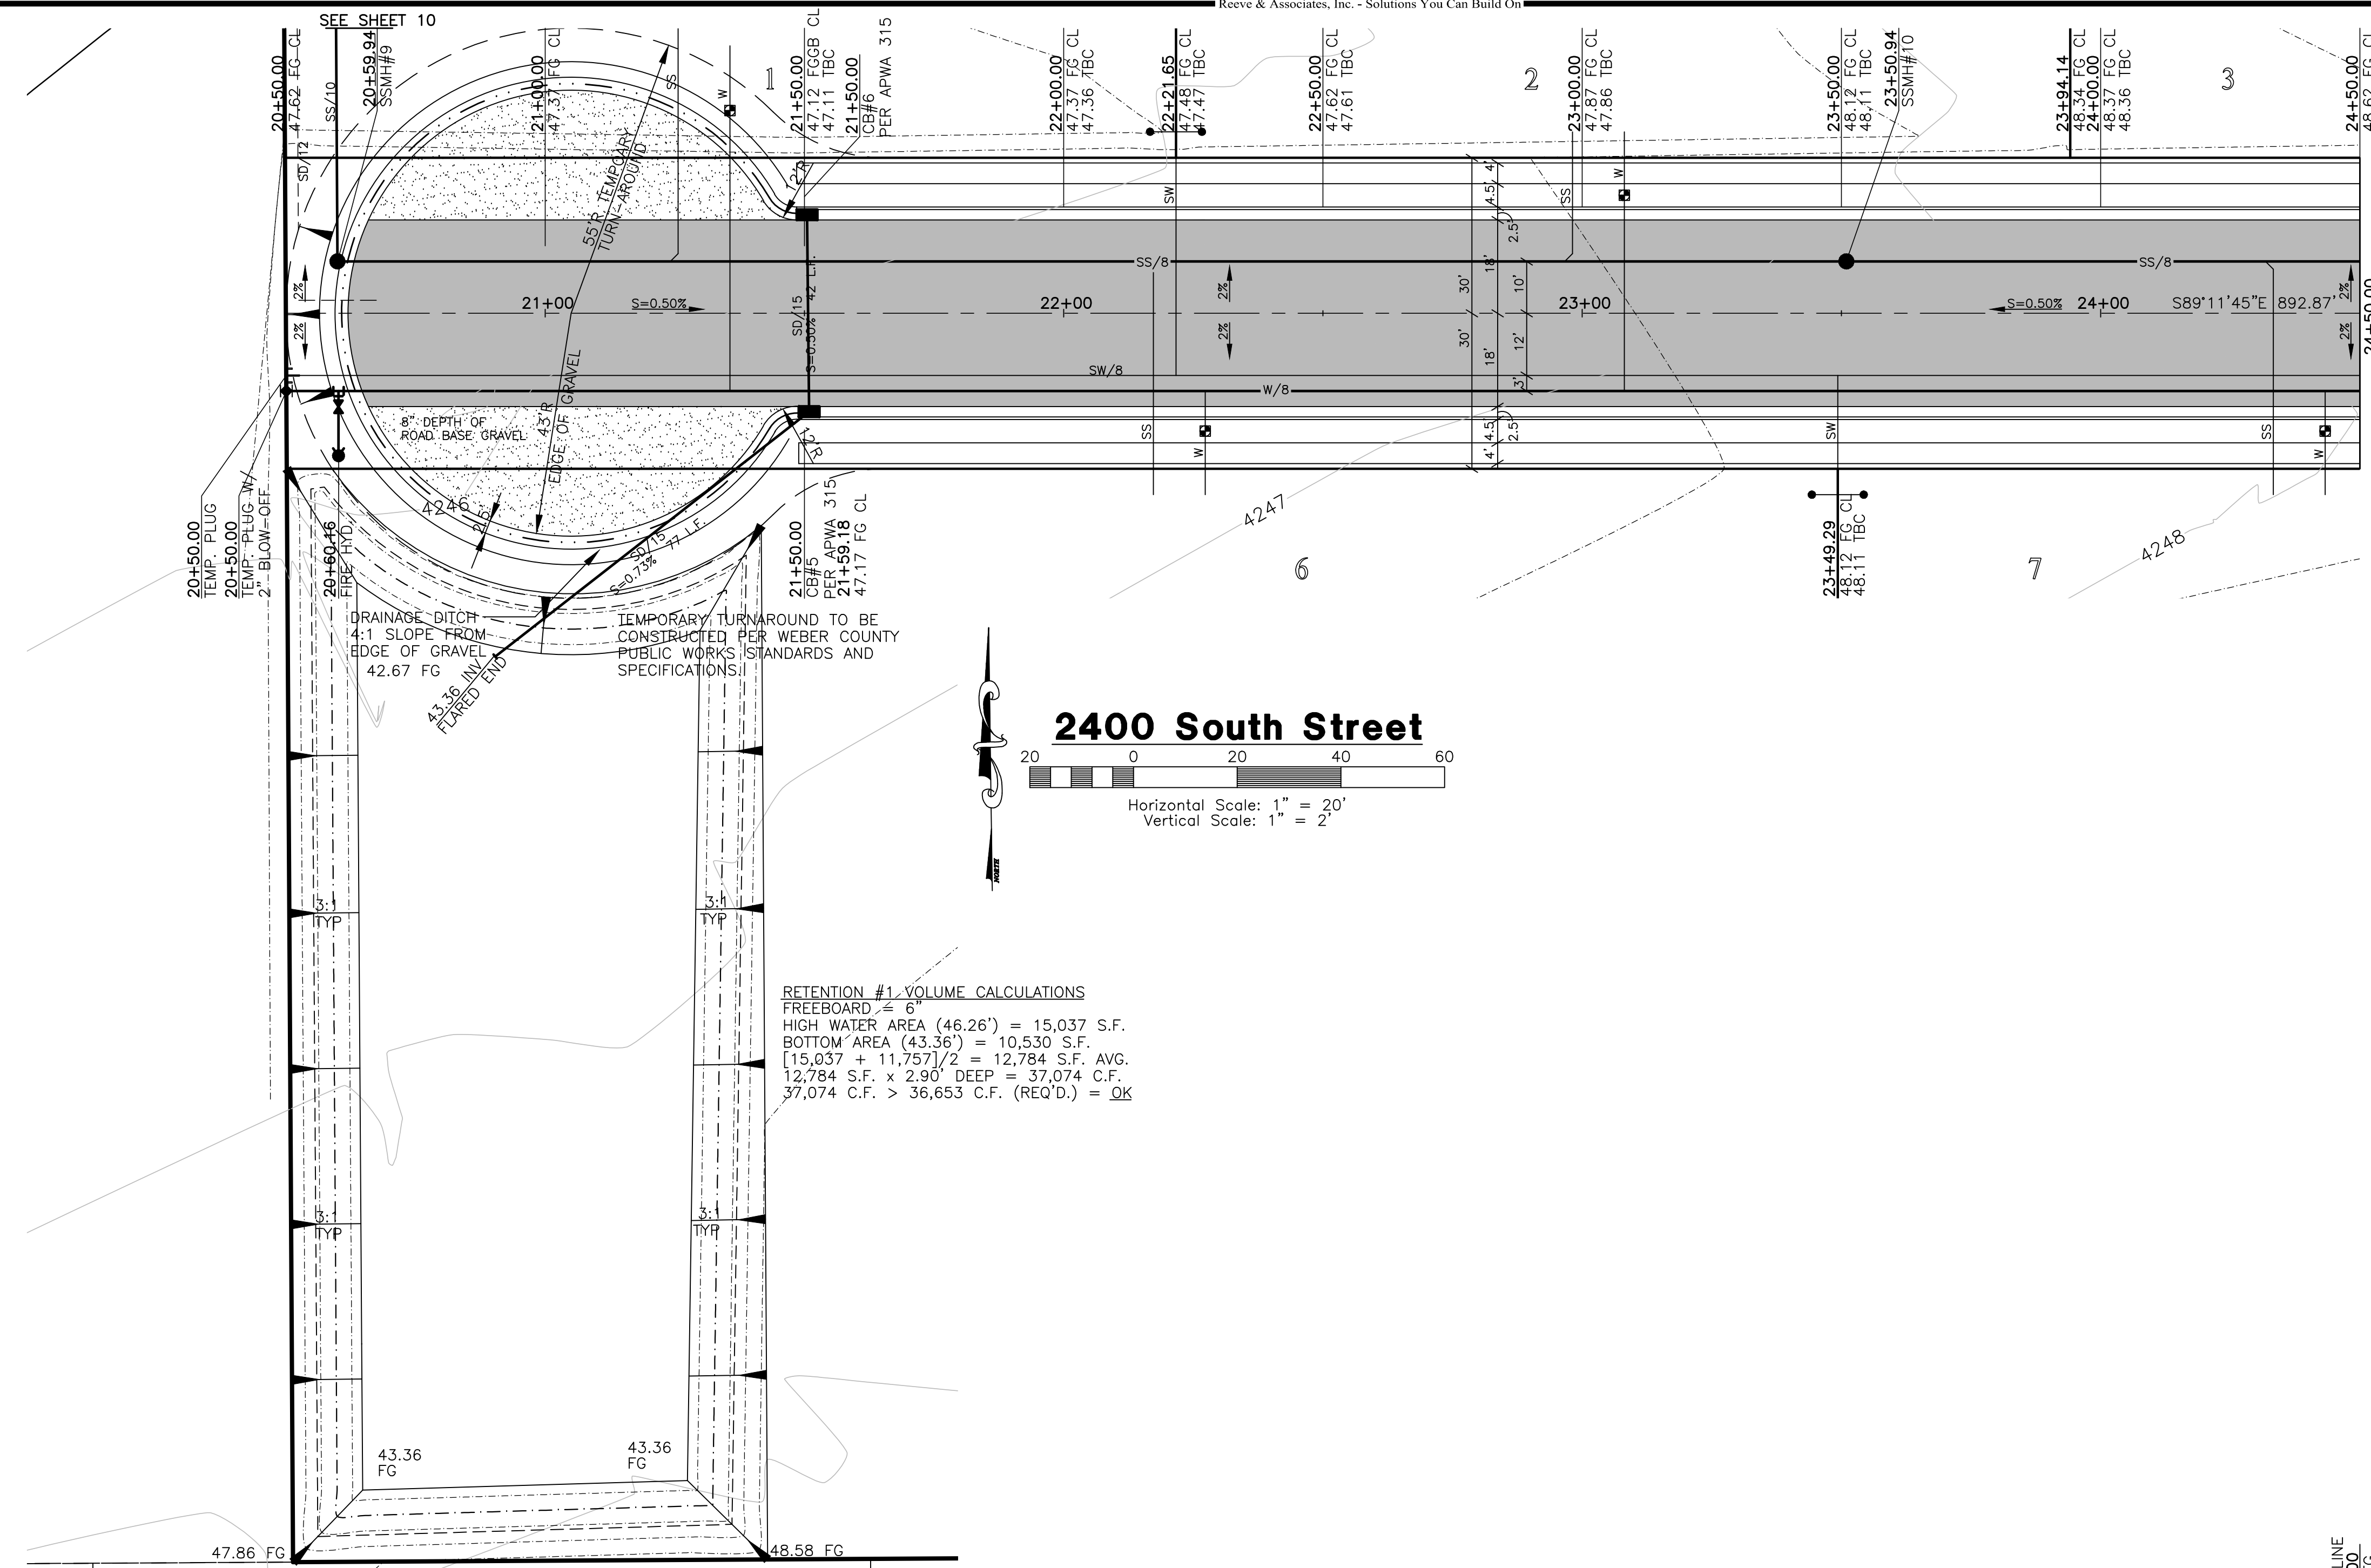

RETENTION #1 VOLUME CALCULATIONS
 FREEBOARD = 6"
 HIGH WATER AREA (46.26') = 15,037 S.F.
 BOTTOM AREA (43.36') = 10,530 S.F.
 [(15,037 + 11,757)/2] = 12,784 S.F. AVG.
 12,784 S.F. x 2.90' DEEP = 37,074 C.F.
 37,074 C.F. > 36,653 C.F. (REQ'D.) = OK

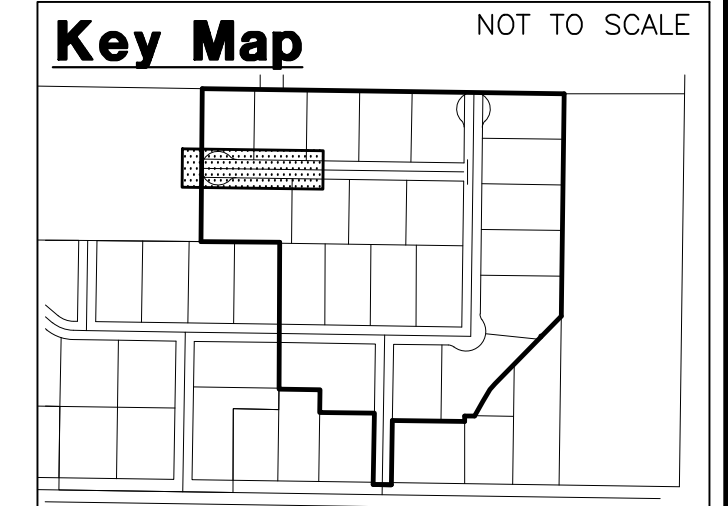

Construction Notes:

- ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
 - CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.
- CULINARY WATER**
 W/8 - 8" PVC C-900 CLASS 200 WATER
- SANITARY SEWER**
 SS/8 - 8" ASTM D3034 SDR 35 SEWER
 SS/10 - 10" ASTM D3034 SDR 35 SEWER
- DUE TO THE SHALLOWNESS OF THE SEWER LINE THROUGH ADJACENT FIELD, CLASS I OR CLASS II PIPE EMBEDMENT (PER ASTM D2487) INSTALLED PER ASTM D 2321 WITH 95% MODIFIED PROCTOR.
- STORM DRAIN**
 SD/15 - 15" RCP STORM DRAIN
- SECONDARY WATER**
 SW/8 - 8" PVC C-900 SECONDARY WATER LINE

Storm Runoff Calculations
 Mallard Springs Subdivision-Basin 1
 9/22/2014 ser

The following runoff calculations are based on the Rainfall - Intensity - Duration Frequency Curve for the West Haven, UT area taken from data compiled by NOAA Atlas 14, using a 100 year storm.

Runoff storm water has been calculated for two different sets of conditions, one being the existing undeveloped land and the other with land fully improved. The difference between the two quantities will be retained in a holding pond

The calculations are as follows:

1. Runoff from the undeveloped existing land.	Q =	0 cfs
Runoff Quantity	A =	9.21 ACRES
Acreage		27.00 mpi
Perc Rate		
Q(out) = 0.00 CFS		
2. Runoff from developed land		
Runoff Coefficients		
Paved Area	61,900	C = 0.9
Landscaped Area	298,625	C = 0.2
Roof	40,500	C = 0.8
Weighted Runoff Coefficient		C = 0.37
Rainfall Intensity	i =	varies with time
Runoff Quantity	Q =	CIA
3. Detention Basin		
Volume in	Q * t	
Volume out	0.00 * t	

The capacity of the retention basin is calculated as the maximum difference between the volume flowing in and the volume flowing out.

The outflow from the retention basin is limited to outflow if undeveloped. Use 0.00 cfs for Q outflow


The required volume of the Retention basin is 36,653 cubic feet

RETENTION BASIN
 Cumulative Volume For Detention Pond
 Mallard Springs Subdivision-Basin 1

C = 0.37
 A = 9.21
 Q(out) = 0.00

time (min)	time (sec)	i (in./hr.)	Q (cfs)	Vol. in (cf)	Vol. out (cf)	Difference (cf)
0	0	0.00	0.00	0.00	0.00	0.00
5	300	6.64	22.53	6760.50	0.00	6760.50
10	600	5.05	17.14	10283.29	0.00	10283.29
15	900	4.17	14.15	12737.02	0.00	12737.02
30	1800	2.81	9.54	17165.96	0.00	17165.96
60	3600	1.74	5.91	21258.92	0.00	21258.92
180	10800	0.65	2.21	23861.30	0.00	23861.30
360	21600	0.36	1.23	26610.30	0.00	26610.30
720	43200	0.22	0.76	32694.75	0.00	32694.75
1440	86400	0.13	0.42	36653.31	0.00	36653.31

West Haven UT
 NOAA Atlas 14

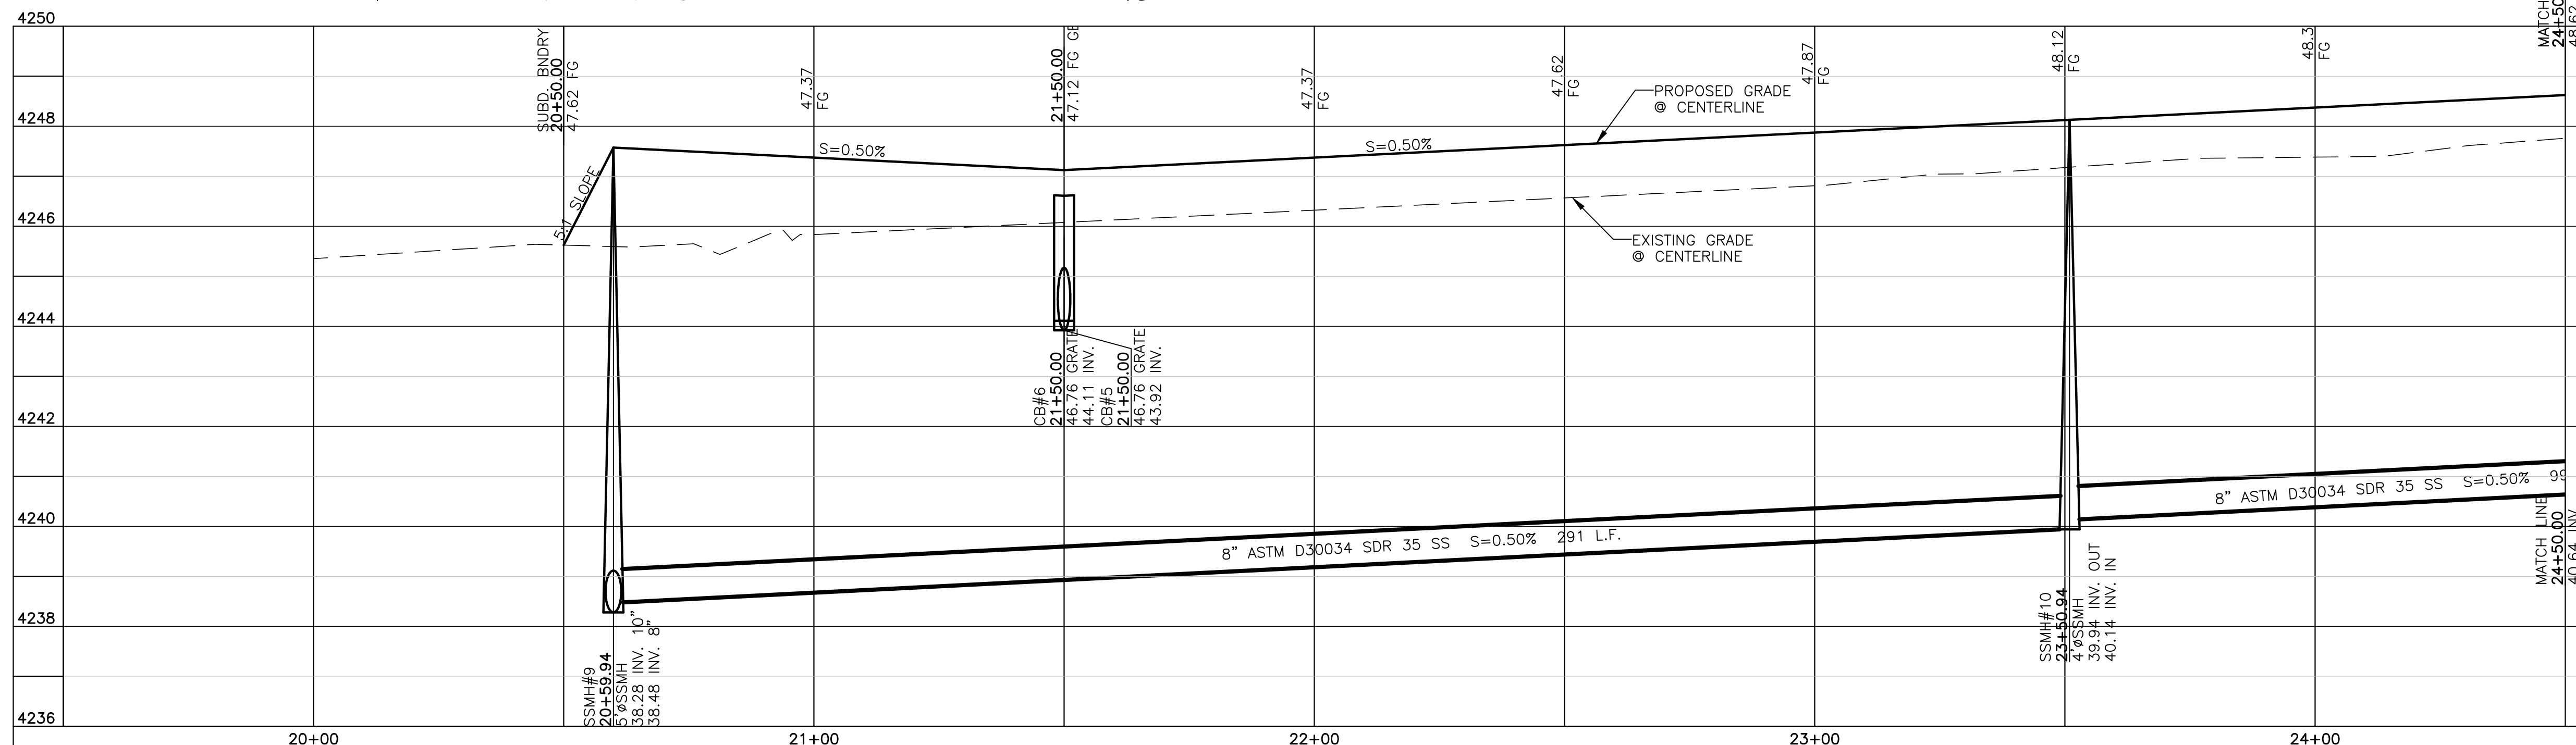


Blue Stakes Location Center
Call: Toll Free
1-800-662-4111
 Two Working Days Before You Dig

Reeve & Associates, Inc.
 920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403
 TEL: (801) 621-2100 FAX: (801) 621-2666 www.reeve-assoc.com
 LAND PLANNERS • CIVIL ENGINEERS • LAND SURVEYORS
 TRAFFIC ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS



REVISIONS	DATE	DESCRIPTION
5-2-14	Rh	County Comments
9-4-14	ST	County Comments
9-30-14	ST	County Comments
10-9-14	ST	County Comments

Mallard Springs Subdivision
 WEBER COUNTY, UTAH


2400 South Street
20+00.00 - 24+50.00

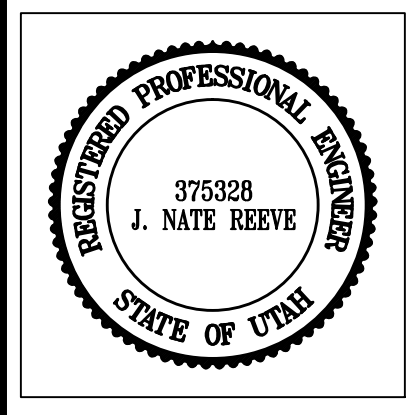

Project Info.
 Engineer: J. NATE REEVE, P.E.
 Drafter: R. HANSEN
 Begin Date: NOVEMBER 4, 2013
 Name: MALLARD SPRINGS SUBDIVISION
 Number: 3442-A30

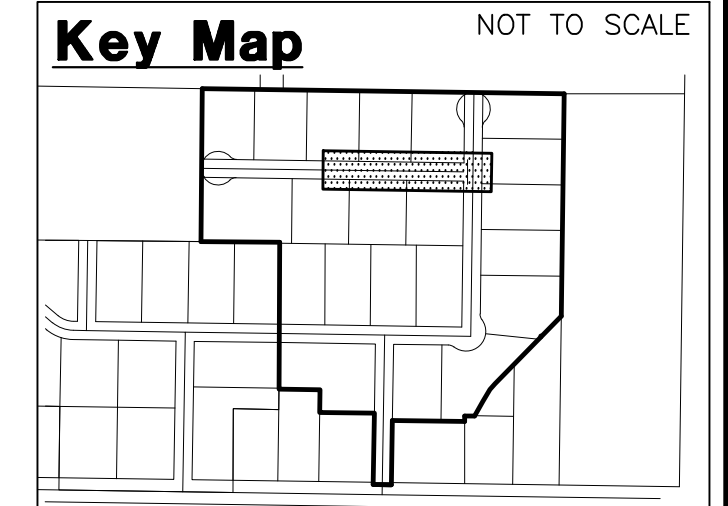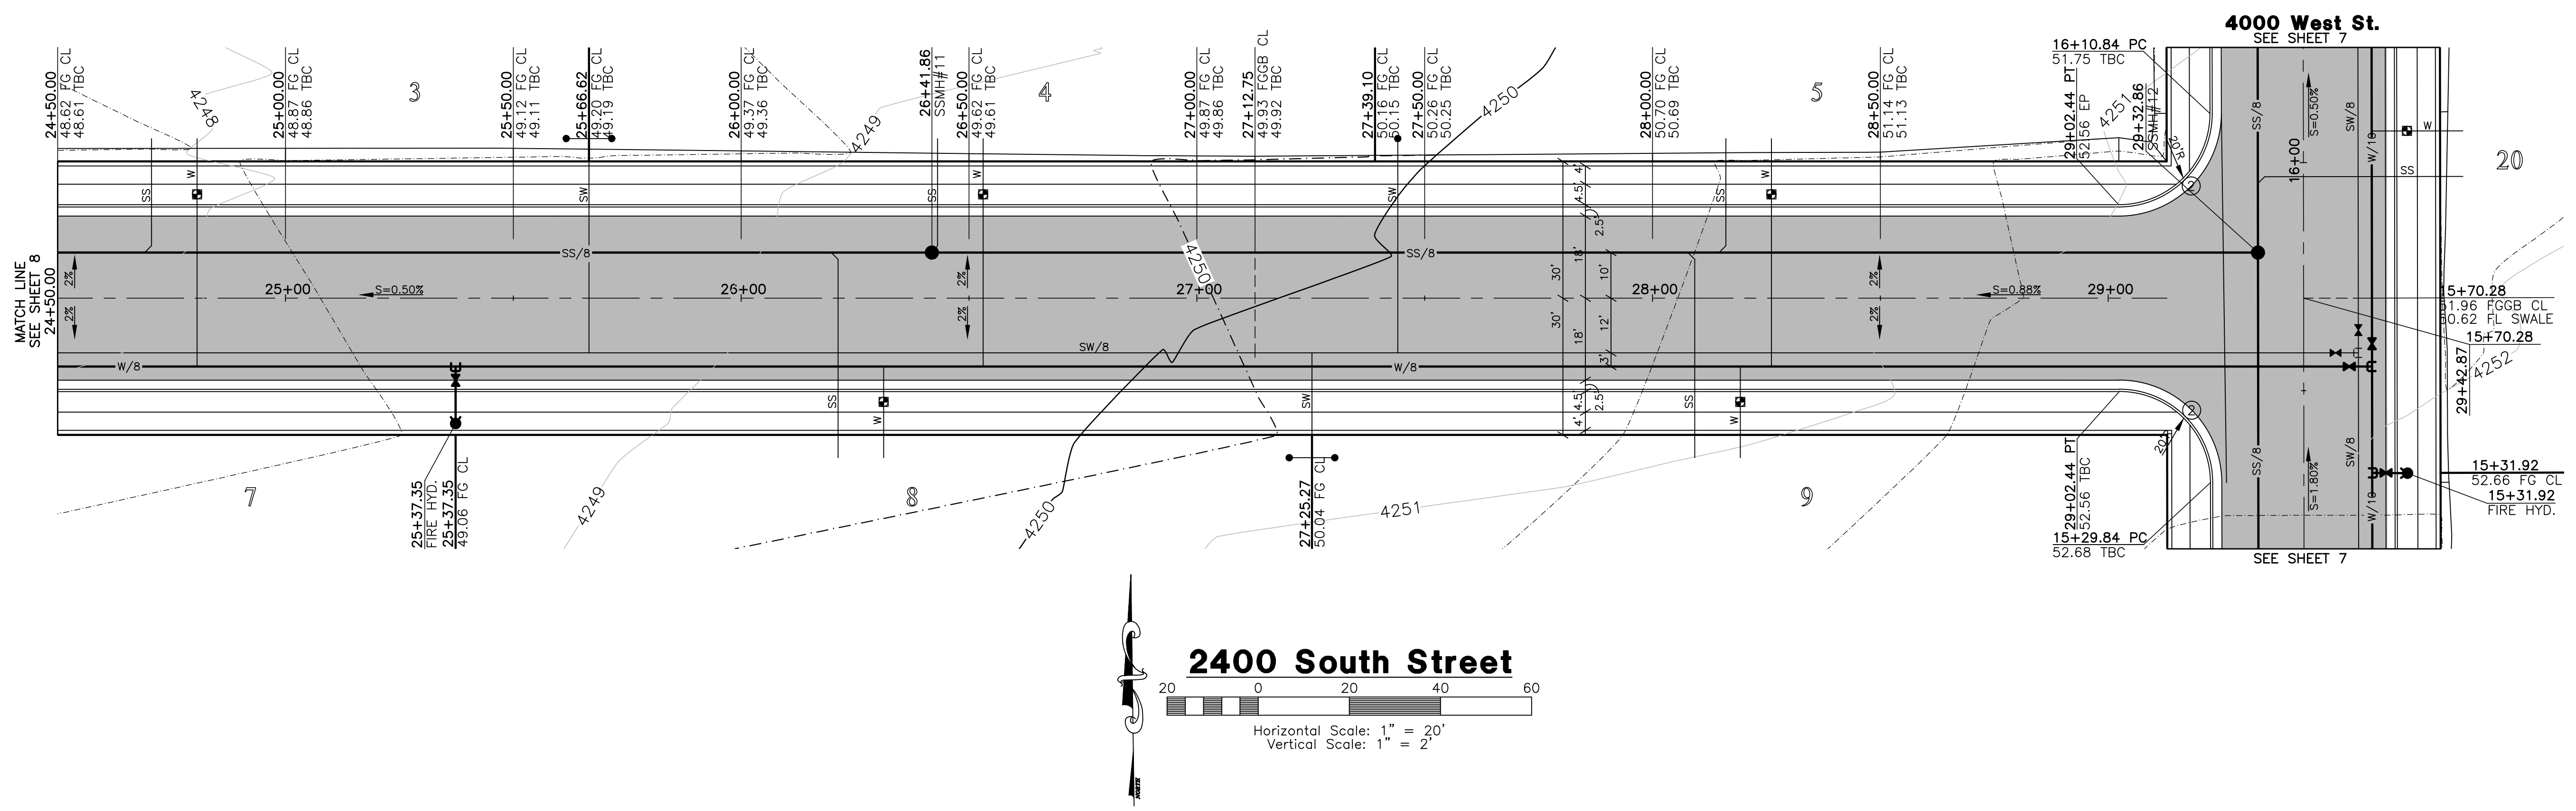

- Construction Notes:**
- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
 - 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.
- CULINARY WATER**
W/8 - 8" PVC C-900 CLASS 200 WATER
- SANITARY SEWER**
SS/8 - 8" ASTM D3034 SDR 35 SEWER
SS/10 - 10" ASTM D3034 SDR 35 SEWER
- DUE TO THE SHALLOWNESS OF THE SEWER LINE THROUGH ADJACENT FIELD, CLASS I OR CLASS II PIPE EMBEDMENT (PER ASTM D2487) INSTALLED PER ASTM D 2321 WITH 95% MODIFIED PROCTOR.
- STORM DRAIN**
SD/15 - 15" RCP STORM DRAIN
- SECONDARY WATER**
SW/8 - 8" PVC C-900 SECONDARY WATER LINE

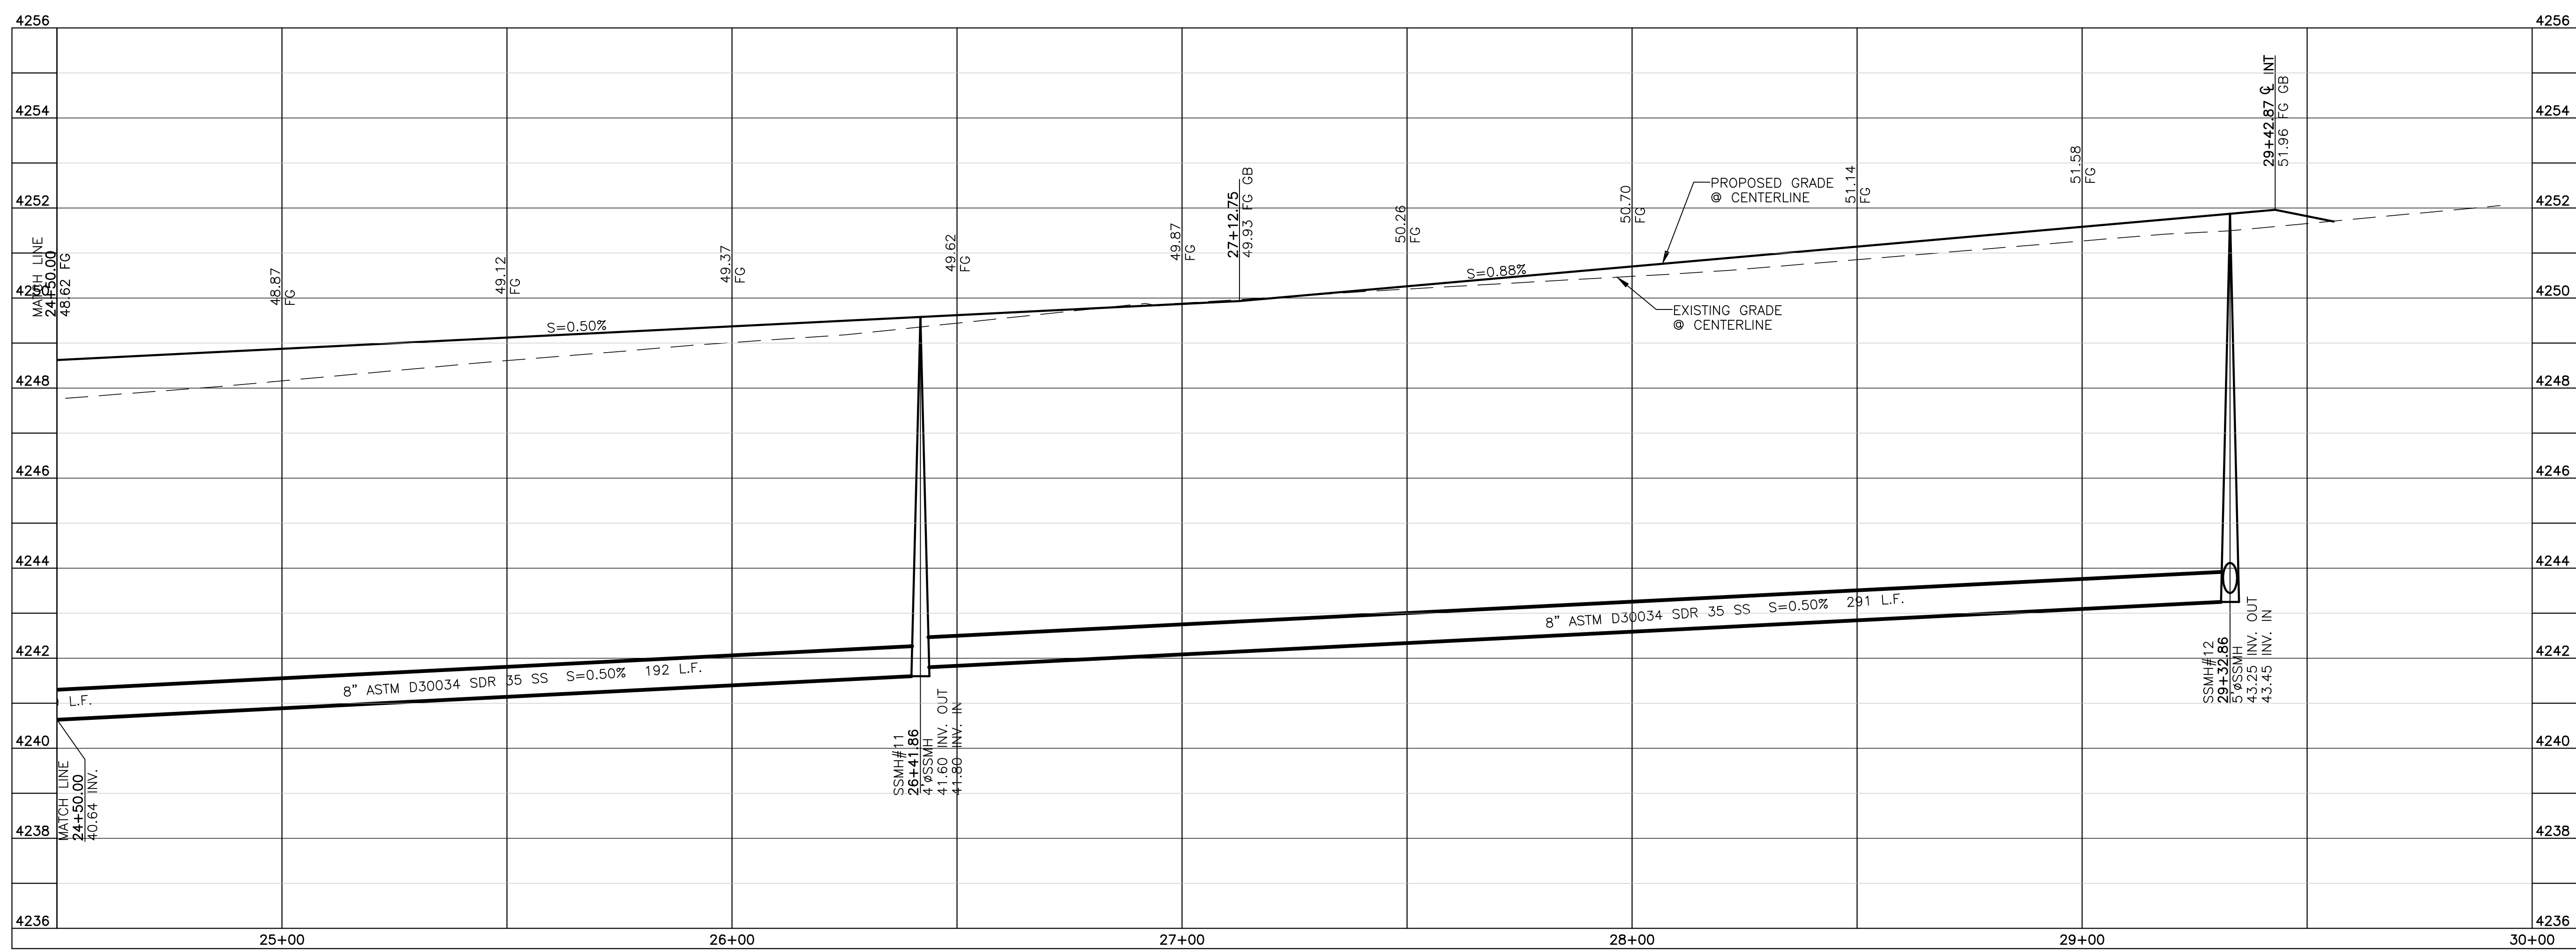


Reeve & Associates, Inc.
920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403
TEL: (801) 921-3100 FAX: (801) 621-2666 www.reeve-assoc.com

IRA
LAND PLANNERS • CIVIL ENGINEERS • LAND SURVEYORS
TRAFFIC ENGINEERS • LANDSCAPE ARCHITECTS

REVISIONS	DATE	DESCRIPTION
5-2-14	Rh	County Comments
9-4-14	ST	County Comments
9-30-14	ST	County Comments
10-9-14	ST	County Comments


Mallard Springs Subdivision
WEBER COUNTY, UTAH

2400 South Street
24+50.00 - 30+00.00

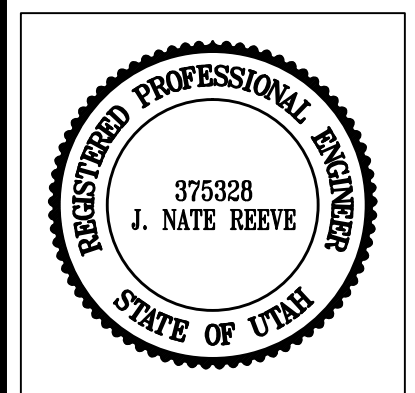




Project Info.
Engineer: J. NATE REEVE, P.E.
Drafted: R. HANSEN
Begin Date: NOVEMBER 4, 2013
Name: MALLARD SPRINGS SUBDIVISION
Number: 3442-A30

Blue Stakes Location Center
Call: Toll Free 1-800-662-4111
Two Working Days Before You Dig

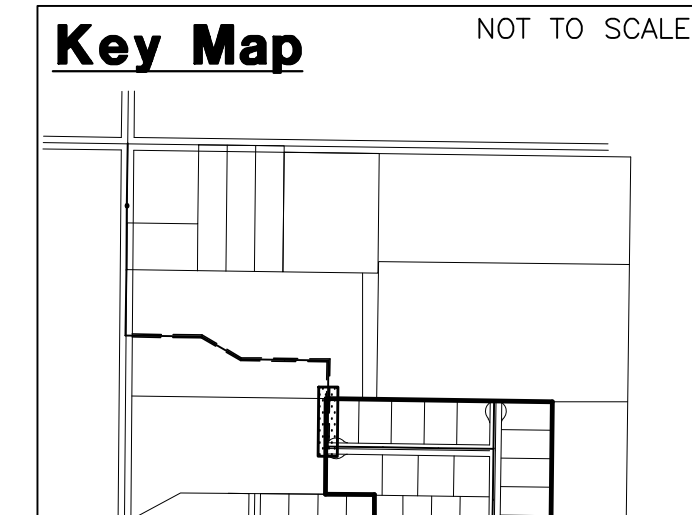


Construction Notes:

- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
 - 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.
- CULINARY WATER**
W/8 - 8" PVC C-900 CLASS 200 WATER
- SANITARY SEWER**
SS/8 - 8" ASTM D3034 SDR 35 SEWER
SS/10 - 10" ASTM D3034 SDR 35 SEWER
- DUE TO THE SHALLOWNESS OF THE SEWER LINE THROUGH ADJACENT FIELD, CLASS I OR CLASS II PIPE EMBEDMENT (PER ASTM D2487) INSTALLED PER ASTM D 2321 WITH 95% MODIFIED PROCTOR.
- STORM DRAIN**
SD/15 - 15" RCP STORM DRAIN
- SECONDARY WATER**
SW/8 - 8" PVC C-900 SECONDARY WATER LINE

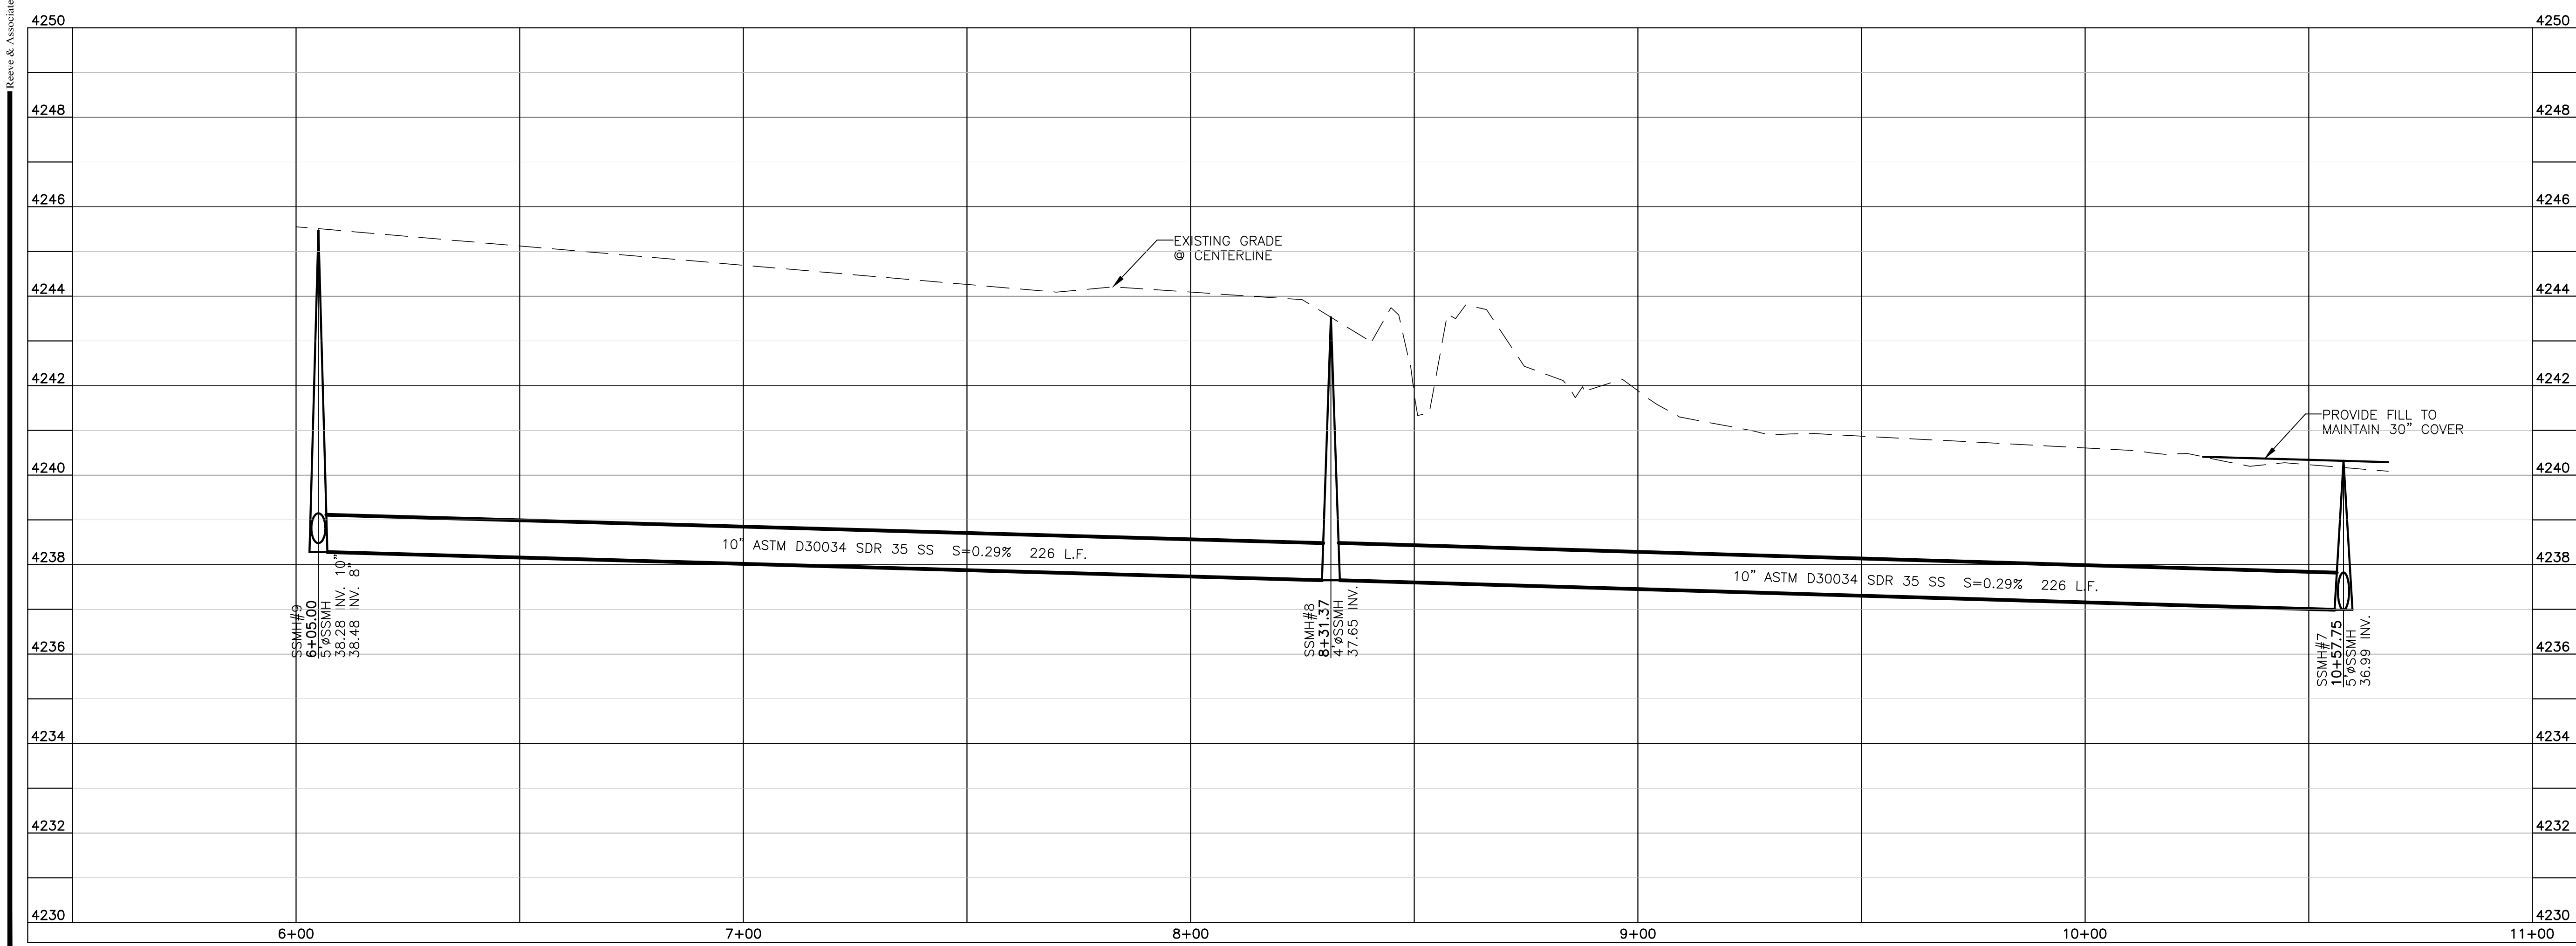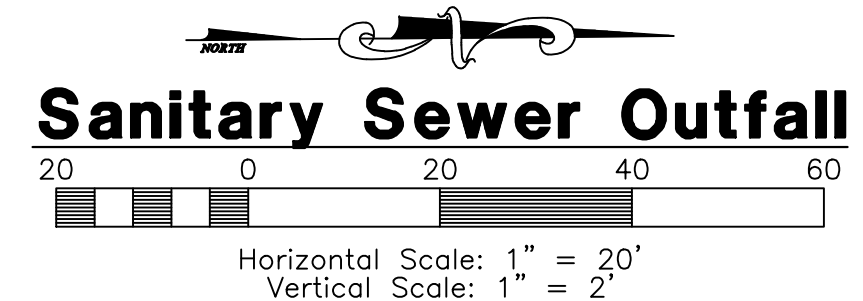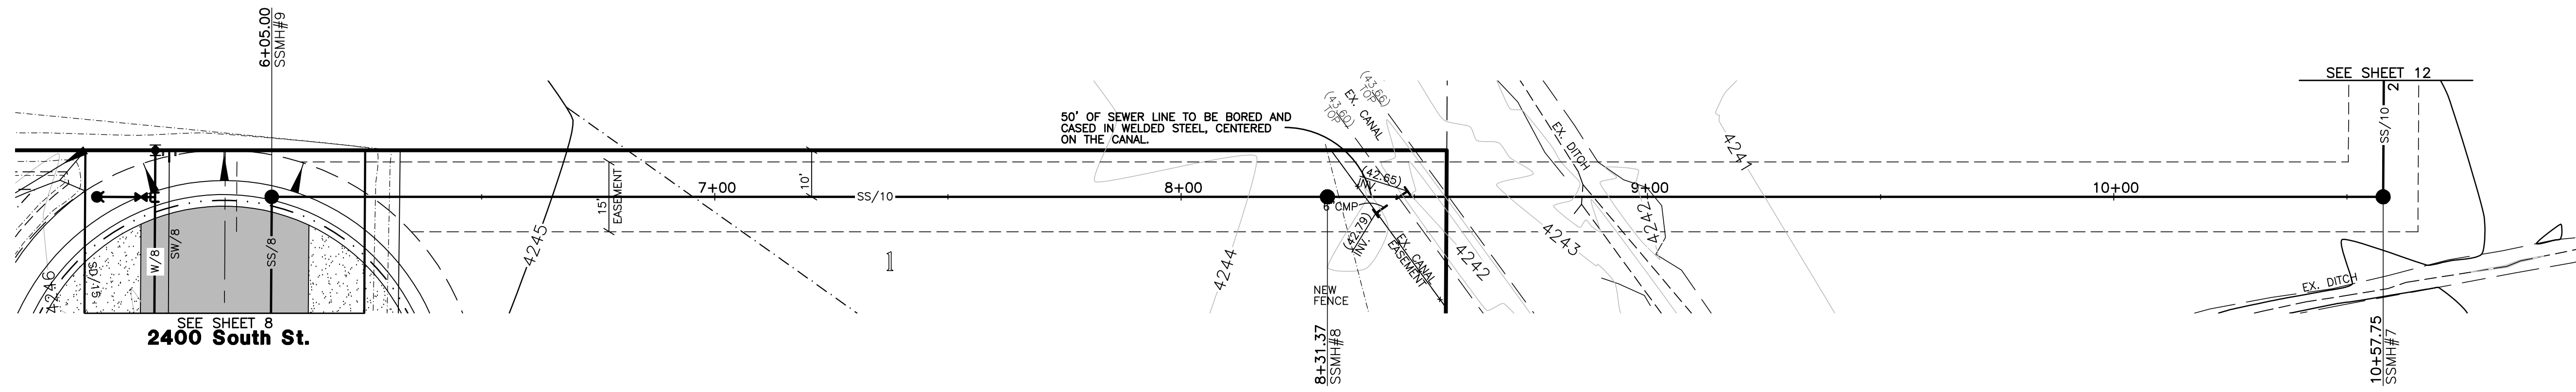

Blue Stakes Location Center
Call: Toll Free
1-800-662-4111
Two Working Days Before You Dig


Reeve & Associates, Inc.
920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403
TEL: (801) 621-2100 FAX: (801) 621-2666 www.reeve-assoc.com
LAND PLANNERS • CIVIL ENGINEERS • LAND SURVEYORS
TRAFFIC ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

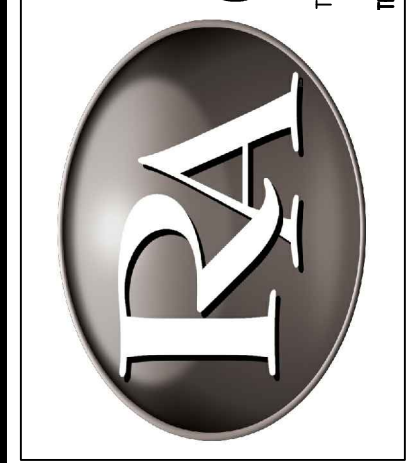

REVISIONS	DATE	DESCRIPTION
5-2-14	Rh	County Comments
9-4-14	ST	County Comments
9-30-14	ST	County Comments
10-9-14	ST	County Comments


Mallard Springs
Subdivision
WEBER COUNTY, UTAH
Sanitary Sewer Outfall
5+50.00 - 11+00.00

Revised: 10-9-14

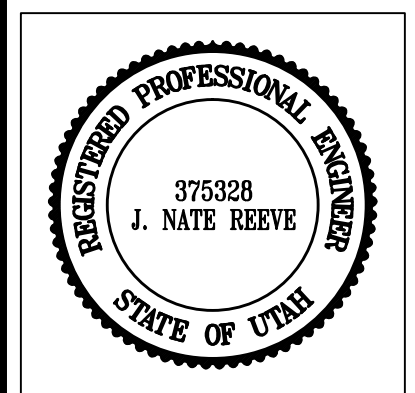

Project Info.
Engineer:
J. NATE REEVE, P.E.
Drafted:
R. HANSEN
Begin Date:
NOVEMBER 4, 2013
Name:
MALLARD SPRINGS
SUBDIVISION
Number: 3442-A30


Sheet **17**
10 Sheets

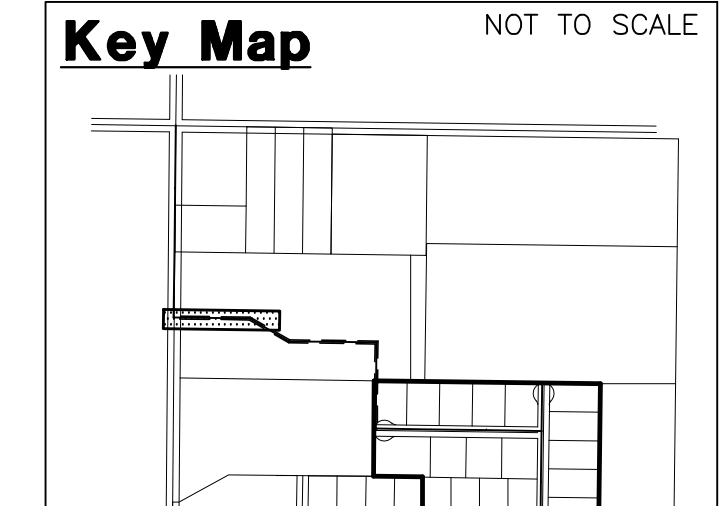

Construction Notes:



- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
 - 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.
- CULINARY WATER**
W/8 - 8" PVC C-900 CLASS 200 WATER
- SANITARY SEWER**
SS/8 - 8" ASTM D3034 SDR 35 SEWER
SS/10 - 10" ASTM D3034 SDR 35 SEWER
- DUE TO THE SHALLOWNESS OF THE SEWER LINE THROUGH ADJACENT FIELD, CLASS I OR CLASS II PIPE EMBEDMENT (PER ASTM D2487) INSTALLED PER ASTM D 2321 WITH 95% MODIFIED PROCTOR.
- STORM DRAIN**
SD/15 - 15" RCP STORM DRAIN
- SECONDARY WATER**
SW/8 - 8" PVC C-900 SECONDARY WATER LINE

Reeve & Associates, Inc.
920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403
LAND PLANNERS • CIVIL ENGINEERS • LAND SURVEYORS
TRAFFIC ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS


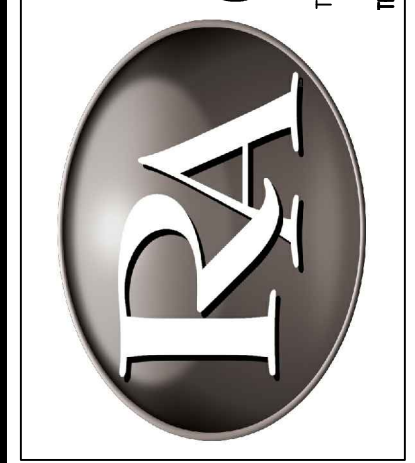


REVISIONS	DATE	DESCRIPTION
5-2-14	Rh	County Comments
9-4-14	ST	County Comments
9-30-14	ST	County Comments
10-9-14	ST	County Comments

4300 West St.
SEE SHEET 13

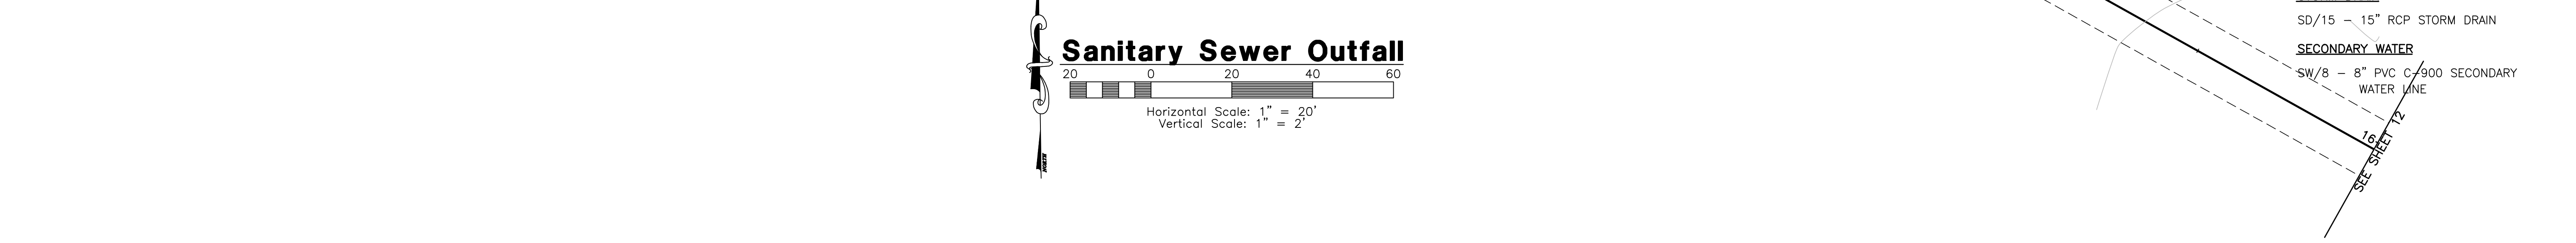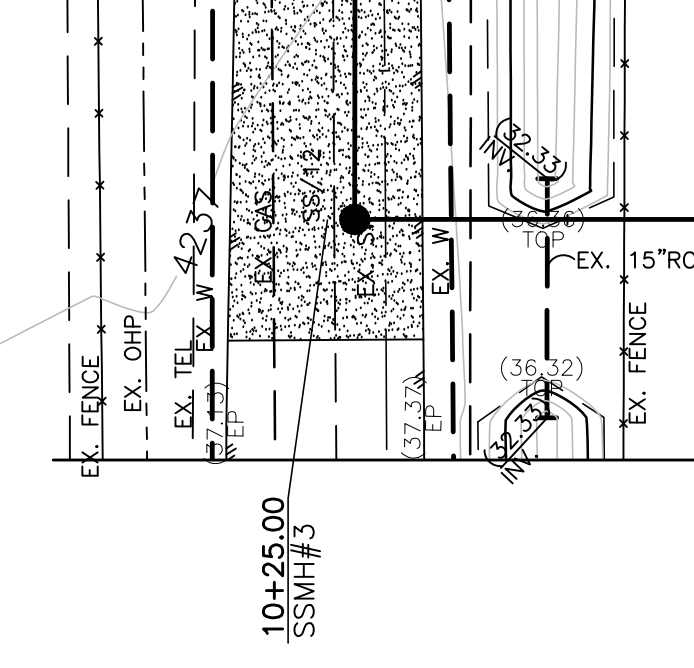

Sanitary Sewer Outfall

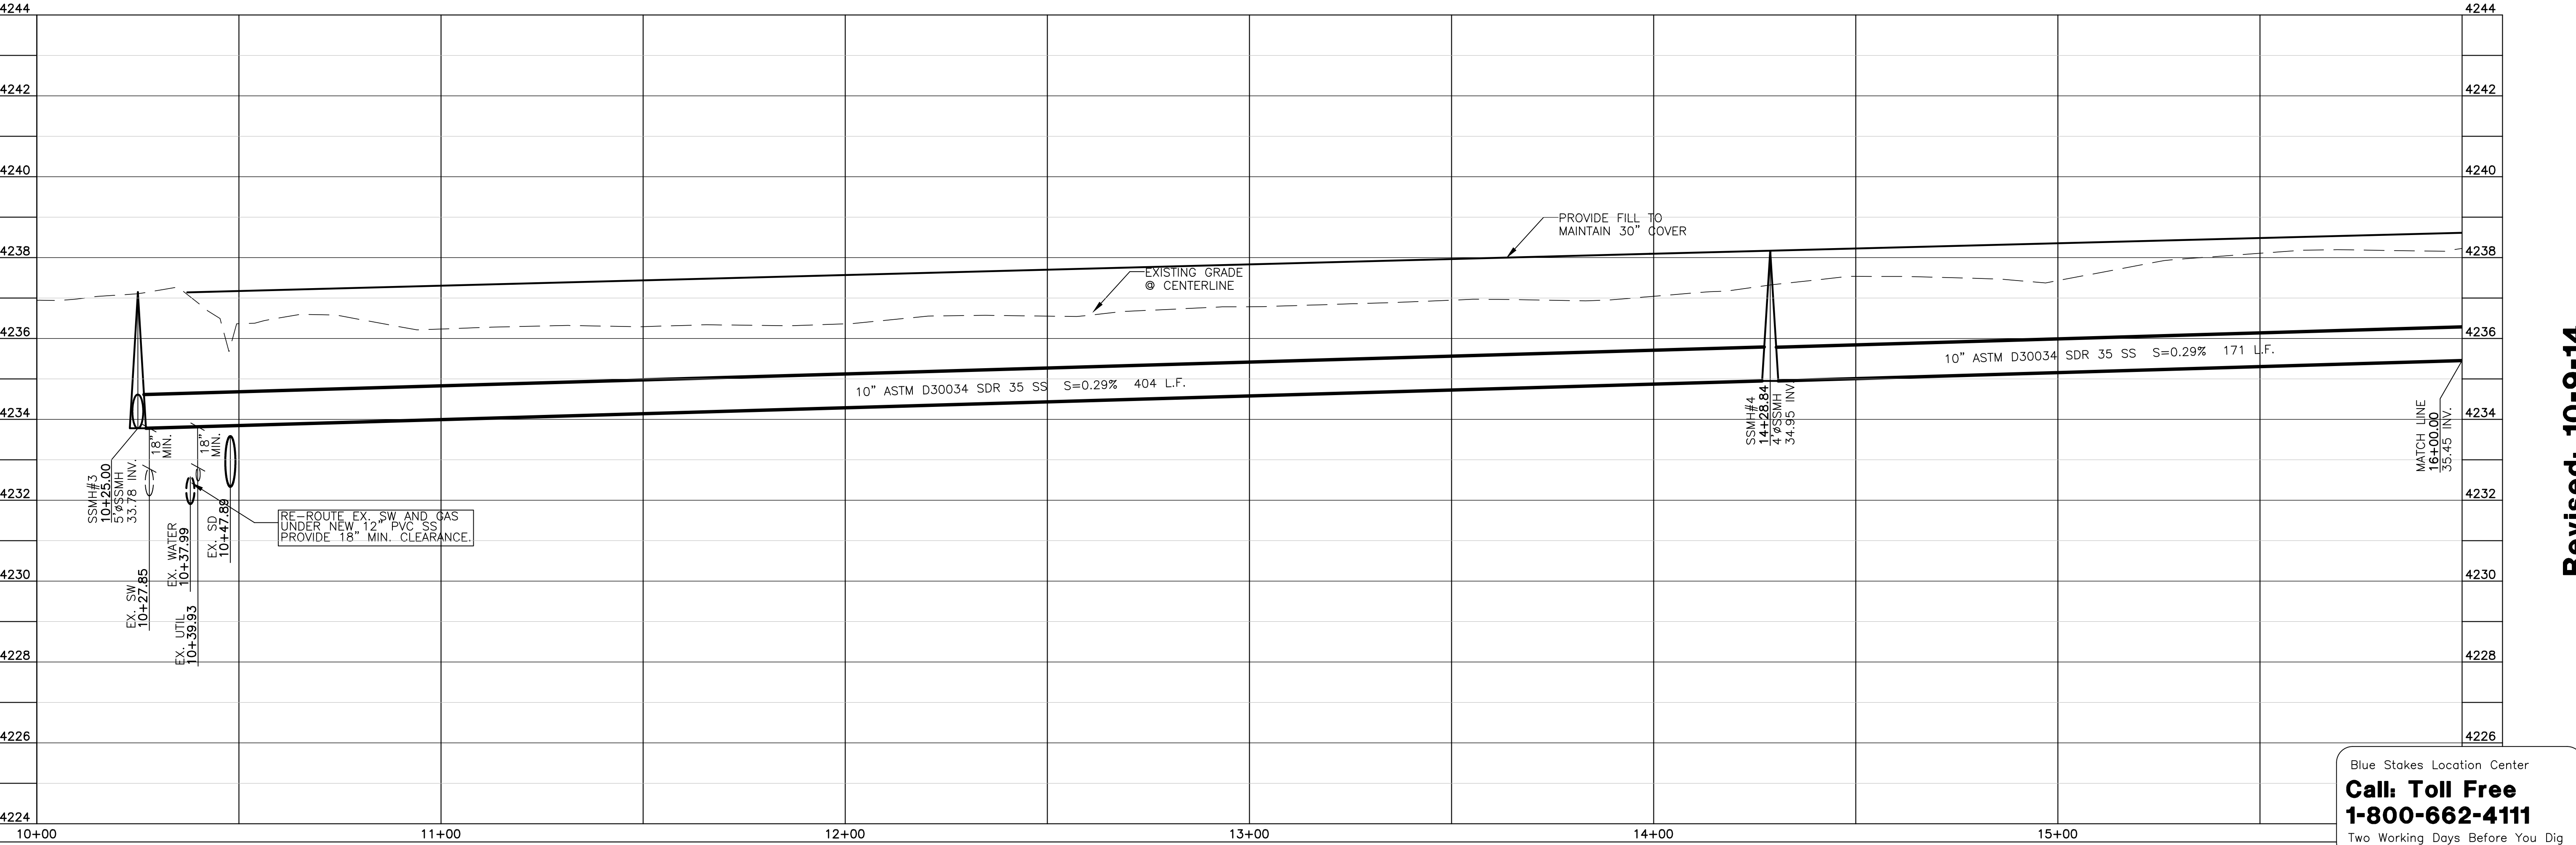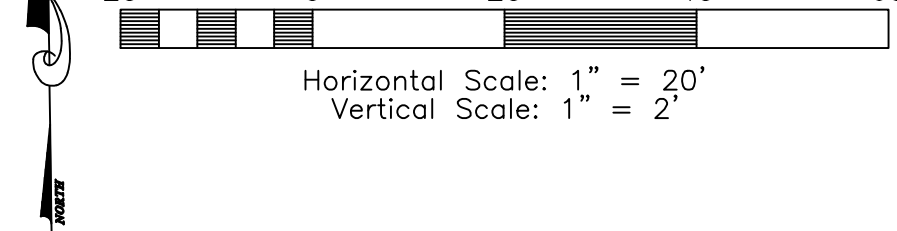

Mallard Springs Subdivision
WEBER COUNTY, UTAH
Sanitary Sewer Outfall
10+00.00 - 16+00.00

Revised: 10-9-14




Project Info.

Engineer: J. NATE REEVE, P.E.
 Drafter: R. HANSEN
 Begin Date: NOVEMBER 4, 2013
 Name: MALLARD SPRINGS SUBDIVISION
 Number: 3442-A30

Blue Stakes Location Center
Call: Toll Free 1-800-662-4111
Two Working Days Before You Dig

Key Map NOT TO SCALE

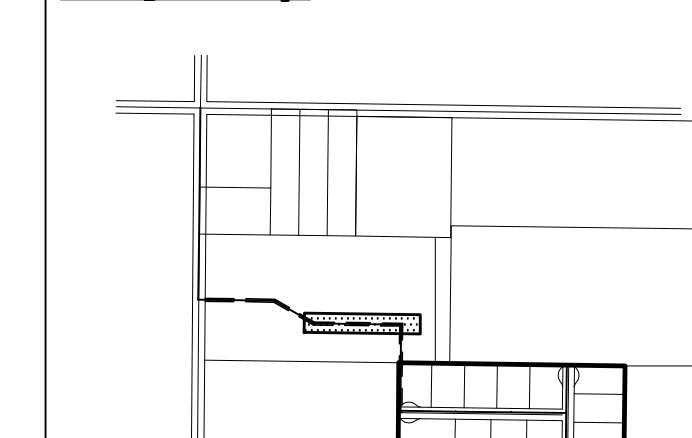

Construction Notes:

1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.

2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.

CULINARY WATER
W/8 - 8" PVC C-900 CLASS 200 WATER

SANITARY SEWER
SS/8 - 8" ASTM D3034 SDR 35 SEWER
SS/10 - 10" ASTM D3034 SDR 35 SEWER




DUE TO THE SHALLOWNESS OF THE SEWER LINE THROUGH ADJACENT FIELD, CLASS I OR CLASS II PIPE EMBEDMENT (PER ASTM D2487) INSTALLED PER ASTM D 2321 WITH 95% MODIFIED PROCTOR.

STORM DRAIN
SD/15 - 15" RCP STORM DRAIN

SECONDARY WATER
SW/8 - 8" PVC C-900 SECONDARY WATER LINE

Reeve & Associates, Inc.
920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403
TEL: (801) 621-2100 FAX: (801) 621-2666 WWW.REEVE-ASSOC.COM
LAND PLANNERS • CIVIL ENGINEERS • LAND SURVEYORS
TRA
TRAFFIC ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

REVISIONS	DATE	DESCRIPTION
5-2-14	Rh	County Comments
9-4-14	ST	County Comments
9-30-14	ST	County Comments
10-9-14	ST	County Comments

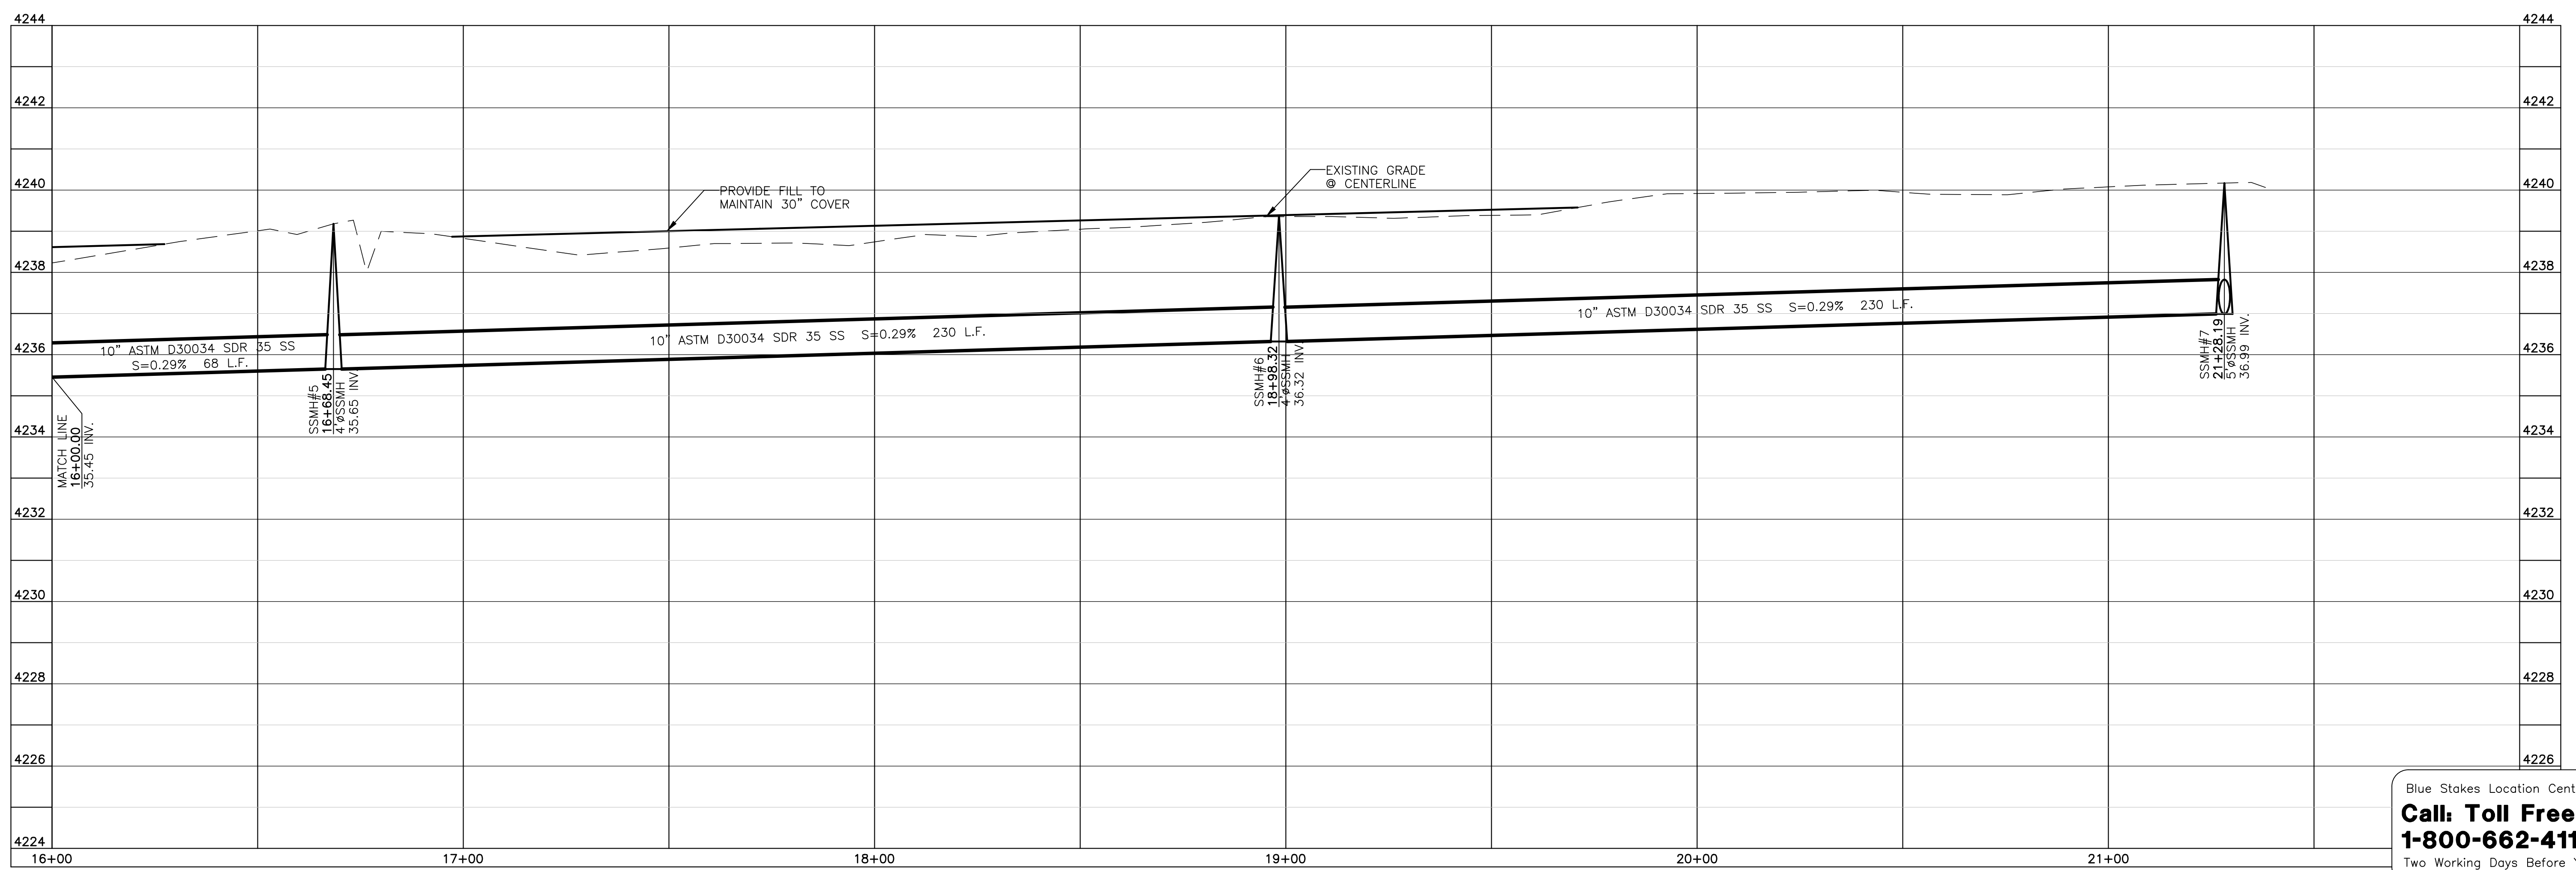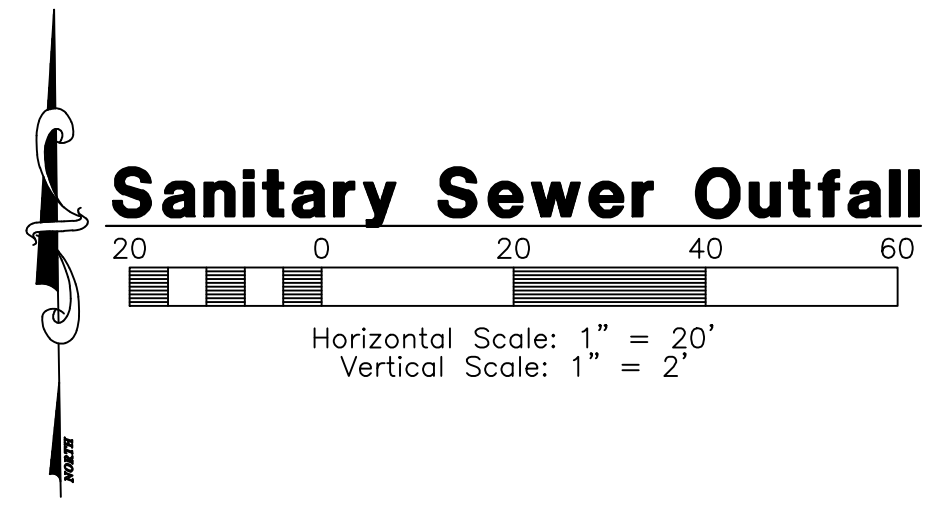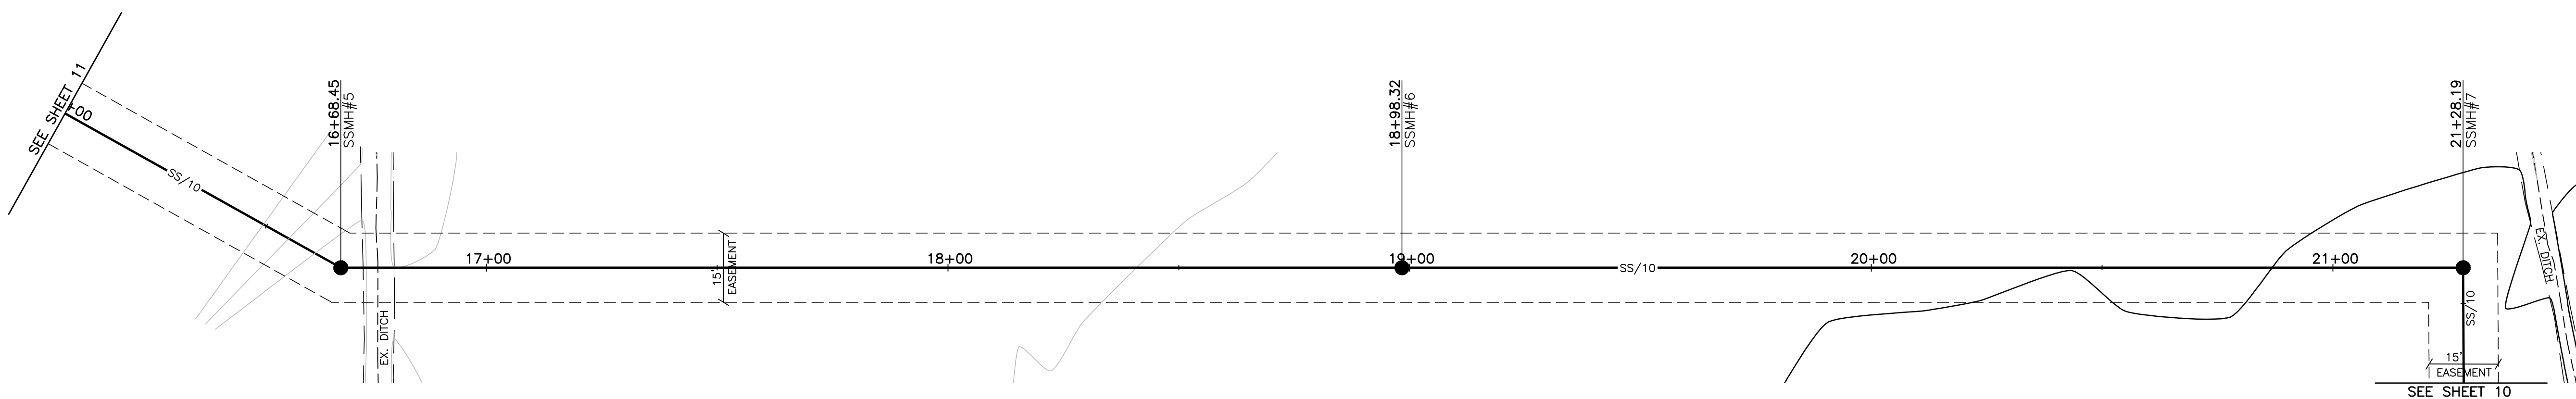


Revised: 10-9-14



Project Info.

Engineer: J. NATE REEVE, P.E.
 Drafter: R. HANSEN
 Begin Date: NOVEMBER 4, 2013
 Name: MALLARD SPRINGS SUBDIVISION
 Number: 3442-A30




Blue Stakes Location Center
Call: Toll Free 1-800-662-4111
 Two Working Days Before You Dig

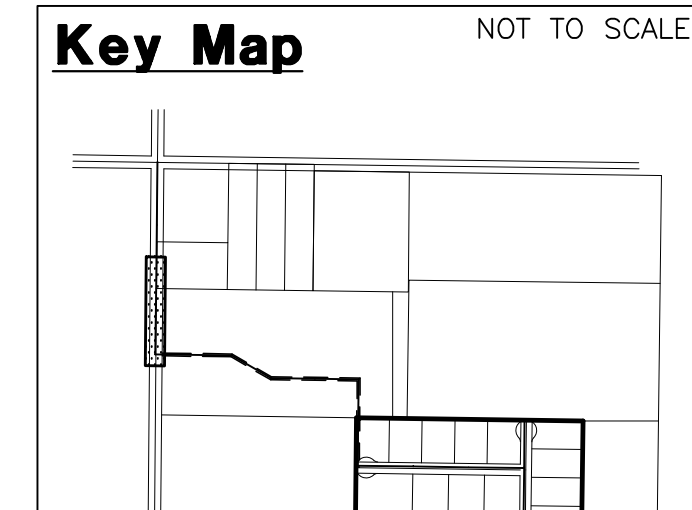

Reeve & Associates, Inc.
 920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403
 TEL: (801) 621-2100 FAX: (801) 621-2666 WWW: REEVE-ASSOC.COM
 LAND PLANNERS • CIVIL ENGINEERS • LAND SURVEYORS
 TRAFFIC ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS


- Construction Notes:**
- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
 - 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.
- CULINARY WATER**
 W/8 - 8" PVC C-900 CLASS 200 WATER
- SANITARY SEWER**
 SS/8 - 8" ASTM D3034 SDR 35 SEWER
 SS/10 - 10" ASTM D3034 SDR 35 SEWER
- DUE TO THE SHALLOWNESS OF THE SEWER LINE THROUGH ADJACENT FIELD, CLASS I OR CLASS II PIPE EMBEDMENT (PER ASTM D2487) INSTALLED PER ASTM D 2321 WITH 95% MODIFIED PROCTOR.
- STORM DRAIN**
 SD/15 - 15" RCP STORM DRAIN
- SECONDARY WATER**
 SW/8 - 8" PVC C-900 SECONDARY WATER LINE

DATE	REVISIONS	DESCRIPTION
5-2-14	Rh	County Comments
9-4-14	ST	County Comments
9-30-14	ST	County Comments
10-9-14	ST	County Comments

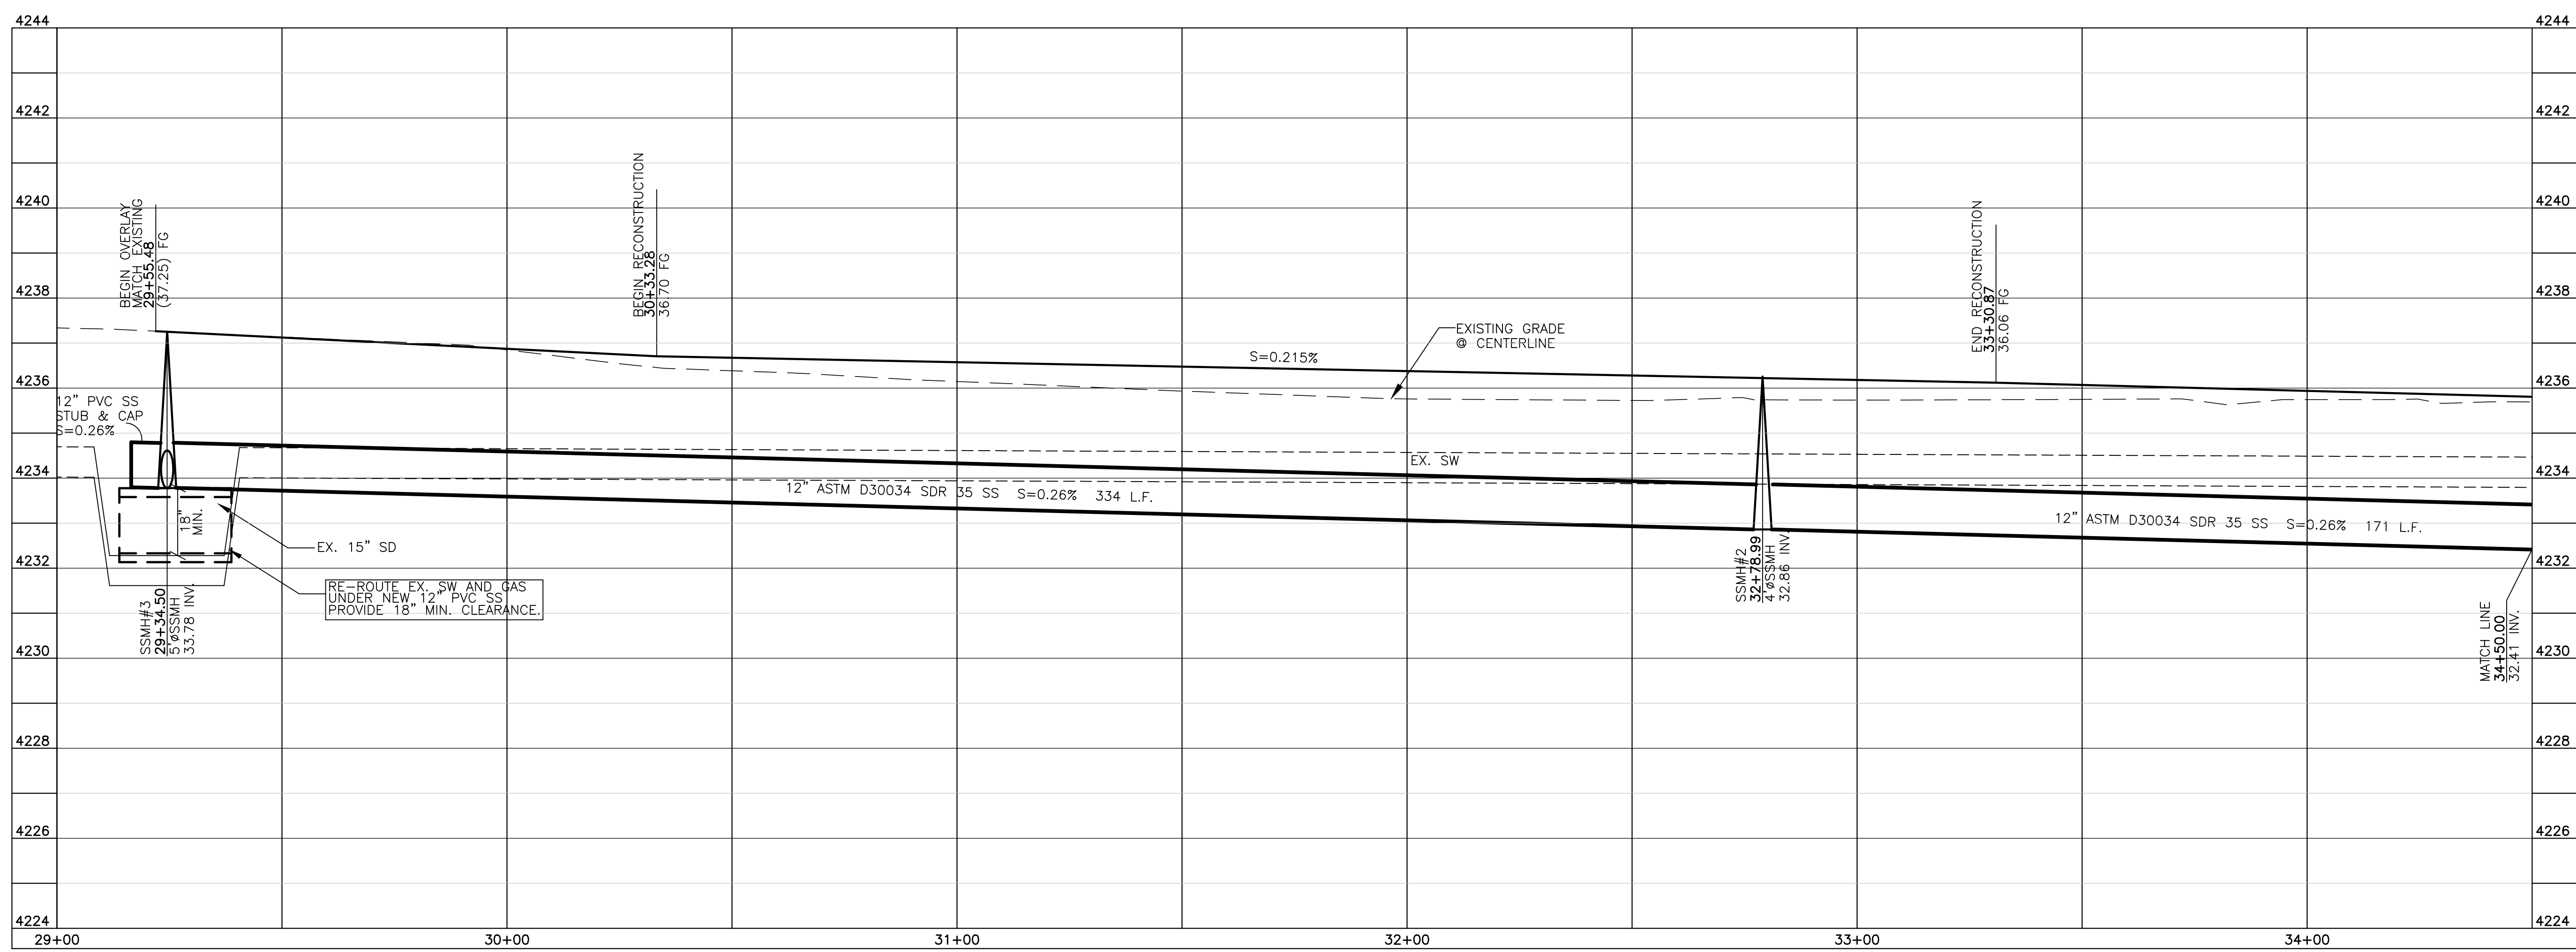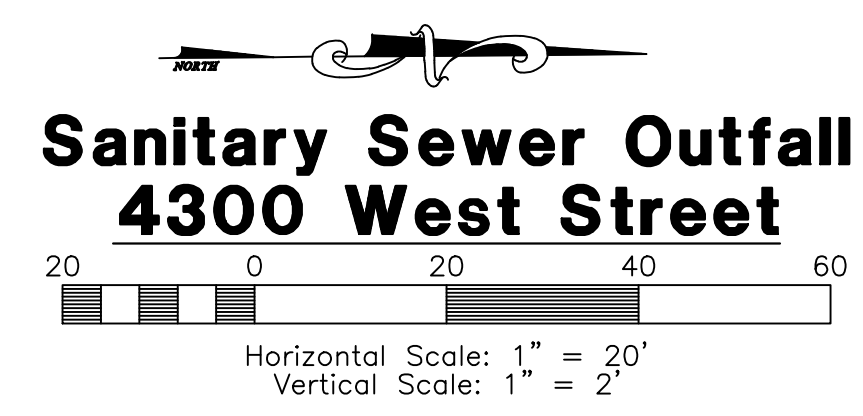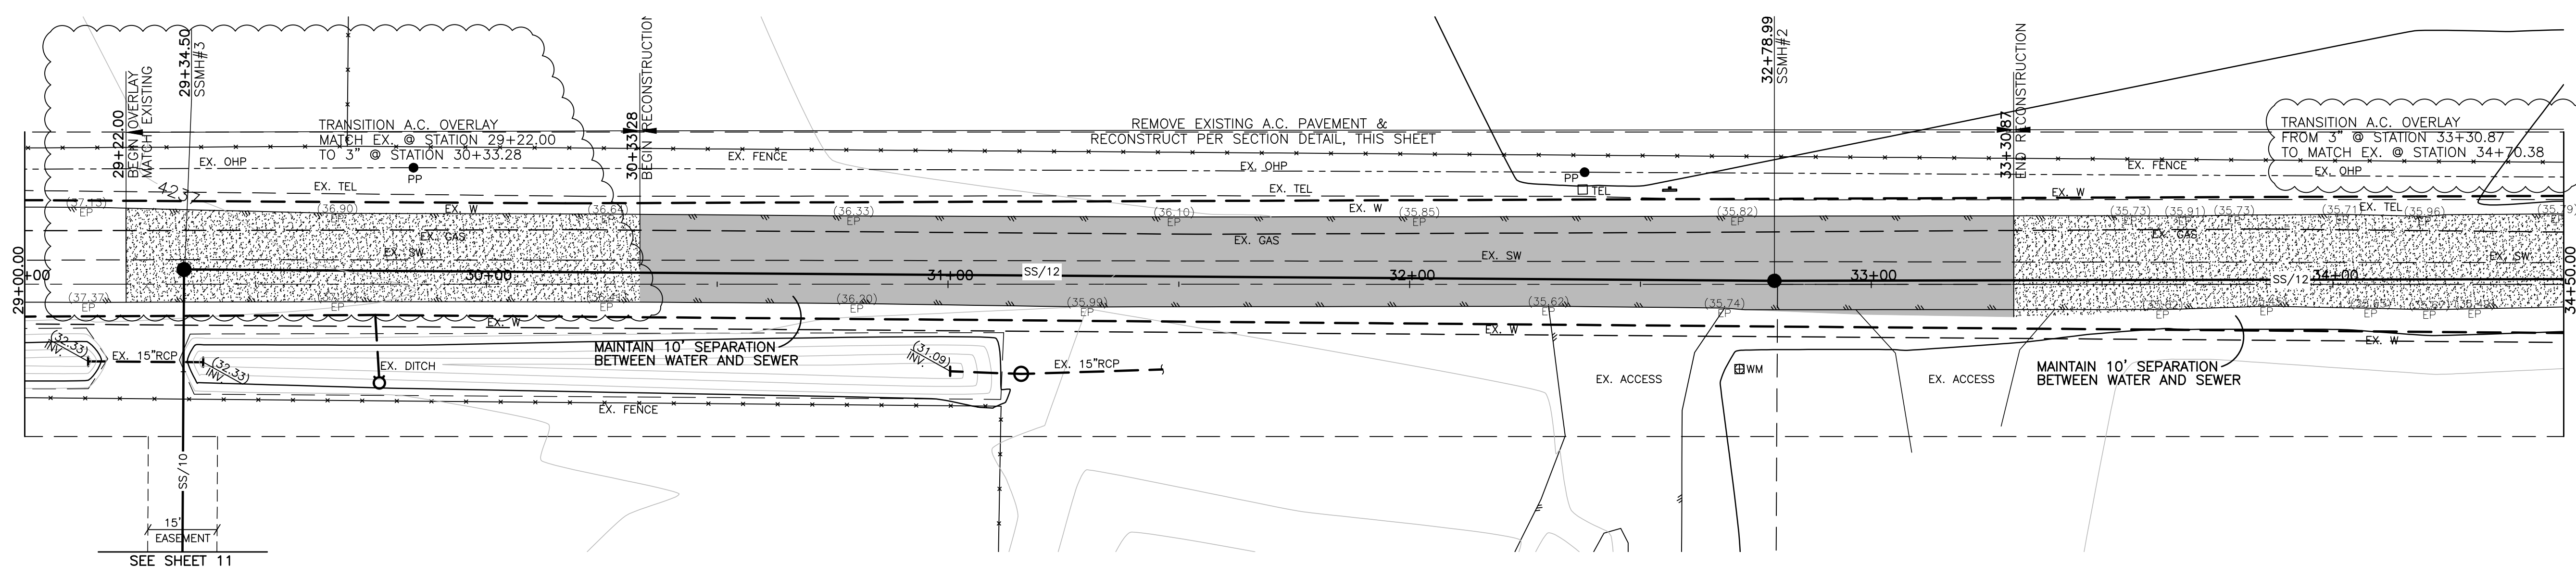

Revised: 10-9-14


Mallard Springs Subdivision
 WEBER COUNTY, UTAH
Sanitary Sewer Outfall - 4300 West St.
29+00.00 - 34+50.00

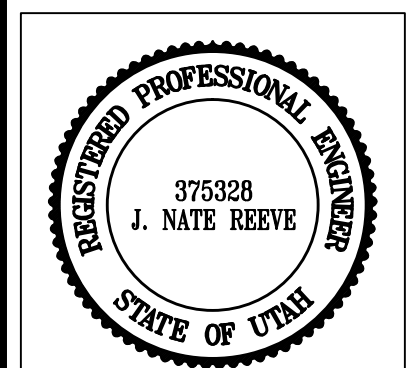

Project Info.
 Engineer: J. NATE REEVE, P.E.
 Drafter: R. HANSEN
 Begin Date: NOVEMBER 4, 2013
 Name: MALLARD SPRINGS SUBDIVISION
 Number: 3442-A30

Blue Stakes Location Center
Call: Toll Free 1-800-662-4111
 Two Working Days Before You Dig

Sheet **13** of **17** Sheets

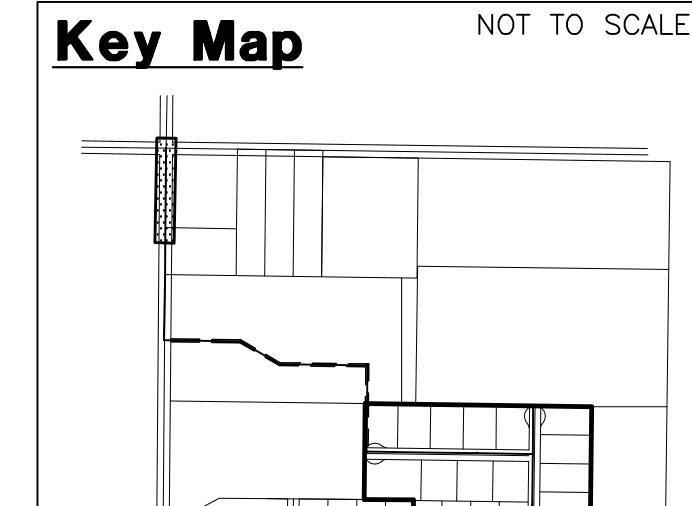




Construction Notes:

- 1) ALL CONSTRUCTION IS TO CONFORM TO THE STANDARD DRAWINGS AND SPECIFICATIONS OF WEBER COUNTY.
 - 2) CONSTRUCT HANDICAP RAMP PER ADA AND CITY REQUIREMENTS.
- CULINARY WATER**
W/8 - 8" PVC C-900 CLASS 200 WATER
- SANITARY SEWER**
SS/8 - 8" ASTM D3034 SDR 35 SEWER
SS/10 - 10" ASTM D3034 SDR 35 SEWER
- DUE TO THE SHALLOWNESS OF THE SEWER LINE THROUGH ADJACENT FIELD, CLASS I OR CLASS II PIPE EMBEDMENT (PER ASTM D2487) INSTALLED PER ASTM D 2321 WITH 95% MODIFIED PROCTOR.
- STORM DRAIN**
SD/15 - 15" RCP STORM DRAIN
- SECONDARY WATER**
SW/8 - 8" PVC C-900 SECONDARY WATER LINE

Reeve & Associates, Inc.
920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403
TEL: (801) 621-2100 FAX: (801) 621-2666 WWW.REEVE-ASSOC.COM

IRA
LAND PLANNERS • CIVIL ENGINEERS • LAND SURVEYORS
PRACTICE ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS


REVISIONS	DATE	DESCRIPTION
5-2-14	Rh	County Comments
9-4-14	ST	County Comments
9-30-14	ST	County Comments
10-9-14	ST	County Comments

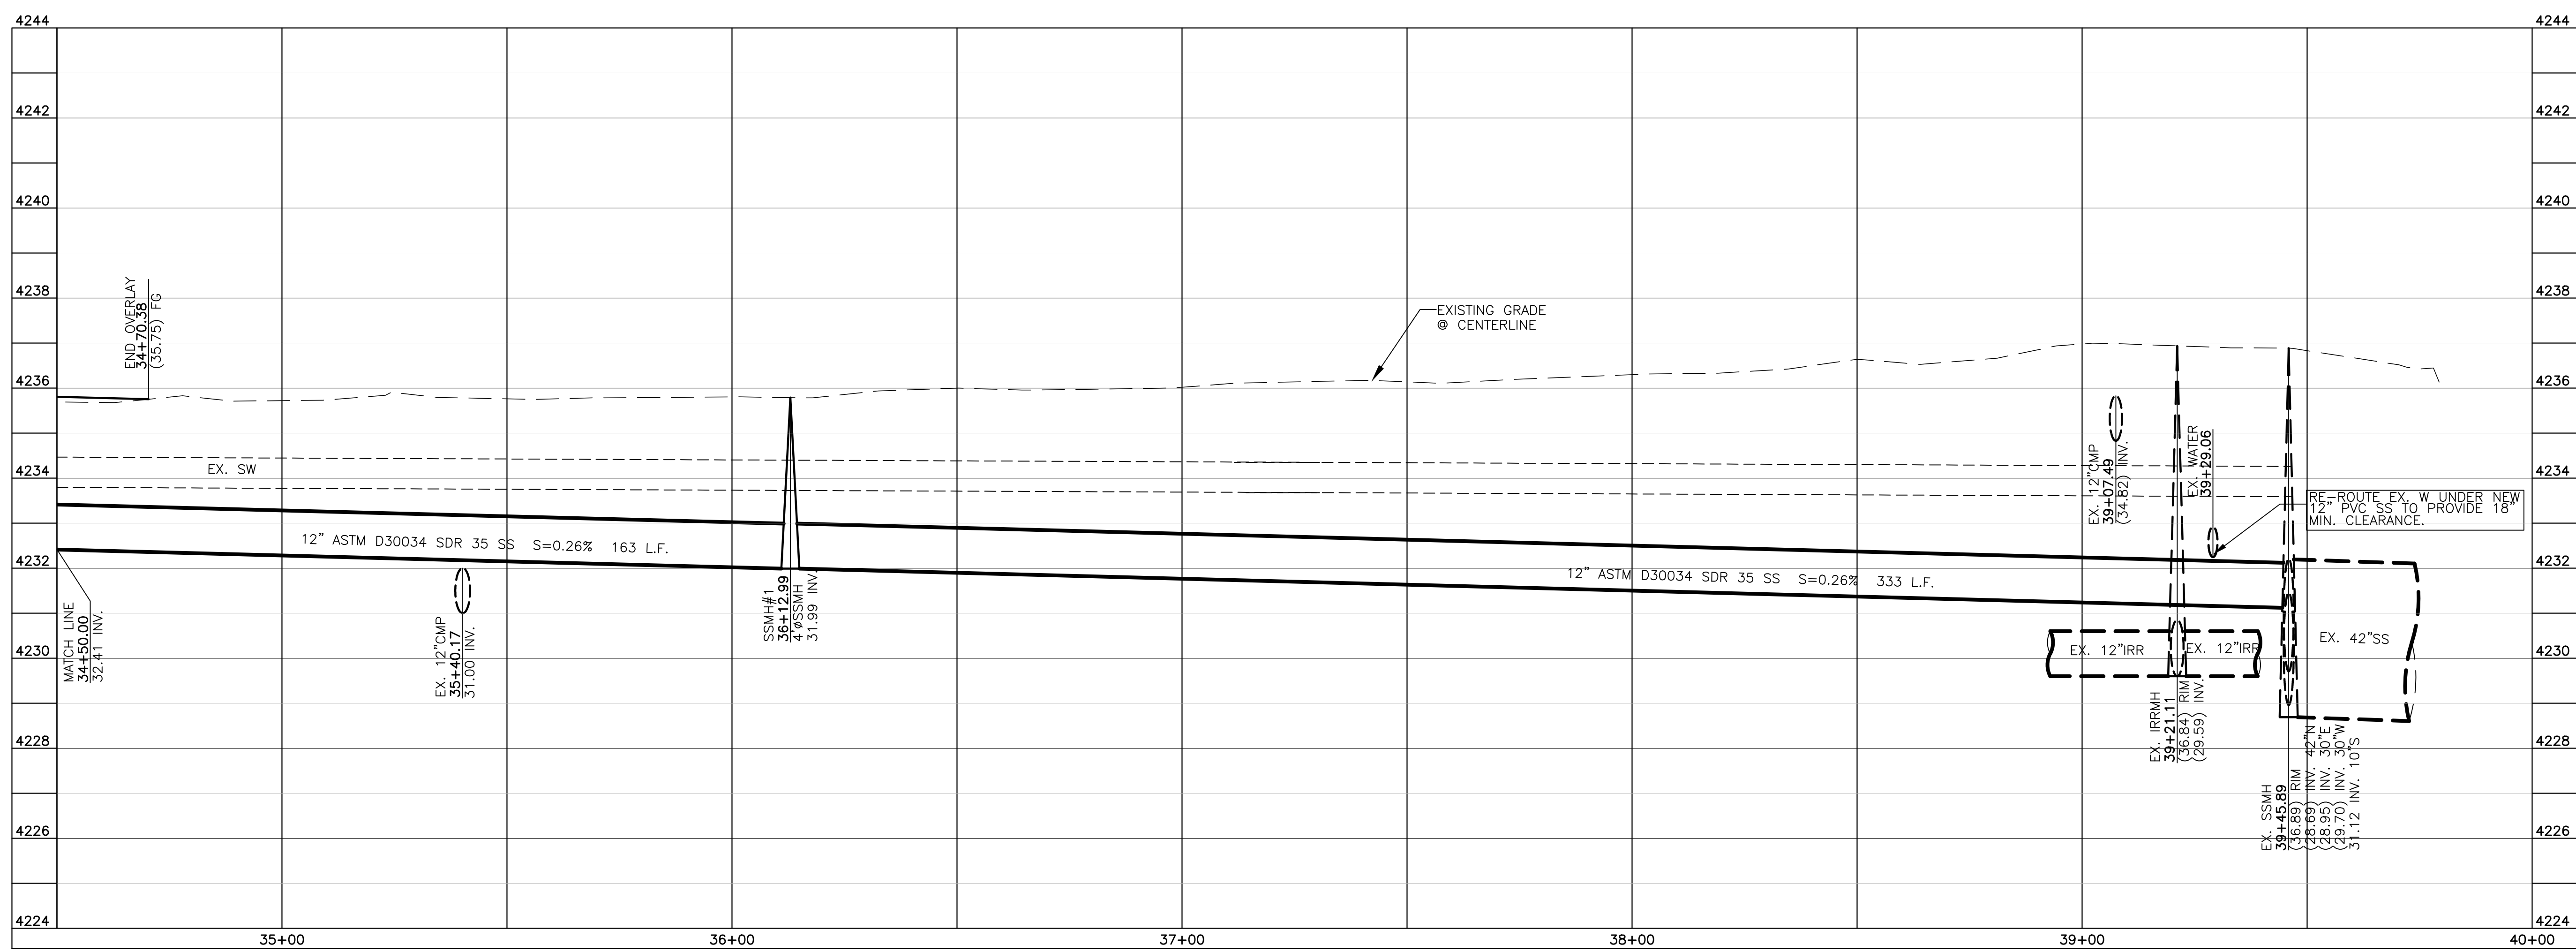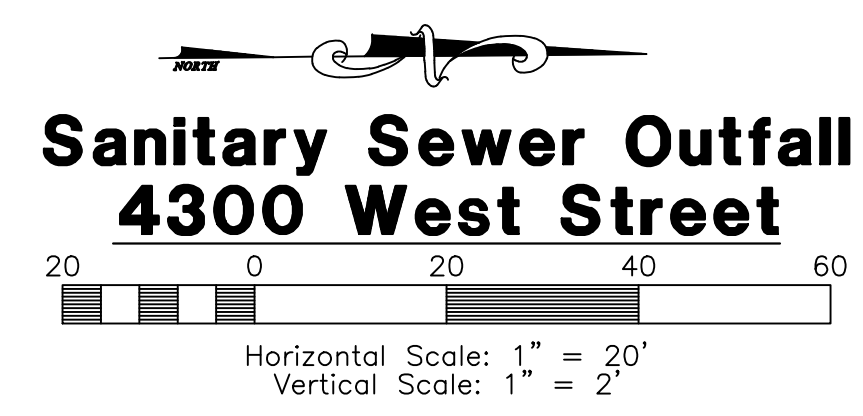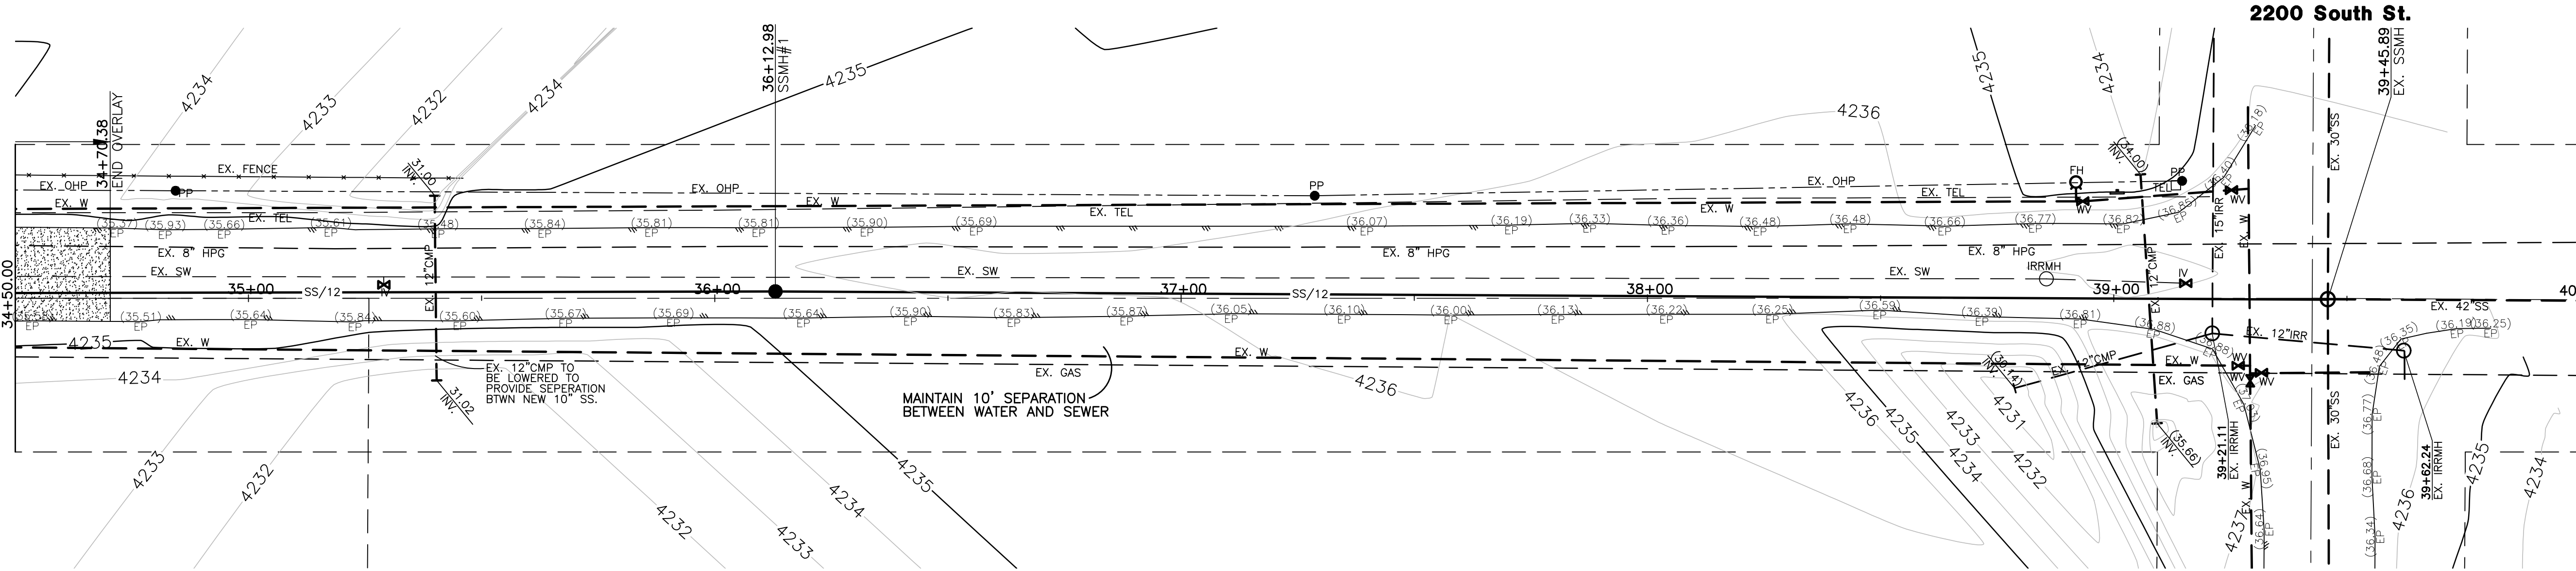

Revised: 10-9-14

Mallard Springs Subdivision
WEBER COUNTY, UTAH

Sanitary Sewer Outfall - 4300 West St.
34+50.00 - 40+00.00

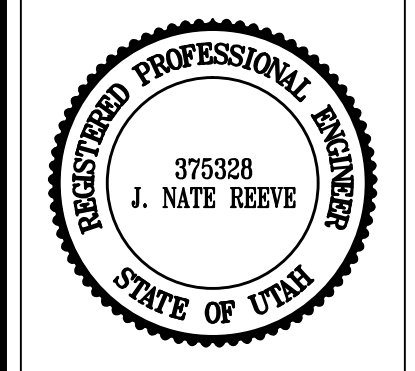

Project Info.
Engineer: J. NATE REEVE, P.E.
Drafted: R. HANSEN
Begin Date: NOVEMBER 4, 2013
Name: MALLARD SPRINGS SUBDIVISION
Number: 3442-A30


Blue Stakes Location Center
Call: Toll Free 1-800-662-4111
Two Working Days Before You Dig

Sheet **17**
14 Sheets

MALLARD SPRINGS SUBDIVISION

Storm Water Pollution Prevention Plan Exhibit

WEBER COUNTY, UTAH
NOVEMBER 2013

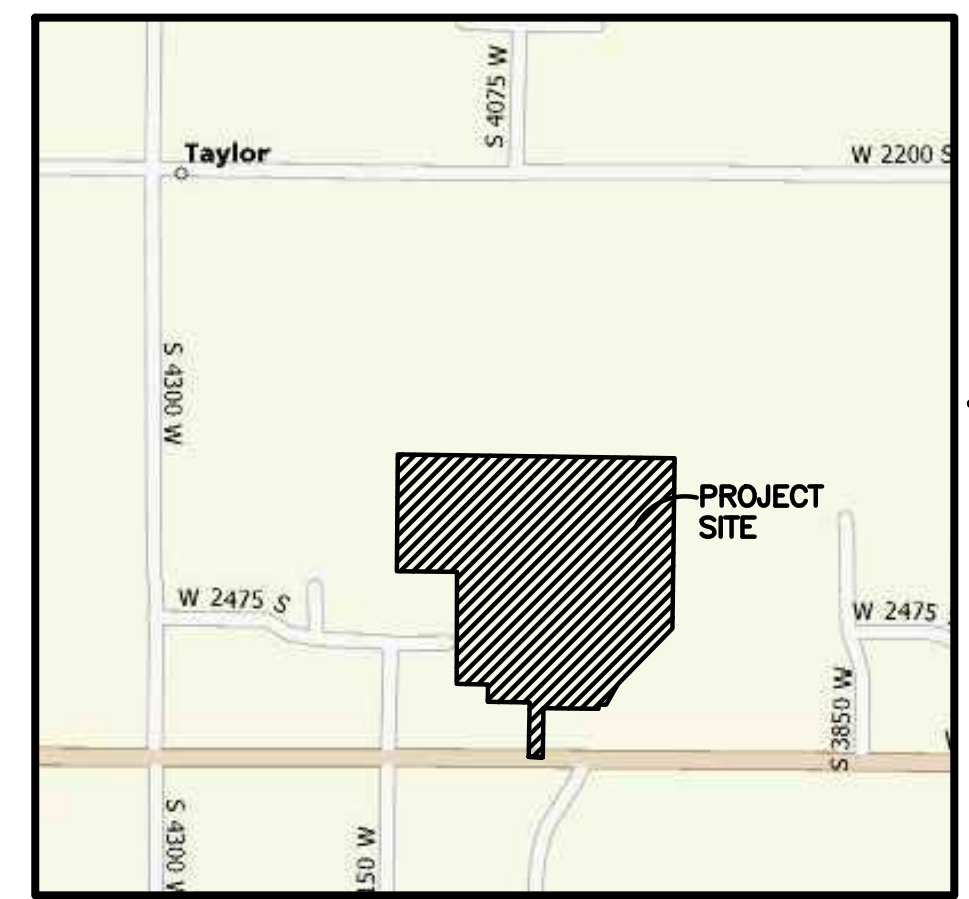


Vicinity Map
NOT TO SCALE



STREETS TO BE SWEEPED WITHIN 1000 FEET OF CONSTRUCTION ENTRANCE DAILY IF NECESSARY


ALL VEHICLES EXITING SITE TO PROCEED THROUGH CONSTRUCTION ENTRANCE TO REDUCE AMOUNTS OF SEDIMENT TRACKED ONTO ROADWAYS.

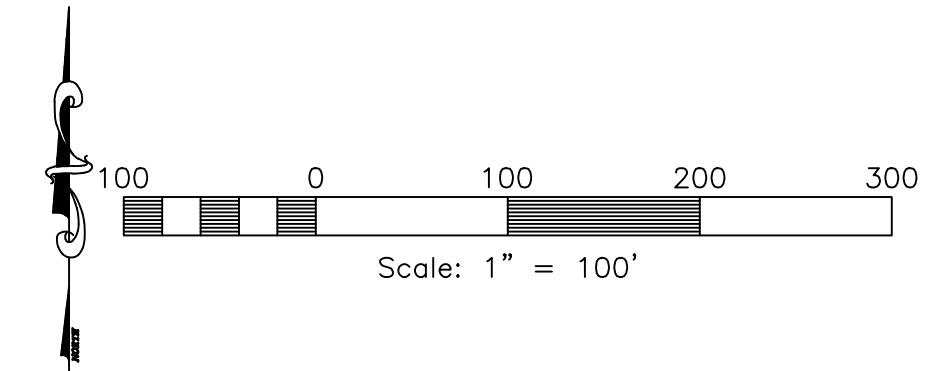

Reeve & Associates, Inc.
 920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403
 TEL: (801) 621-2100 FAX: (801) 621-2668 WWW.REEVE-ASSOC.COM
 LAND PLANNERS • CIVIL ENGINEERS • LAND SURVEYORS
 TRAFFIC ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

REVISIONS	DATE	DESCRIPTION
5-2-14	RH	County Comments
9-4-14	ST	County Comments
9-30-14	ST	County Comments
10-9-14	ST	County Comments

Mallard Springs Subdivision
 WEBER COUNTY, UTAH
Storm Water Pollution Prevention Plan Exhibit

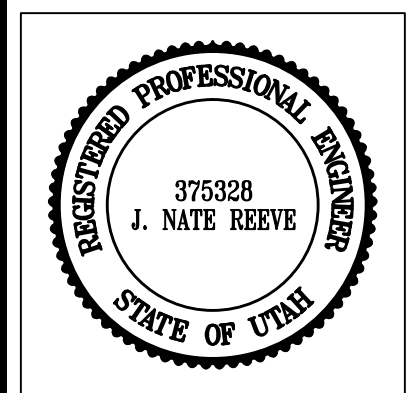

Project Info.

Engineer: J. NATE REEVE, P.E.
 Drafter: R. HANSEN
 Begin Date: NOVEMBER 4, 2013
 Name: MALLARD SPRINGS SUBDIVISION
 Number: 3442-A30


Construction Activity Schedule

- PROJECT LOCATION.....WEBER COUNTY, UTAH
- PROJECT BEGINNING DATE.....NOVEMBER 2013
- BMP'S DEPLOYMENT DATE.....NOVEMBER 2013
- STORM WATER MANAGEMENT CONTACT / INSPECTOR.....DOUG HAMBLIN (801) 731-7703
- SPECIFIC CONSTRUCTION SCHEDULE INCLUDING BMP CONSTRUCTION SCHEDULE TO BE INCLUDED WITH SWPPP BY OWNER/DEVELOPER


Sheet	17
15	Sheets

Notes:

- Describe all BMP's to protect storm water inlets:
All storm water inlets to be protected by straw wattle barriers, or gravel bags (see detail).
- Describe BMP's to eliminate/reduce contamination of storm water from:
 - Equipment / building / concrete wash areas:
To be performed in designated areas only and surrounded with silt fence barriers.
 - Soil contaminated by soil amendments:
If any contaminants are found or generated, contact environmental engineer and contacts listed.
 - Areas of contaminated soil:
If any contaminants are found or generated, contact environmental engineer and contacts listed.
 - Fueling area:
To be performed in designated areas only and surrounded with silt fence.
 - Vehicle maintenance areas:
To be performed in designated areas only and surrounded with silt fence.
 - Vehicle parking areas:
To be performed in designated areas only and surrounded with silt fence.
 - Equipment storage areas:
To be performed in designated areas only and surrounded with silt fence.
 - Materials storage areas:
To be performed in designated areas only and surrounded with silt fence.
 - Waste containment areas:
To be performed in designated areas only and surrounded with silt fence.
 - Service areas:
To be performed in designated areas only and surrounded with silt fence.
- BMP's for wind erosion:
Stockpiles and site as needed to be watered regularly to eliminate / control wind erosion
- Construction Vehicles and Equipment:
 - Maintenance
 - Maintain all construction equipment to prevent oil or other fluid leaks.
 - Keep vehicles and equipment clean, prevent excessive build-up of oil and grease.
 - Regularly inspect on-site vehicles and equipment for leaks, and repair immediately.
 - Check incoming vehicles and equipment (including delivery trucks, and employee and subcontractor vehicles) for leaking oil and fluids. Do not allow leaking vehicles or equipment on-site.
 - Segregate and recycle wastes, such as greases, used oil or oil filters, antifreeze, cleaning solutions, automotive batteries, hydraulic, and transmission fluids.
 - Fueling
 - If fueling must occur on-site, use designated areas away from drainage.
 - Locate on-site fuel storage tanks within a bermed area designed to hold the tank volume.
 - Cover retention area with an impervious material and install in a manner to ensure that any spills will be contained in the retention area. To catch spills or leaks when removing or changing fluids.
 - Use drip pans for any oil or fluid changes.
 - Washing
 - Use as little water as possible to avoid installing erosion and sediment controls for the wash area.
 - If washing must occur on-site, use designated, bermed wash areas to prevent waste water discharge into storm water, creeks, rivers, and other water bodies.
 - Use phosphate-free, biodegradable soaps.
 - Do not permit steam cleaning on-site.
- Spill Prevention and Control
 - Minor Spills:
Minor spills are those which are likely to be controlled by on-site personnel. After contacting local emergency response agencies, the following actions should occur upon discovery of a minor spill:
 - Contain the spread of the spill.
 - If the spill occurs on paved or impermeable surfaces, clean up using "dry" methods (i.e. absorbent materials, cat litter, and / or rags).
 - If the spill occurs in dirt areas, immediately contain the spill by constructing an earth dike. Dig up property dispose of contaminated soil.
 - If the spill occurs during rain, cover the impacted area to avoid runoff.
 - Record all steps taken to report and contain spill.
 - Major Spills:
On-site personnel should not attempt to control major spills until the appropriate and qualified emergency response staff have arrived at the site. For spills of federal reportable quantities, also notify the National Response Center at (800) 424-8802. A written report should be sent to all notified authorities. Failure to report major spills can result in significant fines and penalties.
- Post Roadway / Utility Construction
 - Maintain good housekeeping practices.
 - Enclose or cover building material storage areas.
 - Properly store materials such as paints and solvents.
 - Store dry and wet materials under cover, away from drainage areas.
 - Avoid mixing excess amounts of fresh concrete or cement on-site.
 - Perform washout of concrete trucks offsite or in designated areas only.
 - Do not wash out concrete trucks into storm drains, open ditches, streets or streams.
 - Do not place material or debris into streams, gutters or catch basins that stop or reduce the flow of runoff water.
 - All public streets and storm drain facilities shall be maintained free of building materials, mud and debris caused by grading or construction operations. Roads will be swept within 1000' of construction entrance daily, if necessary.
 - Install straw wattle around all inlets contained within the development and all others that receive runoff from the development.
- Erosion Control Plan Notes
 - The contractor will designate an emergency contact that can be reached 24 hours a day 7 days a week.
 - A stand-by crew for emergency work shall be available at all times during potential rain or snow runoff events. Necessary materials shall be available on site and stockpiled at convenient locations to facilitate rapid construction of emergency devices when rain or runoff is eminent.
 - Erosion control devices shown on the plans and approved for the project may not be removed without approval of the engineer of record. If devices are removed, no work may continue that have the potential of erosion without consulting the engineer of record. If deemed necessary erosion control should be reestablished before this work begins.
 - Graded areas adjacent to fill slopes located at the site perimeter must drain away from the top of the slope at the conclusion of each working day. This should be confirmed by survey or other means acceptable to the engineer of record.
 - All silt and debris shall be removed from all devices within 24 hours after each rain or runoff event.
 - Except as otherwise approved by the inspector, all removable protective devices shown shall be in place at the end of each working day and through weekends until removal of the system is approved.
 - All loose soil and debris, which may create a potential hazard to offsite property, shall be removed from the site as directed by the Engineer of record of the governing agency.
 - The placement of additional devices to reduce erosion damage within the site is left to the discretion of the Engineer of record.
 - Desilting basins may not be removed or made inoperable without the approval of the engineer of record and the governing agency.
 - Erosion control devices will be modified as need as the project progresses, and plans of these changes submitted for approval by the engineer of record and the governing agency.
- Conduct a minimum of one inspection of the erosion and sediment controls every two weeks. Maintain documentation on site.
 - Part III.D.4 of general permit UTR300000 identifies the minimum inspection requirements.
 - Part III.D.4.C identifies the minimum inspection report requirements.
 - Failure to complete and/or document storm water inspections is a violation of part III.D.4 of Utah General Permit UTR 300000.

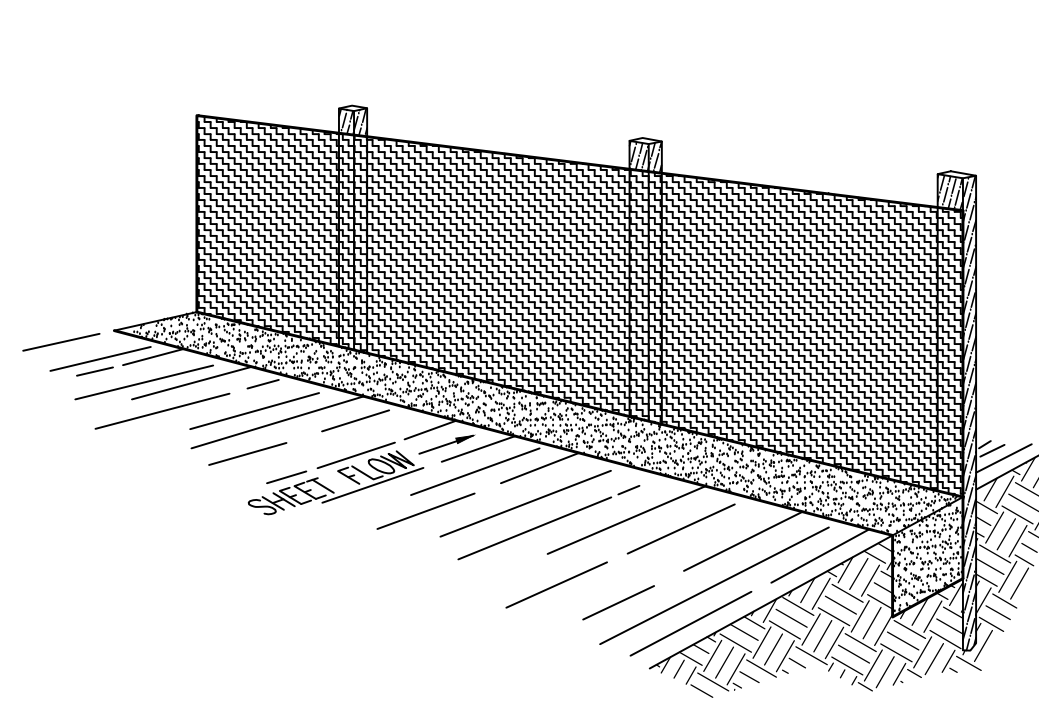

Perspective View

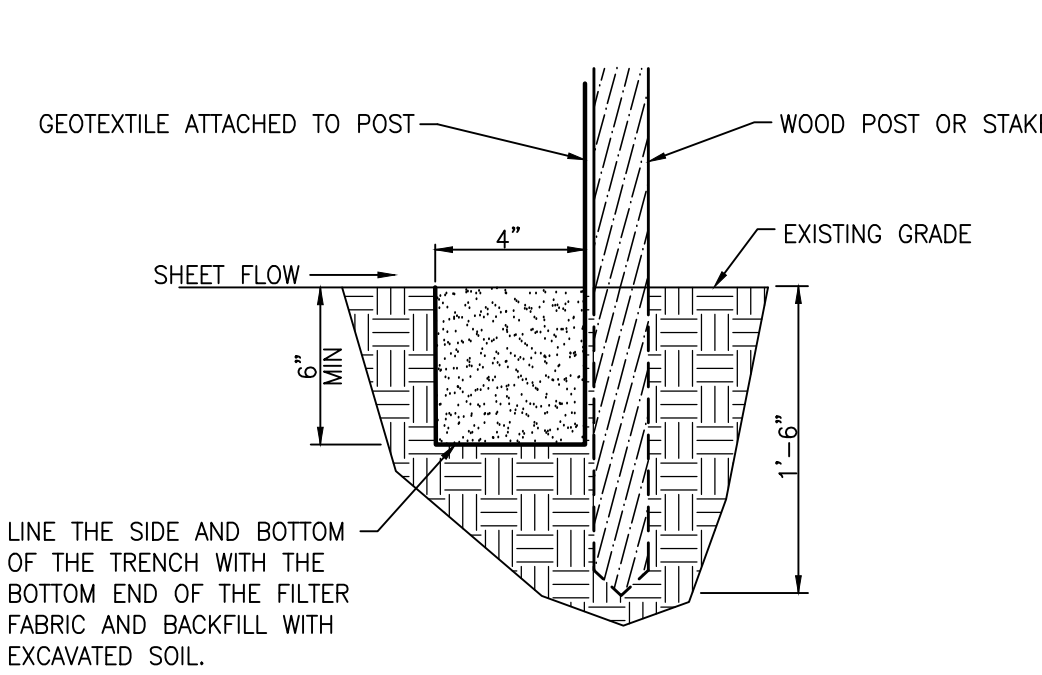

Section

INSTALLATION

The silt fence should be installed prior to major soil disturbances in the drainage area. The fence should be placed across the slope along a line of uniform elevation wherever flow of sediment is anticipated. Table 1 shows generally-recommended maximum slope lengths (slope spacing between fences) at various site grades for most silt fence applications.

TABLE 1: Recommended Maximum Slope Lengths for Silt Fence (Richardson & Middlebrooks, 1991)	
Slope Steepness (%)	Max. Slope Length m (ft)
<2%	30.5m (100ft)
2-5%	22.9m (75ft)
5-10%	15.2m (50ft)
10-20%	7.6m (25ft)
>20%	4.5m (15ft)

PREFABRICATED SILT FENCE ROLLS

- Excavate a minimum 15.2cm x 15.2cm (6"x6") trench at the desired location.
- Unroll the silt fence, positioning the post against the downstream wall of the trench.
- Adjacent rolls of silt fence should be joined by nesting the end post of one fence into the other. Before nesting the end posts, rotate each post until the geotextile is wrapped completely around the post, then abut the end posts to create a tight seal as shown in Figure 1.
- Drive posts into the ground until the required fence height and/or anchorage depth is obtained.
- Bury the loose geotextile at the bottom of the fence in the upstream trench and backfill with natural soil, tamping the backfill to provide good compaction and anchorage. Figure 2 illustrates a typical silt fence installation and anchor trench placement.

should generally be less than three (3) times the height of the fence.

- If a steel or plastic mesh is required to reinforce the geotextile, it shall have a minimum mesh opening of 15.2cm (6").
- Fasten the mesh to the upslope side of the posts using heavy duty wire staples, tie wires or hog strings. Extend the mesh into the bottom of the trench.
- The geotextile shall then be stapled or wired to the posts. An extra 20-50cm (8-20") of geotextile shall extend into the trench.

INSPECTION

- Inspect the silt fence daily during periods of rainfall, immediately after significant rainfall event and weekly during periods of no rainfall. Make any repairs immediately.
- When sediment deposits behind the silt fence are one-third of the fence height, remove and properly dispose of the silt accumulations. Avoid damage to the fabric during cleanout.

REMOVAL

- Silt fence should not be removed until construction ceases and the upslope area has been properly stabilized and/or revegetated.


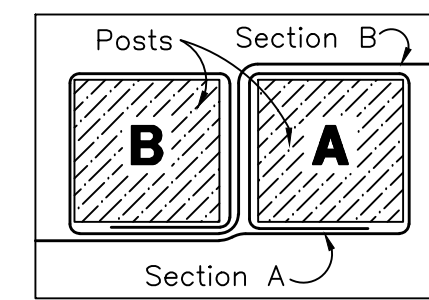


Figure 1:
Top View of
Roll-to-Roll Connection


Silt Fence Detail

SCALE: NONE

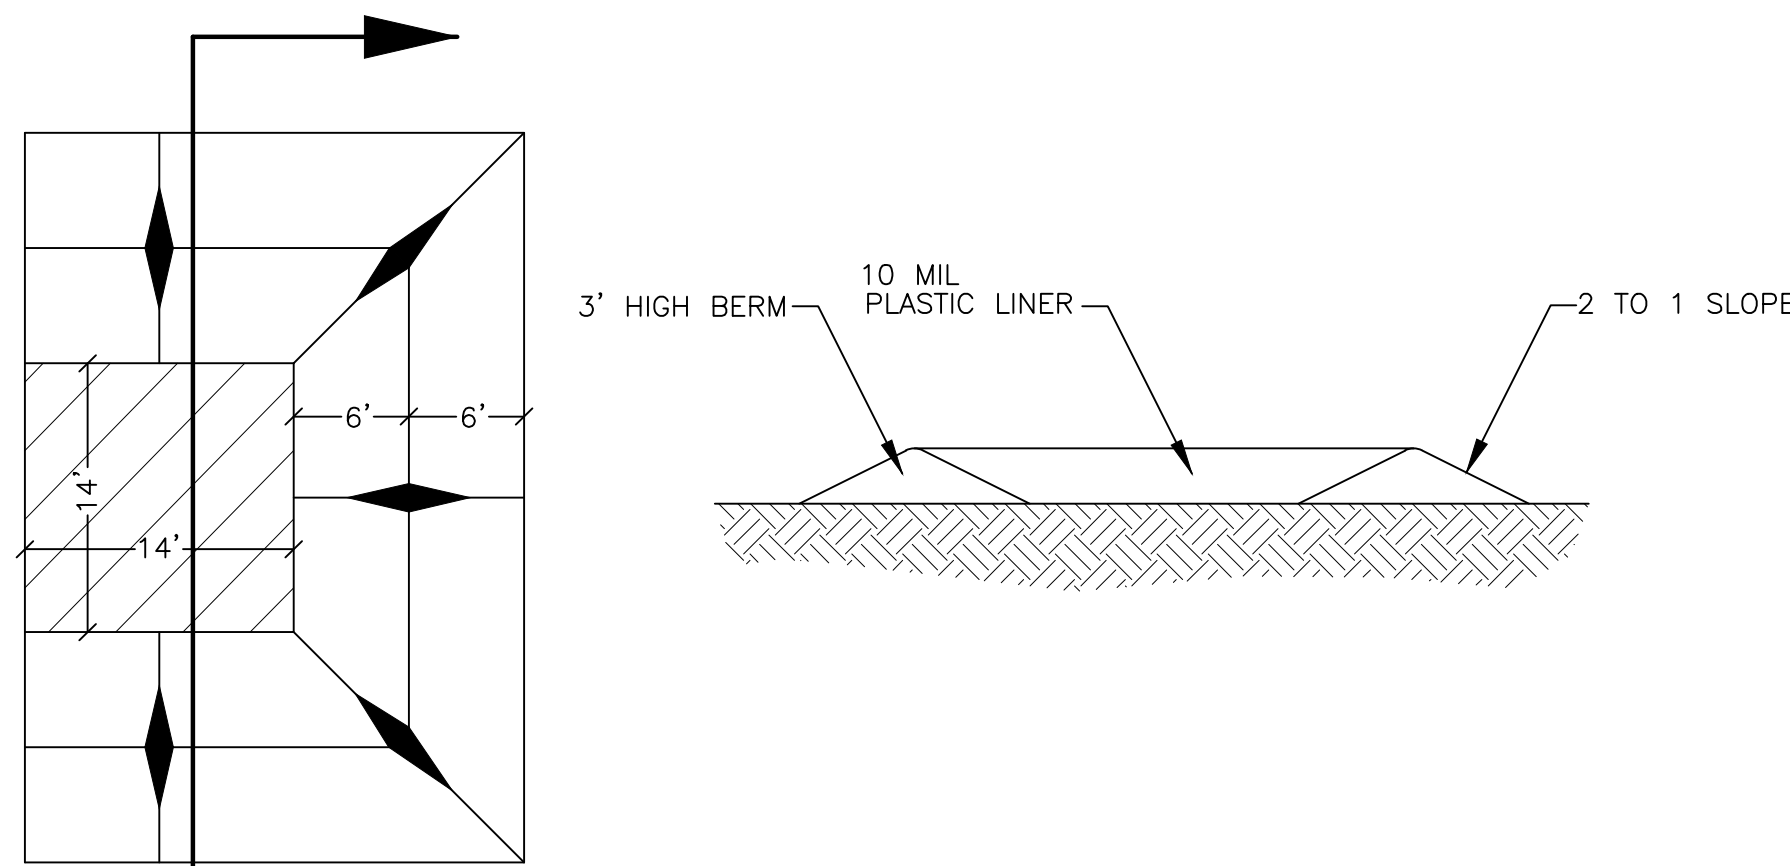


**Concrete Washout Area
w/ 10 mil Plastic Liner**


SCALE: NONE

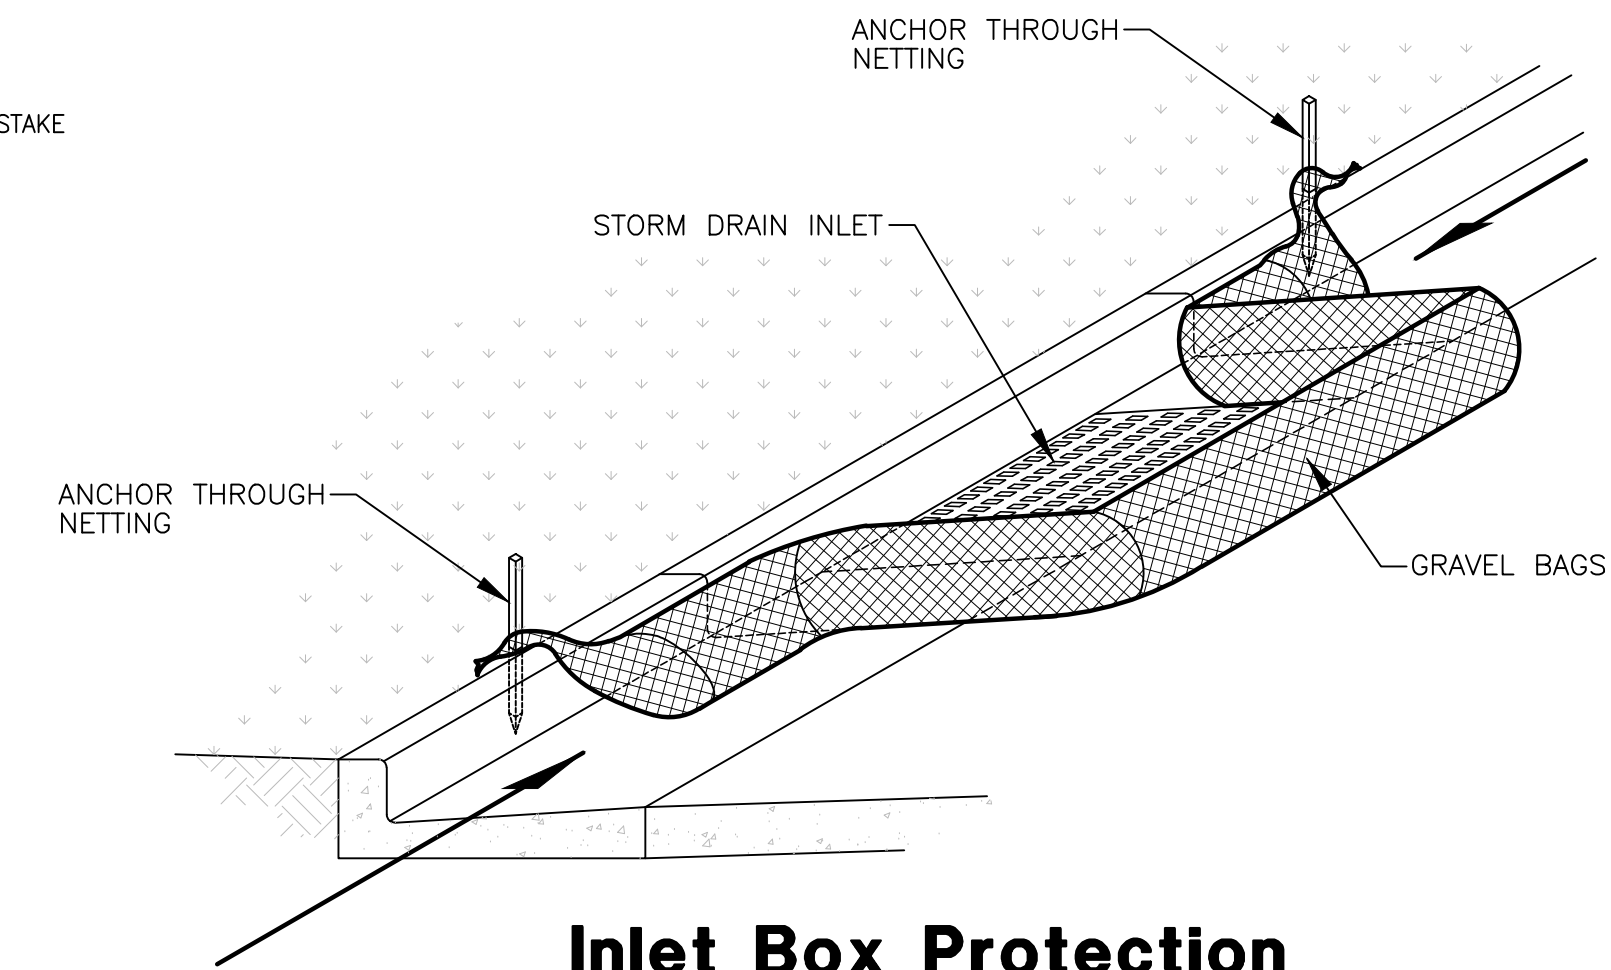


Inlet Box Protection

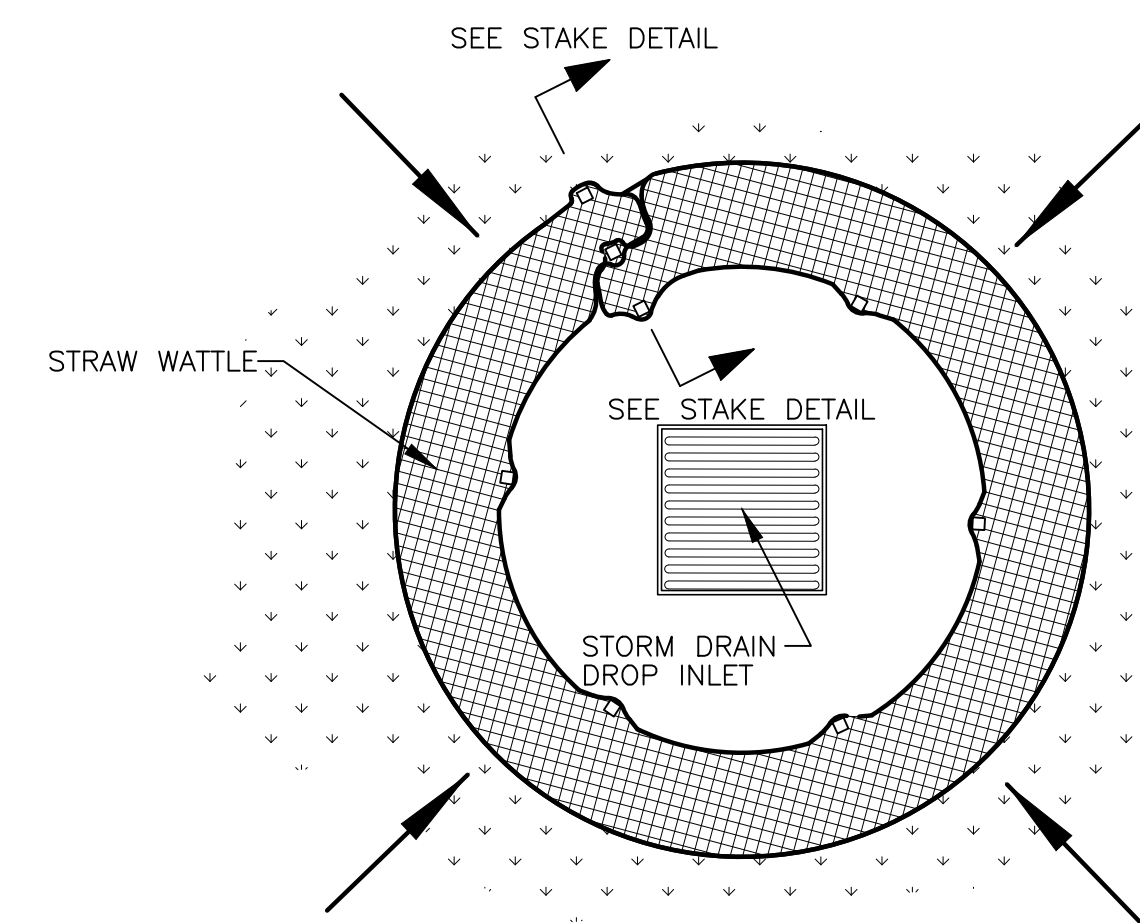


Plan View

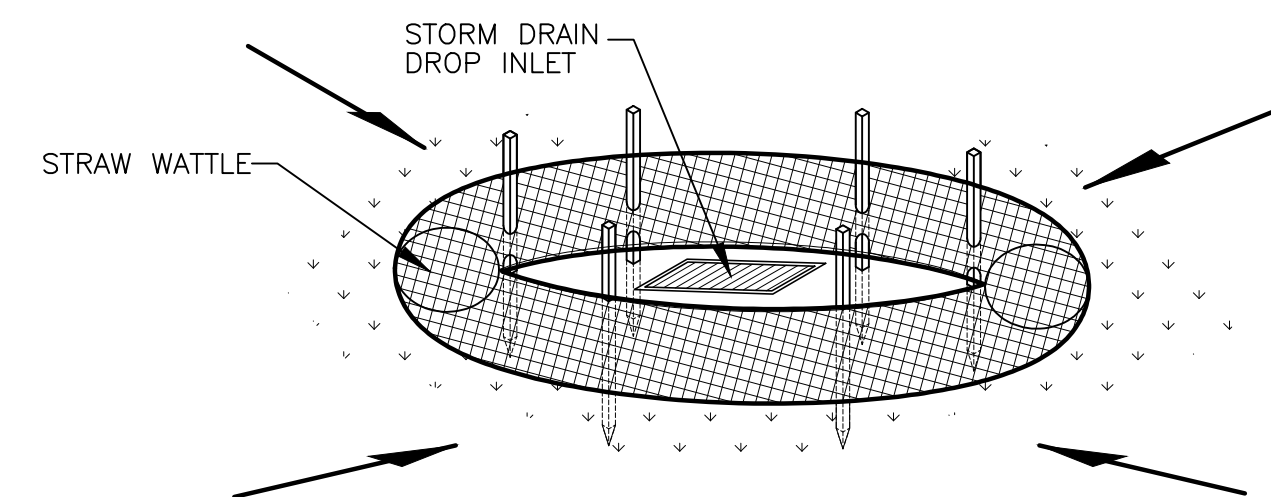

Drop Inlet Protection

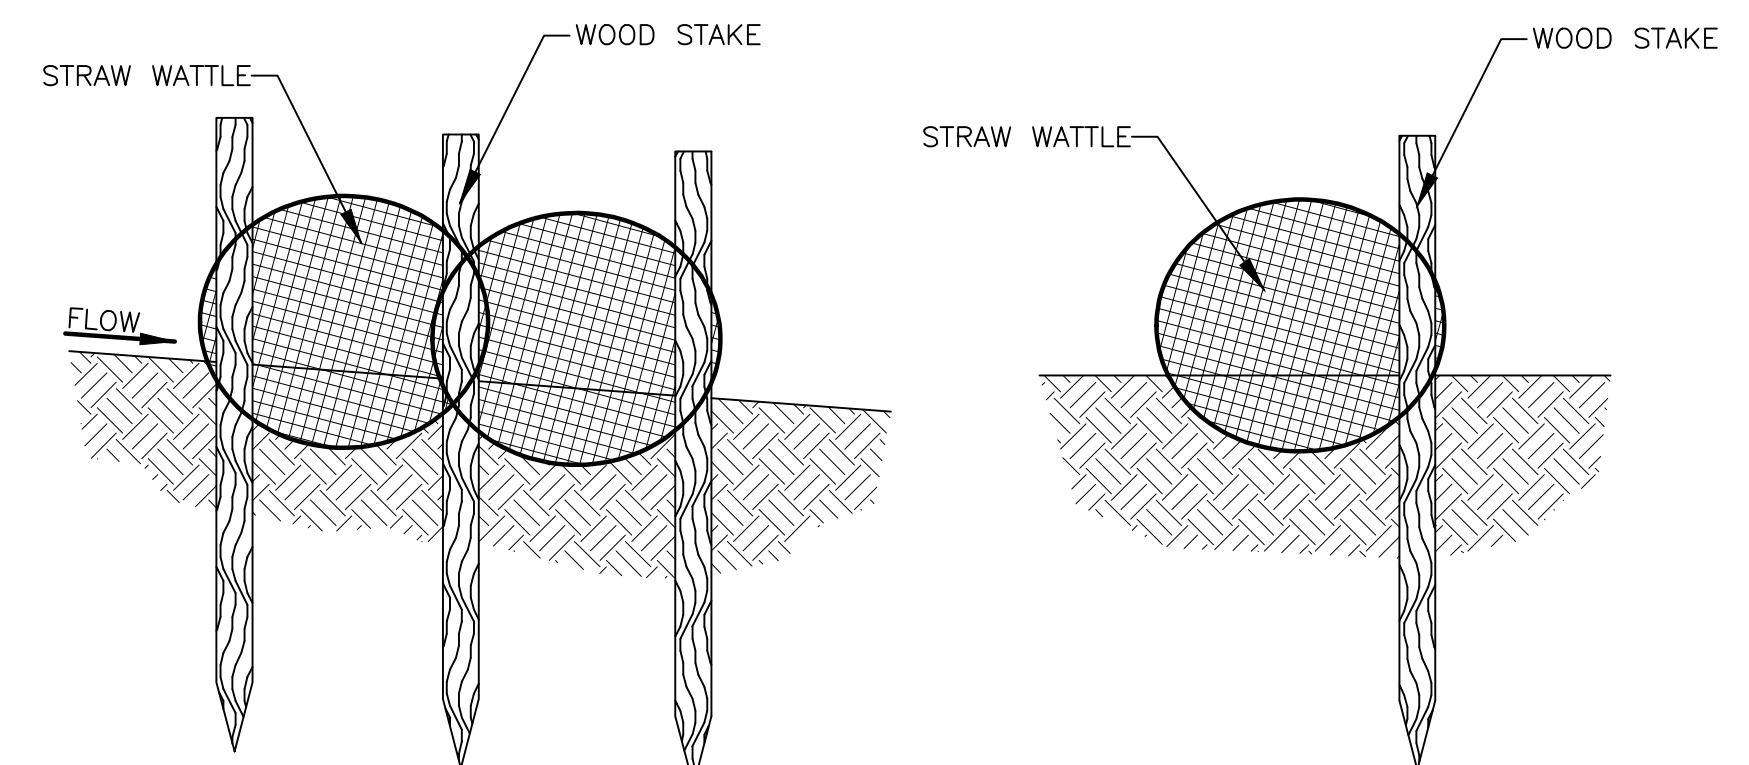

Stake Detail

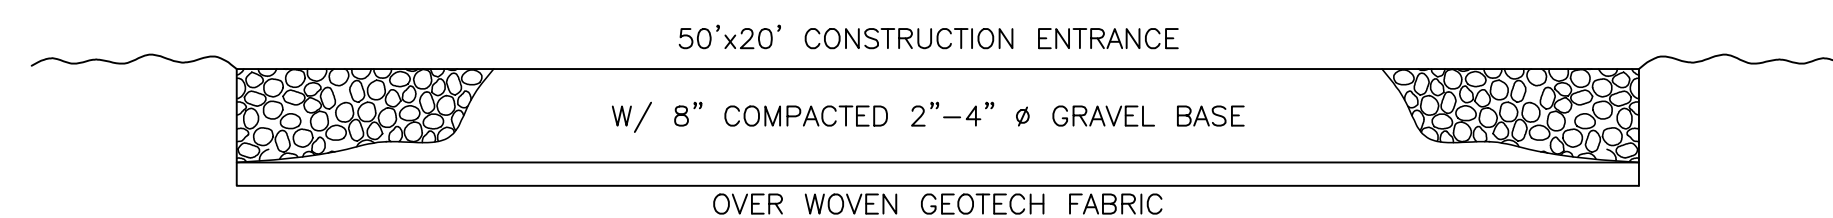

Cross Section 50' x 20' Construction Entrance

Reeve & Associates, Inc.
IRA
 920 CHAMBERS STREET, SUITE 14, OGDEN, UTAH 84403
 TEL: (801) 621-2100 FAX: (801) 621-2666 www.reeve-assoc.com
 LAND PLANNERS • CIVIL ENGINEERS • LAND SURVEYORS
 PUBLIC ENGINEERS • STRUCTURAL ENGINEERS • LANDSCAPE ARCHITECTS

REVISIONS	DATE	DESCRIPTION
5-2-14	RH	County Comments
9-4-14	ST	County Comments
9-30-14	ST	County Comments
10-9-14	ST	County Comments

Mallard Springs Subdivision
 WEBER COUNTY, UTAH
Storm Water Pollution Prevention Plan Details

Revised: 10-9-14

REGISTERED PROFESSIONAL ENGINEER
 375328
 J. NATE REEVE
 STATE OF UTAH


Project Info.
 Engineer: J. NATE REEVE, P.E.
 Drafter: R. HANSEN
 Begin Date: NOVEMBER 4, 2013
 Name: MALLARD SPRINGS SUBDIVISION
 Number: 3442-A30

Sheet **17**
16 Sheets

DATE	DESCRIPTION
5-2-14	RH County Comments
9-4-14	ST County Comments
9-30-14	ST County Comments
10-9-14	ST County Comments


Mallard Springs Subdivision
 WEBER COUNTY, UTAH

Overall Grading Plan

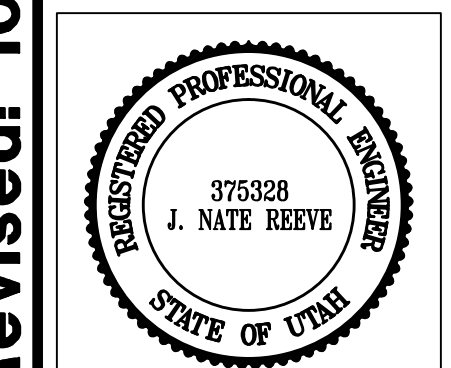

Project Info.
 Engineer: J. NATE REEVE, P.E.
 Drafter: R. HANSEN
 Begin Date: NOVEMBER 4, 2013
 Name: MALLARD SPRINGS SUBDIVISION
 Number: 3442-A30

Sheet **17**
 1 Sheets

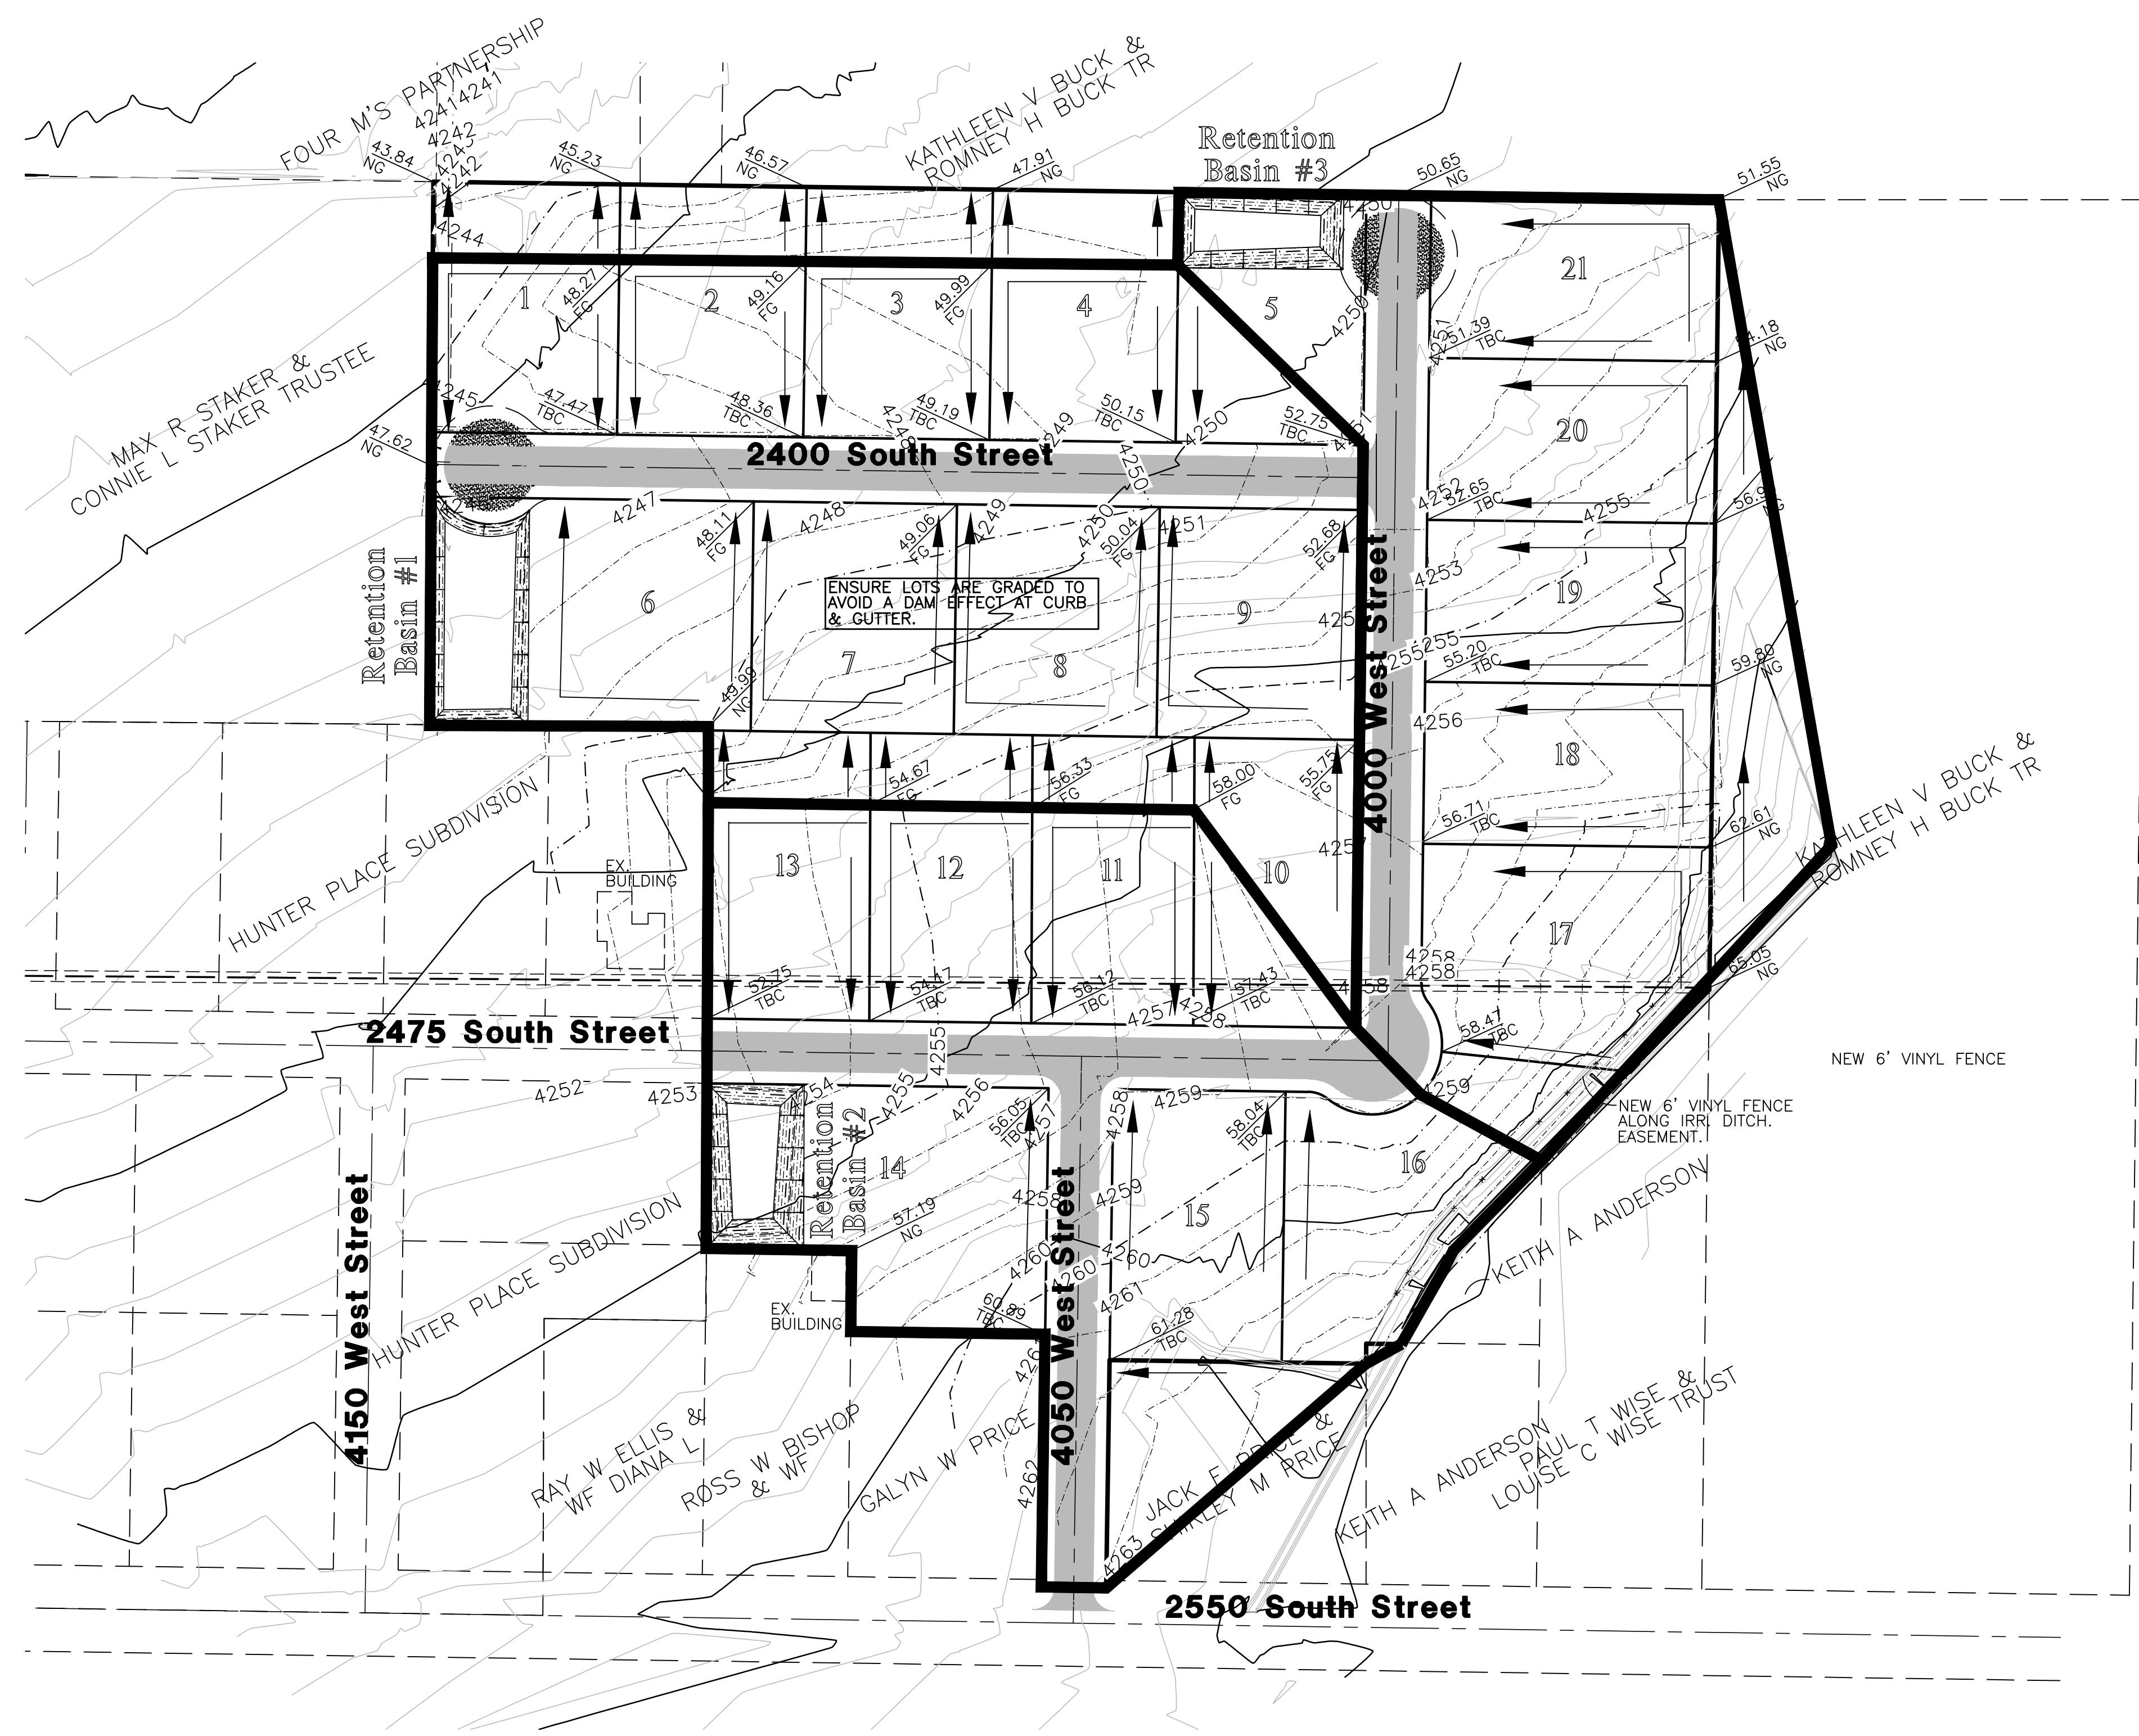

LEGEND

--- PROPOSED 1' CONTOURS
 — EXISTING 1' CONTOURS

