


PROVIDE 4" THICKNESS OF 3/4" OR 1" GRAVEL BASE COURSE UNDER SIDEWALK, DRIVEWAY APPROACHES AND CURB & GUTTER WHEN SUBGRADE IS CLAY OR C.B.R. IS LESS THAN 10 OR AS DIRECTED BY COUNTY ENGINEER

Street Section (60' R.O.W.)

SCALE: NONE

*VERIFY LOCATION WITH PHONE, GAS AND POWER COMPANIES.

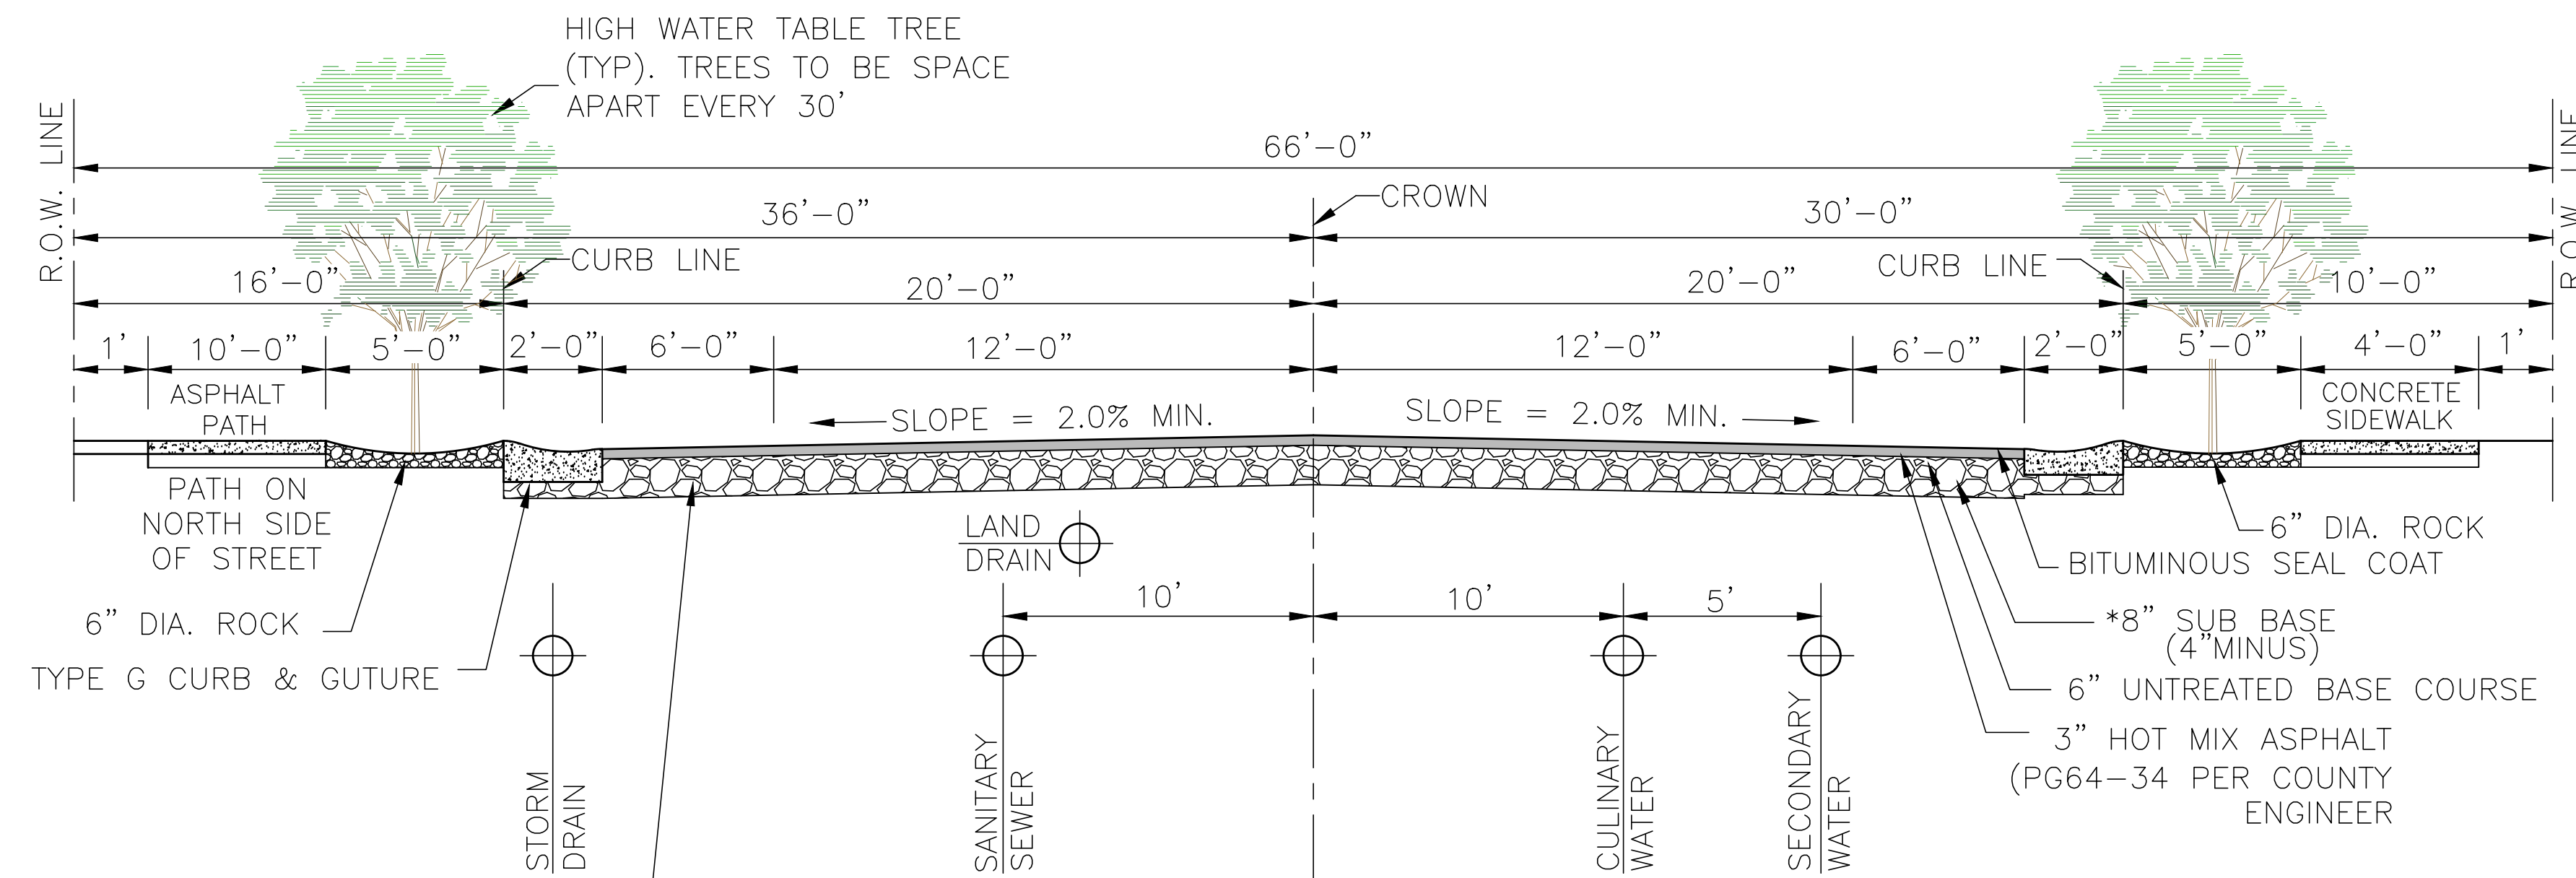

PROVIDE 4" THICKNESS OF 3/4" OR 1" GRAVEL BASE COURSE UNDER SIDEWALK, DRIVEWAY APPROACHES AND CURB & GUTTER WHEN SUBGRADE IS CLAY OR C.B.R. IS LESS THAN 10 OR AS DIRECTED BY COUNTY ENGINEER

Street Section (66' R.O.W.)

SCALE: NONE

*VERIFY LOCATION WITH PHONE, GAS AND POWER COMPANIES.

Notes

- STREETS HEADING IN A EAST/WEST DIRECTION WILL HAVE A 10' PATH ON THE NORTH SIDE OF THE STREET.
- STREETS HEADING IN A NORTH/SOUTH DIRECTION WILL HAVE A 10' PATH ON THE EAST SIDE OF THE STREET.