

**Geotechnical Investigation  
Vaquero Village Subdivision Phase 2  
Ogden, Utah**



**July 15, 2020**

**Prepared by:**



8143 South 2475 East, South Weber, Utah



8143 South 2475 East South Weber, Utah 84405  
Phone: 801 814-1714

Prepared for:

Lync Construction  
Attn: Pat Burns  
pat@lynconstruction.com  
801 710-2234

**Geotechnical Investigation  
Vaquero Village Subdivision Phase 2  
Approximately 600 South 7100 West  
Ogden, Utah  
CG Project No.: 145-006**

Prepared by:



Mark I. Christensen, P.E.  
Principal

**Christensen Geotechnical**  
8143 South 2475 East  
South Weber, Utah 84405

July 15, 2020

# TABLE OF CONTENTS

---

<b>1.0</b>	<b>INTRODUCTION.....</b>	<b>1</b>
1.1	PURPOSE AND SCOPE OF WORK.....	1
1.2	PROJECT DESCRIPTION .....	1
<b>2.0</b>	<b>METHODS OF STUDY .....</b>	<b>2</b>
2.1	FIELD INVESTIGATION.....	2
2.2	LABORATORY TESTING.....	2
<b>3.0</b>	<b>GENERAL SITE CONDITIONS.....</b>	<b>4</b>
3.1	SURFACE CONDITIONS.....	4
3.2	SUBSURFACE CONDITIONS.....	4
3.2.1	<i>Soils</i> .....	4
3.2.2	<i>Groundwater</i> .....	4
<b>4.0</b>	<b>SEISMIC CONSIDERATIONS .....</b>	<b>5</b>
4.1	FAULTING.....	5
4.2	SEISMIC DESIGN CRITERIA .....	5
4.3	LIQUEFACTION.....	6
<b>5.0</b>	<b>ENGINEERING ANALYSIS AND RECOMMENDATIONS.....</b>	<b>7</b>
5.1	GENERAL CONCLUSIONS.....	7
5.2	EARTHWORK .....	7
5.2.1	<i>General Site Preparation and Grading</i> .....	7
5.2.2	<i>Soft Soil Stabilization</i> .....	7
5.2.3	<i>Temporary Construction Excavations</i> .....	7
5.2.4	<i>Structural Fill and Compaction</i> .....	8
5.3	FOUNDATIONS .....	8
5.4	ESTIMATED SETTLEMENT.....	9
5.5	LATERAL EARTH PRESSURES.....	9
5.6	CONCRETE SLAB-ON-GRADE CONSTRUCTION.....	10
5.7	MOISTURE PROTECTION AND SURFACE DRAINAGE.....	10
5.8	SUBSURFACE DRAINAGE .....	11
5.9	PAVEMENT DESIGN.....	11
<b>6.0</b>	<b>LIMITATIONS.....</b>	<b>12</b>
<b>7.0</b>	<b>REFERENCES.....</b>	<b>13</b>

## **ATTACHED PLATES**

<b>Plate 1</b> .....	<b>Vicinity Map</b>
<b>Plate 2</b> .....	<b>Exploration Location Map</b>
<b>Plates 3 to 5</b> .....	<b>Test Pit Logs</b>
<b>Plate 6</b> .....	<b>Key to Soil Symbols and Terms</b>
<b>Plate 7</b> .....	<b>Atterberg Limits Test Results</b>
<b>Plate 8</b> .....	<b>Grain Size Distribution Test Results</b>
<b>Plate 9</b> .....	<b>Consolidation Test Results</b>

## **1.0 INTRODUCTION**

### **1.1 PURPOSE AND SCOPE OF WORK**

This report presents the results of a geotechnical investigation that was performed for the proposed Vaquero Village Subdivision Phase 2 which is to be located at approximately 600 South 7100 West in Ogden, Utah. The general location of the project is indicated on the Project Vicinity Map, Plate 1. In general, the purposes of this investigation were to evaluate the subsurface conditions and the nature and engineering properties of the subsurface soils; and to provide recommendations for general site grading and for the design and construction of floor slabs, pavements, and foundations. This investigation included subsurface exploration, representative soil sampling, field and laboratory testing, engineering analysis, and preparation of this report. The work performed for this report was authorized by Mr. Pat Burns.

### **1.2 PROJECT DESCRIPTION**

Based on a site plan by Great Basin Engineering and conversations with our client, we understand that the proposed development at the site is to consist of a residential subdivision approximately 10 acres in size. The proposed structures within the development are to consist of single-family residences that are one to two stories in height, with basements. The development will also include associated roadways, utilities, and landscaping. Footing loads for the proposed structures are anticipated to be on the order of 3 to 4 klf for walls and 150 psf for floors. If structural loads are different from those anticipated, Christensen Geotechnical should be notified and allowed to reevaluate our recommendations.

## 2.0 METHODS OF STUDY

### 2.1 FIELD INVESTIGATION

The subsurface conditions at the site were explored by excavating three test pits to depths of approximately 7 feet below the existing site grade. The approximate test pit locations are shown on the Exploration Location Map, Plate 2. The subsurface conditions as encountered in the test pits were recorded at the time of excavation and are presented on the attached Test Pit Logs, Plates 3 to 5. A key to the symbols and terms used on the Test Pit Logs may be found on Plate 6.

The test pit excavation was accomplished with a tracked excavator. Disturbed and undisturbed soil samples were collected from the test pit sidewalls at the time of excavation. The disturbed samples were collected and placed in bags and buckets. The undisturbed samples consisted of block samples which were placed in bags. The samples were visually classified in the field and portions of each sample were packaged and transported to our laboratory for testing. The classifications for the individual soil units are shown on the attached Test Pit Logs.

### 2.2 LABORATORY TESTING

Of the soils collected during the field investigation, representative samples were selected for testing in the laboratory in order to evaluate the pertinent engineering properties. The laboratory testing performed included moisture content and density determinations, Atterberg limits evaluations, gradation analyses, and a one-dimensional consolidation test. A summary of our laboratory testing is presented in the table below:

**Table No. 1: Laboratory Test Results**

TEST HOLE NO.	DEPTH (ft.)	NATURAL DRY DENSITY (pcf)	NATURAL MOISTURE (%)	ATTERBERG LIMITS		GRAIN SIZE DISTRIBUTION (%)			SOIL TYPE
				LIQUID LIMIT	PLASTICITY INDEX	GRAVEL (+ #4)	SAND	SILT/CLAY (- #200)	
TP-1	6		32.7	NP	NP	0.0	94.4	5.6	SP-SM
TP-2	2		17.7	21	8			54.9	CL
TP-3	3	93.2	28.4	30	10			94.7	CL
TP-3	6		29.5	NP	NP	0.0	94.7	5.3	SP-SM

The results of our laboratory tests are also presented on the Test Pit Logs (Plates 3 through 5), and more detailed laboratory results are presented on the laboratory testing plates (Plates 7 through 9).

Samples will be retained in our laboratory for 30 days following the date of this report, at which time they will be disposed of unless a written request for additional holding time is received prior to the disposal date.

## **3.0 GENERAL SITE CONDITIONS**

### **3.1 SURFACE CONDITIONS**

At the time of our investigation, the subject site was undeveloped land. The property was nearly level and was covered with common grasses and weeds. The site was bordered by undeveloped land to the north and west, a pond and undeveloped land to the east, and an existing subdivision to the south.

### **3.2 SUBSURFACE CONDITIONS**

#### **3.2.1 Soils**

Based on the three test pits completed for this investigation, the site is covered with ½ to 1 foot of topsoil. The soils below the topsoil consisted of 3 to 3½ feet of Sandy Lean CLAY and Lean CLAY (CL) overlying Poorly Graded SAND with silt (SP-SM), which extended beyond the maximum depth explored (7 feet).

#### **3.2.2 Groundwater**

Groundwater was encountered within each of our test pits at depths of 3 to 4 feet below the existing site grades. It should be understood that groundwater is likely below its seasonal high and may fluctuate in response to seasonal changes, precipitation, and irrigation. Due to the high groundwater, a foundation drain is recommended for all subgrade walls.



## 4.0 SEISMIC CONSIDERATIONS

### 4.1 FAULTING

Based upon published data, no active faults are known to traverse the site and no faulting was indicated during our field investigation. The nearest known active fault is the Weber Segment of the Wasatch Fault, which lies approximately 10.7 miles east of the subject property (UGS).

### 4.2 SEISMIC DESIGN CRITERIA

The State of Utah and Utah municipalities have adopted the 2018 International Building Code (IBC) for seismic design. The IBC seismic design is based on seismic hazard maps which depict probabilistic ground motions and spectral response; the maps, ground motions, and spectral response having been developed by the United States Geological Survey (USGS). Seismic design values, including the design spectral response, may be calculated for a specific site using the web-based application by the Applied Technology Council (ATC) and the project site's approximate latitude and longitude and Site Class. Based on our field exploration, it is our opinion that this location is best described as a Site Class D, which represents a "stiff soil" profile. The spectral acceleration values obtained from the ATC web-based application are shown below.

**Table 2: IBC Seismic Response Spectrum Values**

Site Location: 41.25519° N -112.15358° W	
Name	Response Spectral Value
$S_S$	0.978
$S_1$	0.350
$S_{MS}$	1.084
$S_{M1}$	See ASCE Section 11.4.8
$S_{DS}$	0.723
$S_{D1}$	See ASCE Section 11.4.8
PGA	0.426
$PGA_M$	0.50

### 4.3 LIQUEFACTION

Certain areas in the intermountain west possess a potential for liquefaction. Liquefaction is a phenomenon in which soils lose their intergranular strength due to an increase of pore pressures during a dynamic event such as an earthquake. The potential for liquefaction is based on several factors, including 1) the grain-size distribution of the soil, 2) the plasticity of the fine fraction of the soil (material passing the No. 200 sieve), 3) the relative density of the soils, 4) earthquake strength (magnitude) and duration, 5) overburden pressures, and 6) the depth to groundwater.

A review of the “Liquefaction-Potential Map for a Part of Weber County, Utah” (Anderson, 1994), indicates that the subject site is located in an area designated as having a high potential for liquefaction. A high potential for liquefaction indicates that there is a 50 percent probability of liquefaction at this site within a 100-year period. A site-specific liquefaction assessment was outside the scope of our services for this project. If a liquefaction assessment for this development is desired, Christensen Geotechnical should be contacted to discuss the additional work required.

## **5.0 ENGINEERING ANALYSIS AND RECOMMENDATIONS**

### **5.1 GENERAL CONCLUSIONS**

Based on the results of our field and laboratory investigations, it is our opinion that the subject site is suitable for the proposed construction provided that the recommendations contained in this report are incorporated into the design and construction of the project.

### **5.2 EARTHWORK**

#### **5.2.1 General Site Preparation and Grading**

Prior to the site grading operations, all vegetation, topsoil, undocumented fill soils, and loose or disturbed soils should be stripped (removed) from the building pad and flatwork concrete areas. Following the stripping operations, the exposed soils should be proof rolled to a firm, unyielding condition. Site grading may then be conducted to bring the site to design grade.

Based on the test pits excavated at the site and our observations, ½ to 1 foot of topsoil cover the site. This topsoil should be removed from below footings, concrete flatwork, and pavements. Where over-excavation is required, the excavation should extend at least 1 foot laterally for every foot of over-excavation. A Christensen Geotechnical representative should observe the site grading operations.

#### **5.2.2 Soft Soil Stabilization**

Once exposed through excavation, all subgrade soils should be proof rolled with a relatively large, wheeled vehicle to a firm, unyielding condition. Due to the high groundwater at the site, soft soils are likely to be encountered. Where encountered, these localized soft areas should be removed and replaced with granular structural fill. If soft areas extend more than 18 inches deep, or where large areas are encountered, stabilization may be considered. The use of stabilization should be approved by the geotechnical engineer, but would likely consist of over-excavating the area by at least 18 inches and then placing a geofabric (such as Mirafi RS280i) at the bottom of the excavation. Over this, a stabilizing fill, consisting of angular coarse gravel with cobbles, would be placed to the design subgrade.

#### **5.2.3 Temporary Construction Excavations**

Based on OSHA requirements and the soil conditions encountered during our field investigation, we anticipate that temporary construction excavations at the site that have vertical walls that

extend to depths of up to 5 feet may be occupied without shoring; however, where groundwater or fill soils are encountered, flatter slopes may be required. Excavations that extend to more than 5 feet in depth should be sloped or shored in accordance with OSHA regulations for a type C soil. The stability of construction excavations is the contractor's responsibility. If the stability of an excavation becomes questionable, the excavation should be evaluated immediately by qualified personnel.

#### 5.2.4 Structural Fill and Compaction

All fill placed for the support of structures, concrete flatwork, and pavements should consist of structural fill. The structural fill may consist of the native clay soils; however, it should be understood that due to their clayey nature these soils may be difficult to moisture-condition and compact. Imported structural fill, if required, should consist of a relatively well-graded granular soil with a maximum particle size of 4 inches, with a maximum of 50 percent passing the No. 4 sieve and a maximum of 30 percent passing the No. 200 sieve. The liquid limit of the fines (material passing the No. 200 sieve) should not exceed 35 and the plasticity index should be less than 15. Additionally, all structural fill, whether native soils or imported material, should be free of topsoil, vegetation, frozen material, particles larger than 4 inches in diameter, and any other deleterious materials. Any imported materials should be approved by the geotechnical engineer prior to importing.

The structural fill should be placed in loose lifts that are a maximum of 8 inches thick. The moisture content should be within 3 percent of optimum and the fill should be compacted to at least 95 percent of the maximum density as determined by ASTM D 1557. Where fill heights exceed 5 feet, the level of compaction should be increased to 98 percent.

### 5.3 FOUNDATIONS

The foundations for the planned structures may consist of conventional continuous and/or spread footings established either on undisturbed native soil or on properly placed and compacted structural fill which extends down to undisturbed native soil. The footings for the proposed structure should be a minimum of 20 inches and 30 inches wide for continuous and spot footings, respectively. Exterior footings should be established at a minimum of 30 inches below the lowest adjacent grade to provide frost protection and confinement. Interior footings not subject to frost should be embedded a minimum of 18 inches for confinement.

Continuous and spread footings that are established on undisturbed native soils or structural fill may be proportioned for a maximum net allowable bearing capacity of 1,500 psf. A one-third increase may be used for transient wind or seismic loads. All footing excavations should be observed by the geotechnical engineer prior to the construction of footings.

#### 5.4 ESTIMATED SETTLEMENT

If the foundations are designed and constructed in accordance with the recommendations presented in this report, there is a low risk that total settlement will exceed 1 inch and a low risk that differential settlement will exceed ½ inch for a 30-foot span. As indicated in Section 4.3, additional settlement may occur during a large earthquake due to liquefaction.

#### 5.5 LATERAL EARTH PRESSURES

Buried structures, such as basement walls, should be designed to resist the lateral loads imposed by the soils retained. The lateral earth pressures on the below-grade walls and the distribution of those pressures will depend upon the type of structure, hydrostatic pressures, in-situ soils, backfill, and tolerable movements. Basement and retaining walls are usually designed with triangular stress distributions, which are based on an equivalent fluid pressure and calculated from lateral earth pressure coefficients. If soils similar to the native soils are used to backfill basement walls, then the walls may be designed using the following ultimate values:

**Table No. 3: Lateral Earth Pressures**

Condition	Lateral Pressure Coefficient	Equivalent Fluid Density (pcf)
Active Static	0.36	42
Active Seismic	0.16	18
At-Rest	0.53	61
Passive Static	2.77	319
Passive Seismic	-0.33	-38

We recommend that walls which are allowed little or no wall movement be designed using “at rest” conditions. Walls that are allowed to rotate at least 0.4 percent of the wall height may be designed with “active” pressures. The coefficients and densities presented above assume level backfill with no buildup of hydrostatic pressures. If anticipated, hydrostatic pressures and any surcharge loads should be added to the presented values. If sloping backfill is present, we

recommend that the geotechnical engineer be consulted to provide more appropriate lateral pressure parameters once the design geometry is established.

The seismic active and passive earth pressure coefficients provided in the table above are based on the Mononobe-Okabe method and only account for the dynamic horizontal force produced by a seismic event. The resulting dynamic pressure should therefore be added to the static pressure to determine the total pressure on the wall. The dynamic pressure distribution may be approximated as an inverted triangle, with stress decreasing with depth and the resultant force acting approximately 0.6 times the height of the retaining wall, measured upward from the bottom of the wall.

Lateral building loads will be resisted by frictional resistance between the footings and the foundation soils and by passive pressure developed by backfill against the wall. For footings on native soils, we recommend that an ultimate coefficient of friction of 0.35 be used. If passive resistance is used in conjunction with frictional resistance, the passive resistance should be reduced by ½. Passive earth pressure from soils subject to frost or heave should usually be neglected in design.

The coefficients and equivalent fluid densities presented above are ultimate values and should be used with an appropriate factor of safety against overturning and sliding. A value of 1.5 is typically used.

## 5.6 CONCRETE SLAB-ON-GRADE CONSTRUCTION

Concrete slabs-on-grade should be constructed over at least 4 inches of compacted gravel to help distribute floor loads, break the rise of capillary water, and to aid in the curing process. The gravel should consist of free-draining gravel compacted to a firm, unyielding condition. To help control normal shrinkage and stress cracking, the floor slab should have adequate reinforcement for the anticipated floor loads, with the reinforcement continuous through the interior joints. In addition, we recommend adequate crack control joints to control crack propagation.

## 5.7 MOISTURE PROTECTION AND SURFACE DRAINAGE

Any wetting of the foundation soils will likely cause some degree of volume change within the soil and should be prevented both during and after construction. We recommend that the following precautions be taken at this site:

1. The ground surface should be graded to drain away from the structures in all directions, with a minimum fall of 8 inches in the first 10 feet.
2. Roof runoff should be collected in rain gutters with downspouts that are designed to discharge well outside of the backfill limits.
3. Sprinkler heads should be aimed away from and placed at least 12 inches from foundation walls.
4. There should be adequate compaction of backfill around foundation walls, to a minimum of 90% density (ASTM D 1557). Water consolidation methods should not be used.

## 5.8 SUBSURFACE DRAINAGE

Due to the high groundwater at the subject site, we recommend that all basement walls incorporate a foundation drain. The foundation drain should consist of a 4-inch-diameter slotted pipe placed at or below the bottom of footings and encased in at least 12 inches of free-draining gravel. The gravel should extend up the foundation wall to within 2 feet of the final ground surface, and a filter fabric, such as Mirafi 140N, should separate the gravel from the native soils. The pipe should be graded to drain to the land drains, a storm drain or other free-gravity outfall unless provisions for pumped sumps are made. The gravel which extends up the wall may be replaced by a fabricated drain panel such as Mirafi G200N or equivalent.

## 5.9 PAVEMENT DESIGN

Pavement sections for roadways within the proposed development were assessed using the PAS computer program (prepared by the American Concrete Pavement Association) and an assumed CBR value of 3 percent. No traffic information was available at the time this report was prepared; Christensen Geotechnical has therefore assumed a traffic load for the roadways based on our experience with similar projects. We have assumed that traffic will consist of 150 passenger cars per day, 4 medium trucks per day and 1 heavy truck per day. We have further assumed no increase in traffic over the life of the pavement. Based on this information, we recommend a pavement section consisting of 3 inches of asphalt over 11 inches of untreated base. As an alternative, a pavement section of 3 inches of asphalt, 6 inches of untreated base, and 7 inches of granular borrow may be used. The asphalt should consist of a high-stability plant mix and should be compacted to at least 96 percent of the Marshall maximum density. The untreated base should meet the material requirements for Weber County or UDOT. The granular borrow should meet the recommendations for imported structural fill as presented in Section 5.2.4 of this report. The untreated base and granular borrow should be compacted to at least 95 percent of the maximum dry density as determined by ASTM D 1557.

## 6.0 LIMITATIONS

The recommendations contained in this report are based on limited field exploration, laboratory testing, and our understanding of the proposed construction. The subsurface data used in this report was obtained from the explorations that were made specifically for this investigation. It is possible that variations in the soil and groundwater conditions could exist between and beyond the points explored. The nature and extent of variations may not be evident until construction occurs. If any conditions are encountered at this site that are different from those described in this report, Christensen Geotechnical should be immediately notified so that we may make any necessary revisions to the recommendations contained in this report. In addition, if the scope of the proposed construction changes from that described in this report, Christensen Geotechnical should be notified.

This report was prepared in accordance with the generally accepted standard of practice at the time the report was written. No other warranty, expressed or implied, is made.

It is the client's responsibility to see that all parties to the project, including the designer, contractor, subcontractors, etc., are made aware of this report in its entirety. The use of information contained in this report for bidding purposes should be done at the contractor's option and risk.



## 7.0 REFERENCES

Anderson, L.R., Keaton, J.R. and Bay, J.R., 1994, "Liquefaction-Potential Map for a Part of Weber County Utah," Utah Geological Survey, Public Information Series 27.

UGS, Utah Quaternary Fault and Fold Database, interactive web-based map.




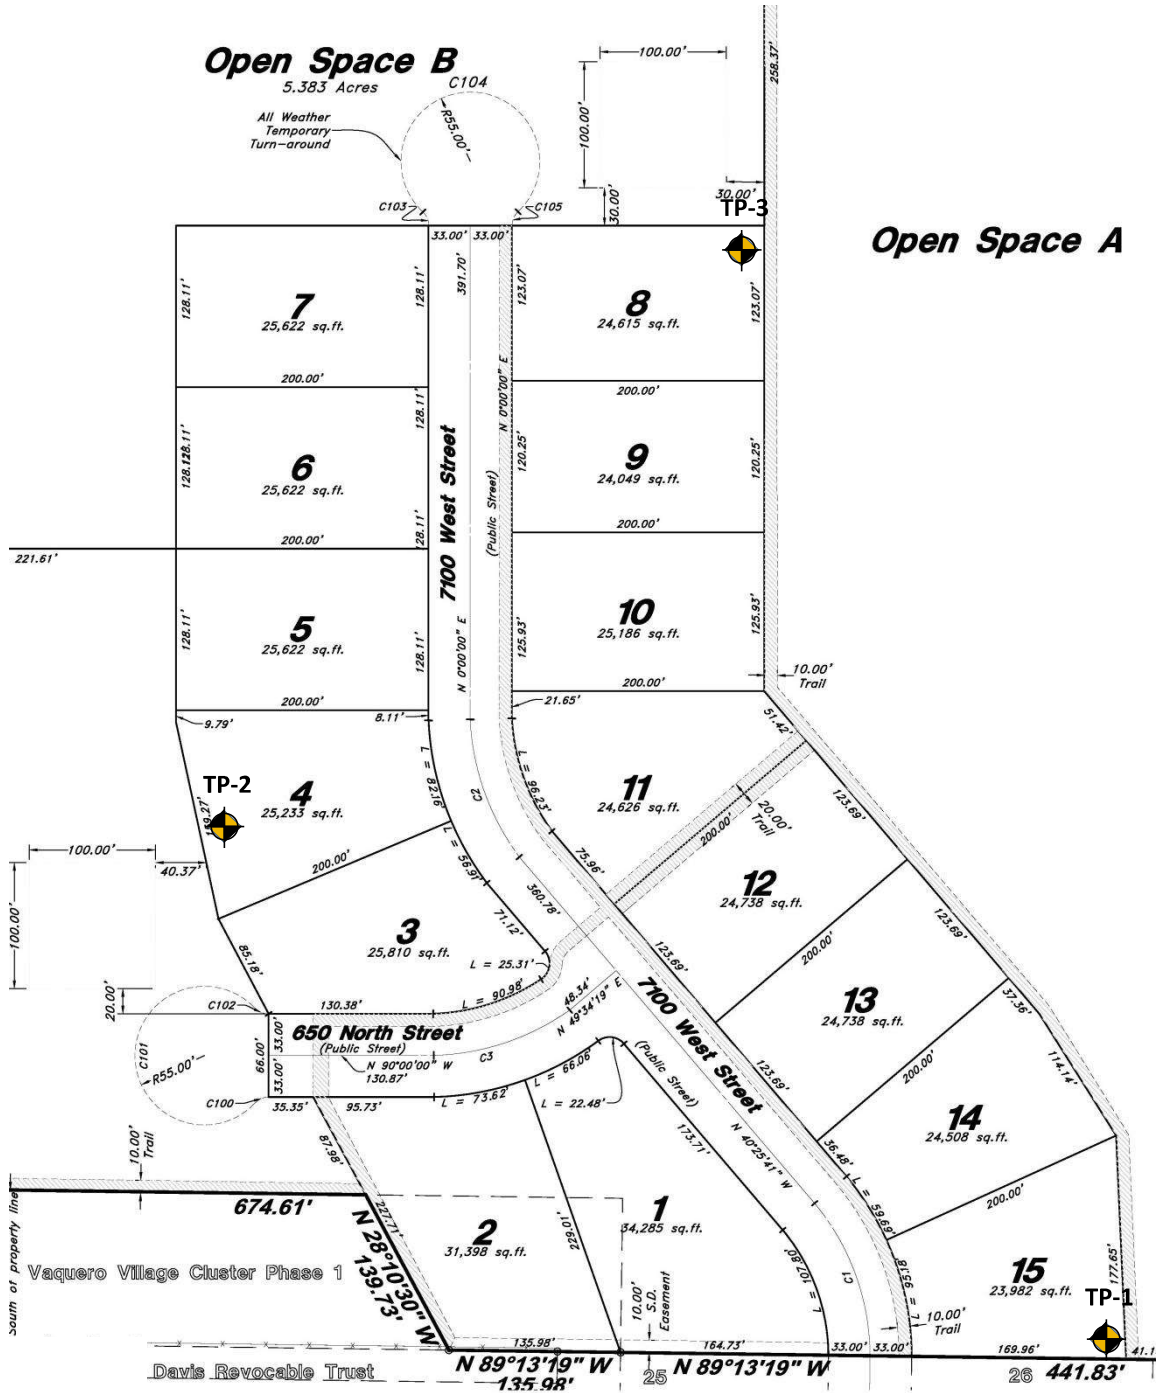
Base Photo: Utah AGRC

Drawing Not to Scale

 Approximate Project Boundary



	<p>Lync Construction          Vaquero Village Subdivision Phase 2          Ogden, Utah          Project No. 145-006</p>	<p>Plate  <b>1</b></p>
<p>Vicinity Map</p>		




Base Map: Great Basin Engineering



Approximate Test Pit Location

Drawing Not to Scale



	<p>Lync Construction          Vaquero Village Subdivision Phase 2          Ogden, Utah          Project No. 145-006  <b>Exploration Location Map</b></p>	<p>Plate  <b>2</b></p>
---	--	----------------------------


Date	Started: 6/1/2020	<h1>TEST PIT LOG</h1>	Logged By: M Christensen		Test Pit No.					
	Completed: 6/1/2020		Equipment: Trackhoe		<h1>TP-1</h1>					
Backfilled: 6/1/2020	Location: See Plate 2		Sheet 1 of 1							
Depth (feet)	Sample Type	Groundwater	Graphic Log	Group Symbol	Material Description	Dry Density (pcf)	Moisture Content (%)	Minus #200 (%)	Liquid Limit	Plasticity Index
					Topsoil; Lean CLAY - moist, dark brown					
				CL	Lean CLAY - stiff, moist, brown					
5	X	▽		SP-SM	Poorly Graded SAND with silt - medium dense, wet, brown		32.7	5.3	NP	NP
					Bottom of test pit at 7 feet					
10										
15										

☒ Bulk/Bag Sample

▣ Undisturbed Sample


▽ Stabilized Groundwater

∇ Groundwater At Time of Excavation

	<p><b>Lync Construction</b>  <b>Vaquero Village Sub. Phase 2</b>  <b>Ogden, Utah</b>  <b>Project No.: 145-006</b></p>	<p><b>Plate</b></p> <p style="font-size: 2em;"><b>3</b></p>
---	---	---





Date	Started: 6/1/2020	<h1>TEST PIT LOG</h1>	Logged By: M Christensen		Test Pit No.					
	Completed: 6/1/2020		Equipment: Trackhoe		<h1>TP-3</h1>					
Backfilled: 6/1/2020	Location: See Plate 2		Sheet 1 of 1							
Depth (feet)	Sample Type	Groundwater	Graphic Log	Group Symbol	Material Description	Dry Density (pcf)	Moisture Content (%)	Minus #200 (%)	Liquid Limit	Plasticity Index
					Topsoil; Lean CLAY - moist, dark brown					
					Lean CLAY - stiff, moist, brown					
	X	▽		CL	- wet below 3 feet	91.8	28.4	94.7	30	10
5	X			SP-SM	Poorly Graded SAND with silt - medium dense, wet, brown		29.5	5.3	NP	NP
					Bottom of test pit at 7 feet					
10										
15										
<div style="display: flex; justify-content: space-between;"> <div> <span>⊗ Bulk/Bag Sample</span>  <span>▣ Undisturbed Sample</span> </div> <div> <span>▽ Stabilized Groundwater</span>  <span>∇ Groundwater At Time of Excavation</span> </div> </div>										
					<b>Lync Construction</b> <b>Vaquero Village Sub. Phase 2</b> <b>Ogden, Utah</b> <b>Project No.: 145-006</b>				<b>Plate</b>  <b>5</b>	

**RELATIVE DENSITY – COURSE GRAINED SOILS**

Relative Density	SPT (blows/ft.)	3 In OD California Sampler (blows/ft.)	Relative Density (%)	Field Test
Very Loose	<4	<5	0 – 15	Easily penetrated with a ½ inch steel rod pushed by hand
Loose	4 – 10	5 – 15	15 – 35	Difficult to penetrate with a ½ inch steel rod pushed by hand
Medium Dense	10 – 30	15 – 40	35 – 65	Easily penetrated 1-foot with a steel rod driven by a 5 pound hammer
Dense	30 – 50	40 – 70	65 – 85	Difficult to penetrate 1-foot with a steel rod driven by a 5 pound hammer
Very Dese	>50	>70	85 - 100	Penetrate only a few inches with a steel rod driven by a 5 pound hammer

**CONSISTENCY – FINE GRAINED SOILS**

Consistency	SPT (blows/ft)	Torvane Undrained Shear Strength (tsf)	Pocket Penetrometer Undrained Shear Strength (tsf)	Field Test
Very Soft	<2	<0.125	<0.25	Easily penetrated several inches with thumb
Soft	2 – 14	0.125 – 0.25	0.25 – 0.5	Easily penetrated one inch with thumb
Medium Stiff	4 – 8	0.25 – 0.5	0.5 – 1.0	Penetrated over ½ inch by thumb with moderate effort. Molded by strong finger pressure
Stiff	8 – 15	0.5 – 1.0	1.0 – 2.0	Indented ½ inch by thumb with great effort
Very Stiff	15 – 30	1.0 – 2.0	2.0 – 4.0	Readily indented with thumbnail
Hard	>30	>2.0	>4.0	Indented with difficulty with thumbnail

**CEMENTATION**

Weakly	Crumbles or breaks with handling or little finger pressure
Moderately	Crumbles or breaks with considerable finger pressure
Strongly	Will not crumble or break with finger pressure

**MOISTURE**

Dry	Absence of moisture, dusty, dry to the touch
Moist	Damp but no visible water
Wet	Visible water, usually below water table

**GRAIN SIZE**

Description	Sieve Size	Grain Size (in)	Approximate Size
Boulders	>12"	>12"	Larger than basketball
Cobbles	3" – 12"	3" – 12"	Fist to basketball
Gravel	Coarse	3/4" - 3"	Thumb to fist
	Fine	#4 – 3"	Pea to thumb
Sand	Coarse	#10 - #4	Rock salt to pea
	Medium	#40 - #10	Sugar to rock salt
	Fine	#200 - #40	Flour to sugar
Silt/Clay	<#200	<0.0029	Flour sized or smaller

**STRATIFICATION**

Occasional	One or less per foot of thickness
Frequent	More than one per foot of thickness

**MODIFIERS**

Trace	<5%
Some	5-12%
With	>12%

**STRATIFICATION**

Seam	1/16 to 1/2 inch
Layer	1/2 to 12 inch

**NOTES**


- The logs are subject to the limitations and conclusions presented in the report.
- Lines separating strata represent approximate boundaries only. Actual transitions may be gradual.
- Logs represent the soil conditions at the points explored at the time of our investigation.
- Soils classifications shown on logs are based on visual methods . Actual designations (based on laboratory testing )may vary.



**Soil Terms Key**

Plate  
6

# Atterberg Limits

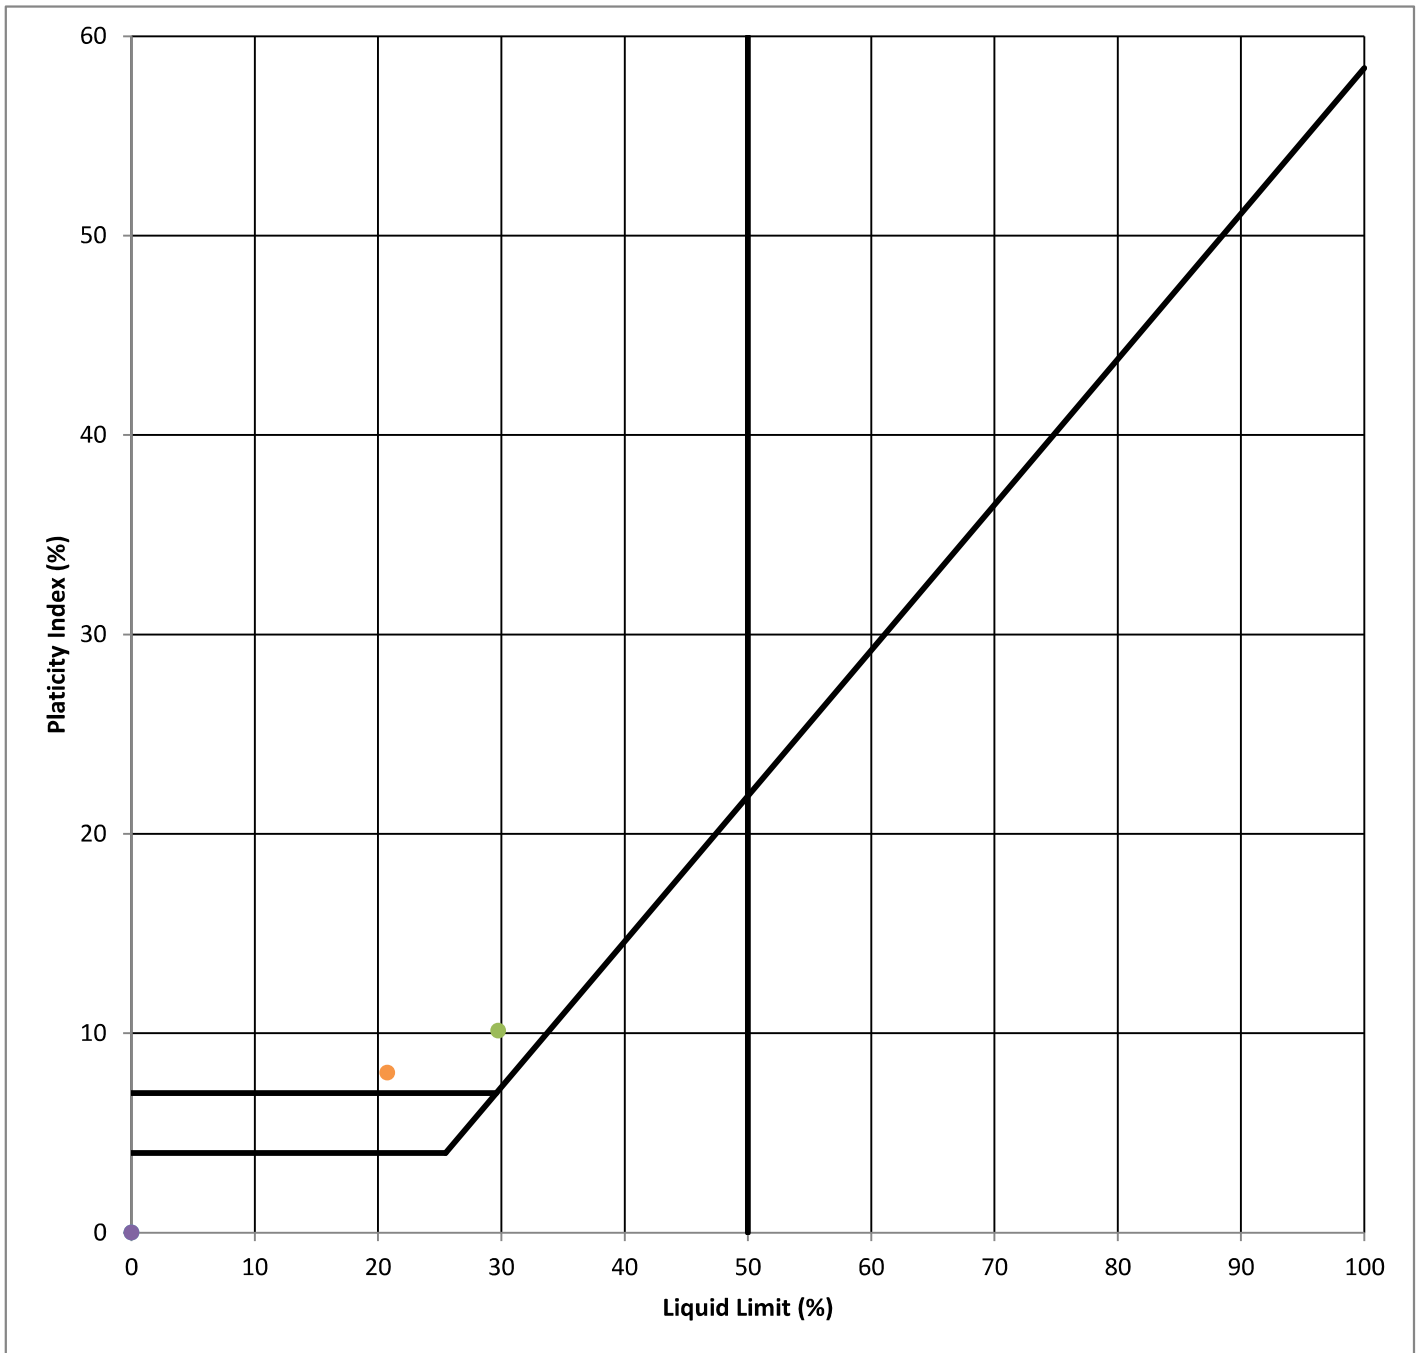

Location	Depth (ft)		Classification	Liquid Limit	PI
TP-1	6	●	Poorly Graded SAND with silt	NP	NP
TP-2	2	●	Sandy Lean CLAY	21	8
TP-3	3	●	Lean CLAY	30	10
TP-3	6	●	Poorly Graded SAND with silt	NP	NP




Lync Construction  
 Vaquero Village Sub. Phase 2  
 Ogden, Utah  
 Project No.: 145-006

Plate


**7**




# Grain Size Distribution

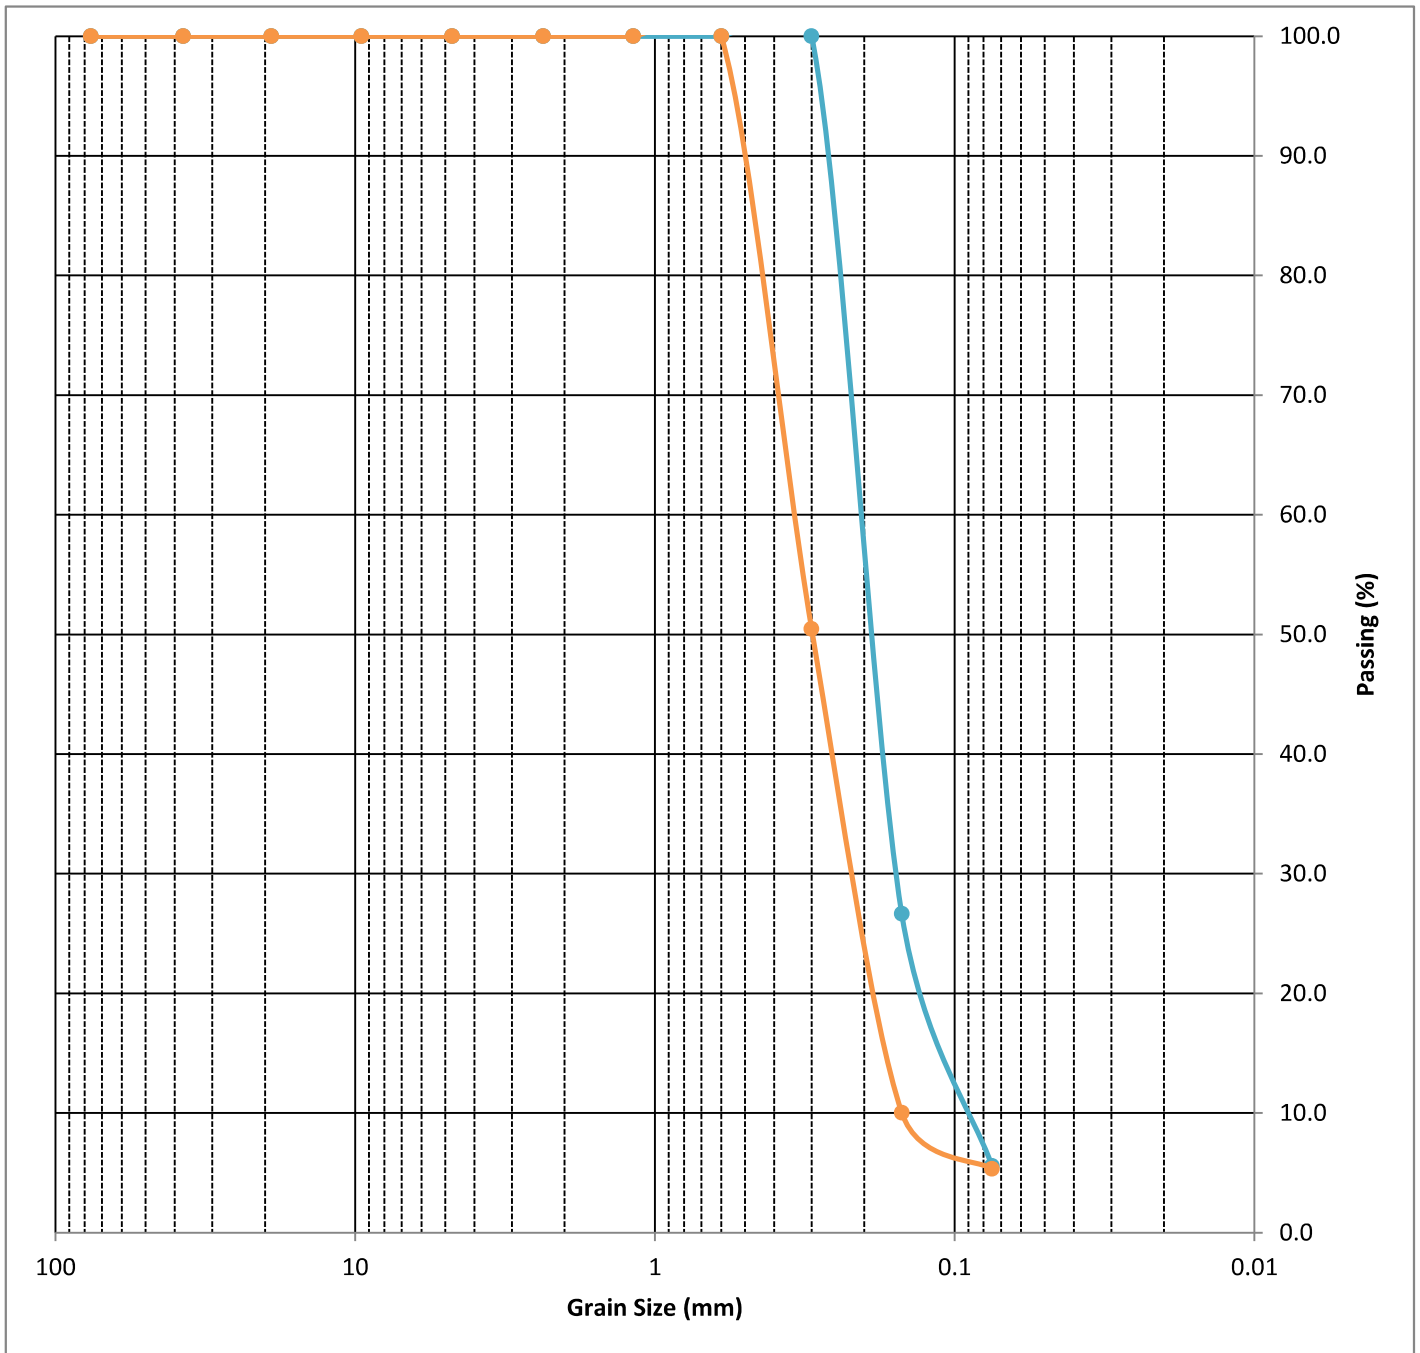


Location	Depth		Classification	% Gravel	% Sand	% Silt and Clay
TP-1	6	●	Poorly Graded SAND with silt	0.0	94.4	5.6
TP-3	6	●	Poorly Graded SAND with silt	0.0	94.7	5.3

	<p><b>Lync Construction</b>  <b>Vaquero Village Sub. Phase 2</b>  <b>Ogden, Utah</b>  <b>Project No.: 145-006</b></p>	<p><b>Plate</b>   <b>8</b></p>
---	---	--

# 1-D Consolidation

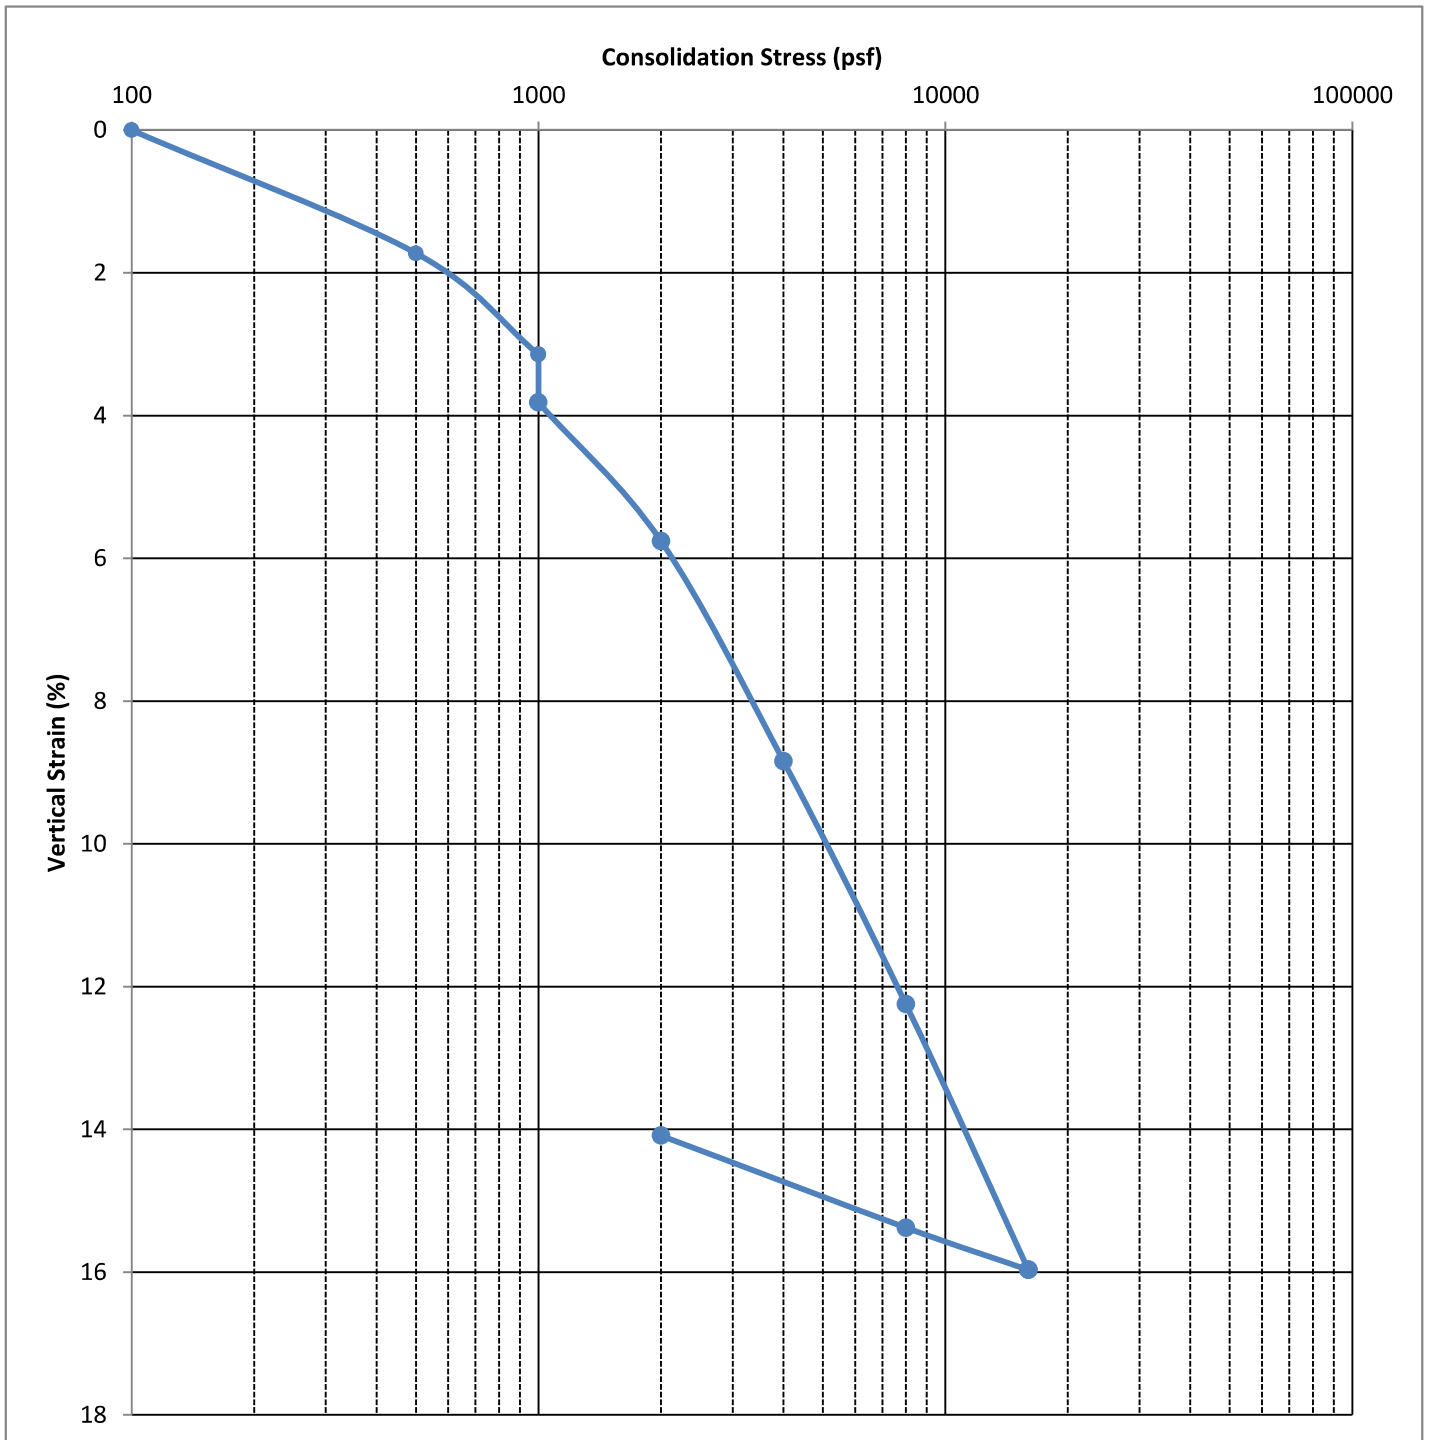

Location	Depth (ft)	Dry Density (pcf)	Moisture Content (%)	$\sigma_o$ (psf)	$\sigma_p$ (psf)	$C_c$	$C_r$	OCR
TP-3	3	93.2	28.4	400	4,000	0.118	0.021	10.0

	<p>Lync Construction          Vaquero Village Sub. Phase 2          Ogden, Utah          Project No.: 145-006</p>	<p>Plate  <b>9</b></p>
---	---	----------------------------